



# Local Government Energy Audit Report

Winslow Southern Regional Office

May 24, 2019

*Prepared for:*

New Jersey Department of Environmental  
Protection, Division of Fish and Wildlife  
220 Blue Anchor Road  
Sicklerville, NJ 08081

*Prepared by:*

TRC Energy Services  
900 Route 9 North  
Woodbridge, NJ 07095

# Disclaimer

---

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC Energy Services (TRC) reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. We encourage the owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2019 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

# Table of Contents

---

<b>1</b>	<b>Executive Summary</b> .....	<b>1</b>
1.1	<b>Planning Your Project</b> .....	4
	Pick Your Installation Approach .....	4
	More Options from Around the State.....	6
<b>2</b>	<b>Existing Conditions</b> .....	<b>7</b>
2.1	Site Overview.....	7
2.2	Building Occupancy .....	7
2.3	Building Envelope .....	8
2.4	Lighting Systems.....	9
2.5	Air Handling Systems .....	10
	Heating and Cooling Systems .....	10
2.6	Domestic Hot Water .....	12
2.7	Plug Load & Vending Machines.....	12
2.8	Water-Using Systems .....	13
<b>3</b>	<b>Energy Use and Costs</b> .....	<b>14</b>
3.1	Electricity .....	15
3.2	Natural Gas.....	16
3.3	Benchmarking.....	17
	Tracking Your Energy Performance.....	18
<b>4</b>	<b>Energy Conservation Measures</b> .....	<b>19</b>
4.1	Lighting .....	22
	ECM 1: Install LED Fixtures .....	22
	ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers.....	22
	ECM 3: Retrofit Fixtures with LED Lamps.....	23
4.2	Lighting Controls.....	23
	Install Occupancy Sensor Lighting Controls .....	23
	Install High/Low Lighting Controls .....	24
4.3	Electric Unitary HVAC .....	24
	Install High Efficiency Air Conditioning Units .....	24
4.4	HVAC.....	25
	ECM 4: Install Programmable Thermostats.....	25
4.5	Domestic Water Heating .....	25
	ECM 5: Install Low-Flow DHW Devices.....	25
<b>5</b>	<b>Energy Efficient Best Practices</b> .....	<b>26</b>
	Energy Tracking with ENERGY STAR® Portfolio Manager® .....	26
	Weatherization.....	26
	Doors and Windows .....	26

---




Lighting Controls .....	26
Thermostat Schedules and Temperature Resets .....	26
AC System Evaporator/Condenser Coil Cleaning .....	27
HVAC Filter Cleaning and Replacement .....	27
Furnace Maintenance .....	27
Water Heater Maintenance .....	27
Water Conservation .....	27
Procurement Strategies .....	28
<b>6 On-site Generation .....</b>	<b>29</b>
6.1 Solar Photovoltaic .....	29
6.2 Combined Heat and Power .....	30
<b>7 Project Funding and Incentives.....</b>	<b>32</b>
7.1 SmartStart .....	33
7.2 Direct Install .....	34
7.3 Energy Savings Improvement Program .....	35
<b>8 Energy Purchasing and Procurement Strategies .....</b>	<b>36</b>
8.1 Retail Electric Supply Options.....	36
8.2 Retail Natural Gas Supply Options .....	36
<b>Appendix A: Equipment Inventory &amp; Recommendations .....</b>	<b>A-1</b>
<b>Appendix B: ENERGY STAR® Statement of Energy Performance.....</b>	<b>B-1</b>
<b>Appendix C: Glossary .....</b>	<b>C-1</b>

# 1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Winslow Southern Regional Office. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC Energy Services (TRC) conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and help protect our environment by reducing statewide energy consumption.

## BUILDING PERFORMANCE REPORT

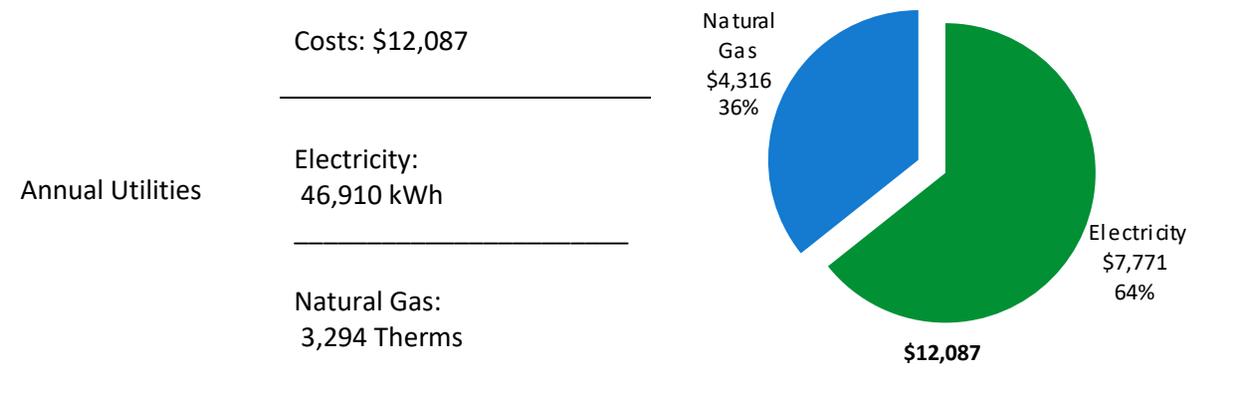

ENERGY STAR® Benchmarking Score	67 <i>(1-100 scale)</i>	This building performs at or above the national average. This report contains suggestions about how to improve building performance and reduce energy costs.
------------------------------------	----------------------------	--

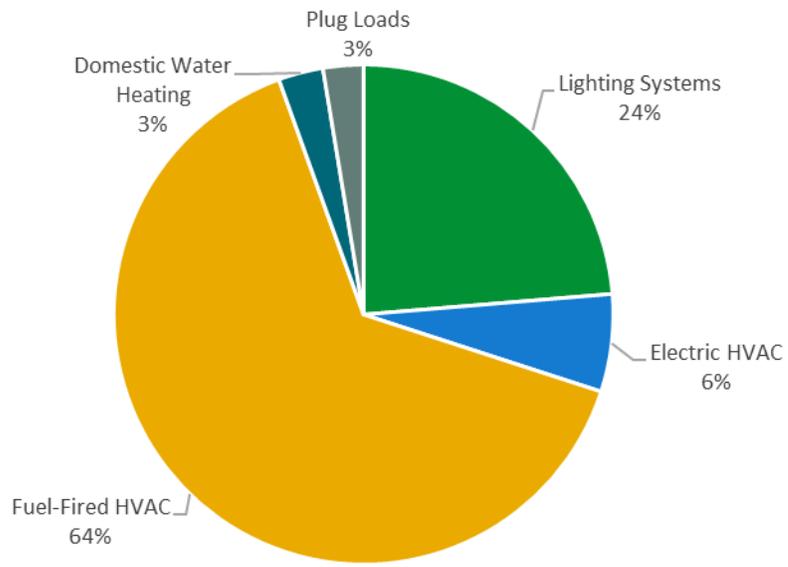


Figure 1 - Energy Use by System


## POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


### Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$44,861
Potential Rebates & Incentives <sup>1</sup>	\$4,251
Annual Cost Savings	\$4,755
Annual Energy Savings	Electricity: 27,587 kWh Natural Gas: 141 Therms
Greenhouse Gas Emission Savings	15 Tons
Simple Payback	8.5 Years
Site Energy Savings (all utilities)	22%

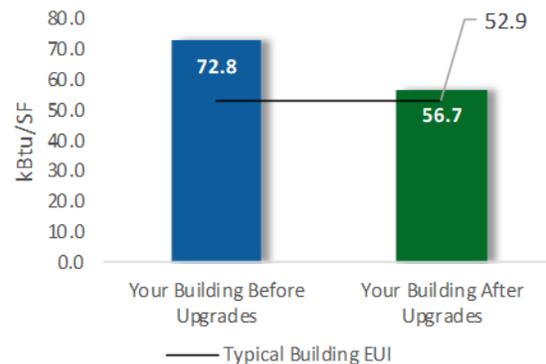

### Scenario 2: Cost Effective Package<sup>2</sup>

Installation Cost	\$26,557
Potential Rebates & Incentives	\$2,956
Annual Cost Savings	\$4,308
Annual Energy Savings	Electricity: 24,866 kWh Natural Gas: 144 Therms
Greenhouse Gas Emission Savings	13 Tons
Simple Payback	5.5 Years
Site Energy Savings (all utilities)	20%

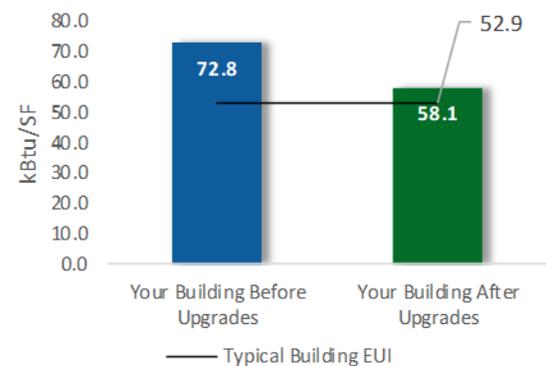

### On-site Generation Potential

Photovoltaic	None
Combined Heat and Power	None

<sup>1</sup> Incentives are based on current SmartStart Prescriptive incentives. Other program incentives may apply.

<sup>2</sup> A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Lifetime Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>24,529</b>	<b>9.5</b>	<b>-2</b>	<b>\$4,034</b>	<b>\$60,505</b>	<b>\$25,875</b>	<b>\$2,956</b>	<b>\$22,919</b>	<b>5.7</b>	<b>24,433</b>
ECM 1	Install LED Fixtures	13,398	2.1	0	\$2,220	\$33,295	\$17,140	\$1,800	\$15,340	6.9	13,492
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	9,172	6.1	-2	\$1,494	\$22,416	\$7,546	\$1,150	\$6,396	4.3	9,012
ECM 3	Retrofit Fixtures with LED Lamps	1,958	1.2	0	\$320	\$4,795	\$1,189	\$6	\$1,183	3.7	1,929
<b>Lighting Control Measures</b>		<b>1,353</b>	<b>0.9</b>	<b>0</b>	<b>\$220</b>	<b>\$1,764</b>	<b>\$3,342</b>	<b>\$375</b>	<b>\$2,967</b>	<b>13.5</b>	<b>1,329</b>
	Install Occupancy Sensor Lighting Controls	1,134	0.8	0	\$185	\$1,478	\$2,742	\$375	\$2,367	12.8	1,114
	Install High/Low Lighting Controls	219	0.1	0	\$36	\$286	\$600	\$0	\$600	16.8	216
<b>Electric Unitary HVAC Measures</b>		<b>1,368</b>	<b>1.9</b>	<b>0</b>	<b>\$227</b>	<b>\$3,399</b>	<b>\$14,962</b>	<b>\$920</b>	<b>\$14,042</b>	<b>62.0</b>	<b>1,377</b>
	Install High Efficiency Air Conditioning Units	1,368	1.9	0	\$227	\$3,399	\$14,962	\$920	\$14,042	62.0	1,377
<b>HVAC System Improvements</b>		<b>337</b>	<b>0.0</b>	<b>14</b>	<b>\$237</b>	<b>\$2,608</b>	<b>\$660</b>	<b>\$0</b>	<b>\$660</b>	<b>2.8</b>	<b>1,959</b>
ECM 4	Install Programmable Thermostats	337	0.0	14	\$237	\$2,608	\$660	\$0	\$660	2.8	1,959
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>3</b>	<b>\$37</b>	<b>\$373</b>	<b>\$22</b>	<b>\$0</b>	<b>\$22</b>	<b>0.6</b>	<b>333</b>
ECM 5	Install Low-Flow DHW Devices	0	0.0	3	\$37	\$373	\$22	\$0	\$22	0.6	333
<b>TOTALS</b>		<b>27,587</b>	<b>12.3</b>	<b>14</b>	<b>\$4,755</b>	<b>\$68,649</b>	<b>\$44,861</b>	<b>\$4,251</b>	<b>\$40,610</b>	<b>8.5</b>	<b>29,432</b>

\* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. , after incentives).

Figure 2 – Evaluated Energy Improvements

## 1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

### Pick Your Installation Approach

New Jersey’s Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Install LED Fixtures	X	X	
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	X	X	
ECM 3	Retrofit Fixtures with LED Lamps	X	X	
ECM 4	Install High Efficiency Furnaces	X	X	
ECM 5	Install Low-Flow Domestic Hot Water Devices		X	

Figure 3 – Funding Options



## New Jersey's Clean Energy Programs At-A-Glance

	<b>SmartStart</b> Flexibility to install at your own pace	<b>Direct Install</b> Turnkey installation	<b>Pay for Performance</b> Whole building upgrades
<b>Who should use it?</b>	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together.  Average peak demand should be below 200 kW.  Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time.  Peak demand should be over 200 kW.
<b>How does it work?</b>	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
<b>What are the Incentives?</b>	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project.  You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
<b>How do I participate?</b>	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.

Take the next step by visiting [www.njcleanenergy.com](http://www.njcleanenergy.com) for program details, applications, and to contact a qualified contractor.

### *Individual Measures with SmartStart*

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

### *Turnkey Installation with Direct Install*

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

### *Whole Building Approach with Pay for Performance*

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

## **More Options from Around the State**

### *Financing and Planning Support with the Energy Savings Improvement Program (ESIP)*

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

### *Resiliency with Return on Investment through Combined Heat & Power (CHP)*

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

### *Ongoing Electric Savings with Demand Response*

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce their electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

## 2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) Report for Winslow Southern Regional Office. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey’s Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

### 2.1 Site Overview

On November 8, 2018, TRC performed an energy audit at Winslow Southern Regional Office located in Sicklerville, New Jersey. TRC met with Kevin Blythe to review the facility operations and help focus our investigation on specific energy-using systems.

The New Jersey Division of Fish and Wildlife is a government agency dedicated to the protection, management and wise use of New Jersey’s fish and wildlife resources.

The Winslow Southern Regional Office is located at 220 Blue Anchor Road in Sicklerville, New Jersey. The facility was built in 1982 and is comprised of two buildings totaling approximately 6,720 square feet. Spaces include: offices, a conference room, reception area, evidence room, storage rooms, restrooms and garage bays.

Lighting at the facility consists of linear fluorescent T8 and T12 fixtures. Cooling is provided by split system air conditioners, while the heating system consists of heat pumps and gas-fired furnaces.

### 2.2 Building Occupancy

The facility is occupied year-round, Monday to Friday. Typical weekday occupancy is ten staff. The typical schedule is presented in the table below

Building Name	Weekday/Weekend	Operating Schedule
Winslow Southern Regional Office	Weekday	7:00 AM - 3:30 PM
	Weekend	Closed

Figure 4 - Building Occupancy Schedule

## 2.3 Building Envelope

This site includes two buildings: the office and the new garage bay.

The office building is a 4,220 square foot, one-story, concrete masonry unit (CMUs) building with exterior wood siding. The building has a pitched roof supported with wood trusses and clad with asphalt shingles and is in good condition. The windows throughout the facility are double glazed with vinyl clad wood frames and sashes. The glass to frame seals are in good condition, showing little evidence of excessive wear. The entrance doors are glass-with-wood frames and the outside mechanical room exit doors are commercial grade metal clad units. The door seals appear in good condition.



*Image 1: Office Building Envelope & Interior Spaces*

The new garage building is a 2,500 square foot slab-on-grade, pre-engineered metal building with concrete block foundation and frame interior walls. Wood trusses support a sloped roof with a standing seam metal roofing system. The metal framed overhead doors and the main entrance door are in good condition.




*Image 2: Garage Bay*

## 2.4 Lighting Systems

The office building is illuminated with 40-Watt linear fluorescent T12 fixtures, while the garage bays are lit with 32-Watt fluorescent T8 lamps. Fixture types for the office building include 2-lamp or 4-lamp, 4-foot long recessed troffer and 2-foot fixtures with U-shape linear T12 lamps. The garage bay fixture types are 3-lamp, 4-foot long recessed troffers. Typically, T8 fluorescent lamps use electronic ballasts and T12 fluorescent lamps use less efficient magnetic ballasts. The U-shape fixtures are found in the corridors. There are some 65-Watt incandescent lamps found in the closet, reception area and the kitchen of the office building. Exit signs throughout the facility are LED. Interior fixtures are controlled with manual wall switches. Lighting levels were generally sufficient and the fixtures are in good condition.

The office building exterior illumination is provided by 150-Watt and 100-Watt wall and recessed mounted high pressure sodium (HPS) fixtures. The garage building has three, 150-Watt metal halide and four, 32-Watt compact fluorescent wall-mounted fixtures. The parking between the buildings is lit with seven, 250-Watt pole-mounted fixtures. Exterior lights are controlled with photocells.

There are two new small storage sheds having LED linear tubes in the interior and one LED fixture for the exterior with onboard sensor.

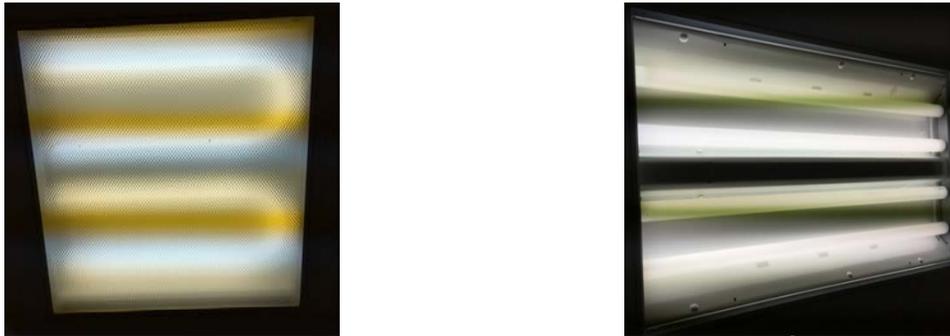

*Image 3: Office Building T12 Lamps*



*Image 3: Linear Fluorescent T8 & Incandescent Lamps*



Image 4: Typical Exterior Light Fixtures

## 2.5 Air Handling Systems

### Heating and Cooling Systems

Heating and cooling systems for the office building consist of two induced draft, atmospheric, gas-fired furnaces with direct expansion (DX) coil in the mechanical room. The cooling coils are connected to two, 5-ton York outside condensing units. Each furnace has 80 MBh heating capacity with 80% combustion efficiency. They are within their normal useful life and appear in good condition. The outdoor condensing units have reached the end of their normal useful life and appear to be in poor condition. They use the R22 refrigerant that has been phased out. The heating and cooling systems are controlled with two local thermostats that split the building into two zones. The local thermostats should be replaced with programmable thermostats. The ductwork appears to be in good condition.

The new garage bay is served with two Mitsubishi heat pumps controlled with programmable thermostats. These 12.6 EER units have a heating capacity of 42 MBh and 3-ton cooling capacity. The units are new and in good condition.



Image 5: Heating & Cooling Systems - Office Building



Image 6: Heating & Cooling Systems - Garage Bay

## 2.6 Domestic Hot Water

Hot water is produced with a 50 gallon, 40 MBh gas-fired storage water heater with an 80% efficiency. The water heater is located in the mechanical room and appears in good condition. The domestic hot water pipes are insulated and in good condition.



Image 7: Domestic hot water system

## 2.7 Plug Load & Vending Machines

The utility bill analysis indicates that plug loads consume approximately 2.60% of total building energy use. This is lower than a typical building.

The staff seems to already be doing a great job managing electrical plug loads. This report makes additional suggestions for ECMs in this area as well as Energy Efficient Best Practices.

There are 18 computer work stations throughout the facility. Plug loads throughout the building include copy machines, printers, water cooler and residential-size refrigerator, microwaves, small refrigerators and coffee machines.



Image 8: Typical Plug load Equipment

## 2.8 Water-Using Systems

There are two restrooms in the office building with toilets and sinks. Faucet flow rates are found to be low flow. The small kitchen has a sink with faucet flow rated for 2.2 gallon per minute (gpm).




*Image 9: Typical Restrooms Sink*

### 3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	46,910 kWh	\$7,771
Natural Gas	3,294 Therms	\$4,316
<b>Total</b>		<b>\$12,087</b>

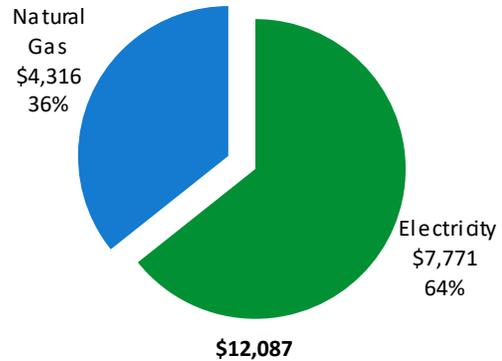

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


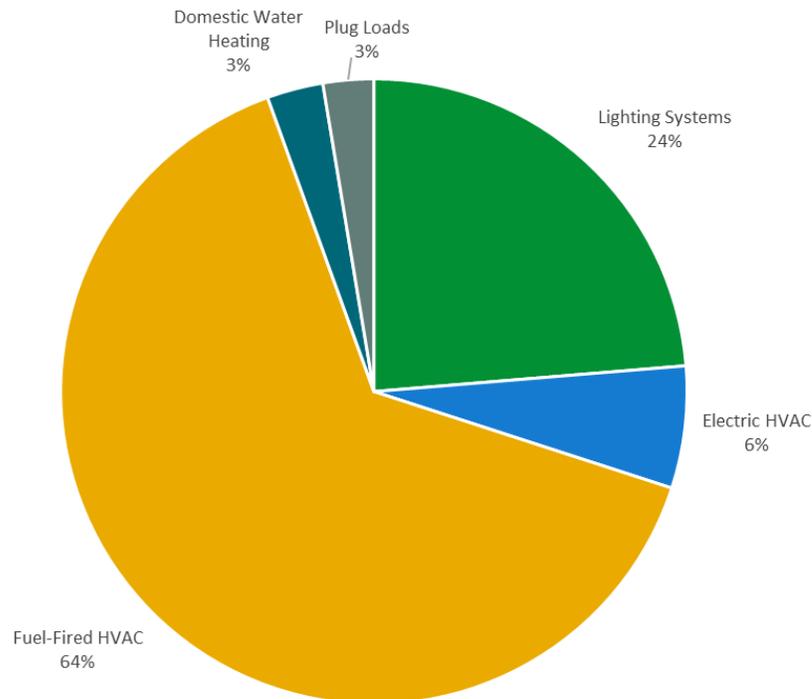


Figure 5 - Energy Balance

### 3.1 Electricity

Atlantic City Electric delivers electricity under rate class MGSS, with electric production provided by Champion Energy Services, a third-party supplier.

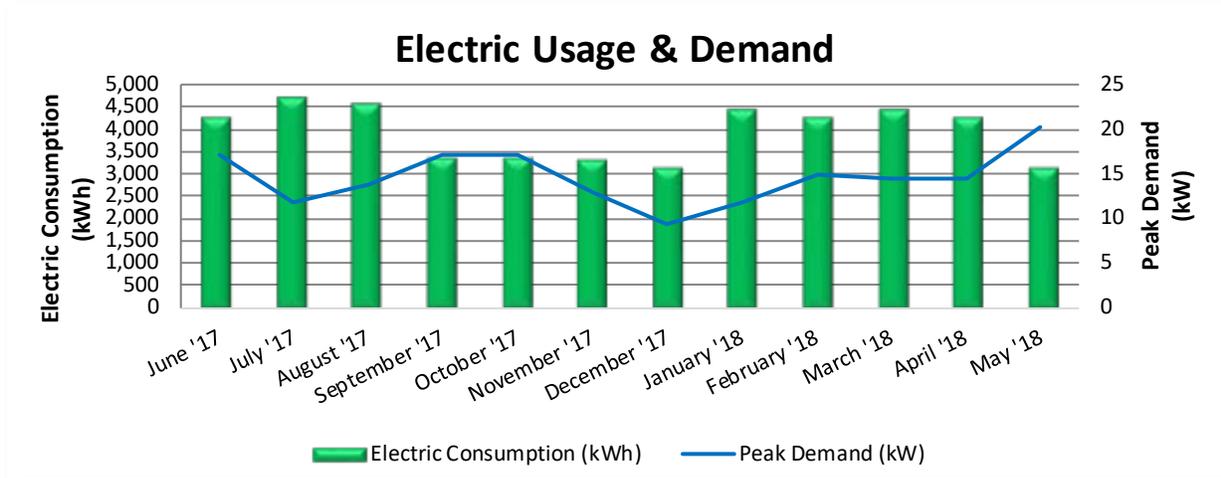


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
6/21/17	30	4,214	17	\$24	\$706
7/21/17	31	4,685	12	\$22	\$764
8/22/17	31	4,539	14	\$28	\$749
9/20/17	30	3,331	17	\$32	\$567
10/19/17	31	3,348	17	\$30	\$556
11/21/17	30	3,296	13	\$25	\$541
12/19/17	31	3,103	9	\$15	\$499
1/23/18	31	4,426	12	\$24	\$723
2/19/18	28	4,221	15	\$24	\$699
3/20/18	31	4,383	15	\$25	\$729
4/20/18	30	4,234	14	\$26	\$703
5/21/18	31	3,130	20	\$35	\$533
<b>Totals</b>	<b>365</b>	<b>46,910</b>	<b>20</b>	<b>\$310</b>	<b>\$7,771</b>
<b>Annual</b>	<b>365</b>	<b>46,910</b>	<b>20</b>	<b>\$310</b>	<b>\$7,771</b>

Notes:

- Peak electric usage occurred in July '17.
- The average electric cost over the past 12 months was \$0.166/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

### 3.2 Natural Gas

South Jersey Gas delivers natural gas under rate class General Service FT.

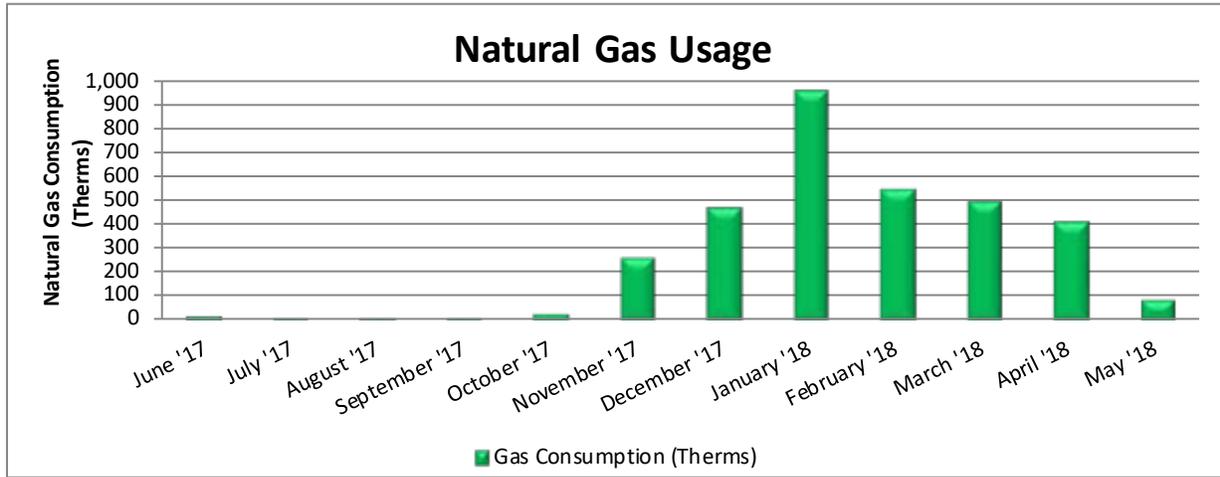

Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
6/21/17	30	20	\$53
7/21/17	31	5	\$35
8/22/17	31	6	\$38
9/20/17	30	6	\$35
10/19/17	31	29	\$60
11/21/17	30	263	\$341
12/19/17	31	473	\$611
1/23/18	31	951	\$1,202
2/19/18	28	550	\$711
3/20/18	31	497	\$630
4/20/18	30	409	\$469
5/21/18	31	84	\$132
<b>Totals</b>	<b>365</b>	<b>3,294</b>	<b>\$4,316</b>
<b>Annual</b>	<b>365</b>	<b>3,294</b>	<b>\$4,316</b>

Notes:

- The average gas cost for the past 12 months is \$1.310/therm, which is the blended rate used throughout the analysis.

### 3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the county, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

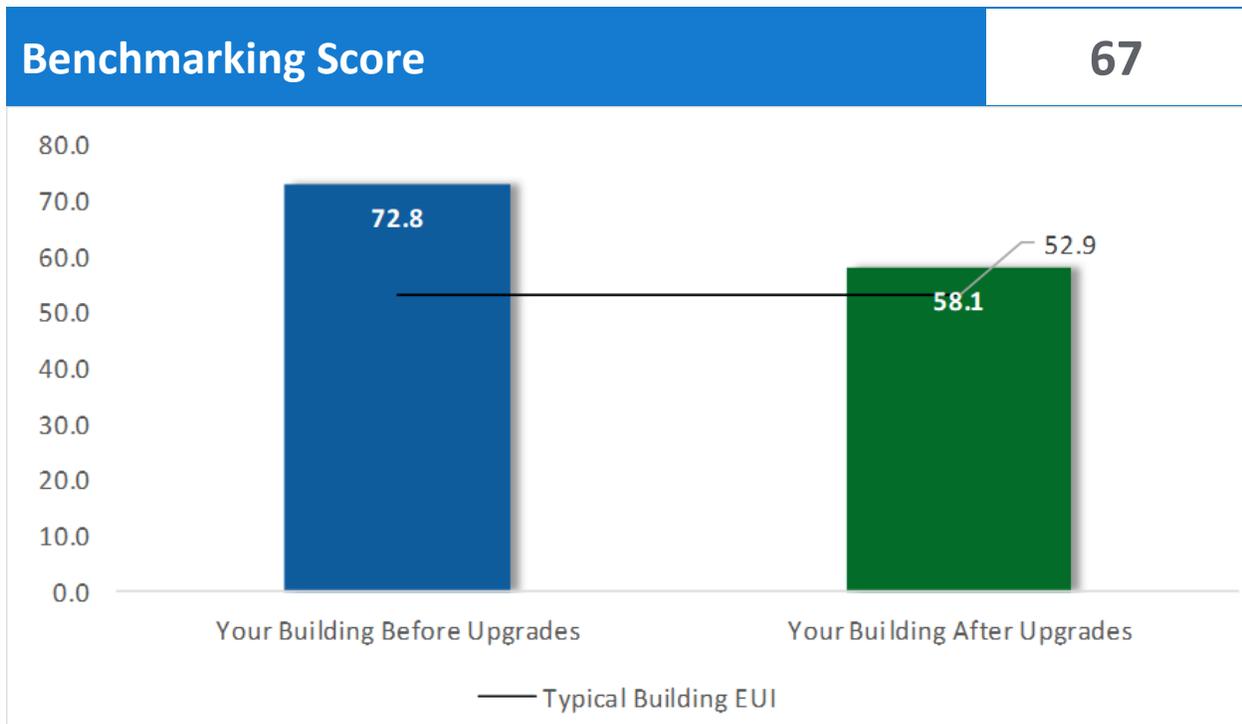


Figure 6 - Energy Use Intensity Comparison

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

## **Tracking Your Energy Performance**

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

**We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.**

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website<sup>3</sup>.

---

<sup>3</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>

## 4 ENERGY CONSERVATION MEASURES

---

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see **Appendix A: Equipment Inventory & Recommendations**.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>24,529</b>	<b>9.5</b>	<b>-2</b>	<b>\$4,034</b>	<b>\$25,875</b>	<b>\$2,956</b>	<b>\$22,919</b>	<b>5.7</b>	<b>24,433</b>
ECM 1	Install LED Fixtures	13,398	2.1	0	\$2,220	\$17,140	\$1,800	\$15,340	6.9	13,492
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	9,172	6.1	-2	\$1,494	\$7,546	\$1,150	\$6,396	4.3	9,012
ECM 3	Retrofit Fixtures with LED Lamps	1,958	1.2	0	\$320	\$1,189	\$6	\$1,183	3.7	1,929
<b>Lighting Control Measures</b>		<b>1,353</b>	<b>0.9</b>	<b>0</b>	<b>\$220</b>	<b>\$3,342</b>	<b>\$375</b>	<b>\$2,967</b>	<b>13.5</b>	<b>1,329</b>
	Install Occupancy Sensor Lighting Controls	1,134	0.8	0	\$185	\$2,742	\$375	\$2,367	12.8	1,114
	Install High/Low Lighting Controls	219	0.1	0	\$36	\$600	\$0	\$600	16.8	216
<b>Electric Unitary HVAC Measures</b>		<b>1,368</b>	<b>1.9</b>	<b>0</b>	<b>\$227</b>	<b>\$14,962</b>	<b>\$920</b>	<b>\$14,042</b>	<b>62.0</b>	<b>1,377</b>
	Install High Efficiency Air Conditioning Units	1,368	1.9	0	\$227	\$14,962	\$920	\$14,042	62.0	1,377
<b>HVAC System Improvements</b>		<b>337</b>	<b>0.0</b>	<b>14</b>	<b>\$237</b>	<b>\$660</b>	<b>\$0</b>	<b>\$660</b>	<b>2.8</b>	<b>1,959</b>
ECM 4	Install Programmable Thermostats	337	0.0	14	\$237	\$660	\$0	\$660	2.8	1,959
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>3</b>	<b>\$37</b>	<b>\$22</b>	<b>\$0</b>	<b>\$22</b>	<b>0.6</b>	<b>333</b>
ECM 5	Install Low-Flow DHW Devices	0	0.0	3	\$37	\$22	\$0	\$22	0.6	333
<b>TOTALS</b>		<b>27,587</b>	<b>12.3</b>	<b>14</b>	<b>\$4,755</b>	<b>\$44,861</b>	<b>\$4,251</b>	<b>\$40,610</b>	<b>8.5</b>	<b>29,432</b>

\* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. , after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>24,529</b>	<b>9.5</b>	<b>-2</b>	<b>\$4,034</b>	<b>\$25,875</b>	<b>\$2,956</b>	<b>\$22,919</b>	<b>5.7</b>	<b>24,433</b>
ECM 1	Install LED Fixtures	13,398	2.1	0	\$2,220	\$17,140	\$1,800	\$15,340	6.9	13,492
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	9,172	6.1	-2	\$1,494	\$7,546	\$1,150	\$6,396	4.3	9,012
ECM 3	Retrofit Fixtures with LED Lamps	1,958	1.2	0	\$320	\$1,189	\$6	\$1,183	3.7	1,929
<b>HVAC System Improvements</b>		<b>337</b>	<b>0.0</b>	<b>14</b>	<b>\$237</b>	<b>\$660</b>	<b>\$0</b>	<b>\$660</b>	<b>2.8</b>	<b>1,959</b>
ECM 4	Install Programmable Thermostats	337	0.0	14	\$237	\$660	\$0	\$660	2.8	1,959
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>3</b>	<b>\$37</b>	<b>\$22</b>	<b>\$0</b>	<b>\$22</b>	<b>0.6</b>	<b>333</b>
ECM 5	Install Low-Flow DHW Devices	0	0.0	3	\$37	\$22	\$0	\$22	0.6	333
<b>TOTALS</b>		<b>27,587</b>	<b>12.3</b>	<b>14</b>	<b>\$4,755</b>	<b>\$44,861</b>	<b>\$4,251</b>	<b>\$40,610</b>	<b>8.5</b>	<b>29,432</b>

\* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. , after incentives).

Figure 8 – Cost Effective ECMs

## 4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>24,529</b>	<b>9.5</b>	<b>-2</b>	<b>\$4,034</b>	<b>\$25,875</b>	<b>\$2,956</b>	<b>\$22,919</b>	<b>5.7</b>	<b>24,433</b>
ECM 1	Install LED Fixtures	13,398	2.1	0	\$2,220	\$17,140	\$1,800	\$15,340	6.9	13,492
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	9,172	6.1	-2	\$1,494	\$7,546	\$1,150	\$6,396	4.3	9,012
ECM 3	Retrofit Fixtures with LED Lamps	1,958	1.2	0	\$320	\$1,189	\$6	\$1,183	3.7	1,929

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources are proposed, we suggest converting all of a specific lighting type (e.g. linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

### **ECM 1: Install LED Fixtures**

Replace existing exterior fixtures containing metal halide and high pressure sodium lamps with new LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixture(s).

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

**Affected building areas:** exterior fixtures.

### **ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers**

Retrofit fluorescent T12 fixtures by removing the fluorescent tubes and ballasts and replacing them with LED tubes and LED drivers (if necessary), which are designed to be used in retrofitted fluorescent fixtures.

The measure uses the existing fixture housing but replaces the electric components with more efficient lighting technology which use less power than other lighting technologies but provides equivalent lighting output. Maintenance savings may also be achieved since LED tubes last longer than fluorescent tubes and therefore do not need to be replaced as often.

**Affected building areas:** interior of the office building.

### **ECM 3: Retrofit Fixtures with LED Lamps**

Replace fluorescent T8, compact fluorescent and incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies.

This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

**Affected building areas:** interior of the office building and exterior of the garage bay.

## 4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Control Measures</b>		<b>1,353</b>	<b>0.9</b>	<b>0</b>	<b>\$220</b>	<b>\$3,342</b>	<b>\$375</b>	<b>\$2,967</b>	<b>13.5</b>	<b>1,329</b>
	Install Occupancy Sensor Lighting Controls	1,134	0.8	0	\$185	\$2,742	\$375	\$2,367	12.8	1,114
	Install High/Low Lighting Controls	219	0.1	0	\$36	\$600	\$0	\$600	16.8	216

Lighting controls reduce energy use by turning off or lowering, lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

### **Install Occupancy Sensor Lighting Controls**

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Installing occupancy sensor lighting controls has a long payback, therefore, this measure is not recommended for implementation on the basis of energy savings alone.

**Affected building areas:** offices, restrooms, and storage room.

### Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety requirements. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Installing high/low lighting controls has a long payback, therefore, this measure is not recommended for implementation on the basis of energy savings alone.

**Affected building areas:** corridor-office building.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as an occupant approaches.

### 4.3 Electric Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Electric Unitary HVAC Measures</b>		<b>1,368</b>	<b>1.9</b>	<b>0</b>	<b>\$227</b>	<b>\$14,962</b>	<b>\$920</b>	<b>\$14,042</b>	<b>62.0</b>	<b>1,377</b>
	Install High Efficiency Air Conditioning Units	1,368	1.9	0	\$227	\$14,962	\$920	\$14,042	62.0	1,377

### Install High Efficiency Air Conditioning Units

We evaluated replacing standard efficiency outside condensing units with high efficiency condensing units. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling load, and the estimated annual operating hours.

Replacing the condensing units has a long payback period and may not be justifiable based simply on energy considerations. However, the units have reached the end of their normal useful life and appear to be in poor condition. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the condensing units are eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

## 4.4 HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>HVAC System Improvements</b>		<b>337</b>	<b>0.0</b>	<b>14</b>	<b>\$237</b>	<b>\$660</b>	<b>\$0</b>	<b>\$660</b>	<b>2.8</b>	<b>1,959</b>
ECM 4	Install Programmable Thermostats	337	0.0	14	\$237	\$660	\$0	\$660	2.8	1,959

### **ECM 4: Install Programmable Thermostats**

Replace manual thermostats with programmable thermostats which provide energy savings by reducing heating and cooling energy usage when a room is unoccupied. Manual thermostats are generally adjusted to a single heating and cooling setpoint and left at that setting regardless of occupancy and they provide the same level of heating and cooling regardless of whether the space is being used. Programmable thermostats can maintain different temperature settings for different times of day and for different days of the week. By reducing heating temperature setpoints and raising cooling temperature setpoints when spaces are unoccupied, the operation of the HVAC equipment is reduced while maintaining comfortable space temperatures for building usage.

## 4.5 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>3</b>	<b>\$37</b>	<b>\$22</b>	<b>\$0</b>	<b>\$22</b>	<b>0.6</b>	<b>333</b>
ECM 5	Install Low-Flow DHW Devices	0	0.0	3	\$37	\$22	\$0	\$22	0.6	333

### **ECM 5: Install Low-Flow DHW Devices**

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerator (kitchen)	1.5 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Additional cost savings may result from reduced water usage.

## 5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Energy Tracking with ENERGY STAR® Portfolio Manager®**



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions<sup>4</sup>. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

### **Weatherization**

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment.


### **Doors and Windows**

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour (ACH) can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

### **Lighting Controls**

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly.

### **Thermostat Schedules and Temperature Resets**



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5°F-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

---

<sup>4</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>

## **AC System Evaporator/Condenser Coil Cleaning**

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

## **HVAC Filter Cleaning and Replacement**

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

## **Furnace Maintenance**

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should: check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.

## **Water Heater Maintenance**

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

## **Water Conservation**



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense™ ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense™ website<sup>5</sup> or download a copy of EPA's "WaterSense™ at Work: Best Management Practices for Commercial and Institutional Facilities"<sup>6</sup> to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

### **Procurement Strategies**

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense™ products where available.

---

<sup>5</sup> <https://www.epa.gov/watersense>

<sup>6</sup> <https://www.epa.gov/watersense/watersense-work-0>

## 6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases reduction, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

### 6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has a **low** potential for installing a PV array.

This facility appears to not meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

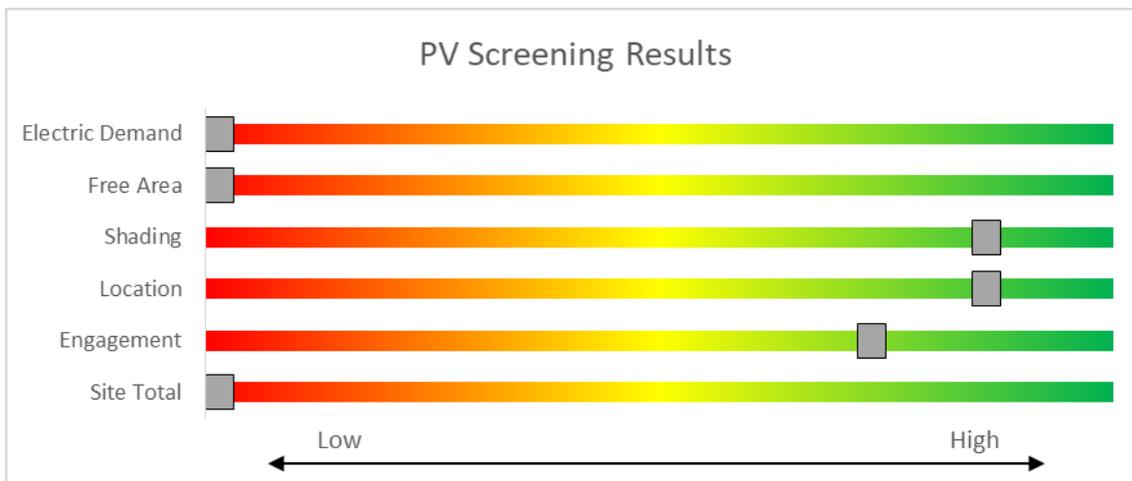


Figure 9 - Photovoltaic Screening

## Solar Renewable Energy Certificate (SREC) Registration Program

Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SREC Registration Program before starting construction. Once your PV system is up and running, you periodically earn credits, which can then be sold on the open market for up to 15 years.

If you are considering installing solar photovoltaics on your building, visit [www.njcleanenergy.com/srec](http://www.njcleanenergy.com/srec) for more information about the SREC Registration Program.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- **Basic Info on Solar PV in NJ:** [www.njcleanenergy.com/whysolar](http://www.njcleanenergy.com/whysolar)
- **NJ Solar Market FAQs:** [www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs](http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs)
- **Approved Solar Installers in the NJ Market:** [www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/?id=60&start=1](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1)

## 6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has **low** potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. Low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

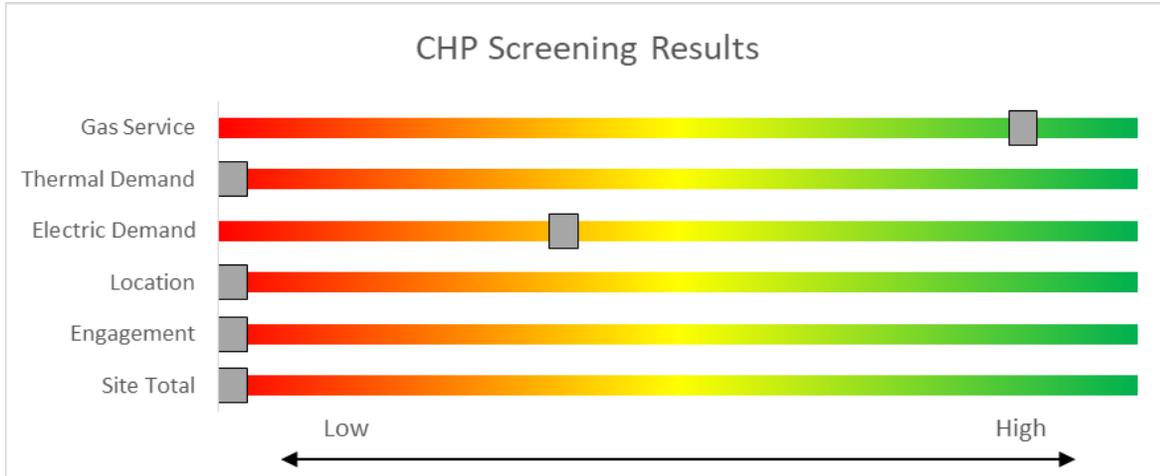


Figure 10 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation:  
[http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/).

## 7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building’s performance? Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available New Jersey’s Clean Energy Programs.

	<b>SmartStart</b> <i>Flexibility to install at your own pace</i>	<b>Direct Install</b> <i>Turnkey installation</i>	<b>Pay for Performance</b> <i>Whole building upgrades</i>
<b>Who should use it?</b>	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together.  Average peak demand should be below 200 kW.  Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time.  Peak demand should be over 200 kW.
<b>How does it work?</b>	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
<b>What are the Incentives?</b>	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project.  You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
<b>How do I participate?</b>	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
<p>Take the next step by visiting <a href="http://www.njcleanenergy.com">www.njcleanenergy.com</a> for program details, applications, and to contact a qualified contractor.</p>			

## 7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy efficiency equipment based on market trends and new technologies.

### **Equipment with Prescriptive Incentives Currently Available:**

*Electric Chillers*

*Electric Unitary HVAC*

*Gas Cooling*

*Gas Heating*

*Gas Water Heating*

*Ground Source Heat Pumps*

*Lighting*

*Lighting Controls*

*Refrigeration Doors*

*Refrigeration Controls*

*Refrigerator/Freezer Motors*

*Food Service Equipment*

*Variable Frequency Drives*

### **Incentives**

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

### **How to Participate**

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit [www.njcleanenergy.com/SSB](http://www.njcleanenergy.com/SSB) for a detailed program description, instructions for applying, and applications.

## 7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

### Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

### How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: [www.njcleanenergy.com/DI](http://www.njcleanenergy.com/DI).

## 7.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

### How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program description and application can be found at: [www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

*ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.*

## 8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website<sup>7</sup>.

### 8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website<sup>8</sup>.

---

<sup>7</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

<sup>8</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html)

---

# APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

## Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	1,300	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,300	0.1	84	0	\$14	\$69	\$10	4.3
Corridors	15	U-Bend Fluorescent - T12: U T12 (34W) - 2L	Wall Switch	S	72	1,300	2, NR	Relamp & Reballast	Yes	15	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	897	0.7	1,056	0	\$172	\$2,171	\$150	11.7
Corridors	6	Exit Signs: LED - 2 W Lamp	None	S	6	8,760		None	No	6	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
File Room	3	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,040	2, NR	Relamp & Reballast	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	718	0.4	467	0	\$76	\$471	\$80	5.1
Endangered Specimen Office	1	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	1	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.1	194	0	\$32	\$234	\$40	6.1
Kitchen	1	Incandescent: Screw in	Wall Switch	S	65	1,300	3	Relamp	No	1	LED Screw-In Lamps: LED Screw-In Lamps	Wall Switch	10	1,300	0.1	79	0	\$13	\$17	\$1	1.3
Men Restroom	1	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	1	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.1	194	0	\$32	\$388	\$55	10.5
Men Restroom	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	1,300	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,300	0.1	84	0	\$14	\$69	\$10	4.3
Women Restroom	1	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	1	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.1	194	0	\$32	\$388	\$55	10.5
Women Restroom	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	1,300	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,300	0.1	84	0	\$14	\$69	\$10	4.3
Conference Room	6	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	6	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.8	1,167	0	\$190	\$980	\$155	4.3
Reception Area	4	Incandescent: Screw in	Wall Switch	S	65	1,300	3, NR	Relamp	Yes	4	LED Screw-In Lamps: LED Screw-In Lamps	Occupancy Sensor	10	897	0.2	332	0	\$54	\$339	\$39	5.5
Reception Area	2	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2	Relamp & Reballast	No	2	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	1,300	0.2	337	0	\$55	\$237	\$40	3.6
Main Entrance	1	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2	Relamp & Reballast	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	1,300	0.1	169	0	\$27	\$118	\$20	3.6
Main Entrance	1	Exit Signs: LED - 2 W Lamp	None	S	6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Closet	1	Incandescent: Screw in	Wall Switch	S	65	1,040	3	Relamp	No	1	LED Screw-In Lamps: LED Screw-In Lamps	Wall Switch	10	1,040	0.1	63	0	\$10	\$17	\$1	1.6
Office	2	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.3	389	0	\$63	\$353	\$60	4.6
Hunters Education	3	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.4	583	0	\$95	\$471	\$80	4.1
Officer's Room	3	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.4	583	0	\$95	\$471	\$80	4.1
Closet	2	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.3	389	0	\$63	\$353	\$40	4.9
Evidence Room	2	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.3	389	0	\$63	\$353	\$60	4.6
Law Enforcement Office	8	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	8	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	1.0	1,556	0	\$253	\$1,217	\$195	4.0
Fisheries Office	3	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.4	583	0	\$95	\$471	\$80	4.1
Land Management	3	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.4	583	0	\$95	\$471	\$80	4.1
Storage Room	2	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.3	389	0	\$63	\$353	\$40	4.9

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Storage Room	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	1,300	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,300	0.1	84	0	\$14	\$69	\$10	4.3
Office	2	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.3	389	0	\$63	\$353	\$60	4.6
Office	2	Linear Fluorescent - T12: 4' T12 (40W) - 4L	Wall Switch	S	176	1,300	2, NR	Relamp & Reballast	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	897	0.3	389	0	\$63	\$353	\$60	4.6
Mud Room	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	1,300	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,300	0.1	84	0	\$14	\$69	\$10	4.3
Back Entrance	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	1,300	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,300	0.1	84	0	\$14	\$69	\$10	4.3
Back Entrance	1	Exit Signs: LED - 2 W Lamp	None	S	6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Exterior Wall Pack	6	High-Pressure Sodium: (1) 150W Lamp	Photocell		188	4,380	1	Fixture Replacement	No	6	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	45	4,380	0.6	3,758	0	\$623	\$5,796	\$600	8.3
Exterior Recessed	2	High-Pressure Sodium: (1) 100W Lamp	Photocell		138	4,380	1	Fixture Replacement	No	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	25	4,380	0.2	990	0	\$164	\$1,932	\$200	10.6
Parking Lot	7	Metal Halide: (1) 250W Lamp	Photocell		295	4,380	1	Fixture Replacement	No	7	LED - Fixtures: Outdoor Pole/Arm Mounted Area/Roadway Fixture	Photocell	75	4,380	1.1	6,745	0	\$1,117	\$6,514	\$700	5.2
Garage Bay Wall Pack	3	Metal Halide: (1) 150W Lamp	Photocell		190	4,380	1	Fixture Replacement	No	3	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	45	4,380	0.3	1,905	0	\$316	\$2,898	\$300	8.2
Garage Bay1	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	1,300	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,300	0.3	425	0	\$69	\$329	\$0	4.7
Garage Bay1	1	Exit Signs: LED - 2 W Lamp	None	S	6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Garage Bay2	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	1,300	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,300	0.3	425	0	\$69	\$329	\$0	4.7
Garage Bay2	1	Exit Signs: LED - 2 W Lamp	None	S	6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Garage Bay Wall Pack	4	Compact Fluorescent: 4-PIN	Photocell		32	4,380	3	Relamp	No	4	LED - Fixtures: Downlight Solid State Retrofit	Photocell	19	4,380	0.0	228	0	\$38	\$100	\$0	2.7
Garage Bay3	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	1,300	3	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,300	0.3	425	0	\$69	\$329	\$0	4.7
Garage Bay3	1	Exit Signs: LED - 2 W Lamp	None	S	6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Storage Shed	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	1,300		None	No	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,300	0.0	0	0	\$0	\$0	\$0	0.0
Storage Shed Wall Pack	1	LED - Fixtures: LED - Fixtures	Photocell	S	11	4,380		None	No	1	LED - Fixtures: LED - Fixtures	Photocell	11	4,380	0.0	0	0	\$0	\$0	\$0	0.0

### Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions				Energy Impact & Financial Analysis							
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mian Building	Main Building	5	Exhaust Fan	0.1	60.0%	No	W	1,300		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Garage Bay	Garage Roll-Up Doors	4	Other	0.3	60.0%	No	W	130		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

### Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Ground Floor	Main Building	2	Split-System AC	5.00		B	NR	Yes	2	Split-System AC	5.00		14.00		1.9	1,368	0	\$227	\$14,962	\$920	62.0
Ground Floor	Garage Bay	2	Split-System Air-Source HP	3.00	42.00	W		No							0.0	0	0	\$0	\$0	\$0	0.0

### Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis					
		System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Main Building	2	Furnace	80.00	B	4	Yes	2	Furnace	80.00	95.00%	AFUE	0.0	0	51	\$662	\$3,625	\$800	4.3

### DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions					Energy Impact & Financial Analysis								
		System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years	
Mechanical Room	Main Building	1	Storage Tank Water Heater (≤ 50 Gal)	W		No							0.0	0	0	\$0	\$0	\$0	0.0

**Low-Flow Device Recommendations**

Location	Recommendation Inputs					Energy Impact & Financial Analysis						
	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Facility	5	3	Faucet Aerator (Lavatory)	2.20	0.50	0.0	0	3	\$37	\$22	\$0	0.6

**Plug Load Inventory**

Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?
Facility	18	Desktop Computer	120.0	Yes
Facility	2	Copy Machine	450.0	Yes
Facility	1	Water Cooler	172.0	Yes
Facility	2	Microwave	800.0	No
Facility	2	Refrigerator	224.0	Yes
Facility	2	Printer	56.0	Yes
Facility	1	Small Refrigerator	45.0	Yes
Facility	2	Coffee Machine	350.0	No

# APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

## ENERGY STAR® Statement of Energy Performance

# 67

ENERGY STAR®  
Score<sup>1</sup>

### Winslow Southern Regional Office

Primary Property Type: Office  
Gross Floor Area (ft<sup>2</sup>): 6,720  
Built: 1982

For Year Ending: April 30, 2018  
Date Generated: February 02, 2019

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
<b>Property Address</b> Winslow Southern Regional Office 220 Blue Anchor Road Sicklerville, New Jersey 08081	<b>Property Owner</b> NJDEP Division of Fish and Wildlife PO Box 420 Trenton, NJ 08625 (609) 358-2072	<b>Primary Contact</b> Dave Golden PO Box 420 Trenton, NJ 08625 (609) 358-2072 david.golden@dep.nj.gov	
<b>Property ID:</b> 6681634			

Energy Consumption and Energy Use Intensity (EUI)			
<b>Site EUI</b> 72.9 kBtu/ft <sup>2</sup>	<b>Annual Energy by Fuel</b>	<b>National Median Comparison</b>	
	Electric - Grid (kBtu) 159,747 (33%)	National Median Site EUI (kBtu/ft <sup>2</sup> )	88.3
	Natural Gas (kBtu) 330,139 (87%)	National Median Source EUI (kBtu/ft <sup>2</sup> )	143.1
		% Diff from National Median Source EUI	-17%
<b>Source EUI</b> 118.1 kBtu/ft <sup>2</sup>		<b>Annual Emissions</b>	
		Greenhouse Gas Emissions (Metric Tons CO <sub>2</sub> e/year)	34

### Signature & Stamp of Verifying Professional

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

Licensed Professional

\_\_\_\_\_  
( ) - \_\_\_\_\_  
\_\_\_\_\_



Professional Engineer Stamp  
(if applicable)

## APPENDIX C: GLOSSARY

TERM	DEFINITION
<b>Blended Rate</b>	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
<b>Btu</b>	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
<b>CHP</b>	<i>Combined heat and power</i> . Also referred to as cogeneration.
<b>COP</b>	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
<b>Demand Response</b>	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
<b>DCV</b>	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
<b>US DOE</b>	<i>United States Department of Energy</i>
<b>EC Motor</b>	<i>Electronically commutated motor</i>
<b>ECM</b>	<i>Energy conservation measure</i>
<b>EER</b>	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
<b>EUI</b>	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
<b>Energy Efficiency</b>	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
<b>ENERGY STAR®</b>	ENERGY STAR® is the government-backed symbol for energy efficiency. The ENERGY STAR® program is managed by the EPA.
<b>EPA</b>	<i>United States Environmental Protection Agency</i>
<b>Generation</b>	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
<b>GHG</b>	<i>Greenhouse gases</i> : gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.

<b>gpf</b>	<i>Gallons per flush</i>
<b>gpm</b>	<i>Gallon per minute</i>
<b>HID</b>	<i>High intensity discharge</i> : high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
<b>hp</b>	<i>Horsepower</i>
<b>HPS</b>	<i>High-pressure sodium</i> : a type of HID lamp
<b>HSPF</b>	<i>Heating seasonal performance factor</i> : a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
<b>HVAC</b>	<i>Heating, ventilating, and air conditioning</i>
<b>IHP 2014</b>	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
<b>IPLV</b>	<i>Integrated part load value</i> : a measure of the part load efficiency usually applied to chillers.
<b>kBtu</b>	One thousand British thermal units
<b>kW</b>	<i>Kilowatt</i> : equal to 1,000 Watts.
<b>kWh</b>	<i>Kilowatt-hour</i> : 1,000 Watts of power expended over one hour.
<b>LED</b>	<i>Light emitting diode</i> : a high-efficiency source of light with a long lamp life.
<b>LGEA</b>	<i>Local Government Energy Audit</i>
<b>Load</b>	The total power a building or system is using at any given time.
<b>Measure</b>	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
<b>MH</b>	<i>Metal halide</i> : a type of HID lamp
<b>MBh</b>	<i>Thousand Btu per hour</i>
<b>MBtu</b>	<i>One thousand British thermal units</i>
<b>MMBtu</b>	<i>One million British thermal units</i>
<b>MV</b>	<i>Mercury Vapor</i> : a type of HID lamp
<b>NJBPU</b>	<i>New Jersey Board of Public Utilities</i>
<b>NJCEP</b>	<i>New Jersey's Clean Energy Program</i> : NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money and the environment.
<b>psig</b>	<i>Pounds per square inch gauge</i>
<b>Plug Load</b>	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.

---

<b>PV</b>	<i>Photovoltaic</i> : refers to an electronic device capable of converting incident light directly into electricity (direct current).
-----------	---

---

<b>SEER</b>	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
-------------	---

---

<b>SEP</b>	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR® Portfolio Manager®.
------------	---

---

<b>Simple Payback</b>	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
-----------------------	--

---

<b>SREC</b>	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
-------------	--

---

<b>T5, T8, T12</b>	A reference to a linear lamp diameter. The number represents increments of 1/8 <sup>th</sup> of an inch.
--------------------	--

---

<b>Temperature Setpoint</b>	The temperature at which a temperature regulating device (thermostat, for example) has been set.
-----------------------------	--

---

<b>therm</b>	100,000 Btu. Typically used as a measure of natural gas consumption.
--------------	--

---

<b>tons</b>	A unit of cooling capacity equal to 12,000 Btu/hr.
-------------	--

---

<b>Turnkey</b>	Provision of a complete product or service that is ready for immediate use
----------------	--

---

<b>VAV</b>	<i>Variable air volume</i>
------------	----------------------------

---

<b>VFD</b>	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
------------	---

---

<b>WaterSense™</b>	The symbol for water efficiency. The WaterSense™ program is managed by the EPA.
--------------------	---

---

<b>Watt (W)</b>	Unit of power commonly used to measure electricity use.
-----------------	---

---