



Local Government Energy Audit Report

Woodrow Wilson School

July 31, 2019

Prepared for:

Elizabeth Board of Education
529 Edgar Road
Elizabeth, New Jersey 07202

Prepared by:

TRC Energy Services
900 Route 9 North
Woodbridge, New Jersey 07095

Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC Energy Services (TRC) reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from RS Means. We encourage the owner of the facility to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2019 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Table of Contents


1	Executive Summary	1
1.1	Planning Your Project	4
	Pick Your Installation Approach	4
	More Options from Around the State.....	6
2	Existing Conditions	7
2.1	Site Overview.....	7
2.2	Building Occupancy	7
2.3	Building Envelope	8
2.4	Lighting Systems.....	9
2.5	Air Handling Systems	10
	Packaged Units	10
	Air Conditioners	10
2.6	Heating Steam System.....	11
	Unit Ventilators	11
2.7	Building Energy Management Systems (EMS)	11
2.8	Domestic Hot Water	12
2.9	Food Service Equipment.....	12
2.10	Refrigeration.....	13
2.11	Plug Load & Vending Machines.....	14
2.12	Water-Using Systems	14
3	Energy Use and Costs	15
3.1	Electricity	17
3.2	Natural Gas	18
3.3	Benchmarking.....	19
	Tracking Your Energy Performance.....	20
4	Energy Conservation Measures	21
4.1	Lighting	24
	ECM 1: Install LED Fixtures	24
	ECM 2: Retrofit Fixtures with LED Lamps.....	24
4.2	Lighting Controls.....	25
	ECM 3: Install Occupancy Sensor Lighting Controls	25
	ECM 4: Install High/Low Lighting Controls	26
4.3	Variable Frequency Drives (VFD).....	26
	ECM 5: Install VFDs on Constant Volume (CV) Fans.....	27
	ECM 6: Install Boiler Draft Fan VFDs	27
4.4	Electric Unitary HVAC	27
	ECM 7: Install High-Efficiency Air Conditioning Units	28

4.5	Gas-Fired Heating	28
	ECM 8: Install High-Efficiency Steam Boilers.....	28
	ECM 9: Install High-Efficiency Furnaces	28
4.6	HVAC.....	29
	ECM 10: Implement Demand Control Ventilation (DCV)	29
4.7	Domestic Water Heating	29
	ECM 11: Install High-Efficiency Gas-Fired Water Heater	29
	ECM 12: Install Low-Flow DHW Devices.....	30
4.8	Food Service & Refrigeration Measures.....	30
	ECM 13: Refrigerator/Freezer Case Electrically Commutated Motors	30
5	Energy Efficient Best Practices	31
	Energy Tracking with ENERGY STAR® Portfolio Manager®	31
	Weatherization.....	31
	Doors and Windows	31
	Window Treatments/Coverings	31
	Lighting Controls	31
	Thermostat Schedules and Temperature Resets	32
	Economizer Maintenance	32
	AC System Evaporator/Condenser Coil Cleaning	32
	HVAC Filter Cleaning and Replacement	32
	Boiler Maintenance	32
	Furnace Maintenance	32
	Water Heater Maintenance	33
	Compressed Air System Maintenance	33
	Water Conservation	34
	Procurement Strategies	34
6	On-site Generation	35
6.1	Solar Photovoltaic	35
6.2	Combined Heat and Power	37
7	Project Funding and Incentives.....	38
7.1	SmartStart	39
7.2	Direct Install	40
7.3	Pay for Performance - Existing Buildings.....	41
7.4	Energy Savings Improvement Program	42
7.5	SREC Registration Program.....	43
8	Energy Purchasing and Procurement Strategies	44
8.1	Retail Electric Supply Options.....	44
8.2	Retail Natural Gas Supply Options	44
	Appendix A: Equipment Inventory & Recommendations	A-1
	Appendix B: ENERGY STAR® Statement of Energy Performance	B-1
	Appendix C: Glossary	C-1

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Woodrow Wilson School. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC Energy Services (TRC) conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT

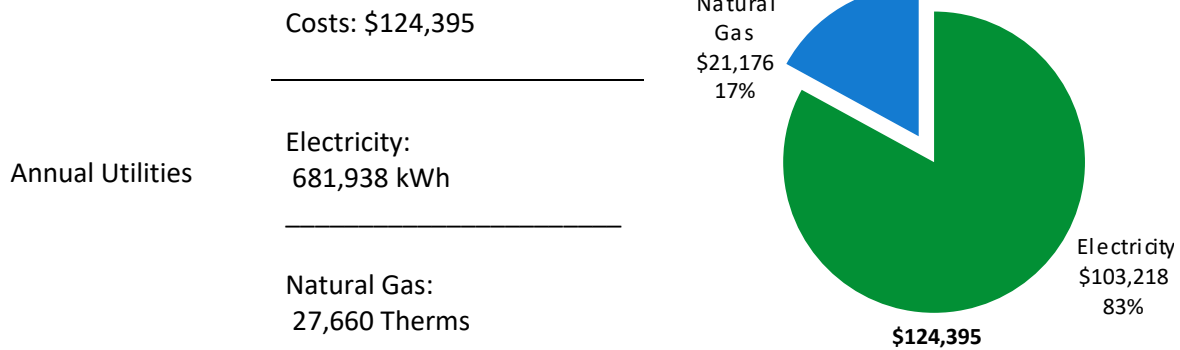

<p>ENERGY STAR® Benchmarking Score</p>	<p>26 <i>(1-100 scale)</i></p>	<p>This building performs at or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.</p>
--	------------------------------------	---

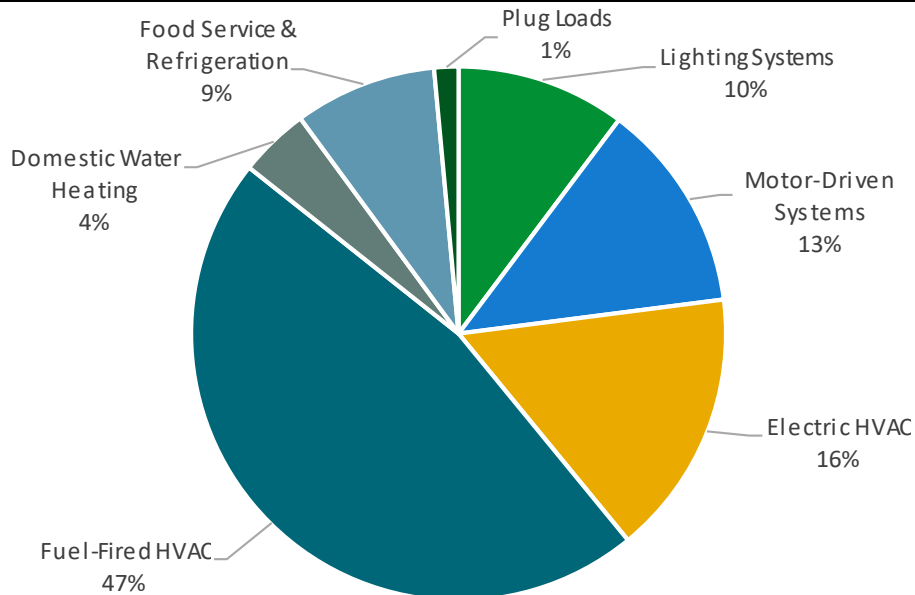


Figure 1 - Energy Use by System


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$438,408
Potential Rebates & Incentives ¹	\$15,176
Annual Cost Savings	\$32,458
Annual Energy Savings	Electricity: 196,294 kWh Natural Gas: 3,588 Therms
Greenhouse Gas Emission Savings	120 Tons
Simple Payback	13.0 Years
Site Energy Savings (all utilities)	20%

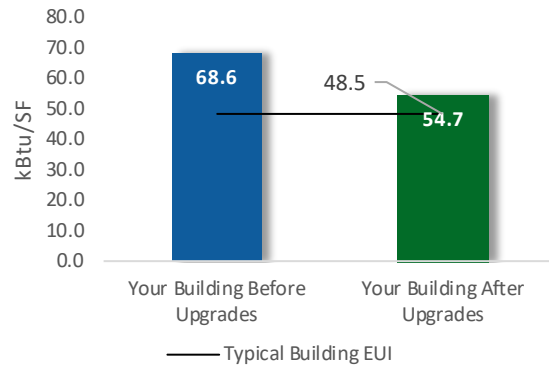

Scenario 2: Cost Effective Package²

Installation Cost	\$88,857
Potential Rebates & Incentives	\$12,486
Annual Cost Savings	\$26,989
Annual Energy Savings	Electricity: 176,303 kWh Natural Gas: 397 Therms
Greenhouse Gas Emission Savings	91 Tons
Simple Payback	2.8 Years
Site Energy Savings (all utilities)	13%

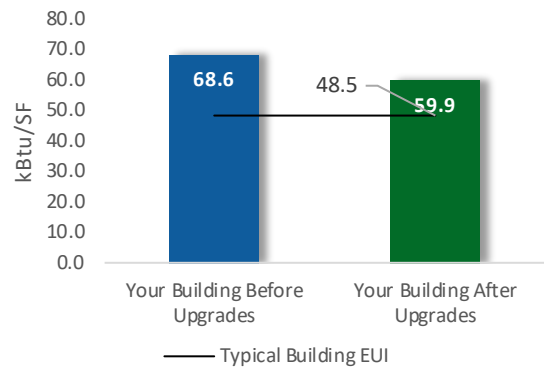

On-site Generation Potential

Photovoltaic	High
Combined Heat and Power	None

¹ Incentives are based on current SmartStart Prescriptive incentives. Other Program incentives may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Lifetime Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		84,401	17.2	-17	\$12,646	\$189,690	\$29,708	\$6,966	\$22,742	1.8	83,019
ECM 1	Install LED Fixtures	3,611	0.4	0	\$547	\$8,200	\$3,950	\$40	\$3,910	7.2	3,637
ECM 2	Retrofit Fixtures with LED Lamps	80,790	16.8	-17	\$12,099	\$181,490	\$25,758	\$6,926	\$18,832	1.6	79,382
Lighting Control Measures		11,025	2.0	-2	\$1,651	\$13,208	\$12,735	\$1,120	\$11,615	7.0	10,832
ECM 3	Install Occupancy Sensor Lighting Controls	7,489	1.3	-2	\$1,122	\$8,973	\$8,910	\$1,120	\$7,790	6.9	7,358
ECM 4	Install High/Low Lighting Controls	3,535	0.6	-1	\$529	\$4,236	\$3,825	\$0	\$3,825	7.2	3,474
Variable Frequency Drive (VFD) Measures		70,462	18.3	0	\$10,665	\$159,978	\$36,944	\$4,400	\$32,544	3.1	70,955
ECM 5	Install VFDs on Constant Volume (CV) Fans	64,438	16.5	0	\$9,753	\$146,300	\$29,176	\$4,400	\$24,776	2.5	64,889
ECM 6	Install Boiler Draft Fan VFDs	6,024	1.9	0	\$912	\$13,678	\$7,768	\$0	\$7,768	8.5	6,067
Electric Unitary HVAC Measures		19,991	5.1	0	\$3,026	\$45,387	\$152,957	\$730	\$152,227	50.3	20,131
ECM 7	Install High Efficiency Air Conditioning Units	19,991	5.1	0	\$3,026	\$45,387	\$152,957	\$730	\$152,227	50.3	20,131
Gas Heating (HVAC/Process) Replacement		0	0.0	304	\$2,324	\$46,479	\$174,639	\$1,200	\$173,439	74.6	35,541
ECM 8	Install High Efficiency Steam Boilers	0	0.0	212	\$1,620	\$32,394	\$138,179	\$0	\$138,179	85.3	24,770
ECM 9	Install High Efficiency Furnaces	0	0.0	92	\$704	\$14,085	\$36,460	\$1,200	\$35,260	50.1	10,771
HVAC System Improvements		9,366	0.0	19	\$1,563	\$23,447	\$8,157	\$0	\$8,157	5.2	11,656
ECM 10	Implement Demand Control Ventilation (DCV)	9,366	0.0	19	\$1,563	\$23,447	\$8,157	\$0	\$8,157	5.2	11,656
Domestic Water Heating Upgrade		0	0.0	55	\$425	\$4,843	\$22,055	\$760	\$21,295	50.2	6,493
ECM 11	Install High Efficiency Gas-Fired Water Heater	0	0.0	16	\$119	\$1,792	\$21,954	\$760	\$21,195	177.4	1,827
ECM 12	Install Low-Flow DHW Devices	0	0.0	40	\$305	\$3,051	\$100	\$0	\$100	0.3	4,667
Food Service & Refrigeration Measures		1,049	0.1	0	\$159	\$2,381	\$1,213	\$0	\$1,213	7.6	1,056
ECM 13	Refrigerator/Freezer Case Electrically Commutated Motors	1,049	0.1	0	\$159	\$2,381	\$1,213	\$0	\$1,213	7.6	1,056
TOTALS (COST EFFECTIVE MEASURES)		176,303	37.7	40	\$26,989	\$391,755	\$88,857	\$12,486	\$76,371	2.8	182,184
TOTALS (ALL MEASURES)		196,294	42.8	359	\$32,458	\$485,413	\$438,408	\$15,176	\$423,232	13.0	239,683

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

New Jersey’s Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Install LED Fixtures	X	X	X
ECM 2	Retrofit Fixtures with LED Lamps	X	X	X
ECM 3	Install Occupancy Sensor Lighting Controls	X	X	X
ECM 4	Install High/Low Lighting Controls		X	X
ECM 5	Install VFDs on Constant Volume (CV) HVAC	X	X	X
ECM 6	Install Boiler Draft Fan VFDs		X	X
ECM 7	Install High Efficiency Electric AC	X		X
ECM 8	Install High Efficiency Steam Boilers			X
ECM 9	Install High Efficiency Furnaces	X		X
ECM 10	Implement Demand Control Ventilation		X	X
ECM 11	Install High Efficiency Gas Water Heater	X	X	X
ECM 12	Install Low-Flow Domestic Hot Water Devices		X	X
ECM 13	Refrigerator/Freezer Case Electrically Commutated Motors		X	X

Figure 3 – Funding Options



New Jersey's Clean Energy Programs At-A-Glance

	SmartStart Flexibility to install at your own pace	Direct Install Turnkey installation	Pay for Performance Whole building upgrades
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified partner to develop your energy reduction plan and set your energy savings targets.

Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.

Individual Measures with SmartStart

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

Turnkey Installation with Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Whole Building Approach with Pay for Performance

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

More Options from Around the State

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat & Power (CHP)

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) Report for Woodrow Wilson School. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey’s Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On February 15, 2019, TRC performed an energy audit at Woodrow Wilson School located in Elizabeth, New Jersey. TRC met with Eduviges Rodriguez to review the school operations and help focus our investigation on specific energy-using systems.

Woodrow Wilson School is a three-story, 74,290 square foot building originally built in 1926 with the latest addition to the building in 1999. Spaces include: classrooms, a gymnasium, offices, a cafeteria, corridors, stairwells, a commercial kitchen, and basement mechanical space.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see **Appendix A: Equipment Inventory & Recommendations**.

2.2 Building Occupancy

The school is occupied 10 months out of the year. Typical weekday occupancy is 76 staff and 635 students.

Building Name	Weekday/Weekend	Operating Schedule
Woodrow Wilson School	Weekday	7:00 AM - 4:30 PM
	Weekend	7:00 AM - 4:30 PM (Saturdays)

Figure 4 - Building Occupancy Schedule

2.3 Building Envelope

The building is constructed of concrete block and structural steel with a brick facade. The roof is flat and covered with asphalt, and it is in fair condition.

There are four temporary classroom units (TCU) located behind the main building that are constructed of structural steel frames. The walls are made of corrugated steel sheeting with insulation material covering the gap between the interior and exterior walls. The roof is covered in roofing membrane. The envelope of the TCUs is in fair condition.

Most of the windows in the old wing of the main building are single-glazed with aluminum frames while the new wing has mostly double-glazed windows with aluminum frames. The TCU windows are all double-glazed with aluminum frames. The exterior doors have aluminum frames. Many of the windows in the old wing have cracks in the frames. Degraded window and door seals increase drafts and outside air infiltration.



Main Building Envelope



Roof



TCU Envelope

2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. There are also several fixtures with compact fluorescent spiral light bulbs with an estimated rating of 26-Watts. Additionally, there are some fixtures with (100-watt & 60-Watt) incandescent light bulbs, and (8-watt, 10-watt and 17-watt) LED bulbs. Typically, T8 fluorescent lamps use electronic ballasts.

Fluorescent fixture types include 1-, 2-, 3-, or 4-lamp, 2- or 4-foot long troffers, recessed, or surface mounted fixtures. Similarly, CFL lamps, incandescent lamps, and LED lamps are situated in a mix of suspended, recessed, and surface mounted fixtures. Most exit signs use LED sources.

Most fixtures are in fair condition. Interior lighting levels were generally sufficient. Most lighting fixtures are controlled manually; however, in some classrooms and offices, the lighting fixtures are controlled by occupancy sensors.



Classroom Fixtures



Gym Lighting Fixtures



Exit Sign



Hallway Lighting

Exterior fixtures in the school include wall packs and area lights located throughout the perimeter of the building and on the TCUs. These fixtures have CFL lamps and high intensity discharge (HID) lamps. A few use LED sources.

Exterior light fixtures are controlled by a time clock or photocell, depending on the fixture.



Wallpack Fixture



TCU Exterior Wallpack

2.5 Air Handling Systems

Packaged Units

The gym, kitchen, and cafeteria are served by individual rooftop units (RTUs). The RTUs serving the gym and cafeteria have capacities of 30-tons each. The RTU serving the kitchen has a capacity of 10-tons. All RTUs have individual furnaces built into them to serve the heating requirement of their respective zones. All units were installed in the year 1999 and may be nearing their effective useful life.

The TCUs are equipped with wall-mounted 3-ton packaged terminal units to serve the cooling and heating requirements of their respective zones. These units have electric resistance heating.

Air Conditioners

Some small classrooms are served by window air conditioning (AC) units. These units are estimated at either 1- or 1.5-ton capacity each. Two of the window AC units are nearing their end of effective useful life.

HVAC system equipment in the old wing is operated by a pneumatic control system, served by a 3 hp air compressor located in the maintenance room.



RTU



Window AC Unit

2.6 Heating Steam System

Two Pacific 5,600 MBh steam boilers serve the major portion of the main building heating load. Steam heat is provided to unit ventilators and radiators. The boilers have an estimated efficiency of 72%. The boilers are configured in a lead-lag control scheme; both boilers are required under high load conditions. Installed in 1956, they are approaching their end of effective useful life.

Unit Ventilators

Most classrooms are equipped with unit ventilator units to serve their heating requirement. These units have supply fan motors and zone valves for the steam lines that operate with a pneumatic control system. This system is original to the building and appears to be in fair operating condition. Radiators provide steam heat to some of the classrooms and offices.



Steam Boiler

2.7 Building Energy Management Systems (EMS)

A Honeywell EMS controls the HVAC equipment serving the new wing of the main building and the boilers.

2.8 Domestic Hot Water

Hot water is produced with a 98 gallon 180 MBh gas-fired storage water heater for the kitchen and restrooms in the old wing, and a 100 gallon 199.9 MBH gas-fired storage water heater for the new wing restrooms. Both heaters have a thermal efficiency of 74%.



Old Wing DHW Heater



New Wing DHW Heater

2.9 Food Service Equipment

The kitchen has a mixture of gas and electric equipment that are used to prepare meals, breakfasts, and lunches for students and staff. Most cooking is done using a combination gas-fired oven. Bulk prepared foods are held in an electric holding cabinet. Equipment is high-efficiency and is in fair condition.

The dishwasher is an ENERGY STAR® high temperature conveyor type unit. This unit is equipped with an electric booster heater.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high-efficiency food service equipment.



Gas Fired Combination Oven



Rack Oven



Electric Steam Table



Food Holding Cabinet

2.10 Refrigeration

The kitchen has two refrigerator chests for storing milk. These units are high-efficiency and in good working condition.

The walk-in low temperature freezer has an estimated 0.75-ton compressor located on top of the freezer and a 1/15-hp two-fan evaporator. The walk-in medium temperature freezer has a 0.58-ton compressor located on top of the freezer and a 1/15-hp two-fan evaporator. Both units have evaporator fan controls and electric defrost controls.

There are also two cold pan serving counters used to store and serve yogurt and milk.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high-efficiency food service equipment.



Walk-In Freezer



Refrigeration Chest



Cold Pan Serving Counter


2.11 Plug Load & Vending Machines

The utility bill analysis indicates that plug loads consume approximately 2% percent of total building energy use. This is lower than a typical building.

The staff seems to already be doing a great job managing the building's electrical plug loads. This report makes additional suggestions for ECMs in this area as well as Energy Efficient Best Practices.

There are approximately 45 computer work stations throughout the school. Plug loads throughout the building include general café and office equipment. There are classroom typical loads such as Smart Boards, projectors, and computers.

There are several residential-style refrigerators throughout the building that are used to store perishables. These vary in condition and efficiency.

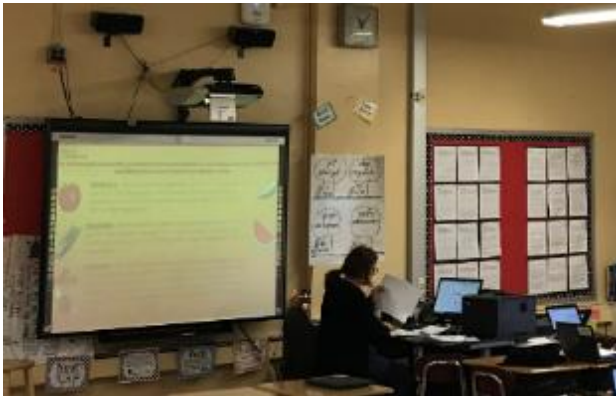

Classroom Plug Loads



Refrigerator


2.12 Water-Using Systems

There are approximately 12 restrooms with toilets, urinals, and sinks. Faucet flow rates are at 2.2 gallons per minute (gpm) or higher.

3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	681,938 kWh	\$103,218
Natural Gas	27,660 Therms	\$21,176
Total		\$124,395

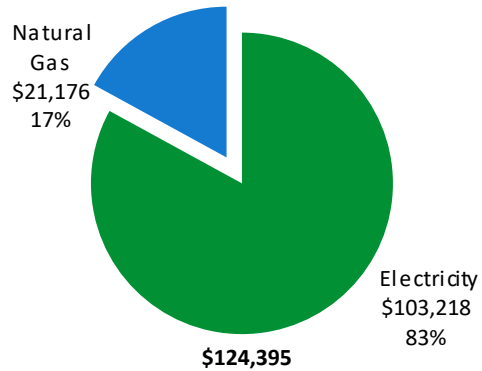

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


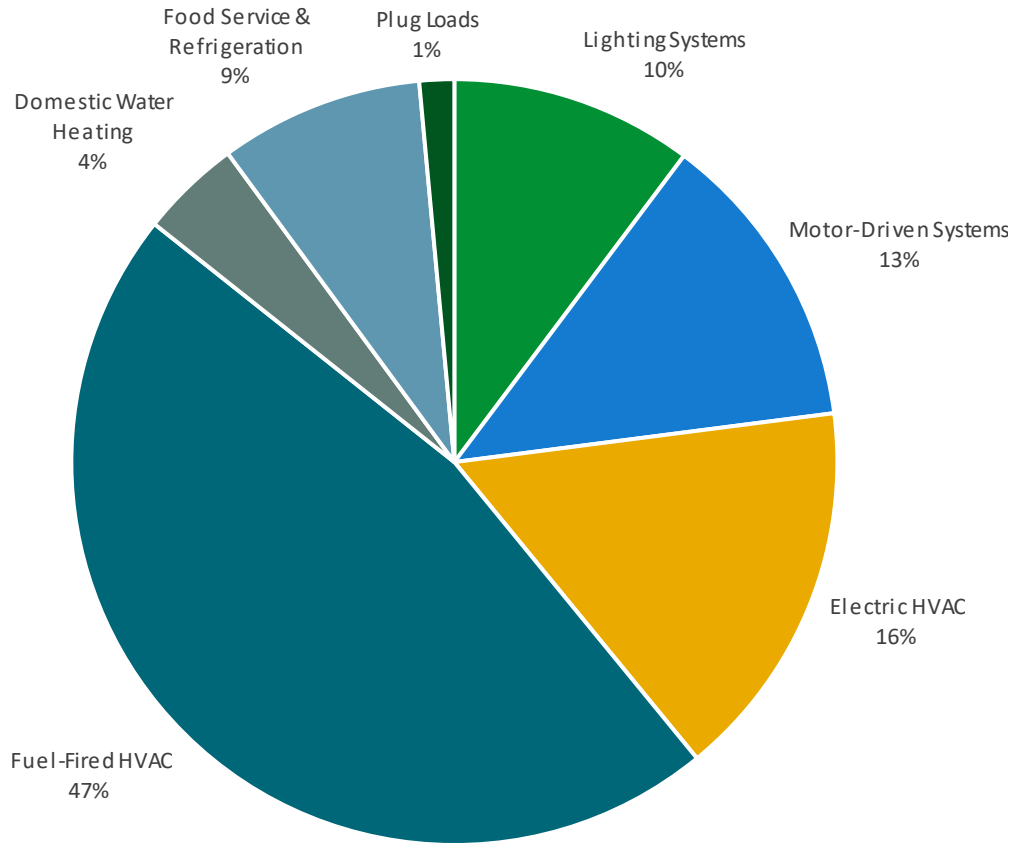


Figure 5 - Energy Balance

3.1 Electricity

PSE&G delivers electricity under rate class GLP, with electric production provided a third-party supplier.

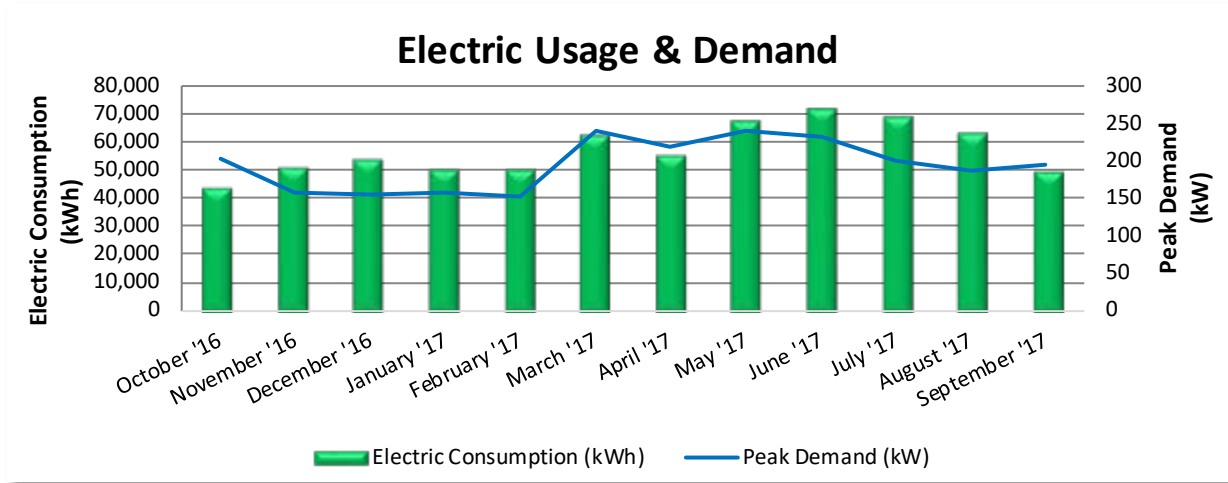


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
11/14/16	29	43,423	203	\$827	\$6,418
12/15/16	31	50,570	158	\$650	\$7,094
1/18/17	34	53,140	154	\$635	\$7,443
2/15/17	28	50,071	158	\$651	\$7,086
3/17/17	30	50,106	152	\$632	\$7,177
4/18/17	32	62,097	241	\$999	\$8,912
5/17/17	29	54,508	219	\$883	\$7,901
6/16/17	30	67,136	241	\$3,037	\$11,444
7/18/17	32	71,269	233	\$2,205	\$11,837
8/16/17	29	68,200	199	\$1,838	\$10,612
9/15/17	30	62,416	186	\$1,631	\$10,232
10/16/17	31	49,002	196	\$801	\$7,061
Totals	365	681,938	241	\$14,789	\$103,218
Annual	365	681,938	241	\$14,789	\$103,218

Notes:

- Peak demand of 241 kW occurred in March/April 2017 and again in May/June 2017.
- The average electric cost over the past 12 months was \$0.151/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

3.2 Natural Gas

Elizabethtown Gas delivers natural gas under rate class ET-GDS utility commercial heat, with natural gas supply provided by UGI Energy Services, a third-party supplier.

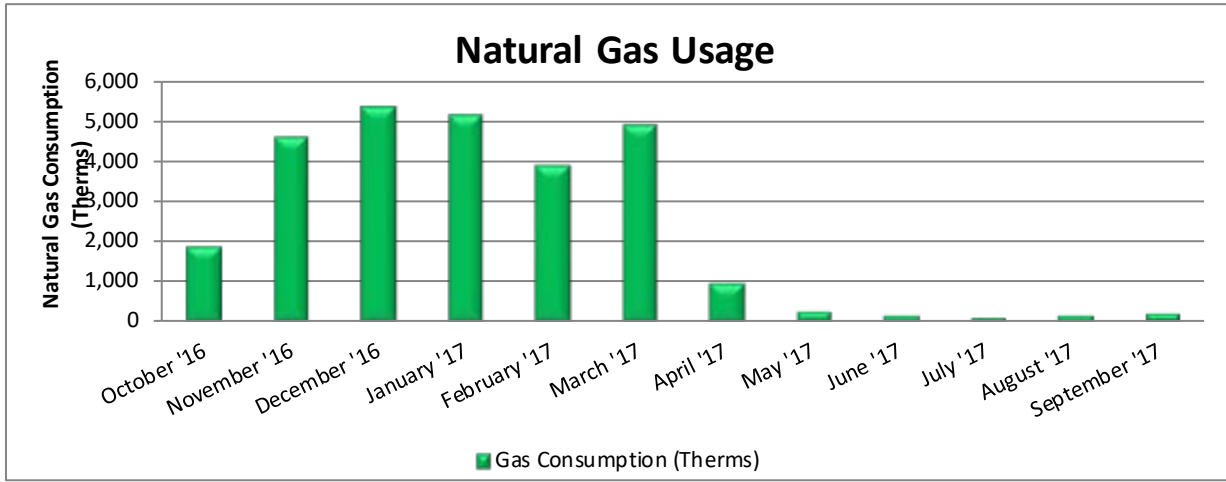

Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
11/10/16	29	1,882	\$1,447
12/12/16	32	4,584	\$3,273
1/12/17	31	5,346	\$3,754
2/10/17	29	5,150	\$3,666
3/10/17	28	3,898	\$2,797
4/11/17	32	4,865	\$3,541
5/11/17	30	964	\$927
6/11/17	31	253	\$248
7/12/17	31	167	\$365
8/10/17	29	131	\$337
9/12/17	33	195	\$393
10/12/17	30	226	\$427
Totals	365	27,660	\$21,176
Annual	365	27,660	\$21,176

Notes:

- The average gas cost for the past 12 months is \$0.766/therm, which is the blended rate used throughout the analysis.
- Winter seasonal use is indicative of a gas space heating profile with moderate gas use for cooking and domestic hot water.

3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the county, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

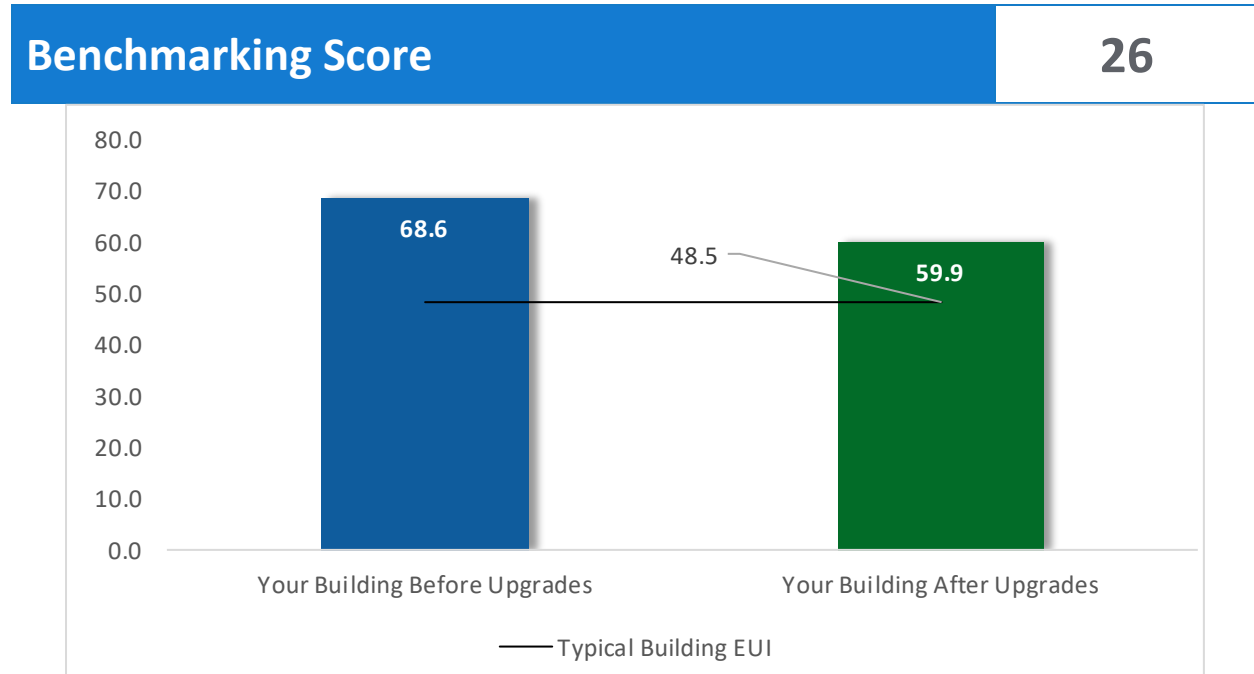


Figure 6 - Energy Use Intensity Comparison

This building performs at, or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website³.

³ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		84,401	17.2	-17	\$12,646	\$29,708	\$6,966	\$22,742	1.8	83,019
ECM 1	Install LED Fixtures	3,611	0.4	0	\$547	\$3,950	\$40	\$3,910	7.2	3,637
ECM 2	Retrofit Fixtures with LED Lamps	80,790	16.8	-17	\$12,099	\$25,758	\$6,926	\$18,832	1.6	79,382
Lighting Control Measures		11,025	2.0	-2	\$1,651	\$12,735	\$1,120	\$11,615	7.0	10,832
ECM 3	Install Occupancy Sensor Lighting Controls	7,489	1.3	-2	\$1,122	\$8,910	\$1,120	\$7,790	6.9	7,358
ECM 4	Install High/Low Lighting Controls	3,535	0.6	-1	\$529	\$3,825	\$0	\$3,825	7.2	3,474
Variable Frequency Drive (VFD) Measures		70,462	18.3	0	\$10,665	\$36,944	\$4,400	\$32,544	3.1	70,955
ECM 5	Install VFDs on Constant Volume (CV) Fans	64,438	16.5	0	\$9,753	\$29,176	\$4,400	\$24,776	2.5	64,889
ECM 6	Install Boiler Draft Fan VFDs	6,024	1.9	0	\$912	\$7,768	\$0	\$7,768	8.5	6,067
Electric Unitary HVAC Measures		19,991	5.1	0	\$3,026	\$152,957	\$730	\$152,227	50.3	20,131
ECM 7	Install High Efficiency Air Conditioning Units	19,991	5.1	0	\$3,026	\$152,957	\$730	\$152,227	50.3	20,131
Gas Heating (HVAC/Process) Replacement		0	0.0	304	\$2,324	\$174,639	\$1,200	\$173,439	74.6	35,541
ECM 8	Install High Efficiency Steam Boilers	0	0.0	212	\$1,620	\$138,179	\$0	\$138,179	85.3	24,770
ECM 9	Install High Efficiency Furnaces	0	0.0	92	\$704	\$36,460	\$1,200	\$35,260	50.1	10,771
HVAC System Improvements		9,366	0.0	19	\$1,563	\$8,157	\$0	\$8,157	5.2	11,656
ECM 10	Implement Demand Control Ventilation (DCV)	9,366	0.0	19	\$1,563	\$8,157	\$0	\$8,157	5.2	11,656
Domestic Water Heating Upgrade		0	0.0	55	\$425	\$22,055	\$760	\$21,295	50.2	6,493
ECM 11	Install High Efficiency Gas-Fired Water Heater	0	0.0	16	\$119	\$21,954	\$760	\$21,195	177.4	1,827
ECM 12	Install Low-Flow DHW Devices	0	0.0	40	\$305	\$100	\$0	\$100	0.3	4,667
Food Service & Refrigeration Measures		1,049	0.1	0	\$159	\$1,213	\$0	\$1,213	7.6	1,056
ECM 13	Refrigerator/Freezer Case Electrically Commutated Motors	1,049	0.1	0	\$159	\$1,213	\$0	\$1,213	7.6	1,056
TOTALS		196,294	42.8	359	\$32,458	\$438,408	\$15,176	\$423,232	13.0	239,683

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		84,401	17.2	-17	\$12,646	\$29,708	\$6,966	\$22,742	1.8	83,019
ECM 1	Install LED Fixtures	3,611	0.4	0	\$547	\$3,950	\$40	\$3,910	7.2	3,637
ECM 2	Retrofit Fixtures with LED Lamps	80,790	16.8	-17	\$12,099	\$25,758	\$6,926	\$18,832	1.6	79,382
Lighting Control Measures		11,025	2.0	-2	\$1,651	\$12,735	\$1,120	\$11,615	7.0	10,832
ECM 3	Install Occupancy Sensor Lighting Controls	7,489	1.3	-2	\$1,122	\$8,910	\$1,120	\$7,790	6.9	7,358
ECM 4	Install High/Low Lighting Controls	3,535	0.6	-1	\$529	\$3,825	\$0	\$3,825	7.2	3,474
Motor Upgrades		0	0.0	0	\$0	\$0	\$0	\$0	0.0	0
ECM 0	Premium Efficiency Motors	0	0.0	0	\$0	\$0	\$0	\$0	0.0	0
Variable Frequency Drive (VFD) Measures		70,462	18.3	0	\$10,665	\$36,944	\$4,400	\$32,544	3.1	70,955
ECM 5	Install VFDs on Constant Volume (CV) Fans	64,438	16.5	0	\$9,753	\$29,176	\$4,400	\$24,776	2.5	64,889
ECM 6	Install Boiler Draft Fan VFDs	6,024	1.9	0	\$912	\$7,768	\$0	\$7,768	8.5	6,067
HVAC System Improvements		9,366	0.0	19	\$1,563	\$8,157	\$0	\$8,157	5.2	11,656
ECM 10	Implement Demand Control Ventilation (DCV)	9,366	0.0	19	\$1,563	\$8,157	\$0	\$8,157	5.2	11,656
Domestic Water Heating Upgrade		0	0.0	40	\$305	\$100	\$0	\$100	0.3	4,667
ECM 12	Install Low-Flow DHW Devices	0	0.0	40	\$305	\$100	\$0	\$100	0.3	4,667
Food Service & Refrigeration Measures		1,049	0.1	0	\$159	\$1,213	\$0	\$1,213	7.6	1,056
ECM 13	Refrigerator/Freezer Case Electrically Commutated Motors	1,049	0.1	0	\$159	\$1,213	\$0	\$1,213	7.6	1,056
TOTALS		176,303	37.7	40	\$26,989	\$88,857	\$12,486	\$76,371	2.8	182,184

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		84,401	17.2	-17	\$12,646	\$29,708	\$6,966	\$22,742	1.8	83,019
ECM 1	Install LED Fixtures	3,611	0.4	0	\$547	\$3,950	\$40	\$3,910	7.2	3,637
ECM 2	Retrofit Fixtures with LED Lamps	80,790	16.8	-17	\$12,099	\$25,758	\$6,926	\$18,832	1.6	79,382

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all fixtures of a specific lighting type (e.g. linear fluorescent) to LED lamps to minimize the number of lamp types in use at the school, which should help reduce future maintenance costs.

ECM 1: Install LED Fixtures

Replace existing fixtures containing high intensity discharge (HID) lamps with new LED light fixtures. This measure saves energy by installing LEDs, which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixture(s).

Maintenance savings may also be achieved as LED lamps last longer than other light sources and therefore do not need to be replaced as often.

Affected building areas: exterior fixtures.

ECM 2: Retrofit Fixtures with LED Lamps

Replace linear fluorescent, compact fluorescent (CFL), or incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as direct replacements for most other lighting technologies.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected building areas: all areas with fluorescent fixtures with linear T8 tubes, incandescent bulbs, and CFL lamp fixtures.

4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		11,025	2.0	-2	\$1,651	\$12,735	\$1,120	\$11,615	7.0	10,832
ECM 3	Install Occupancy Sensor Lighting Controls	7,489	1.3	-2	\$1,122	\$8,910	\$1,120	\$7,790	6.9	7,358
ECM 4	Install High/Low Lighting Controls	3,535	0.6	-1	\$529	\$3,825	\$0	\$3,825	7.2	3,474

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 3: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend lighting controls that use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote-mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected building areas: offices, study rooms, classrooms, gymnasium, cafeteria, kitchen, restrooms, TCUs, and storage rooms.

ECM 4: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety requirements. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be taken into account when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Affected building areas: hallways.

For this type of measure the occupancy sensors will generally be ceiling- or fixture-mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as an occupant approaches.

4.3 Variable Frequency Drives (VFD)

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures		70,462	18.3	0	\$10,665	\$36,944	\$4,400	\$32,544	3.1	70,955
ECM 5	Install VFDs on Constant Volume (CV) Fans	64,438	16.5	0	\$9,753	\$29,176	\$4,400	\$24,776	2.5	64,889
ECM 6	Install Boiler Draft Fan VFDs	6,024	1.9	0	\$912	\$7,768	\$0	\$7,768	8.5	6,067

Variable frequency drives (VFDs) control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new motor—unless the existing motor meets or exceeds IHP 2014 standards—to conservatively account for the cost of an inverter duty rated motor.

Premium efficiency motors have been proposed to be installed only in conjunction with proposed VFD motor measures. Non-inverter duty rated motors will need to be replaced when the VFD measure is implemented. If the proposed VFD measure is not selected for implementation the motor replacement should be reevaluated.

ECM 5: Install VFDs on Constant Volume (CV) Fans

Install VFDs to control constant volume fan motor speeds. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor, if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone while maintaining a constant supply air temperature.

For air handlers with direct expansion (DX) cooling systems, the minimum air flow across the cooling coil required to prevent the coil from freezing must be determined during the final project design. The control system programming should maintain the minimum air flow whenever the compressor is operating.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

Affected air handlers: supply and return fans in gym RTU, cafeteria RTU, and kitchen RTU.

ECM 6: Install Boiler Draft Fan VFDs

Replace existing volume control devices on boiler draft fans, such as inlet vanes or dampers, with VFDs. Inlet vanes or dampers are an inefficient means of controlling the air volume compared to VFDs. The existing volume control device will be removed or permanently disabled, and the control signal will be redirected to the VFD to determine proper fan motor speed.

Energy savings result from reducing the draft fan speed (and power) when conditions allow for reduced combustion air flow.

Additional maintenance savings may result from this measure. VFDs are solid state electronic devices, which generally require less maintenance than mechanical air volume control devices.

4.4 Electric Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Electric Unitary HVAC Measures		19,991	5.1	0	\$3,026	\$152,957	\$730	\$152,227	50.3	20,131
ECM 7	Install High Efficiency Air Conditioning Units	19,991	5.1	0	\$3,026	\$152,957	\$730	\$152,227	50.3	20,131

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units at the school are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high-efficiency unit can be justified by the marginal savings from the improved efficiency. When the equipment is eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

ECM 7: Install High-Efficiency Air Conditioning Units

Replace standard-efficiency packaged air conditioning units with high-efficiency packaged air conditioning units. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high-efficiency unit, the average cooling load, and the estimated annual operating hours.

4.5 Gas-Fired Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Gas Heating (HVAC/Process) Replacement		0	0.0	304	\$2,324	\$174,639	\$1,200	\$173,439	74.6	35,541
ECM 8	Install High Efficiency Steam Boilers	0	0.0	212	\$1,620	\$138,179	\$0	\$138,179	85.3	24,770
ECM 9	Install High Efficiency Furnaces	0	0.0	92	\$704	\$36,460	\$1,200	\$35,260	50.1	10,771

ECM 8: Install High-Efficiency Steam Boilers

Replace older inefficient steam boilers with high-efficiency steam boilers. Energy savings results from improved combustion efficiency and reduced standby losses at low loads.

For the purposes of this analysis, we evaluated the replacement of boilers on a one-for-one basis with equipment of the same capacity. We recommend that you work with your mechanical design team to select boilers that are sized appropriately for the heating load at the school. In many cases, installing multiple modular boilers rather than one or two large boilers will result in higher overall plant efficiency while providing additional system redundancy.

Replacing the boilers has a long payback based on energy savings and may not be justifiable based simply on energy considerations. However, the boilers are nearing the end of their normal useful life. Typically, the marginal cost of purchasing high-efficiency boilers can be justified by the marginal savings from the improved efficiency. When the boiler is eventually replaced, consider purchasing boilers that exceed the minimum efficiency required by building codes.

ECM 9: Install High-Efficiency Furnaces

Replace standard-efficiency furnaces with condensing furnaces. Improved combustion technology and heat exchanger design optimize heat recovery from the combustion gases, which can significantly improve furnace efficiency. Savings result from improved system efficiency.

Note: these units produce acidic condensate that requires proper drainage.

This measure is part of a measure to replace package units at this site and as such, must be considered in combination with ECM 7.

4.6 HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
HVAC System Improvements		9,366	0.0	19	\$1,563	\$8,157	\$0	\$8,157	5.2	11,656
ECM 10	Implement Demand Control Ventilation (DCV)	9,366	0.0	19	\$1,563	\$8,157	\$0	\$8,157	5.2	11,656

ECM 10: Implement Demand Control Ventilation (DCV)

Demand control ventilation (DCV) monitors the indoor air's carbon dioxide (CO₂) content to measure room occupancy. This data is used to regulate the amount of outdoor air provided to the space for ventilation.

Standard ventilation systems often provide outside air based on a space's estimated maximum occupancy rather than actual occupancy. During low occupancy periods, the space may then be over-ventilated. This wastes energy through heating and cooling the excess outside air flow. DCV reduces unnecessary outdoor air intake by regulating ventilation based on actual occupancy levels. DCV is most suited for facilities where occupancy levels vary significantly from hour to hour and day to day.

Energy savings associated with DCV are based on hours of operation, space occupancy, outside air reduction, and other factors. Energy savings results from eliminating unnecessary ventilation and space conditioning.

Affected building areas: gymnasium, kitchen, and cafeteria

4.7 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade		0	0.0	55	\$425	\$22,055	\$760	\$21,295	50.2	6,493
ECM 11	Install High Efficiency Gas-Fired Water Heater	0	0.0	16	\$119	\$21,954	\$760	\$21,195	177.4	1,827
ECM 12	Install Low-Flow DHW Devices	0	0.0	40	\$305	\$100	\$0	\$100	0.3	4,667

ECM 11: Install High-Efficiency Gas-Fired Water Heater

Replace the existing tank water heater with a high-efficiency tank water heater. Energy savings result from the increased efficiency of the unit, which uses less gas to heat water and fewer operating hours to maintain the tank water temperature.

ECM 12: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Pre-rinse spray valves (PRSVs)—often used in commercial and institutional kitchens—remove food waste from dishes prior to dishwashing.

Additional cost savings may result from reduced water usage.

4.8 Food Service & Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Food Service & Refrigeration Measures		1,049	0.1	0	\$159	\$1,213	\$0	\$1,213	7.6	1,056
ECM 13	Refrigerator/Freezer Case Electrically Commutated Motors	1,049	0.1	0	\$159	\$1,213	\$0	\$1,213	7.6	1,056

ECM 13: Refrigerator/Freezer Case Electrically Commutated Motors

Replace shaded pole or permanent split capacitor (PSC) motors with electronically commutated (EC) motors in walk-in cooler and freezer. Fractional horsepower EC motors are significantly more efficient than mechanically commutated, brushed motors, particularly at low speeds or partial load. By using variable-speed technology, EC motors can optimize fan usage. Because these motors are brushless and use DC power, losses due to friction and phase shifting are eliminated.

Savings for this measure consider both the increased efficiency of the motor as well as the reduction in refrigeration load due to motor heat loss.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR® Portfolio Manager®



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions.⁴ Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Weatherization

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment.

Doors and Windows

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour (ACH) can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Window Treatments/Coverings


Use high-reflectivity films or cover windows with shades or shutters to reduce solar heat gain and reduce the load on cooling and heating systems. Older, single pane windows and east or west-facing windows are especially prone to solar heat gain. In addition, use shades or shutters at night during cold weather to reduce heat loss.

Lighting Controls

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly.

⁴ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>

Thermostat Schedules and Temperature Resets



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

Economizer Maintenance

Economizers can significantly reduce cooling system load. A malfunctioning economizer can increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air. Common economizer malfunctions include broken outdoor thermostat or enthalpy control, or dampers that are stuck or improperly adjusted.

Periodic inspection and maintenance will keep economizers working in sync with the heating and cooling system. This maintenance should be part of annual system maintenance, and it should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position.

AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Boiler Maintenance

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the water side or fire side of the boiler.

Furnace Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should: check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.

Water Heater Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Compressed Air System Maintenance

Compressed air systems require periodic maintenance to operate at peak efficiency. A maintenance plan for compressed air systems should include:

- Inspection, cleaning, and replacement of inlet filter cartridges
- Cleaning of drain traps
- Daily inspection of lubricant levels to reduce unwanted friction
- Inspection of belt condition and tension
- Check for leaks and adjust loose connections
- Overall system cleaning

Contact a qualified technician for help with setting up periodic maintenance schedule.

Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense™ ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense website⁵ or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"⁶ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the school has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense™ products where available.

⁵ <https://www.epa.gov/watersense>

⁶ <https://www.epa.gov/watersense/watersense-work-0>

6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the school's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the school's electric demand, size and location of free area, and shading elements shows that the facility has **high** potential for installing a PV array.

The amount of free area, ease of installation (location), and the lack of shading elements contribute to the **high** potential. A PV array located on the roof may be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

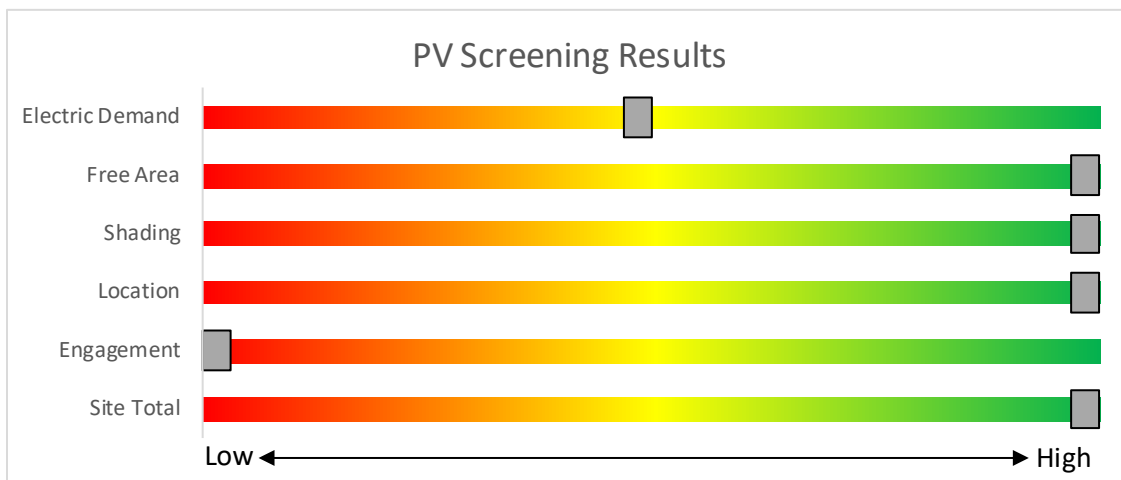

Potential	High	
System Potential	175	kW DC STC
Electric Generation	208,490	kWh/yr
Displaced Cost	\$31,560	/yr
Installed Cost	\$455,000	

Figure 9 - Photovoltaic Screening

Solar Renewable Energy Credit (SREC) Registration Program

Rebates are not available for solar projects, but owners of solar projects MUST register their projects in the SREC Registration Program before starting construction. Once your PV system is up and running, you periodically earn credits, which can then be sold on the open market for up to 15 years.

If you are considering installing solar photovoltaics on your building, visit www.njcleanenergy.com/srec for more information about the SREC Registration Program.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- **Basic Info on Solar PV in New Jersey:** www.njcleanenergy.com/whysolar
- **New Jersey Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs
- **Approved Solar Installers in the New Jersey Market:** www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the school and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the school’s ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the school has **no** potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

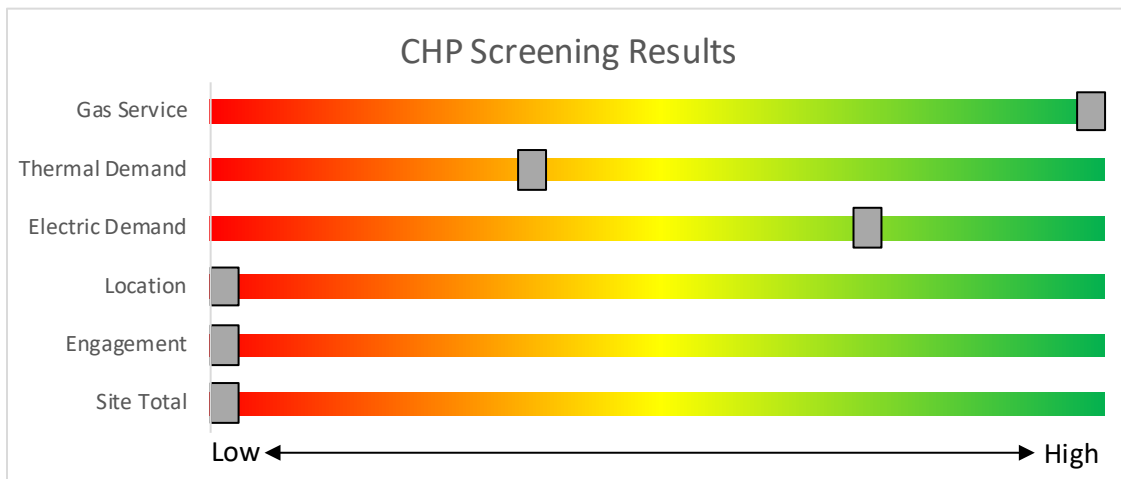


Figure 10 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/

7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building’s performance? Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available New Jersey’s Clean Energy Programs.

	SmartStart <i>Flexibility to install at your own pace</i>	Direct Install <i>Turnkey installation</i>	Pay for Performance <i>Whole building upgrades</i>
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.			

7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy efficiency equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers
Electric Unitary HVAC
Gas Cooling
Gas Heating
Gas Water Heating
Ground Source Heat Pumps
Lighting

Lighting Controls
Refrigeration Doors
Refrigeration Controls
Refrigerator/Freezer Motors
Food Service Equipment
Variable Frequency Drives

Incentives

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit www.njcleanenergy.com/SSB for a detailed program description, instructions for applying, and applications.

7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

7.3 Pay for Performance - Existing Buildings



Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures that results in at least 15% source energy savings, and lighting cannot make up the majority of the savings. P4P is a generally a good option for medium-to-large sized facilities looking to implement as many

measures as possible under a single project to achieve deep energy savings. This program has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program.

The scope of work presented in this audit report does not quite meet the requirements of the current P4P program. However, due to the size of the facility and existing conditions, should additional measures be identified at a later point in time, for example through further evaluation or the Energy Savings Improvement Program process, this facility could potentially meet the requirements necessary to participate in the P4P program.

Incentives

Incentives are based on estimated and achieved energy savings ranging from \$0.18-\$0.22/kWh and \$1.80-\$2.50/therm, capped at the lesser of 50% total project cost, or \$1 million per electric account and \$1 million per natural gas account, per fiscal year, not to exceed \$2 million per project. An incentive of \$0.15/square foot is also available to offset the cost of developing the Energy Reduction Plan (see below) contingent on the project moving forward with measure installation.

How to Participate

Contact one of the pre-approved consultants and contractors (“Partners”). Under direct contract to you, they will help further evaluate the measures identified in this report through development of the energy reduction plan), assist you in implementing selected measures, and verify actual savings one year after the installation. Your Partner will also help you apply for incentives.

Approval of the final scope of work is required by the program prior to installation. Installation can be done by the contractor of your choice (some P4P Partners are also contractors) or by internal staff, but the Partner remains involved throughout construction to ensure compliance with the program requirements.

Detailed program descriptions, instructions for applying, applications and list of Partners can be found at: www.njcleanenergy.com/P4P.

7.4 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at: www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

7.5 SREC Registration Program

The SREC Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number, which enables it to generate New Jersey SRECs. SREC's are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SREC's to be placed in the customer's electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project's life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar Renewable Portfolio Standard. Purchasing SRECs can help them meet those requirements. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period fluctuates depending on supply and demand.

Information about the SRP can be found at: www.njcleanenergy.com/srec.

8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website⁷.

8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website⁸.

⁷ www.state.nj.us/bpu/commercial/shopping.html.

⁸ www.state.nj.us/bpu/commercial/shopping.html

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	4	Compact Fluorescent: Spiral bulb	Wall Switch	S	26	3,648	2	Relamp	No	4	LED Lamps: LED lamp	Wall Switch	18	3,648	0.0	125	0	\$19	\$69	\$4	3.5
Boiler Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Boiler Room	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	5	LED Lamps: Circular bulb	Wall Switch	S	10	3,648		None	No	5	LED Lamps: Circular bulb	Wall Switch	10	3,648	0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	1	LED Lamps: Small circular bulb	Wall Switch	S	8	3,648		None	No	1	LED Lamps: Small circular bulb	Wall Switch	8	3,648	0.0	0	0	\$0	\$0	\$0	0.0
Custodian office	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	674	0	\$101	\$416	\$75	3.4
Custodian office	2	Compact Fluorescent: Spiral bulb	Wall Switch	S	26	3,648	2	Relamp	No	2	LED Lamps: LED lamp	Wall Switch	18	3,648	0.0	63	0	\$9	\$34	\$2	3.5
Storage	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	265	0	\$40	\$73	\$20	1.3
Custodian sink	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Boiler room hall	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,517	0.1	674	0	\$101	\$371	\$40	3.3
Cafeteria	36	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	36	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	1.1	6,066	-1	\$908	\$2,125	\$465	1.8
Cafeteria	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Sprinkler room	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	265	0	\$40	\$73	\$20	1.3
Mech room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Storage	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	265	0	\$40	\$73	\$20	1.3
Kitchen G08	27	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	27	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.8	4,549	-1	\$681	\$1,796	\$375	2.1
Kitchen store	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Elevator room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
G05A Boys	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
G04A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
G06A girls	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Cafeteria hall	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 4	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,517	0.2	1,348	0	\$202	\$742	\$80	3.3
Cafeteria hall	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
G16A Art	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,517	2	Relamp	No	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.2	822	0	\$123	\$329	\$90	1.9
Stair 3	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,648	2	Relamp	No	4	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	3,648	0.2	899	0	\$135	\$292	\$80	1.6

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
K1A BR	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
K1A Hall	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,517	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.3	1,096	0	\$164	\$438	\$120	1.9
K1A Hall	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
1st floor hallway	12	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,648	2, 4	Relamp	Yes	12	LED - Linear Tubes: (4) 4' Lamps	High/Low Control	58	2,517	0.6	3,562	-1	\$534	\$1,326	\$240	2.0
1st floor hallway	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,517	0.1	505	0	\$76	\$335	\$30	4.0
1st floor hallway	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Child study 3A	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,517	2	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	274	0	\$41	\$110	\$30	1.9
Child study 3A	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	3,648	2, 3	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Stair 2	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,648	2	Relamp	No	4	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	3,648	0.2	899	0	\$135	\$292	\$80	1.6
Stair 2	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Room 10	21	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	21	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.3	1,018	0	\$152	\$383	\$105	1.8
Room 11	19	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	19	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	921	0	\$138	\$347	\$95	1.8
Boys RR	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Custodian 2nd floor	1	Compact Fluorescent: Spiral bulb	Wall Switch	S	26	3,648	2	Relamp	No	1	LED Lamps: LED lamp	Wall Switch	18	3,648	0.0	31	0	\$5	\$17	\$1	3.5
Girls 2nd floor	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	265	0	\$40	\$73	\$20	1.3
Room 12	14	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	2,517	2	Relamp	No	14	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,517	0.6	2,171	0	\$325	\$1,022	\$280	2.3
12 closet	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,648	2	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,648	0.0	128	0	\$19	\$65	\$12	2.8
12 IDF	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Room 13	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	581	0	\$87	\$219	\$60	1.8
Room 14	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	581	0	\$87	\$219	\$60	1.8
13 closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
14 closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Main office	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.2	1,011	0	\$151	\$489	\$95	2.6
Main office	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,648	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	3,648	0.0	225	0	\$34	\$73	\$20	1.6
Gym	16	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,648	2, 3	Relamp	Yes	16	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,517	0.9	4,750	-1	\$711	\$1,438	\$355	1.5

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Gym	4	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Gym office	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,648	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	3,648	0.0	225	0	\$34	\$73	\$20	1.6
Gym office	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,648	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	3,648	0.0	225	0	\$34	\$73	\$20	1.6
Stage	6	Incandescent: Bulb	Wall Switch	S	100	3,648	2, 3	Relamp	Yes	6	LED Lamps: LED lamp	Occupancy Sensor	15	2,517	0.4	2,158	0	\$323	\$373	\$41	1.0
6 Stairway	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.1	530	0	\$79	\$146	\$40	1.3
7 Stairway	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.1	530	0	\$79	\$146	\$40	1.3
7 Stairway	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Music closet	1	Incandescent: Bulb	Wall Switch	S	100	3,648	2	Relamp	No	1	LED Lamps: LED lamp	Wall Switch	15	3,648	0.1	341	0	\$51	\$17	\$1	0.3
Counselor	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Main vestibule	2	Incandescent: Bulb	Wall Switch	S	100	3,648	2, 3	Relamp	Yes	2	LED Lamps: LED lamp	Occupancy Sensor	15	2,517	0.1	719	0	\$108	\$304	\$37	2.5
Principal	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,517	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.0	183	0	\$27	\$73	\$20	1.9
Principal	1	LED Lamps: Small circular bulb	Wall Switch	S	8	3,648		None	No	1	LED Lamps: Small circular bulb	Wall Switch	8	3,648	0.0	0	0	\$0	\$0	\$0	0.0
Room 15	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,517	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.3	1,096	0	\$164	\$438	\$120	1.9
15 closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Room 16	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	581	0	\$87	\$219	\$60	1.8
16 closet	1	Compact Fluorescent: Spiral bulb	Wall Switch	S	26	3,648	2	Relamp	No	1	LED Lamps: LED lamp	Wall Switch	18	3,648	0.0	31	0	\$5	\$17	\$1	3.5
Room 17	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	581	0	\$87	\$219	\$60	1.8
Room 17	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
2nd floor hall	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 4	Relamp	Yes	24	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,517	0.7	4,044	-1	\$606	\$1,776	\$240	2.5
2nd floor hall	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stair 4	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.1	662	0	\$99	\$183	\$50	1.3
Stair 4	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Room 20	17	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	17	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	824	0	\$123	\$310	\$85	1.8
Room 21	17	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	17	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	824	0	\$123	\$310	\$85	1.8
Room 3rd floor	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Custodian	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Girls 3rd floor	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Room 22	18	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	18	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	872	0	\$131	\$329	\$90	1.8
22 office	6	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	3,648	2, 3	Relamp	Yes	6	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.1	530	0	\$79	\$380	\$65	4.0
Room 23	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	581	0	\$87	\$219	\$60	1.8
23 closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Room 24	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	581	0	\$87	\$219	\$60	1.8
Room 24B	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,648	2, 3	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,517	0.1	594	0	\$89	\$416	\$75	3.8
Library 24A	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.2	1,011	0	\$151	\$489	\$95	2.6
Closet	1	Compact Fluorescent: Spiral bulb	Wall Switch	S	26	3,648	2	Relamp	No	1	LED Lamps: LED lamp	Wall Switch	18	3,648	0.0	31	0	\$5	\$17	\$1	3.5
Staff bathroom	1	LED Lamps: Bulb	Wall Switch	S	17	3,648		None	No	1	LED Lamps: Bulb	Wall Switch	17	3,648	0.0	0	0	\$0	\$0	\$0	0.0
Room 25	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	581	0	\$87	\$219	\$60	1.8
25 closet	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Room 26	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	2,517	2	Relamp	No	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	581	0	\$87	\$219	\$60	1.8
26 closet	1	Compact Fluorescent: Spiral bulb	Wall Switch	S	26	3,648	2	Relamp	No	1	LED Lamps: LED lamp	Wall Switch	18	3,648	0.0	31	0	\$5	\$17	\$1	3.5
Room 27	12	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	3,648	2, 3	Relamp	Yes	12	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,517	0.2	1,059	0	\$159	\$489	\$95	2.5
27 closet	1	Compact Fluorescent: Spiral bulb	Wall Switch	S	26	3,648	2	Relamp	No	1	LED Lamps: LED lamp	Wall Switch	18	3,648	0.0	31	0	\$5	\$17	\$1	3.5
3rd floor hallway	25	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 4	Relamp	Yes	25	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,517	0.8	4,212	-1	\$631	\$2,038	\$250	2.8
3rd floor hallway	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Girls 3rd floor	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Custodians 3rd floor	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Boys 3rd floor	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Faculty room	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,517	2	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,517	0.1	548	0	\$82	\$219	\$60	1.9
Room 206A	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,517	2	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,517	0.4	1,645	0	\$246	\$657	\$180	1.9
Room 208A	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,517	2	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,517	0.4	1,645	0	\$246	\$657	\$180	1.9

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Room 309A	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,517	2	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,517	0.4	1,645	0	\$246	\$657	\$180	1.9
New wing 3rd hall	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 4	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,517	0.3	1,685	0	\$252	\$815	\$100	2.8
New wing 3rd hall	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stair 5	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.1	662	0	\$99	\$183	\$50	1.3
Stair 5	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Room 109A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Room 108A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Room 106A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Girls 2nd floor	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Boys 2nd floor	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
Custodian 2nd floor	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
VP office	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,517	2	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	365	0	\$55	\$146	\$40	1.9
New wing hall 2nd floor	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,517	2	Relamp	No	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.2	914	0	\$137	\$365	\$100	1.9
New wing hall 2nd floor	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
TCU 4	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,517	0.1	505	0	\$76	\$380	\$65	4.2
4 closet	17	LED Lamps: Bulb	Wall Switch	S	17	3,648	3	None	Yes	17	LED Lamps: Bulb	Occupancy Sensor	17	2,517	0.1	360	0	\$54	\$270	\$0	5.0
4 bathroom	1	Incandescent: Bulbs	Wall Switch	S	60	3,648	2	Relamp	No	1	LED Lamps: LED lamp	Wall Switch	9	3,648	0.0	205	0	\$31	\$17	\$1	0.5
TCU3	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
TCU 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
TCU 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,648	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,648	0.0	132	0	\$20	\$37	\$10	1.3
Exterior trailer	4	Compact Fluorescent: Spiral bulb	PhotoCell		26	4,380	2	Relamp	No	4	LED Lamps: LED lamp	PhotoCell	18	4,380	0.0	137	0	\$21	\$69	\$4	3.1
Exterior school	5	Metal Halide: (1) 100W Lamp	Timeclock		128	4,015	1	Fixture Replacement	No	5	LED - Fixtures: Porch (Wall Mounted)	Timeclock	38	4,015	0.2	1,799	0	\$272	\$2,469	\$25	9.0
Exterior school	1	Compact Fluorescent: Spiral bulb	Timeclock		42	4,015	2	Relamp	No	1	LED Lamps: LED lamp	Timeclock	20	4,015	0.0	88	0	\$13	\$17	\$1	1.2
Parking lot	3	Metal Halide: (1) 175W Lamp	Timeclock		215	4,015	1	Fixture Replacement	No	3	LED - Fixtures: Porch (Wall Mounted)	Timeclock	65	4,015	0.2	1,813	0	\$274	\$1,481	\$15	5.3
Exterior	2	LED - Fixtures: Area light	Timeclock		37	4,015		None	No	2	LED - Fixtures: Area light	Timeclock	37	4,015	0.0	0	0	\$0	\$0	\$0	0.0

	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Exterior	1	LED - Fixtures: Door mount area	Timeclock		45	4,015		None	No	1	LED - Fixtures: Door mount area	Timeclock	45	4,015	0.0	0	0	\$0	\$0	\$0	0.0

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions					Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Gym	1	Supply Fan	15.0	91.0%	No	B	3,391	5	No	93.0%	Yes	1	4.4	17,325	0	\$2,622	\$7,041	\$1,200	2.2
Roof	Gym	1	Return Fan	7.5	88.5%	No	B	3,391	5	No	91.0%	Yes	1	2.3	8,999	0	\$1,362	\$4,738	\$600	3.0
Roof	Kitchen	1	Supply Fan	5.0	87.5%	No	B	3,391	5	No	89.5%	Yes	1	1.5	6,015	0	\$910	\$4,076	\$400	4.0
Roof	Kitchen	1	Exhaust Fan	0.3	72.4%	No	B	3,391		No	72.4%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Cafeteria	1	Supply Fan	20.0	91.0%	No	B	3,391	5	No	93.0%	Yes	1	5.9	23,100	0	\$3,496	\$8,582	\$1,600	2.0
Roof	Cafeteria	1	Return Fan	7.5	88.5%	No	B	3,391	5	No	91.0%	Yes	1	2.3	8,999	0	\$1,362	\$4,738	\$600	3.0
Boiler Room	Boiler	2	Combustion Air Fan	3.0	86.5%	No	B	2,745	6	No	89.5%	Yes	2	1.9	6,024	0	\$912	\$7,768	\$0	8.5
Boiler Room	Boiler Feed Water	3	Boiler Feed Water Pump	0.5	68.5%	No	W	2,745		No	68.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	Boiler	2	Process Pump	1.5	82.5%	No	W	2,745		No	82.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Boiler Room	DHW Recirculation	2	Process Pump	0.1	68.5%	No	W	2,745		No	68.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Maintenance	Pneumatic Control System	2	Air Compressor	1.5	80.0%	No	W	800		No	80.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Exhaust (Throughout Building)	6	Exhaust Fan	0.5	68.5%	No	W	2,745		No	68.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Kitchen Hood	1	Kitchen Hood Exhaust Fan	0.5	68.5%	No	W	5,250		No	68.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classrooms	Classrooms	34	Supply Fan	0.3	68.5%	No	W	3,391		No	68.5%	No		0.0	0	0	\$0	\$0	\$0	0.0

Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions						Energy Impact & Financial Analysis						
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Gym (RTU-1)	1	Packaged AC	30.00		B	7	Yes	1	Packaged AC	30.00		9.50		2.0	7,792	0	\$1,179	\$66,479	\$0	56.4
Roof	Kitchen (RTU-2)	1	Packaged AC	10.00		B	7	Yes	1	Packaged AC	10.00		11.50		0.9	3,604	0	\$545	\$17,821	\$730	31.3
Roof	Cafeteria (RTU-3)	1	Packaged AC	30.00		B	7	Yes	1	Packaged AC	30.00		9.50		2.0	7,792	0	\$1,179	\$66,479	\$0	56.4
TCUs	TCUs	4	Packaged Terminal AC	3.00		W		No						0.0	0	0	\$0	\$0	\$0	0.0	
TCUs	TCUs (electric heater)	4	Electric Resistance Heat		51.18	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Classrooms	Classrooms	2	Window AC	1.00		B	7	Yes	2	Window AC	1.00		12.00		0.2	803	0	\$122	\$2,178	\$0	17.9
Classrooms	Classrooms	1	Window AC	1.50		W		No						0.0	0	0	\$0	\$0	\$0	0.0	

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis					
		System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	Whole Building	2	Forced Draft Steam Boiler	#####	B	8	Yes	2	Forced Draft Steam Boiler	#####	81.00%	Et	0.0	0	212	\$1,620	\$138,179	\$0	85.3
Roof	Gym (RTU-1)	1	Furnace	720.00	B	9	Yes	1	Furnace	720.00	95.00%	AFUE	0.0	0	41	\$315	\$16,313	\$400	50.5
Roof	Kitchen (RTU-2)	1	Furnace	169.20	B	9	Yes	1	Furnace	169.20	95.00%	AFUE	0.0	0	10	\$74	\$3,834	\$400	46.4
Roof	Cafeteria (RTU-3)	1	Furnace	720.00	B	9	Yes	1	Furnace	720.00	95.00%	AFUE	0.0	0	41	\$315	\$16,313	\$400	50.5

Demand Control Ventilation Recommendations

Location	Area(s)/System(s) Affected	Recommendation Inputs					Energy Impact & Financial Analysis						
		ECM #	Number of Zones	Cooling Capacity of Controlled System (Tons)	Electric Heating Capacity of Controlled System (kBtu/hr)	Output Heating Capacity of Controlled System (MBh)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Gym (RTU-1)	10	2.00	30.00	0.00	720.00	0.0	4,084	9	\$683	\$2,719	\$0	4.0
Roof	Kitchen (RTU-2)	10	2.00	10.00	0.00	169.20	0.0	1,198	2	\$197	\$2,719	\$0	13.8
Roof	Cafeteria (RTU-3)	10	2.00	30.00	0.00	720.00	0.0	4,084	9	\$683	\$2,719	\$0	4.0

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Boiler Room	Kitchen & Restrooms	1	Storage Tank Water Heater (> 50 Gal)	B	11	Yes	1	Storage Tank Water Heater (> 50 Gal)	Natural Gas	80.00%	Et	0.0	0	8	\$60	\$10,402	\$360	168.2
Café Storage	New Wing Restrooms	1	Storage Tank Water Heater (> 50 Gal)	B	11	Yes	1	Storage Tank Water Heater (> 50 Gal)	Natural Gas	80.00%	Et	0.0	0	8	\$60	\$11,552	\$400	186.7

Low-Flow Device Recommendations

Location	Recommendation Inputs					Energy Impact & Financial Analysis						
	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restrooms	12	14	Faucet Aerator (Lavatory)	2.20	0.50	0.0	0	40	\$305	\$100	\$0	0.3

Walk-In Cooler/Freezer Inventory & Recommendations

Location	Existing Conditions		Proposed Conditions				Energy Impact & Financial Analysis						
	Cooler/Freezer Quantity	Case Type/Temperature	ECM #	Install EC Evaporator Fan Motors?	Install Electric Defrost Control?	Install Evaporator Fan Control?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Low Temp Freezer (-35F to -5F)	13	Yes	No	No	0.1	524	0	\$79	\$607	\$0	7.6
Kitchen	1	Medium Temp Freezer (0F to 30F)	13	Yes	No	No	0.1	524	0	\$79	\$607	\$0	7.6

Commercial Refrigerator/Freezer Inventory & Recommendations

Location	Existing Conditions			Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Refrigerator/ Freezer Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	2	Refrigerator Chest	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0

Novelty Cooler Inventory & Recommendations

Location	Existing Conditions		Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Cooler Description	ECM #	Install Automatic Shutoff Control?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	2	Refrigerated Cold Pan Serving Counter		No	0.00	0	0	\$0	\$0	\$0	0.0

Cooking Equipment Inventory & Recommendations

Location	Existing Conditions				Proposed Conditions		Energy Impact & Financial Analysis					
	Quantity	Equipment Type	High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Gas Griddle (4 Feet Width)	Yes		No	0.0	0	0	FALSE	\$0	\$0	#DIV/0!
Kitchen	1	Electric Fryer	Yes		No	0.0	0	0	FALSE	\$0	\$0	#DIV/0!
Kitchen	1	Gas Combination Oven/Steam Cooker (<15 Pans)	Yes		No	0.0	0	0	FALSE	\$0	\$0	#DIV/0!
Kitchen	1	Gas Convection Oven (Full Size)	Yes		No	0.0	0	0	FALSE	\$0	\$0	#DIV/0!
Kitchen	3	Electric Steamer	Yes		No	0.0	0	0	FALSE	\$0	\$0	#DIV/0!
Kitchen	1	Insulated Food Holding Cabinet (Full Size)	Yes		No	0.0	0	0	FALSE	\$0	\$0	#DIV/0!

Dishwasher Inventory & Recommendations

Existing Conditions		Proposed Conditions				Energy Impact & Financial Analysis								
Location	Quantity	Dishwasher Type	Water Heater Fuel Type	Booster Heater Fuel Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Payback w/ Incentives in Years
Kitchen	1	Single Tank Conveyor (High Temp)	Electric	Electric	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0

Plug Load Inventory

Existing Conditions				
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Throughout Building	45	Computer	150.0	Yes
Throughout Building	1	Laptop	45.0	Yes
Throughout Building	12	Printer (Small)	20.0	Yes
Throughout Building	14	Printer (Medium)	60.0	Yes
Throughout Building	1	Photocopier	600.0	Yes
Throughout Building	21	Smartboards	150.0	Yes
Throughout Building	4	Microwave	200.0	Yes
Throughout Building	1	Mini Fridge	1,000.0	Yes
Throughout Building	6	Refrigerator	153.0	Yes
Throughout Building	3	Coffee Machine	156.0	Yes
Throughout Building	2	LCD TV	71.0	Yes

APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

ENERGY STAR® Statement of Energy Performance

LEARN MORE AT energystar.gov

26

**ENERGY STAR®
Score¹**

Woodrow Wilson Elementary School (19)

Primary Property Type: K-12 School
Gross Floor Area (ft²): 74,290
Built: 1926

For Year Ending: September 30, 2017
Date Generated: March 18, 2019

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
Property Address Woodrow Wilson Elementary School (19) 529 Edgar Road Elizabeth, New Jersey 07202	Property Owner Elizabeth Board of Education 500 North Broad Street Elizabeth, NJ 07208 908-436-5180	Primary Contact Luis Couto 500 North Broad Street Elizabeth, NJ 07208 908-436-5180 coutolu@epsnj.org	
Property ID: 6688947			
Energy Consumption and Energy Use Intensity (EUI)			
Site EUI 68.7 kBtu/ft ²	Annual Energy by Fuel	National Median Comparison	
	Electric - Grid (kBtu) 2,342,050 (46%)	National Median Site EUI (kBtu/ft ²)	54.3
	Natural Gas (kBtu) 2,764,794 (54%)	National Median Source EUI (kBtu/ft ²)	100.6
Source EUI 127.3 kBtu/ft ²		% Diff from National Median Source EUI	27%
		Annual Emissions	
		Greenhouse Gas Emissions (Metric Tons CO2e/year)	384

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

() - _____



Professional Engineer Stamp (if applicable)

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
Btu	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
CHP	<i>Combined heat and power</i> . Also referred to as cogeneration.
COP	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
DCV	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
US DOE	<i>United States Department of Energy</i>
EC Motor	<i>Electronically commutated motor</i>
ECM	<i>Energy conservation measure</i>
EER	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
EUI	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
ENERGY STAR®	ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA.
EPA	<i>United States Environmental Protection Agency</i>
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
GHG	<i>Greenhouse gas</i> : gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
gpf	<i>Gallons per flush</i>

gpm	<i>Gallon per minute</i>
HID	<i>High intensity discharge: high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.</i>
hp	<i>Horsepower</i>
HPS	<i>High-pressure sodium: a type of HID lamp.</i>
HSPF	<i>Heating seasonal performance factor: a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.</i>
HVAC	<i>Heating, ventilating, and air conditioning</i>
IHP 2014	<i>US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.</i>
IPLV	<i>Integrated part load value: a measure of the part load efficiency usually applied to chillers.</i>
kBtu	<i>One thousand British thermal units</i>
kW	<i>Kilowatt: equal to 1,000 Watts.</i>
kWh	<i>Kilowatt-hour: 1,000 Watts of power expended over one hour.</i>
LED	<i>Light emitting diode: a high-efficiency source of light with a long lamp life.</i>
LGEA	<i>Local Government Energy Audit</i>
Load	<i>The total power a building or system is using at any given time.</i>
Measure	<i>A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.</i>
MH	<i>Metal halide: a type of HID lamp.</i>
MBh	<i>Thousand Btu per hour</i>
MBtu	<i>One thousand British thermal units</i>
MMBtu	<i>One million British thermal units</i>
MV	<i>Mercury Vapor: a type of HID lamp.</i>
NJBPU	<i>New Jersey Board of Public Utilities</i>
NJCEP	<i>New Jersey's Clean Energy Program: NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money and the environment.</i>
psig	<i>Pounds per square inch gauge</i>
Plug Load	<i>Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.</i>
PV	<i>Photovoltaic: refers to an electronic device capable of converting incident light directly into electricity (direct current).</i>

SEER	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
-------------	---

SEP	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR® Portfolio Manager®.
------------	---

Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
-----------------------	--

SREC	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
-------------	--

T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch.
--------------------	--

Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
-----------------------------	--

therm	100,000 Btu. Typically used as a measure of natural gas consumption.
--------------	--

tons	A unit of cooling capacity equal to 12,000 Btu/hr.
-------------	--

Turnkey	Provision of a complete product or service that is ready for immediate use
----------------	--

VAV	<i>Variable air volume</i>
------------	----------------------------

VFD	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
------------	---

WaterSense™	The symbol for water efficiency. The WaterSense program is managed by the EPA.
--------------------	--

Watt (W)	Unit of power commonly used to measure electricity use.
-----------------	---
