



Local Government Energy Audit Report

Albion Park

June 10, 2019

Prepared for:

Township of Winslow
498 Evergreen Avenue
Berlin, New Jersey 08009

Prepared by:

TRC Energy Services
900 Route 9 North
Woodbridge, New Jersey 07095

Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC Energy Services (TRC) reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBP) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from *RS Means*. We encourage the owner of the facility is encouraged to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBP do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBP reserves the right to extend, modify, or terminate programs without prior notice. Review available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2019 TRC Energy Services. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Table of Contents


1	Executive Summary.....	1
1.1	Planning Your Project	3
	Pick Your Installation Approach	3
	More Options from Around the State	5
2	Existing Conditions.....	6
2.1	Site Overview.....	6
2.2	Building Occupancy	6
2.3	Building Envelope	7
2.4	Lighting Systems.....	7
2.5	Heating Systems	8
2.6	Domestic Hot Water	9
2.7	Refrigeration	9
2.8	Food Service Equipment.....	10
2.9	Plug Load & Vending Machines	10
2.10	Water-Using Systems	10
3	Energy Use and Costs	11
3.1	Electricity	12
3.2	Natural Gas.....	13
3.3	Benchmarking.....	14
	Tracking Your Energy Performance	15
4	Energy Conservation Measures	16
4.1	Lighting	18
	Install LED Fixtures	18
	ECM 1: Retrofit Fluorescent Fixtures with LED Lamps and Drivers.....	18
	Retrofit Fixtures with LED Lamps	19
4.2	Lighting Controls.....	20
	Install Occupancy Sensor Lighting Controls	20
4.3	Domestic Water Heating	21
	ECM 2: Install Low-Flow DHW Devices.....	21
5	Energy Efficient Best Practices	22
	Energy Tracking with ENERGY STAR® Portfolio Manager®	22
	Lighting Controls	22
	Thermostat Schedules and Temperature Resets	22
	Furnace Maintenance	22
	Water Heater Maintenance	22
	Water Conservation	23
	Procurement Strategies	23
6	On-site Generation	24

6.1	Solar Photovoltaic	24
6.2	Combined Heat and Power	25
7	Project Funding and Incentives.....	26
7.1	SmartStart	27
7.2	Direct Install	28
7.3	Energy Savings Improvement Program	29
8	Energy Purchasing and Procurement Strategies.....	30
8.1	Retail Electric Supply Options.....	30
8.2	Retail Natural Gas Supply Options	30
Appendix A: Equipment Inventory & Recommendations		A-1
Appendix B: ENERGY STAR® Statement of Energy Performance		B-1
Appendix C: Glossary.....		C-1

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Albion Park. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT

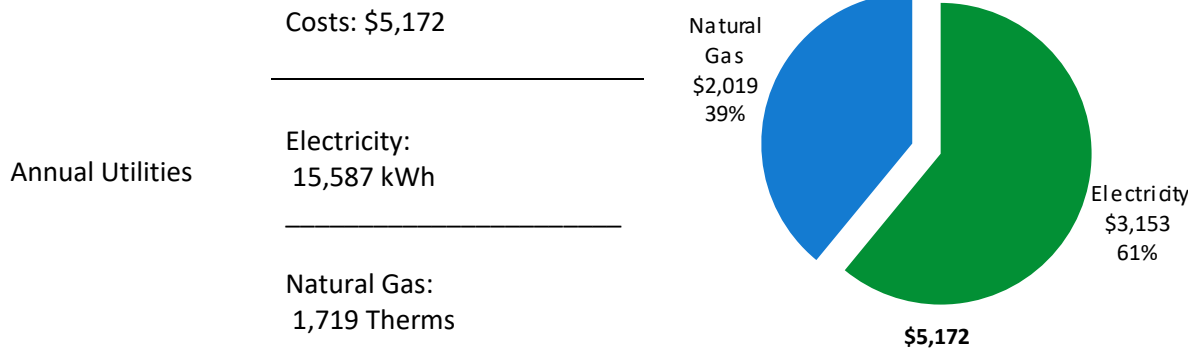

ENERGY STAR® Benchmarking Score	N/A <i>(1-100 scale)</i>	A standard energy use benchmark is not available for this facility type. This report contains suggestions about how to improve building performance and reduce energy costs.
------------------------------------	-----------------------------	--

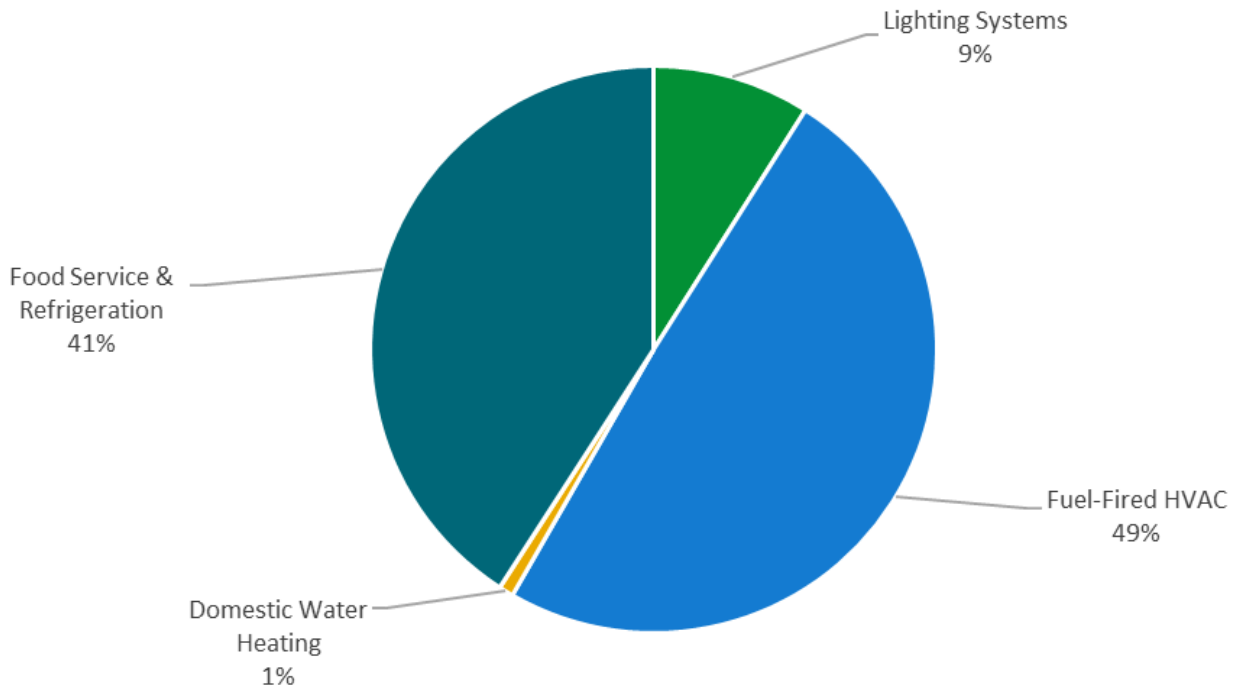


Figure 1 - Energy Use by System


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$38,149
Potential Rebates & Incentives ¹	\$822
Annual Cost Savings	\$856
Annual Energy Savings	Electricity: 4,236 kWh
Greenhouse Gas Emission Savings	2 Tons
Simple Payback	43.6 Years
Site Energy Savings (all utilities)	43.6%

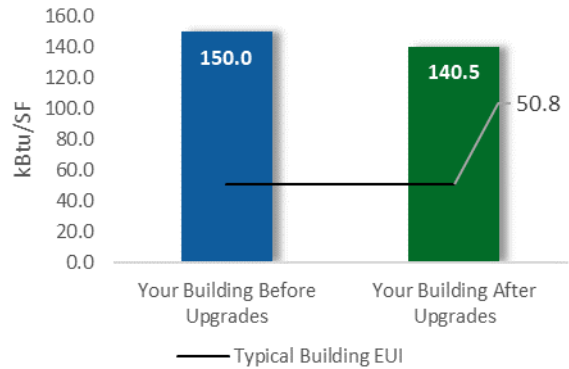

Scenario 2: Cost Effective Package²

Installation Cost	\$365
Potential Rebates & Incentives	\$50
Annual Cost Savings	\$75
Annual Energy Savings	Electricity: 376 kWh
Greenhouse Gas Emission Savings	0 Tons
Simple Payback	4.2 Years
Site Energy Savings (all utilities)	1%

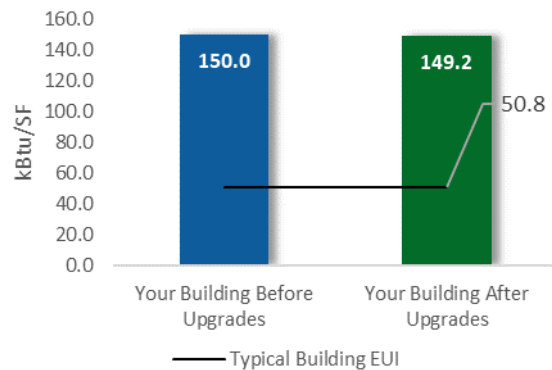

On-site Generation Potential

Photovoltaic	None
Combined Heat and Power	None

¹ Incentives are based on current SmartStart Prescriptive incentives. Other Program incentives may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Lifetime Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		4,026	13.9	0	\$813	\$12,200	\$38,012	\$802	\$37,210	45.8	4,044
	Install LED Fixtures	3,794	13.5	0	\$767	\$11,511	\$37,024	\$700	\$36,324	47.3	3,820
ECM 1	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	175	0.2	0	\$35	\$521	\$344	\$50	\$294	8.5	170
	Retrofit Fixtures with LED Lamps	56	0.2	0	\$11	\$168	\$644	\$52	\$592	52.9	55
Lighting Control Measures		9	0.0	0	\$2	\$14	\$116	\$20	\$96	54.9	9
	Install Occupancy Sensor Lighting Controls	9	0.0	0	\$2	\$14	\$116	\$20	\$96	54.9	9
Domestic Water Heating Upgrade		201	0.0	0	\$41	\$407	\$22	\$0	\$22	0.5	203
ECM 2	Install Low-Flow DHW Devices	201	0.0	0	\$41	\$407	\$22	\$0	\$22	0.5	203
TOTALS		4,236	13.9	0	\$856	\$12,621	\$38,149	\$822	\$37,327	43.6	4,256

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

New Jersey Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	X	X	
ECM 2	Install Low-Flow Domestic Hot Water Devices		X	

Figure 3 – Funding Options



New Jersey's Clean Energy Programs At-A-Glance

	SmartStart Flexibility to install at your own pace	Direct Install Turnkey installation	Pay for Performance Whole building upgrades
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified partner to develop your energy reduction plan and set your energy savings targets.

Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.

Individual Measures with SmartStart

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

Turnkey Installation with Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Whole Building Approach with Pay for Performance

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

More Options from Around the State

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat & Power (CHP)

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce their electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Albion Park. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey’s Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On September 6, 2018, TRC performed an energy audit at Albion Park located in Berlin, New Jersey. TRC met with David Pantalone to review the facility operations and help focus our investigation on specific energy-using systems.

Albion Park, home of the Winslow Township Eagles, is located on Evergreen Avenue in the Albion section of the Township. This facility is 15 acres, which includes two baseball fields, a basketball court, a football field, a 1,500 square foot concession stand and a modular play structure. Spaces in concession stand include restrooms, a kitchen, storage and mechanical rooms.

The lighting system at the concession stand consists of inefficient linear fluorescent T8 and T12 lamps that are controlled by manual switches. The exterior perimeter lighting is provided by 100-Watt, high pressure sodium (HPS) lamps that are on timeclock. The sport fields and basketball court are illuminated with 1000-Watt metal halide pole mounted fixtures.

The concession stand has no cooling equipment and heating is provided by a Rheem forced air furnace.

2.2 Building Occupancy

The Township Park’s supervisor has mentioned that Albion Park is used for six months during the year. The typical schedule is presented in the table below.

Building Occupancy Schedule		
Building Name	Weekday/Weekend	Operating Schedule
Albion Park	Weekday	4:00 PM - 9:00 PM
	Weekend	7:00 AM - 7:00 PM

Figure 4 - Building Occupancy Schedule

2.3 Building Envelope

Building walls are constructed of concrete masonry units. It has a pitched roof, with an asphalt shingles covering, that is in good condition. Steel trusses support the pitched roof with a wood deck. Exterior doors are constructed of metal and are in good condition. Overall, the building envelope appears to be in good condition.



Image 1: Building Envelope

2.4 Lighting Systems

The primary interior lighting system uses 32-Watt T8 and 40-Watt T12 linear fluorescent lamps. There are also fixtures containing two lamps, which are both 40-Watt compact fluorescent 4-PIN lamps. The storage and mechanical room are lit with T12 lamps, and the restrooms are lit using T8 lamps with electronic ballasts. The 4-PIN compact fluorescent lamps (CFLs) are found in the kitchen and the main area. Exit signs in the building are LED lamps. Interior lighting is controlled by manual wall switches.

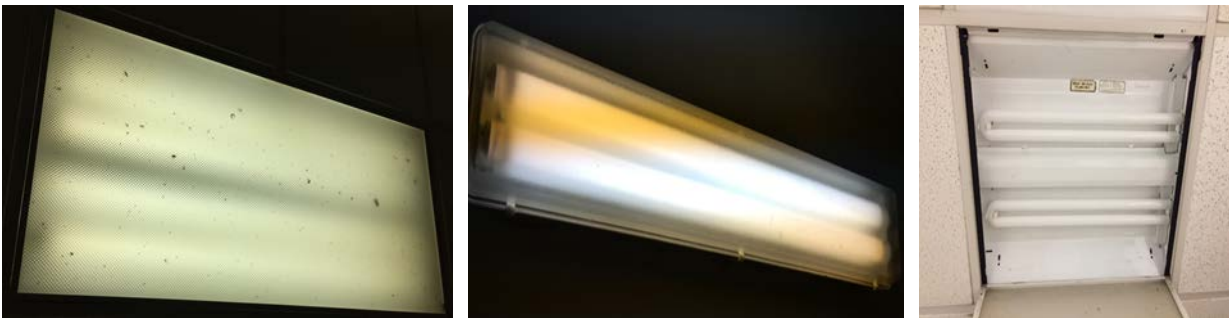


Image 2: Typical Interior Lighting Systems

The building perimeter is illuminated with one 100-Watt HPS lamp that is controlled by a timeclock. A 1000-Watt pole mounted, metal halide fixture provides illumination to the soccer and basketball fields. The control system for the pole mounted fixtures is provided by a breaker panel.



Image 3: Exterior Lighting Systems

2.5 Heating Systems

Heating is provided by a Rheem 105 MBh output capacity condensing forced air furnace. The burner is fully modulating with a nominal efficiency of 93%. The unit is controlled with a programmable thermostat and is located in the mechanical room. It is new and appears in good condition.



Image 4: Rheem Gas-Fired Furnace

2.6 Domestic Hot Water

Hot water is produced with a Bradford White, 19-gallon, 1.5 kW electric storage water heater. The heater is located in the mechanical room and is in good condition. The hot water is used in the kitchen and the restrooms.



Image 5: 19-Gallon, Electric Water Heater

2.7 Refrigeration

The concession stand has a stand-up refrigerator with glass doors. Our analysis determined that these two refrigerators account for 9.35% of the total facility energy use. The refrigeration unit is in good condition.



Image 6: Standup Glass Door Refrigerator

2.8 Food Service Equipment

The concession stand building contains a small kitchen that has a gas-fired fryer and electric hot dog cookers.



Image 7: Gas Fryer & Electric Hot Dog Cookers

2.9 Plug Load & Vending Machines

The utility bill analysis indicates that plug loads consume approximately 1.23% percent of total building energy use. This is lower than a typical building.

You seem to already be doing a great job managing your electrical plug loads. This report makes additional suggestions for ECMs in this area as well as energy efficient best practices.

The concession stands plug load includes a small refrigerator, a commercial coffee machine, and a microwave.

2.10 Water-Using Systems

There are two restrooms with toilets, sinks, and one urinal. Faucet flow rates are at 2.2 gallons per minute (gpm) or higher. Toilets are rated at 2.2 gallons per flush (gpf) and urinals are rated at 2.2 gpf.

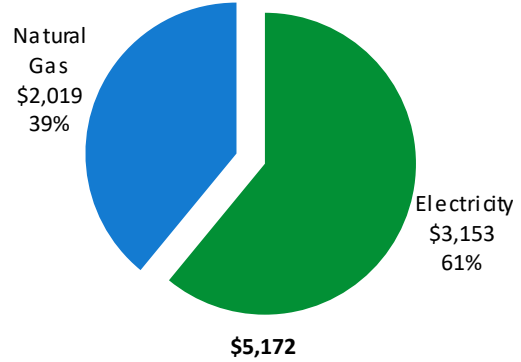


Image 8: Typical Sink

3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	15,587 kWh	\$3,153
Natural Gas	1,719 Therms	\$2,019
Total		\$5,172



An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


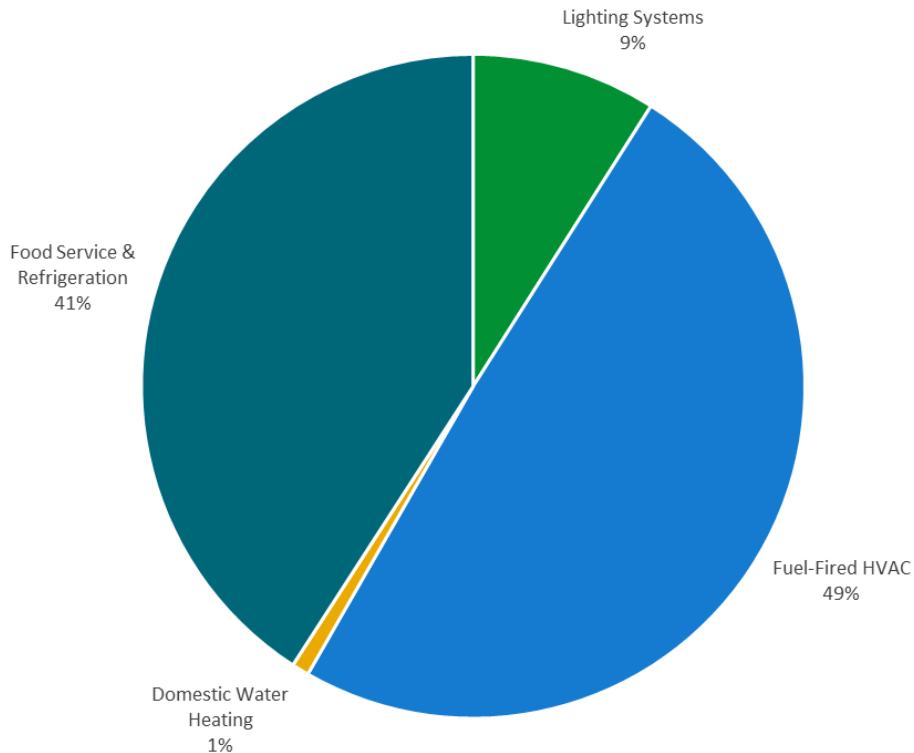


Figure 5 - Energy Balance

3.1 Electricity

Atlantic City Electric delivers electricity under general service rate class, with electric production provided by New Energy, a third-party supplier.

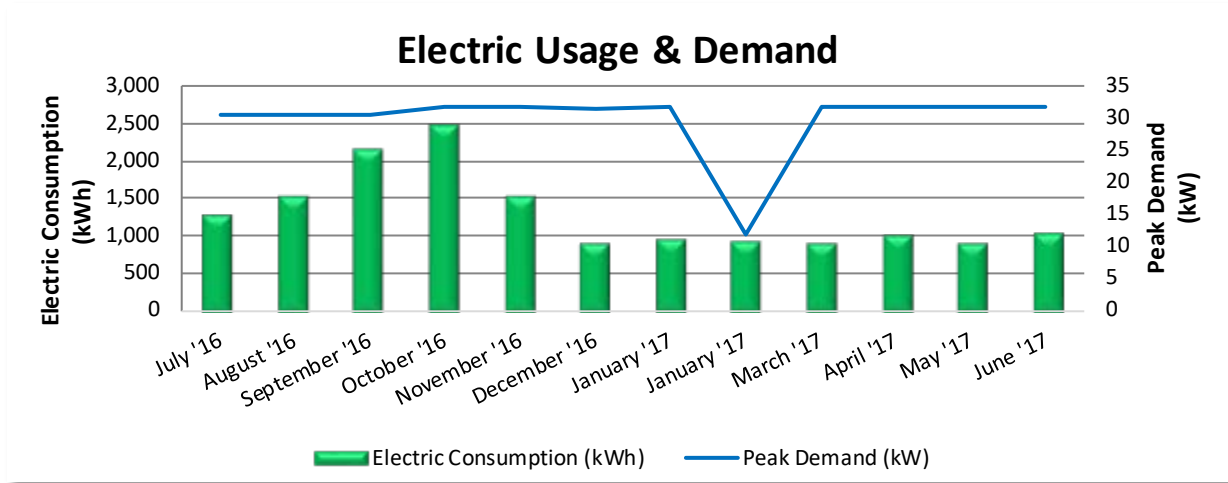


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
7/19/16	31	1,284	31	\$57	\$269
8/17/16	31	1,510	31	\$50	\$299
9/21/16	30	2,136	31	\$67	\$424
10/20/16	31	2,450	32	\$51	\$449
11/17/16	30	1,521	32	\$46	\$291
12/16/16	31	911	31	\$47	\$195
1/19/17	31	973	32	\$56	\$215
2/15/17	28	932	12	\$17	\$167
3/17/17	31	908	32	\$50	\$197
4/19/17	30	1,004	32	\$55	\$218
5/18/17	31	903	32	\$48	\$195
6/19/17	30	1,055	32	\$60	\$234
Totals	365	15,587	32	\$604	\$3,153
Annual	365	15,587	32	\$604	\$3,153

Notes:

- Peak electric usage occurred in October '16.
- The average electric cost over the past 12 months was \$0.202/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.
- The electric profile shows that the facility is minimally used in the winter months.

3.2 Natural Gas

South Jersey Gas delivers natural gas under general service FT rate class.

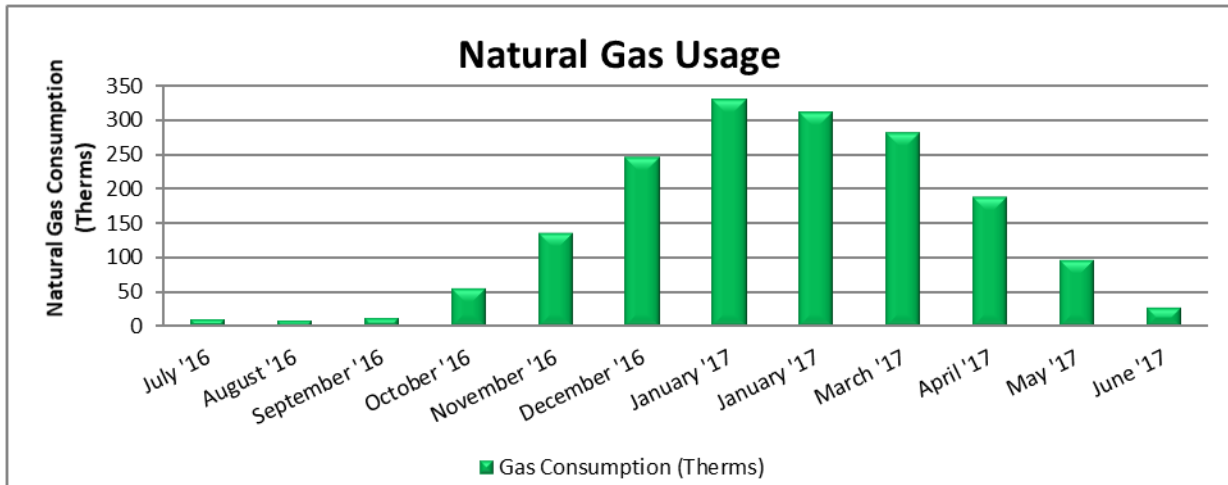

Gas Billing Data				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
7/19/16	31	12	\$45	Yes
8/17/16	31	10	\$39	Yes
9/21/16	30	15	\$49	No
10/20/16	31	56	\$83	Yes
11/17/16	30	137	\$158	No
12/16/16	31	247	\$265	Yes
1/19/17	31	331	\$353	Yes
2/15/17	28	312	\$328	Yes
3/17/17	31	283	\$303	Yes
4/19/17	30	189	\$215	No
5/18/17	31	99	\$124	No
6/19/17	30	28	\$58	No
Totals	365	1,719	\$2,019	
Annual	365	1,719	\$2,019	

Notes:

- The average gas cost for the past 12 months is \$1.175/therm, which is the blended rate used throughout the analysis.

3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the county, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

Benchmarking Score	N/A
---------------------------	------------

Due to its unique characteristics, this facility type is not able to receive a benchmarking score. This report contains suggestions about how to improve facility performance and reduce energy costs.

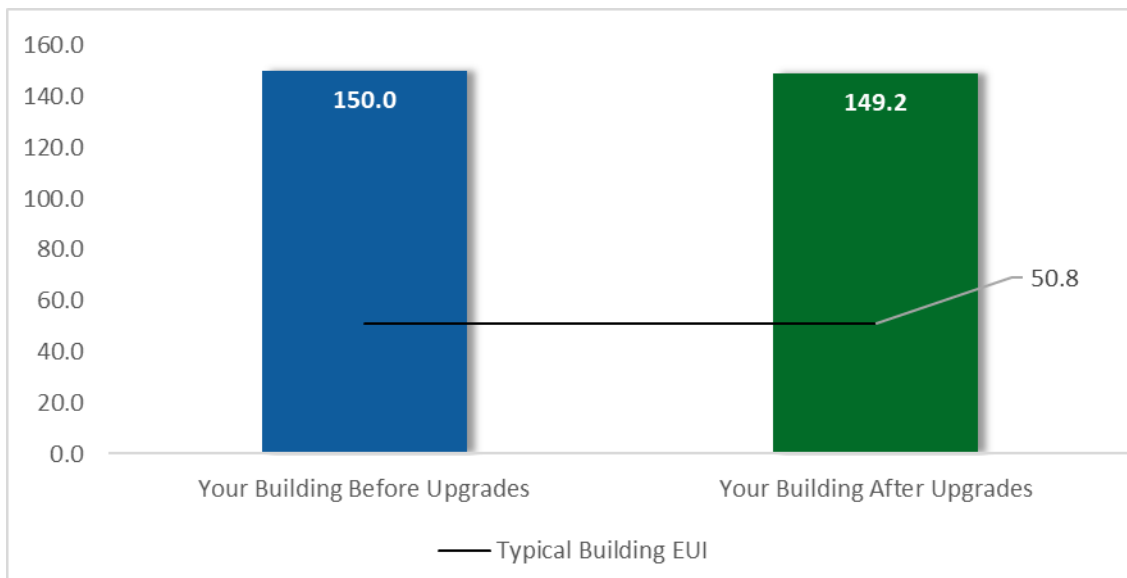


Figure 6 - Energy Use Intensity Comparison

The Site and Source Energy Use Intensities (EUIs) calculated using the data from the utility bills is an effective method to track energy efficiency efforts. However, the median EUIs are not relevant for this property and the Township of Winslow Albion Park cannot be compared to other facilities nationwide.

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website.

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the New Jersey Board of Public Utilities. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see **Appendix A: Equipment Inventory & Recommendations**.

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Lifetime Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		4,026	13.9	0	\$813	\$12,200	\$38,012	\$802	\$37,210	45.8	4,044
	Install LED Fixtures	3,794	13.5	0	\$767	\$11,511	\$37,024	\$700	\$36,324	47.3	3,820
ECM 1	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	175	0.2	0	\$35	\$521	\$344	\$50	\$294	8.5	170
	Retrofit Fixtures with LED Lamps	56	0.2	0	\$11	\$168	\$644	\$52	\$592	52.9	55
Lighting Control Measures		9	0.0	0	\$2	\$14	\$116	\$20	\$96	54.9	9
	Install Occupancy Sensor Lighting Controls	9	0.0	0	\$2	\$14	\$116	\$20	\$96	54.9	9
Domestic Water Heating Upgrade		201	0.0	0	\$41	\$407	\$22	\$0	\$22	0.5	203
ECM 2	Install Low-Flow DHW Devices	201	0.0	0	\$41	\$407	\$22	\$0	\$22	0.5	203
TOTALS		4,236	13.9	0	\$856	\$12,621	\$38,149	\$822	\$37,327	43.6	4,256

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		175	0.2	0	\$35	\$344	\$50	\$294	8.5	170
ECM 1	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	175	0.2	0	\$35	\$344	\$50	\$294	8.5	170
Domestic Water Heating Upgrade		201	0.0	0	\$41	\$22	\$0	\$22	0.5	203
ECM 2	Install Low-Flow DHW Devices	201	0.0	0	\$41	\$22	\$0	\$22	0.5	203
TOTALS		376	0.2	0	\$75	\$365	\$50	\$315	4.2	372

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		4,026	13.9	0	\$813	\$38,012	\$802	\$37,210	45.8	4,044
	Install LED Fixtures	3,794	13.5	0	\$767	\$37,024	\$700	\$36,324	47.3	3,820
ECM 1	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	175	0.2	0	\$35	\$344	\$50	\$294	8.5	170
	Retrofit Fixtures with LED Lamps	56	0.2	0	\$11	\$644	\$52	\$592	52.9	55

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources are proposed, we suggest converting all of a specific lighting type (e.g. linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

Install LED Fixtures

Replace existing fixtures containing 100-Watt HPS, 1000-Watt MH and 40-Watt, 4-PIN CFL lamps with new LED light fixtures. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixtures

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

The simple payback of this measure is very high, as a result it not recommended as a high priority measure in the basis of energy savings alone.

Affected building areas: interior, exterior perimeter and sport fields.

Reasons for not Recommending as a High Priority Measure: The projected payback period for this measure based on the energy savings exceeds the expected useful life of the new fixtures. The upgrade to high efficiency fixtures is not justified by energy savings alone.

ECM 1: Retrofit Fluorescent Fixtures with LED Lamps and Drivers

Retrofit fluorescent T12 fixtures by removing the fluorescent tubes and ballasts and replacing them with LED tubes and LED drivers (if necessary), which are designed to be used in retrofitted fluorescent fixtures.

The measure uses the existing fixture housing but replaces the electric components with more efficient lighting technology which use less power than other lighting technologies but provides equivalent lighting output. Maintenance savings may also be achieved since LED tubes last longer than fluorescent tubes and therefore do not need to be replaced as often.

Affected building areas: storage and mechanical rooms.

Retrofit Fixtures with LED Lamps

Replace compact fluorescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies.

This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected building areas: kitchen.

Reasons for not Recommending as a High Priority Measure: The projected payback period for this measure based on the energy savings exceeds the expected useful life of the retrofit lamps. The upgrade to high efficiency fixtures is not justified by energy savings alone.

4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		9	0.0	0	\$2	\$116	\$20	\$96	54.9	9
	Install Occupancy Sensor Lighting Controls	9	0.0	0	\$2	\$116	\$20	\$96	54.9	9

Lighting controls reduce energy use by turning off or lowering, lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Reasons for not Recommending as a High Priority Measure: The projected payback period for this measure based on the energy savings exceeds the expected useful life of the occupancy sensor controls. This measure is not justified by energy savings alone.

4.3 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$) *	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
	Domestic Water Heating Upgrade	201	0.0	0	\$41	\$22	\$0	\$22	0.5	203
ECM 2	Install Low-Flow DHW Devices	201	0.0	0	\$41	\$22	\$0	\$22	0.5	203

ECM 2: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing.

Additional cost savings may result from reduced water usage.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR® Portfolio Manager®



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions.³ Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Lighting Controls

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly.

Thermostat Schedules and Temperature Resets



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

Furnace Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should: check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.

Water Heater Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

³ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense™ ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense™ website⁴ or download a copy of EPA's "WaterSense™ at Work: Best Management Practices for Commercial and Institutional Facilities"⁵ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense™ products where available.

⁴ <https://www.epa.gov/watersense>

⁵ <https://www.epa.gov/watersense/watersense-work-0>

6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases reduction, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has a **low** potential for installing a PV array.

This facility does appear not meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

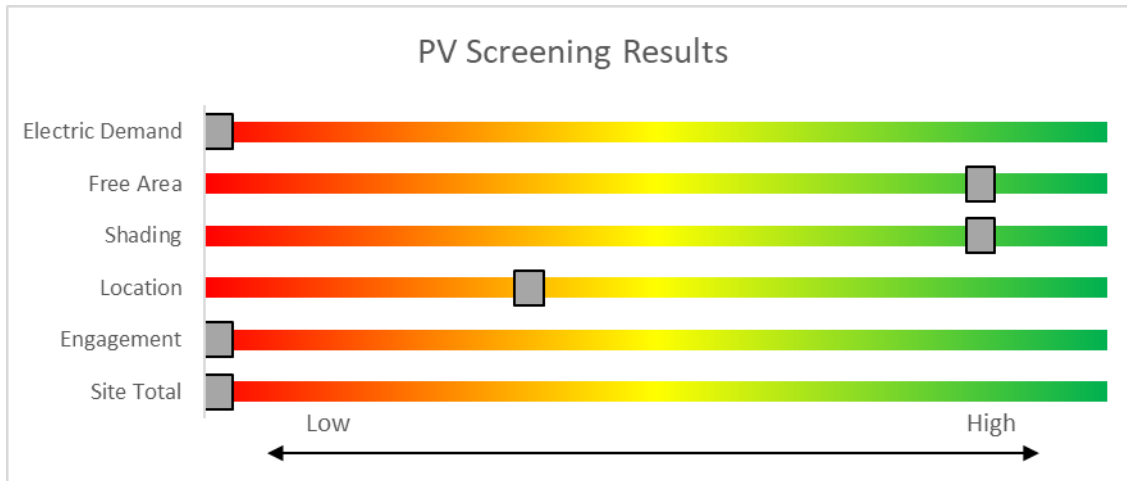


Figure 9 - Photovoltaic Screening

6.2 Combined Heat and Power

Combined heat and power (CHP) generate electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has **no** potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. Low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

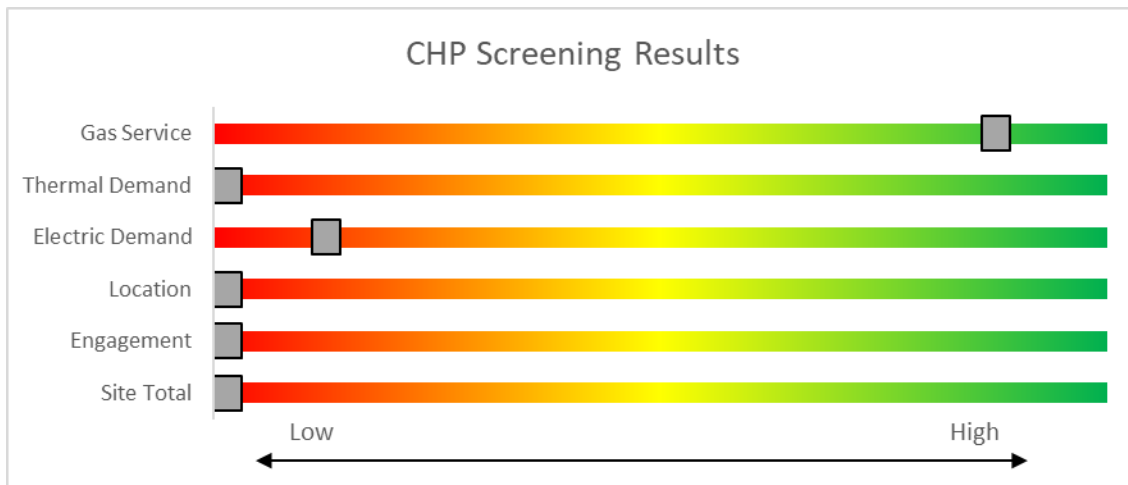


Figure 10 - Combined Heat and Power Screening

7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building’s performance? New Jersey’s Clean Energy Programs can help. Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available New Jersey’s Clean Energy Programs.

	SmartStart <i>Flexibility to install at your own pace</i>	Direct Install <i>Turnkey installation</i>	Pay for Performance <i>Whole building upgrades</i>
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.			

7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy efficiency equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers
Electric Unitary HVAC
Gas Cooling
Gas Heating
Gas Water Heating
Ground Source Heat Pumps
Lighting

Lighting Controls
Refrigeration Doors
Refrigeration Controls
Refrigerator/Freezer Motors
Food Service Equipment
Variable Frequency Drives

Incentives

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit www.njcleanenergy.com/SSB for a detailed program description, instructions for applying, and applications.

7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

7.3 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at: www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website⁶.

8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website⁷.

⁶ www.state.nj.us/bpu/commercial/shopping.html.

⁷ www.state.nj.us/bpu/commercial/shopping.html

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Exterior Wall Pack	7	High-Pressure Sodium: (1) 100W Lamp	Timeclock		138	2,000	NR	Fixture Replacement	No	7	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Timeclock	25	2,000	0.5	1,582	0	\$320	\$6,762	\$700	18.9
Storage Room	3	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	1,176	1	Relamp & Reballast	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,176	0.1	154	0	\$31	\$206	\$30	5.8
Entrance	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	240	1	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	240	0.0	10	0	\$2	\$69	\$10	28.2
Entrance	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical Room	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	240	1	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	240	0.0	10	0	\$2	\$69	\$10	28.2
Main Area	4	Compact Fluorescent: 4-PIN	Wall Switch	S	80	240	NR	Fixture Replacement	No	4	LED - Fixtures: Ambient 2x2 Fixture (LED Panel)	Wall Switch	40	240	0.1	28	0	\$6	\$400	\$0	70.9
Mechanical Room	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Main Area	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	4	Compact Fluorescent: 4-PIN	Wall Switch	S	80	240	NR, NR	Relamp	Yes	4	LED - Fixtures: Ambient 2x2 Fixture (LED Panel)	Occupancy Sensor	40	166	0.1	37	0	\$7	\$516	\$20	67.1
Kitchen	1	Compact Fluorescent: Screen in	Wall Switch	S	23	240	NR	Relamp	No	1	LED - Fixtures: Downlight Solid State Retrofit	Wall Switch	10	240	0.0	2	0	\$0	\$33	\$0	70.9
Kitchen	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Women Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	240	NR	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	240	0.0	10	0	\$2	\$73	\$20	26.8
Women Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	240	NR	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	240	0.0	3	0	\$1	\$33	\$6	47.0
Men Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	240	NR	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	240	0.0	10	0	\$2	\$73	\$20	26.8
Men Restroom	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	240	NR	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	240	0.0	3	0	\$1	\$33	\$6	47.0
Men Restroom	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Field Pole Lighting	25	Metal Halide: (1) 1000W Lamp	Breaker Panel		1,080	112	NR	Fixture Replacement	No	25	LED - Fixtures: Large Pole/Arm-Mounted Area/Roadway Fixture	Breaker Panel	300	112	12.9	2,184	0	\$442	\$29,863	\$0	67.6

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions					Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	Kitchen	1	Exhaust Fan	0.5	60.0%	No	W	240		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	Grinder Pump	1	Process Pump	0.3	60.0%	No	W	144		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Mechanical Room	1	Furnace	105.00	N		No						0.0	0	0	\$0	\$0	\$0	0.0

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions				Proposed Conditions						Energy Impact & Financial Analysis						
		System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Consession Stand	1	Storage Tank Water Heater (≤ 50 Gal)	W		No						0.0	0	0	\$0	\$0	\$0	0.0

Low-Flow Device Recommendations

Location	Recommendation Inputs					Energy Impact & Financial Analysis						
	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restrooms	2	2	Faucet Aerator (Lavatory)	2.20	0.50	0.0	167	0	\$34	\$14	\$0	0.4
Kitchen	2	1	Faucet Aerator (Kitchen)	2.20	1.50	0.0	34	0	\$7	\$7	\$0	1.0

Commercial Refrigerator/Freezer Inventory & Recommendations

Location	Existing Conditions			Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Refrigerator/ Freezer Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Stand-Up Refrigerator, Glass Door (31 - 50 cu. ft.)	No		No	0.0	0	0	\$0	\$0	\$0	0.0

Cooking Equipment Inventory & Recommendations

Location	Existing Conditions			Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Equipment Type	High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Gas Steamer	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	3	Electric Steamer	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0

Plug Load Inventory

Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?
Consession Stand	1	Microwave	1,000.0	No
Consession Stand	1	Commercial Coffee Machine	1,500.0	No
Consession Stand	1	Refrigerator	124.0	Yes

APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

EPA's Portfolio Manager® currently does not have a comparable building type for the Township of Winslow Albion Park. Therefore, there is no SEP for this property. The NJCEP LGEA program has set up a profile within Portfolio Manager, but its intent is solely to provide the Township of Winslow with a method to track monthly utility bills

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate financial savings. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
BTU	A British thermal unit is the amount of heat required to increase the temperature of one pound water by one-degree Fahrenheit. Commonly used to measure natural gas consumption.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing energy management systems.
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
HVAC	Heating, ventilation, and air conditioning.
kW	Kilowatt. Equal to 1,000 Watts.
Load	The total amount of power used by a building system at any given time.
Measure	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
MMBtu	One million British thermal units.
psig	Pounds per square inch.
Plug Load	Refers to the amount of energy used in a space by products that are powered by means of an ordinary AC plug.
Simple Payback	The amount of time needed to recoup the funds expended in an investment, or to reach the break-even point.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
Turnkey	Provision of a complete product or service that is ready for immediate use
Watt (W)	Unit of power commonly used to measure electricity use.