



# Local Government Energy Audit Report

Hammonton Human Services

April 30, 2024

*Prepared for:*

Atlantic County

310 Bellevue Ave

Hammonton, New Jersey 08034

*Prepared by:*

TRC

317 George Street

New Brunswick, New Jersey 08901

## Disclaimer

---

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based on previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2024 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

# Table of Contents

---


<b>1</b>	<b>Executive Summary.....</b>	<b>1</b>
<b>1.1</b>	<b>Planning Your Project .....</b>	<b>4</b>
	Pick Your Installation Approach .....	4
	Options from Your Utility Company.....	4
	<i>Prescriptive and Custom Rebates</i> .....	4
	<i>Direct Install</i> .....	4
	<i>Engineered Solutions</i> .....	4
	Options from New Jersey's Clean Energy Program .....	5
<b>2</b>	<b>Existing Conditions.....</b>	<b>6</b>
2.1	Site Overview.....	6
2.2	Building Occupancy .....	6
2.3	Building Envelope .....	6
2.4	Lighting Systems.....	7
2.5	Air Handling Systems.....	8
	Air Handling Units (AHUs) .....	8
2.6	Heating Hot Water Systems .....	9
2.7	Domestic Hot Water .....	9
2.8	Food Service Equipment.....	10
2.9	Plug Load and Vending Machines .....	10
2.10	Water-Using Systems .....	11
<b>3</b>	<b>Energy Use and Costs .....</b>	<b>12</b>
3.1	Electricity .....	14
3.2	Natural Gas.....	15
3.3	Benchmarking.....	16
	Tracking Your Energy Performance .....	17
<b>4</b>	<b>Energy Conservation Measures .....</b>	<b>18</b>
4.1	Lighting .....	21
	ECM 1: Retrofit Fixtures with LED Lamps .....	21
4.2	Lighting Controls.....	21
	ECM 2: Install Occupancy Sensor Lighting Controls .....	21
	ECM 3: Install High/Low Lighting Controls .....	22
4.3	Unitary HVAC.....	22
	ECM 4: Install High Efficiency Air Conditioning Units.....	23
4.4	Gas-Fired Heating.....	23
	ECM 5: Install High Efficiency Hot Water Boilers .....	23
4.5	Domestic Water Heating .....	23
	ECM 6: Install Low-Flow DHW Devices.....	23
4.6	Food Service & Refrigeration Measures.....	24

ECM 7: Vending Machine Control .....	24
4.7 Measures for Future Consideration .....	24
Installation of a Building Automation System .....	25
<b>5 Energy Efficient Best Practices .....</b>	<b>26</b>
Energy Tracking with ENERGY STAR Portfolio Manager .....	26
Lighting Maintenance.....	26
Motor Controls.....	26
Fans to Reduce Cooling Load .....	26
AC System Evaporator/Condenser Coil Cleaning .....	27
Boiler Maintenance .....	27
Label HVAC Equipment .....	27
Water Heater Maintenance .....	27
Plug Load Controls.....	28
Water Conservation .....	28
Procurement Strategies .....	28
<b>6 On-site Generation .....</b>	<b>29</b>
6.1 Solar Photovoltaic .....	30
6.2 Combined Heat and Power .....	32
<b>7 Electric Vehicles (EV) .....</b>	<b>33</b>
7.1 Electric Vehicle Charging .....	33
<b>8 Project Funding and Incentives.....</b>	<b>35</b>
8.1 Utility Energy Efficiency Programs .....	36
Prescriptive and Custom .....	36
Direct Install .....	36
Engineered Solutions .....	37
8.2 New Jersey's Clean Energy Programs.....	38
Large Energy Users.....	38
Combined Heat and Power .....	39
Successor Solar Incentive Program (SuSI) .....	40
Energy Savings Improvement Program .....	41
<b>9 Project Development .....</b>	<b>42</b>
<b>10 Energy Purchasing and Procurement Strategies .....</b>	<b>43</b>
10.1 Retail Electric Supply Options.....	43
10.2 Retail Natural Gas Supply Options .....	43
<b>Appendix A: Equipment Inventory &amp; Recommendations .....</b>	<b>A-1</b>
<b>Appendix B: ENERGY STAR Statement of Energy Performance .....</b>	<b>B-1</b>
<b>Appendix C: Glossary .....</b>	<b>C-1</b>

# 1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPB) has sponsored this Local Government Energy Audit (LGEA) report for Hammonton Human Services. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

## BUILDING PERFORMANCE REPORT

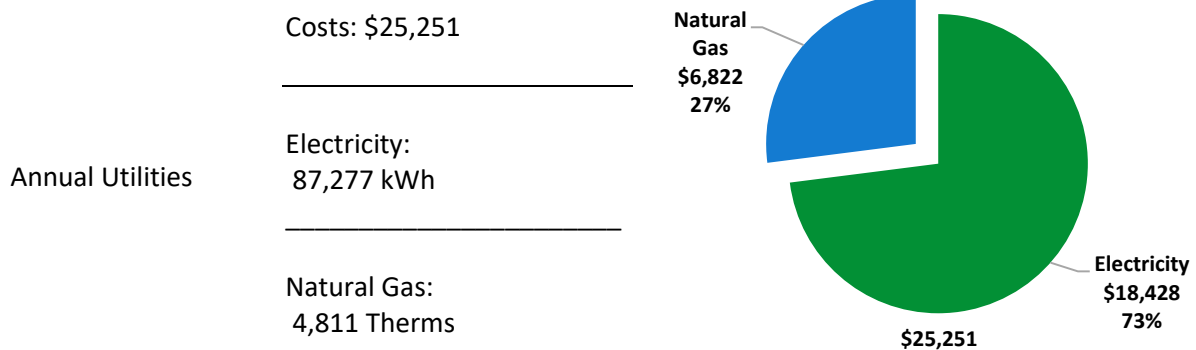

ENERGY STAR®  
Benchmarking Score

N/A  
(1-100 scale)

A standard energy use benchmark is not available for this facility type. This report contains suggestions about how to improve building performance and reduce energy costs.

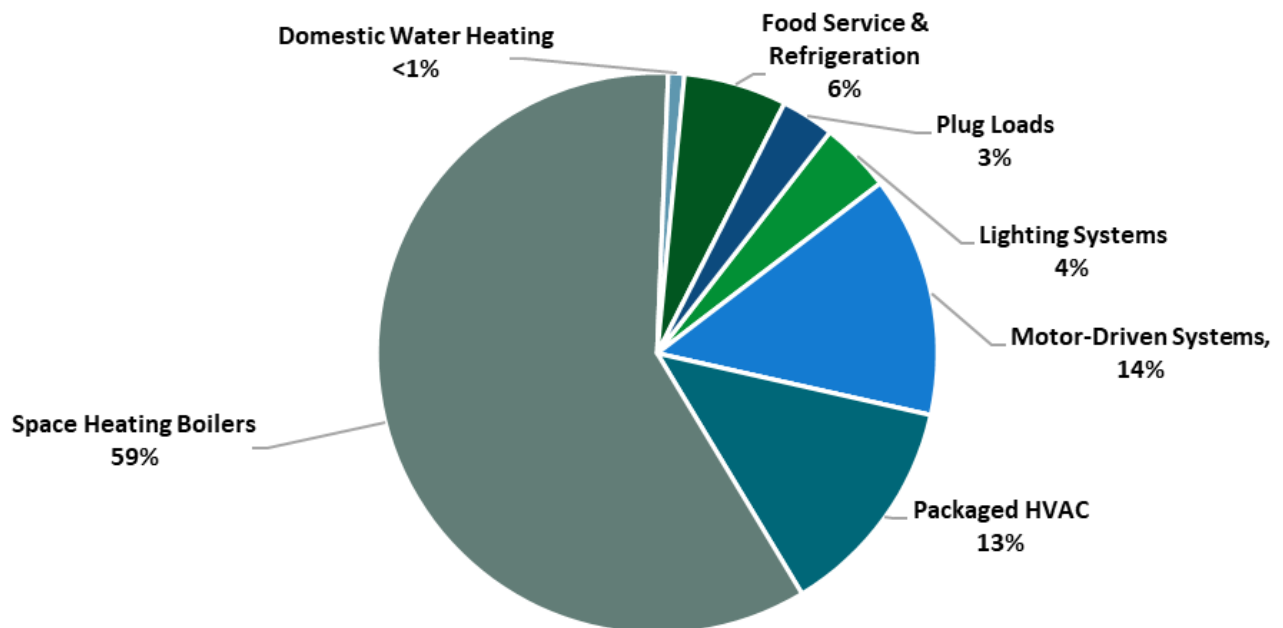


Figure 1 - Energy Use by System


## POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


### Scenario 1: Full Package (All Evaluated Measures)

Installation Cost	\$72,155
Potential Rebates & Incentives <sup>1</sup>	\$4,659
Annual Cost Savings	\$4,609
Annual Energy Savings	Electricity: 19,790 kWh Natural Gas: 303 Therms
Greenhouse Gas Emission Savings	12 Tons
Simple Payback	14.6 Years
Site Energy Savings (All Utilities)	13%

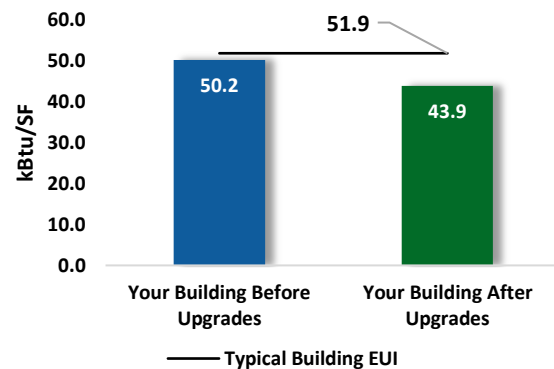

### Scenario 2: Cost Effective Package<sup>2</sup>

Installation Cost	\$6,446
Potential Rebates & Incentives	\$1,357
Annual Cost Savings	\$1,849
Annual Energy Savings	Electricity: 8,551 kWh Natural Gas: 31 Therms
Greenhouse Gas Emission Savings	4 Tons
Simple Payback	2.8 Years
Site Energy Savings (all utilities)	4%

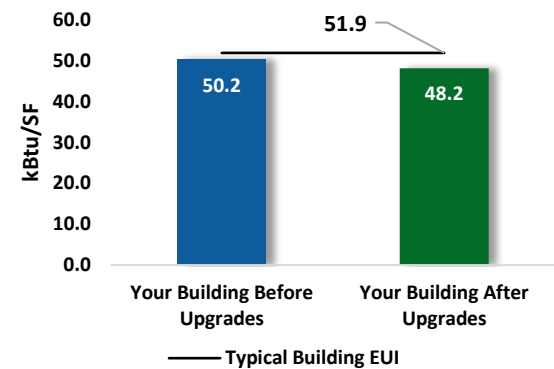

### On-site Generation Potential

Photovoltaic	None
Combined Heat and Power	None

<sup>1</sup> Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

<sup>2</sup> A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>3,762</b>	<b>1.3</b>	<b>-1</b>	<b>\$783</b>	<b>\$2,072</b>	<b>\$460</b>	<b>\$1,612</b>	<b>2.1</b>	<b>3,696</b>
ECM 1	Retrofit Fixtures with LED Lamps	Yes	3,762	1.3	-1	\$783	\$2,072	\$460	\$1,612	2.1	3,696
<b>Lighting Control Measures</b>			<b>1,565</b>	<b>0.5</b>	<b>0</b>	<b>\$326</b>	<b>\$3,770</b>	<b>\$725</b>	<b>\$3,045</b>	<b>9.3</b>	<b>1,538</b>
ECM 2	Install Occupancy Sensor Lighting Controls	Yes	1,198	0.4	0	\$249	\$3,320	\$480	\$2,840	11.4	1,177
ECM 3	Install High/Low Lighting Controls	Yes	367	0.0	0	\$76	\$450	\$245	\$205	2.7	361
<b>Unitary HVAC Measures</b>			<b>11,239</b>	<b>7.5</b>	<b>0</b>	<b>\$2,373</b>	<b>\$52,762</b>	<b>\$2,734</b>	<b>\$50,028</b>	<b>21.1</b>	<b>11,318</b>
ECM 4	Install High Efficiency Air Conditioning Units	No	11,239	7.5	0	\$2,373	\$52,762	\$2,734	\$50,028	21.1	11,318
<b>Gas Heating (HVAC/Process) Replacement</b>			<b>0</b>	<b>0.0</b>	<b>27</b>	<b>\$386</b>	<b>\$12,947</b>	<b>\$569</b>	<b>\$12,378</b>	<b>32.0</b>	<b>3,190</b>
ECM 5	Install High Efficiency Hot Water Boilers	No	0	0.0	27	\$386	\$12,947	\$569	\$12,378	32.0	3,190
<b>Domestic Water Heating Upgrade</b>			<b>0</b>	<b>0.0</b>	<b>4</b>	<b>\$59</b>	<b>\$143</b>	<b>\$72</b>	<b>\$72</b>	<b>1.2</b>	<b>490</b>
ECM 6	Install Low-Flow DHW Devices	Yes	0	0.0	4	\$59	\$143	\$72	\$72	1.2	490
<b>Food Service &amp; Refrigeration Measures</b>			<b>3,224</b>	<b>0.4</b>	<b>0</b>	<b>\$681</b>	<b>\$460</b>	<b>\$100</b>	<b>\$360</b>	<b>0.5</b>	<b>3,246</b>
ECM 7	Vending Machine Control	Yes	3,224	0.4	0	\$681	\$460	\$100	\$360	0.5	3,246
<b>TOTALS (COST EFFECTIVE MEASURES)</b>			<b>8,551</b>	<b>2.1</b>	<b>3</b>	<b>\$1,849</b>	<b>\$6,446</b>	<b>\$1,357</b>	<b>\$5,089</b>	<b>2.8</b>	<b>8,970</b>
<b>TOTALS (ALL MEASURES)</b>			<b>19,790</b>	<b>9.6</b>	<b>30</b>	<b>\$4,609</b>	<b>\$72,155</b>	<b>\$4,659</b>	<b>\$67,496</b>	<b>14.6</b>	<b>23,478</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

## 1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

### Pick Your Installation Approach

Utility-run energy efficiency programs and New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

### Options from Your Utility Company

#### *Prescriptive and Custom Rebates*

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the Prescriptive and Custom Rebates program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval may be required for some incentives. Contact your utility company for more details prior to project installation.

#### *Direct Install*

The Direct Install program provides turnkey installation of multiple measures through an authorized contractor. This program can provide incentives up to 70% or 80% of the cost of selected measures. A Direct Install contractor will assess and verify individual measure eligibility and perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

#### *Engineered Solutions*

The Engineered Solutions program provides tailored energy-efficiency assistance and turnkey engineering services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. The program provides all professional services from audit, design, construction administration, to commissioning and measurement and verification for custom whole-building energy-efficiency projects. Engineered Solutions allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs.

For more details on these programs please contact your utility provider.

## **Options from New Jersey's Clean Energy Program**

### *Financing and Planning Support with the Energy Savings Improvement Program (ESIP)*

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

### *Resiliency with Return on Investment through Combined Heat and Power (CHP)*

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

### *Successor Solar Incentive Program (SuSI)*

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

### *Ongoing Electric Savings with Demand Response*

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

### *Large Energy User Program (LEUP)*

LEUP is designed to promote self-investment in energy efficiency. It incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

For more details on these programs please visit [New Jersey's Clean Energy Program website](#) .



## 2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) report for Hammonton Human Services. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

### 2.1 Site Overview

On February 1, 2023, TRC performed an energy audit at Hammonton Human Services located in Hammonton, New Jersey. TRC met with Rick McGee to review the facility operations and help focus our investigation on specific energy-using systems.

Hammonton Human Services is a one-story, 15,500 square foot building built in 1980. Spaces include offices, cafeteria, corridors, stairwells, dental clinic, commercial kitchen, restrooms, and mechanical space.

### 2.2 Building Occupancy

The facility is occupied Monday through Friday during regular business hours. Janitorial services are performed after hours.

Building Name	Weekday/Weekend	Operating Schedule
Hammonton Human Services	Weekday	8:30 AM - 4:00 PM
	Weekend	Closed

*Figure 3 - Building Occupancy Schedule*

### 2.3 Building Envelope

Building walls are structural steel with vertical, decorative steel panels. The flat roof is supported with steel trusses and covered with built up roofing topped with stone ballast.

Most of the windows are tinted, double-glazed, fixed units with aluminum frames. One window is comprised of 4-inch square glass blocks set in mortar. Exterior doors have metal frames and are in fair condition with worn door seals. Degraded window and door seals increase drafts and outside air infiltration.



*Exterior Construction*

## 2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. Linear fixture types include 1-lamp, 2-lamp, or 4-lamp, 2-foot or 4-foot-long troffer fixtures and a few 2-foot fixtures with U-bend or linear tube lamps. There are several interior fixtures with screw in LED A19 lamps. All exit signs are LED units. Most fixtures are in good condition. Interior lighting levels were generally sufficient.



*Dental Clinic 2-lamp T8  
Troffer*



*LED Exit Sign*

There are no automatic controls for interior lighting. All interior lighting fixtures are controlled by wall switches.

Exterior fixtures include one LED spotlight controlled with a photocell for illuminating the American flag and four timeclock-controlled canopy lights with A19 LED lamps at the front entrance. There are three pole-mounted, lantern-style fixtures in the main parking lot also controlled with the time clock.



*LED Spotlight*



*LED Canopy Fixtures*

## 2.5 Air Handling Systems

### **Air Handling Units (AHUs)**

The facility is conditioned by five air-handling units which are each equipped with a supply fan, refrigerant coil, and hot water coil. These units are located above the ceiling and were inaccessible during the audit. The supply fan motor data was estimated based on the capacity of the connected condensing units. They are assumed to be standard efficiency, constant speed motors ranging in size from 1.0 hp to 5.0 hp. Cooling is provided by outdoor condensing units and the heating source is provided by the hot water boiler.

The outdoor condensing units are in fair condition and nearing the end of their useful life. System cooling capacities range between 3 tons and 10 tons while efficiencies run around 9 EER to 10 EER.

The HVAC systems are controlled by thermostats located in the conditioned space.



*10-ton Condenser*



*3-ton Condenser*

## 2.6 Heating Hot Water Systems

One Weil-McLain 325.00 MBh output, non-condensing hot water boiler which serves the building's heating load. This is a cast iron sectional boiler with a modulating burner operating at 80% nominal efficiency.

The hydronic distribution system is a two-pipe, heating-only system.

The boilers are configured in a constant flow primary distribution with two, 3/4 hp constant speed hot water pumps operating with a manual lead-lag control scheme. The boilers provide hot water to fin tube radiators, air handling hot water coils, and air handling units throughout the building.



*Weil McLean Boiler*



*Heating Hot Water Circulating Pumps*

## 2.7 Domestic Hot Water

Hot water is produced by a Navian NR210 180 MBh, gas-fired instantaneous water heater with a nominal efficiency of 98%. The domestic hot water pipes are insulated, and the insulation is in good condition.



*Navian DHW Heater*

## 2.8 Food Service Equipment

The kitchen has a mix of gas and electric equipment that is used to prepare and store meals. Most cooking is done using a conventional gas-fired oven. There is one commercial grade double solid door refrigerator, one commercial grade single solid door freezer and a Manitowoc ice maker in the kitchen.

Visit [https://www.energystar.gov/products/commercial\\_food\\_service\\_equipment](https://www.energystar.gov/products/commercial_food_service_equipment) for the latest information on high efficiency food service equipment.



*Commercial Grade Refrigerator*



*Gas fired Commercial Grade Oven/Range*

## 2.9 Plug Load and Vending Machines

The location is doing a great job managing the electrical plug loads. This report makes additional suggestions for ECMs in this area as well as energy efficient best practices.

There are 24 computer workstations throughout the facility. Plug loads include eight televisions, general cafe equipment, four microwaves, and general office equipment.

There are two residential-style refrigerators that are used to store kitchen and staff owned food. These vary in condition and efficiency.

There are two refrigerated beverage vending machines with no occupancy-based controls.

A hydraulic elevator is available for public use.



*Residential-style Refrigerator*



*Refrigerated Vending Machine*

## 2.10 Water-Using Systems

There are several restrooms with toilets, urinals, and sinks. The dental clinic has seven lavatories as well. Faucet flow rates are between 1.0 gallons per minute (gpm) and 1.5 gpm. Toilets are rated at 1.6 gallons per flush (gpf) and urinals are rated 1.0 gpf.



*Restroom Lavatory*




*Dental Clinic Wash Basin*

### 3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	87,277 kWh	\$18,428
Natural Gas	4,811 Therms	\$6,822
Total		\$25,251

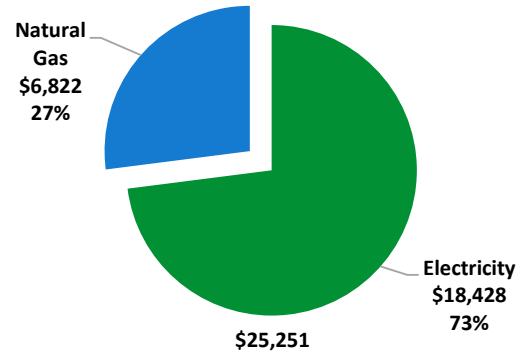

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


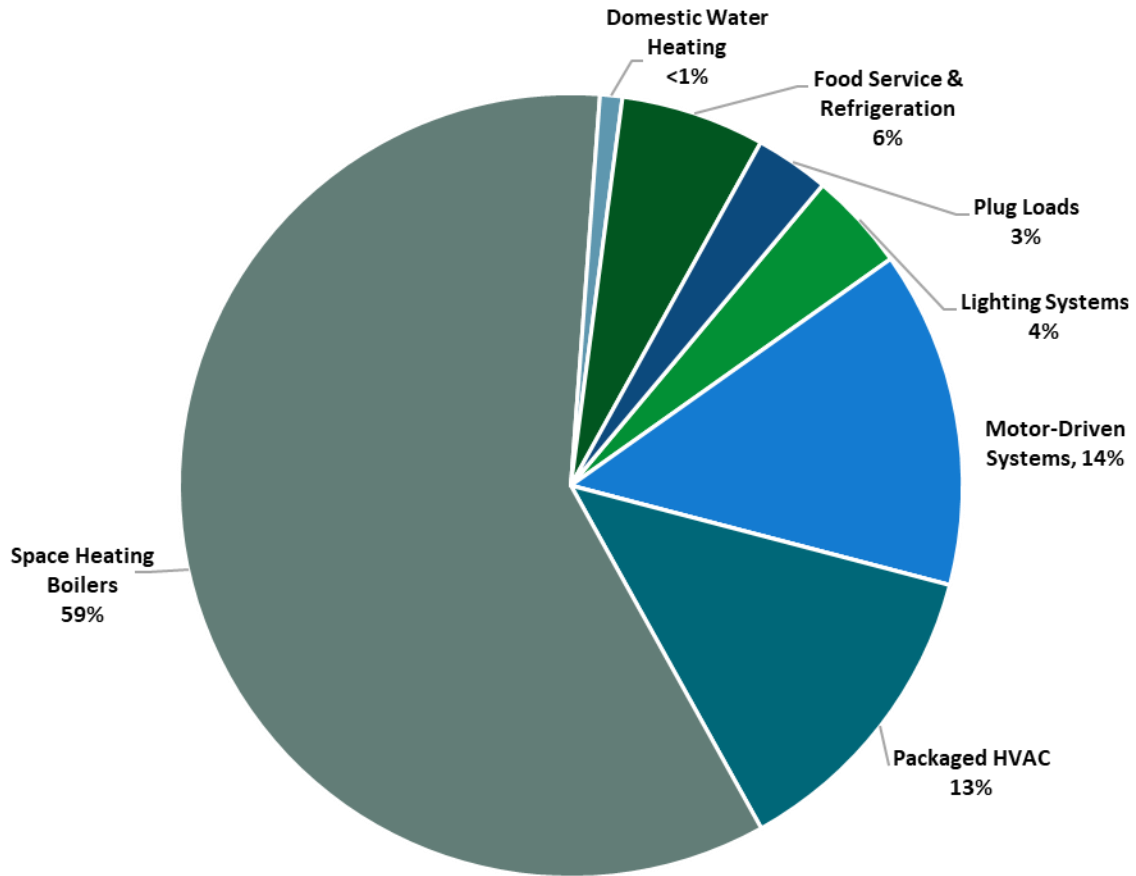


Figure 4 - Energy Balance

### 3.1 Electricity

Atlantic City Electric delivers electricity under rate class Annual General Service Secondary, with electric production provided by Constellation New Energy, a third-party supplier.

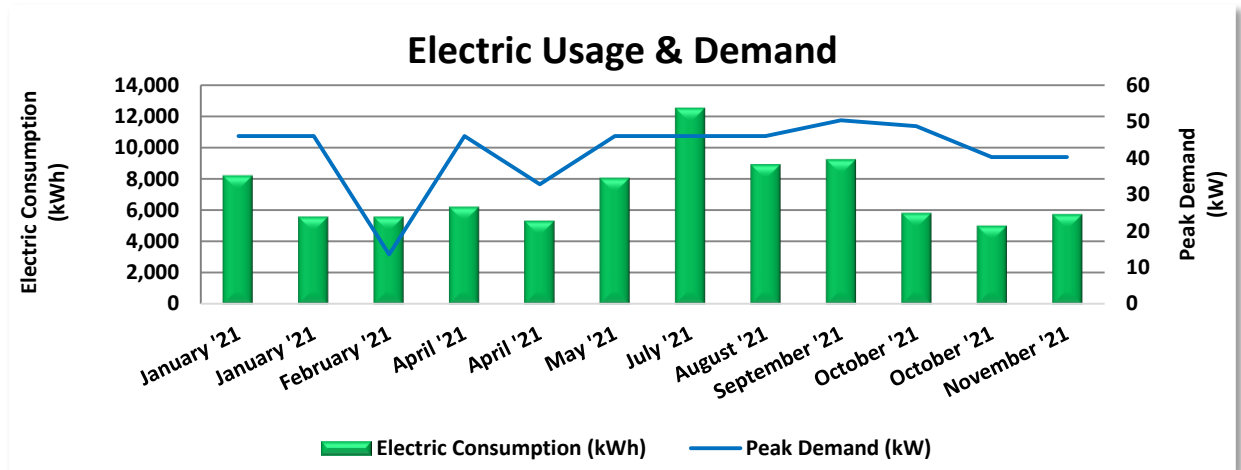


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
1/19/21	33	8,240	46	\$588	\$1,647
2/12/21	24	5,600	46	\$415	\$1,154
3/15/21	31	5,600	14	\$536	\$1,339
4/16/21	32	6,240	46	\$556	\$1,430
5/14/21	28	5,360	33	\$488	\$1,243
6/14/21	31	8,080	46	\$540	\$1,626
7/19/21	35	12,560	46	\$610	\$2,258
8/17/21	29	8,960	46	\$488	\$1,694
9/19/21	33	9,280	50	\$667	\$1,976
10/18/21	29	5,840	49	\$517	\$1,388
11/15/21	28	5,040	40	\$428	\$1,213
12/14/21	29	5,760	40	\$444	\$1,311
<b>Totals</b>	<b>362</b>	<b>86,560</b>	<b>50</b>	<b>\$6,278</b>	<b>\$18,277</b>
<b>Annual</b>	<b>365</b>	<b>87,277</b>	<b>50</b>	<b>\$6,330</b>	<b>\$18,428</b>

Notes:

- Peak demand of 50 kW occurred in September '21.
- Average demand over the past 12 months was 42 kW.
- The average electric cost over the past 12 months was \$0.211/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

## 3.2 Natural Gas

South Jersey Gas delivers natural gas under rate class General Service FT (GSGFT), with natural gas supply provided by UGI Energy Services, LLC, a third-party supplier.

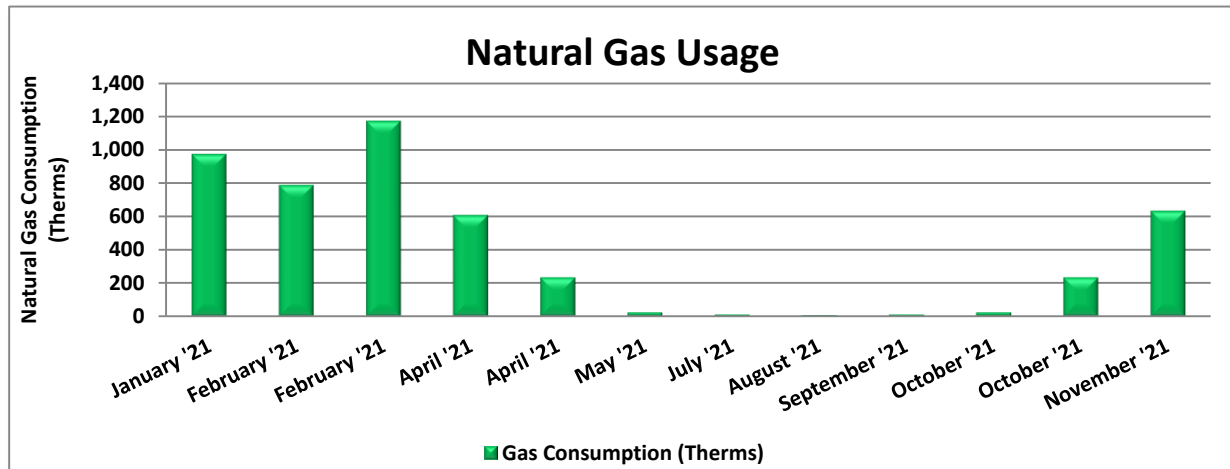

Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
1/18/21	28	974	\$1,318
2/21/21	34	788	\$1,066
3/15/21	22	1,173	\$1,588
4/16/21	32	607	\$842
5/14/21	28	234	\$343
6/14/21	31	25	\$71
7/19/21	35	10	\$57
8/16/21	28	7	\$44
9/20/21	35	10	\$57
10/18/21	28	24	\$67
11/15/21	28	233	\$350
12/14/21	29	633	\$888
<b>Totals</b>	<b>358</b>	<b>4,718</b>	<b>\$6,691</b>
<b>Annual</b>	<b>365</b>	<b>4,811</b>	<b>\$6,822</b>

Notes:

- The average gas cost for the past 12 months is \$1.418/therm, which is the blended rate used throughout the analysis.

### 3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

#### Benchmarking Score

N/A

Due to its unique characteristics, this building type is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

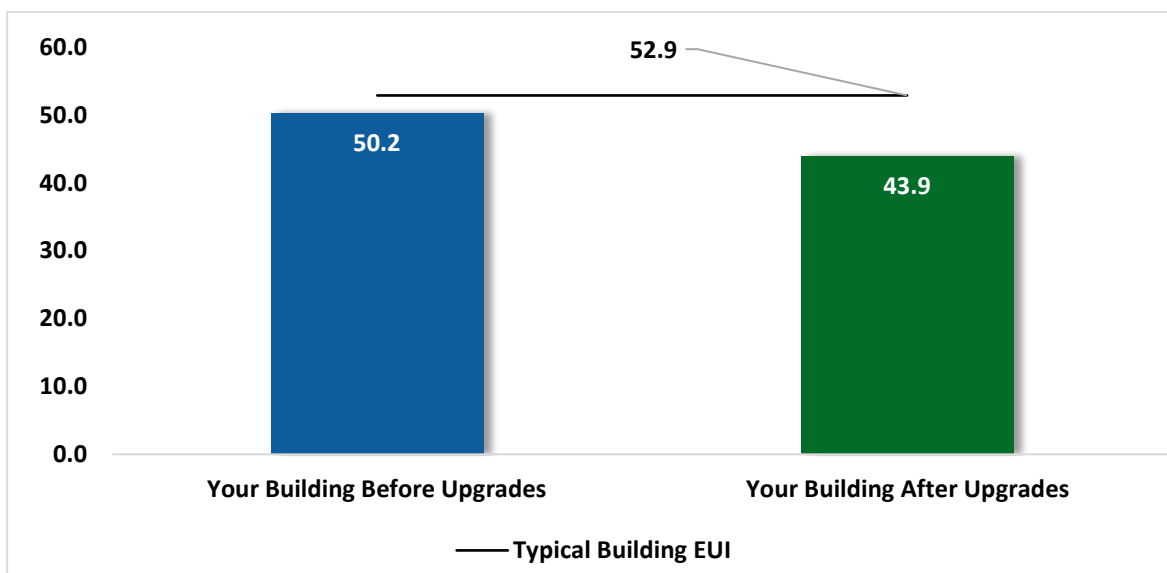


Figure 5 - Energy Use Intensity Comparison<sup>3</sup>

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

<sup>3</sup> Based on all evaluated ECMs



### **Tracking Your Energy Performance**

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance.

**We have created a Portfolio Manager account for your facility and have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.**

Free online training is available to help you use ENERGY STAR Portfolio Manager to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR and Portfolio Manager, visit their [website](#).

## 4 ENERGY CONSERVATION MEASURES

---

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives in this report are based on the previously run state rebate program SmartStart, which has been retired. Now, all investor-owned gas and electric utility companies are offering complementary energy efficiency programs directly to their customers. Some measures and proposed upgrades may be eligible for higher incentives than those shown below. The incentives in the summary tables should be used for high-level planning purposes. To verify incentives, reach out to your utility provider or visit the [NJCEP website](#) for more information.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>3,762</b>	<b>1.3</b>	<b>-1</b>	<b>\$783</b>	<b>\$2,072</b>	<b>\$460</b>	<b>\$1,612</b>	<b>2.1</b>	<b>3,696</b>
ECM 1	Retrofit Fixtures with LED Lamps	Yes	3,762	1.3	-1	\$783	\$2,072	\$460	\$1,612	2.1	3,696
<b>Lighting Control Measures</b>			<b>1,565</b>	<b>0.5</b>	<b>0</b>	<b>\$326</b>	<b>\$3,770</b>	<b>\$725</b>	<b>\$3,045</b>	<b>9.3</b>	<b>1,538</b>
ECM 2	Install Occupancy Sensor Lighting Controls	Yes	1,198	0.4	0	\$249	\$3,320	\$480	\$2,840	11.4	1,177
ECM 3	Install High/Low Lighting Controls	Yes	367	0.0	0	\$76	\$450	\$245	\$205	2.7	361
<b>Unitary HVAC Measures</b>			<b>11,239</b>	<b>7.5</b>	<b>0</b>	<b>\$2,373</b>	<b>\$50,402</b>	<b>\$2,734</b>	<b>\$47,668</b>	<b>20.1</b>	<b>11,318</b>
ECM 4	Install High Efficiency Air Conditioning Units	No	11,239	7.5	0	\$2,373	\$50,402	\$2,734	\$47,668	20.1	11,318
<b>Gas Heating (HVAC/Process) Replacement</b>			<b>0</b>	<b>0.0</b>	<b>27</b>	<b>\$386</b>	<b>\$12,947</b>	<b>\$569</b>	<b>\$12,378</b>	<b>32.0</b>	<b>3,190</b>
ECM 5	Install High Efficiency Hot Water Boilers	No	0	0.0	27	\$386	\$12,947	\$569	\$12,378	32.0	3,190
<b>Domestic Water Heating Upgrade</b>			<b>0</b>	<b>0.0</b>	<b>4</b>	<b>\$59</b>	<b>\$143</b>	<b>\$72</b>	<b>\$72</b>	<b>1.2</b>	<b>490</b>
ECM 6	Install Low-Flow DHW Devices	Yes	0	0.0	4	\$59	\$143	\$72	\$72	1.2	490
<b>Food Service &amp; Refrigeration Measures</b>			<b>3,224</b>	<b>0.4</b>	<b>0</b>	<b>\$681</b>	<b>\$460</b>	<b>\$100</b>	<b>\$360</b>	<b>0.5</b>	<b>3,246</b>
ECM 7	Vending Machine Control	Yes	3,224	0.4	0	\$681	\$460	\$100	\$360	0.5	3,246
<b>TOTALS</b>			<b>19,790</b>	<b>9.6</b>	<b>30</b>	<b>\$4,609</b>	<b>\$69,795</b>	<b>\$4,659</b>	<b>\$65,136</b>	<b>14.1</b>	<b>23,478</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 6 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>3,762</b>	<b>1.3</b>	<b>-1</b>	<b>\$783</b>	<b>\$2,072</b>	<b>\$460</b>	<b>\$1,612</b>	<b>2.1</b>	<b>3,696</b>
ECM 1	Retrofit Fixtures with LED Lamps	3,762	1.3	-1	\$783	\$2,072	\$460	\$1,612	2.1	3,696
<b>Lighting Control Measures</b>		<b>1,565</b>	<b>0.5</b>	<b>0</b>	<b>\$326</b>	<b>\$3,770</b>	<b>\$725</b>	<b>\$3,045</b>	<b>9.3</b>	<b>1,538</b>
ECM 2	Install Occupancy Sensor Lighting Controls	1,198	0.4	0	\$249	\$3,320	\$480	\$2,840	11.4	1,177
ECM 3	Install High/Low Lighting Controls	367	0.0	0	\$76	\$450	\$245	\$205	2.7	361
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>4</b>	<b>\$59</b>	<b>\$143</b>	<b>\$72</b>	<b>\$72</b>	<b>1.2</b>	<b>490</b>
ECM 6	Install Low-Flow DHW Devices	0	0.0	4	\$59	\$143	\$72	\$72	1.2	490
<b>Food Service &amp; Refrigeration Measures</b>		<b>3,224</b>	<b>0.4</b>	<b>0</b>	<b>\$681</b>	<b>\$460</b>	<b>\$100</b>	<b>\$360</b>	<b>0.5</b>	<b>3,246</b>
ECM 7	Vending Machine Control	3,224	0.4	0	\$681	\$460	\$100	\$360	0.5	3,246
<b>TOTALS</b>		<b>8,551</b>	<b>2.1</b>	<b>3</b>	<b>\$1,849</b>	<b>\$6,446</b>	<b>\$1,357</b>	<b>\$5,089</b>	<b>2.8</b>	<b>8,970</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – Cost Effective ECMs

## 4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>3,762</b>	<b>1.3</b>	<b>-1</b>	<b>\$783</b>	<b>\$2,072</b>	<b>\$460</b>	<b>\$1,612</b>	<b>2.1</b>	<b>3,696</b>
ECM 1	Retrofit Fixtures with LED Lamps	3,762	1.3	-1	\$783	\$2,072	\$460	\$1,612	2.1	3,696

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

### **ECM 1: Retrofit Fixtures with LED Lamps**

Replace fluorescent with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

**Affected Building Areas:** all areas with fluorescent fixtures with T8 tubes

## 4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Control Measures</b>		<b>1,565</b>	<b>0.5</b>	<b>0</b>	<b>\$326</b>	<b>\$3,770</b>	<b>\$725</b>	<b>\$3,045</b>	<b>9.3</b>	<b>1,538</b>
ECM 2	Install Occupancy Sensor Lighting Controls	1,198	0.4	0	\$249	\$3,320	\$480	\$2,840	11.4	1,177
ECM 3	Install High/Low Lighting Controls	367	0.0	0	\$76	\$450	\$245	\$205	2.7	361

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

### **ECM 2: Install Occupancy Sensor Lighting Controls**

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

**Affected Building Areas:** offices, kitchen, library, restrooms, and storage rooms

### **ECM 3: Install High/Low Lighting Controls**

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as occupants approach the area.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

**Affected Building Areas:** hallways

## 4.3 Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Unitary HVAC Measures</b>		<b>11,239</b>	<b>7.5</b>	<b>0</b>	<b>\$2,373</b>	<b>\$50,402</b>	<b>\$2,734</b>	<b>\$47,668</b>	<b>20.1</b>	<b>11,318</b>
ECM 4	Install High Efficiency Air Conditioning Units	11,239	7.5	0	\$2,373	\$50,402	\$2,734	\$47,668	20.1	11,318

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When these split system air conditioning units is eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

#### **ECM 4: Install High Efficiency Air Conditioning Units**

We evaluated replacing standard efficiency split system air conditioning units with high efficiency units. All of the replacement units will incorporate heating hot water coils in the AHUs. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling and heating load, and the estimated annual operating hours.

**Affected Units:** split system air conditioning units with indoor AHUs

### 4.4 Gas-Fired Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
	<b>Gas Heating (HVAC/Process) Replacement</b>	<b>0</b>	<b>0.0</b>	<b>27</b>	<b>\$386</b>	<b>\$12,947</b>	<b>\$569</b>	<b>\$12,378</b>	<b>32.0</b>	<b>3,190</b>
ECM 5	Install High Efficiency Hot Water Boilers	0	0.0	27	\$386	\$12,947	\$569	\$12,378	32.0	3,190

#### **ECM 5: Install High Efficiency Hot Water Boilers**

Replace older inefficient hot water boilers with higher efficiency hot water boilers. Energy savings results from improved combustion efficiency and reduced standby losses at low loads.

For the purposes of this analysis, we evaluated the replacement of boilers on a one-for-one basis with equipment of the same capacity. We recommend that you work with your mechanical design team to select boilers that are sized appropriately for the heating load. In many cases installing multiple modular boilers, rather than one or two large boilers, will result in higher overall plant efficiency while providing additional system redundancy.

Replacing the boilers has a long payback and may not be justifiable based simply on energy considerations. However, the boiler in this facility is nearing the end of their normal useful life. Typically, the marginal cost of purchasing high efficiency boilers can be justified by the marginal savings from the improved efficiency. When the boiler is eventually replaced, consider purchasing a boiler that exceed the minimum efficiency required by building codes. We also recommend working with your mechanical design team to determine whether the heating system can operate with return water temperatures below 130°F, which would allow the use of condensing boilers.

### 4.5 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
	<b>Domestic Water Heating Upgrade</b>	<b>0</b>	<b>0.0</b>	<b>4</b>	<b>\$59</b>	<b>\$143</b>	<b>\$72</b>	<b>\$72</b>	<b>1.2</b>	<b>490</b>
ECM 6	Install Low-Flow DHW Devices	0	0.0	4	\$59	\$143	\$72	\$72	1.2	490

#### **ECM 6: Install Low-Flow DHW Devices**

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing.

Additional cost savings may result from reduced water usage.

## 4.6 Food Service & Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Food Service &amp; Refrigeration Measures</b>		<b>3,224</b>	<b>0.4</b>	<b>0</b>	<b>\$681</b>	<b>\$460</b>	<b>\$100</b>	<b>\$360</b>	<b>0.5</b>	<b>3,246</b>
ECM 7	Vending Machine Control	3,224	0.4	0	\$681	\$460	\$100	\$360	0.5	3,246

### ECM 7: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and they power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

## 4.7 Measures for Future Consideration

There are additional opportunities for improvement that Atlantic County may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment, and/or include significant system reconfiguration. These measure(s) are therefore beyond the scope of this energy audit. These measure(s) are described here to support a whole building approach to energy efficiency and sustainability.

Atlantic County may wish to consider the Energy Savings Improvement Program (ESIP) or other whole building approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to:

- Evaluate these measures further.
- Develop firm costs.
- Determine measure savings.
- Prepare detailed implementation plans.

Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

### **Installation of a Building Automation System**

Most larger facilities have some type of building automation system (BAS), which provides for centralization, remote control, and monitoring of HVAC equipment and sometimes lighting or other building systems. A BAS utilizes a system of temperature and pressure sensors that obtain feedback about field conditions and provide signals to control systems that adjust HVAC system operation for optimal functioning. Thirty years ago, most control systems were pneumatic systems driven by compressed air, with pneumatic thermostats and air driven actuators for valves and dampers. Pneumatics controls have largely been replaced by direct digital control (DDC) systems, but many pneumatic systems remain. Contemporary DDC systems afford tighter controls and enhanced monitoring and trending capabilities as compared to the older systems.

Often smaller facilities are not equipped with central controls. For many small sites, it has been less costly to install distributed local controls, such as programmable thermostats and timeclocks, rather than centralized DDC. Local controls do a reasonably good job of scheduling equipment and maintaining operating conditions by relying on controls integral to HVAC units, such as logic for compressor staging, to manage the equipment operating algorithms.

Even for smaller sites, inefficiencies arise when temperature sensors and thermostat schedules are not maintained, when there are separate systems for heating and cooling, and especially when equipment is added, or the facility is reconfigured or repurposed.

Based on our survey, it appears that the installation of a BAS at your site could increase the efficiency of your building HVAC system operation.

A controls upgrade would enable automated equipment start and stop times, temperature setpoints, and lockouts and deadbands to be programmed remotely using a graphic interface. Controls can be configured to optimize ventilation and outside air intake by adjusting economizer position, damper function, and fan speed. Existing chilled and hot water distribution system controls are typically tied in, including associated pumps and valves. Coordinated control of HVAC systems is dependent on a network of sensors and status points. A comprehensive building control system provides monitoring and control for all HVAC systems, so operators can adjust system programming for optimal comfort and energy savings.

It is recommended that an HVAC engineer or contractor who specializes in BAS be contacted for a detailed evaluation and implementation costs. For the purposes of this report, the potential energy savings and measure costs were estimated based on industry standards and previous project experience. Further analysis should be conducted for the feasibility of this measure. This is not an investment grade analysis nor should be used as a basis for design and construction.

## 5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5%–20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Energy Tracking with ENERGY STAR Portfolio Manager**



You've heard it before—you cannot manage what you do not measure. ENERGY STAR Portfolio Manager is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions<sup>4</sup>. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

### **Lighting Maintenance**



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.
- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

### **Motor Controls**

Electric motors often run unnecessarily, and this is an overlooked opportunity to save energy. These motors should be identified and turned off when appropriate. For example, exhaust fans often run unnecessarily when ventilation requirements are already met. Whenever possible, use automatic devices such as twist timers or occupancy sensors to turn off motors when they are not needed.

### **Fans to Reduce Cooling Load**

Install ceiling fans to supplement your cooling system. Thermostat settings can typically be increased by 4°F with no change in overall occupant comfort due to the wind chill effect of moving air.

---

<sup>4</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.

### **AC System Evaporator/Condenser Coil Cleaning**

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

### **Boiler Maintenance**

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely and efficiently. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the boiler sections to improve heat transfer.

### **Label HVAC Equipment**

For improved coordination in maintenance practices, we recommend labeling or re-labeling the site HVAC equipment. Maintain continuity in labeling by following labeling conventions as indicated in the facility drawings or BAS building equipment list. Use weatherproof or heatproof labeling or stickers for permanence, but do not cover over original equipment nameplates, which should be kept clean and readable whenever possible. Besides equipment, label piping for service and direction of flow when possible. Ideally, maintain a log of HVAC equipment, including nameplate information, asset tag designation, areas served, installation year, service dates, and other pertinent information.

This investment in your equipment will enhance collaboration and communication between your staff and your contracted service providers and may help you with regulatory compliance.


### **Water Heater Maintenance**

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues, and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

## **Plug Load Controls**



Reducing plug loads is a common way to decrease your electrical use. Limiting the energy use of plug loads can include increasing occupant awareness, removing under-used equipment, installing hardware controls, and using software controls. Consider enabling the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips<sup>5</sup>. Your local utility may offer incentives or rebates for this equipment.

## **Water Conservation**



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense® ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense website<sup>6</sup> or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"<sup>7</sup> to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

## **Procurement Strategies**

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR or WaterSense products where available.

---

<sup>5</sup> For additional information refer to "Assessing and Reducing Plug and Process Loads in Office Buildings" <http://www.nrel.gov/docs/fy13osti/54175.pdf>, or "Plug Load Best Practices Guide" <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

<sup>6</sup> <https://www.epa.gov/watersense>.

<sup>7</sup> <https://www.epa.gov/watersense/watersense-work-0>.

## 6 ON-SITE GENERATION

---

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

## 6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has no potential for installing a PV array.

This facility does not appear to meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as sufficient and sustained electric demand and sufficient flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

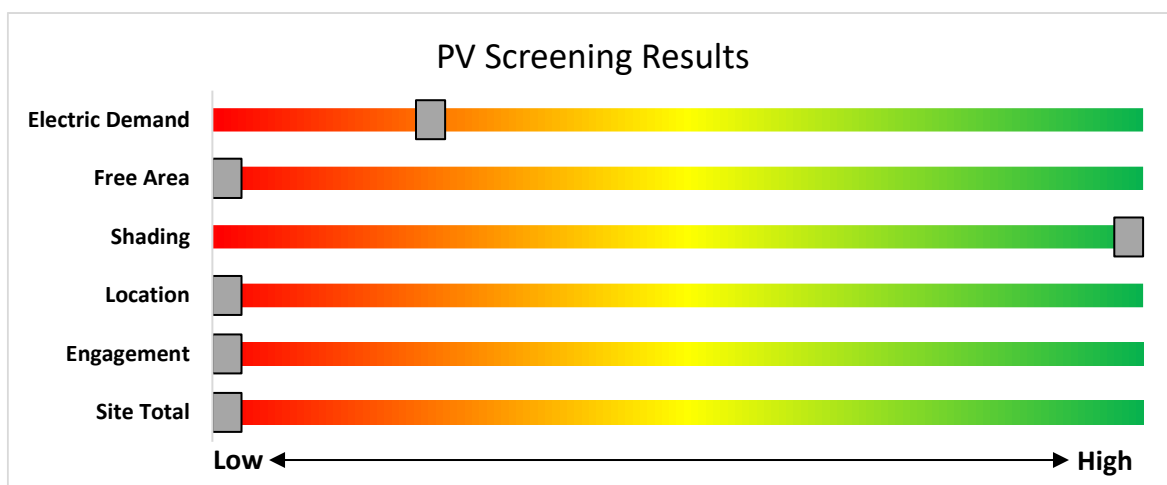


Figure 8 - Photovoltaic Screening

### **Successor Solar Incentive Program (SuSI)**

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners *must* register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

**Successor Solar Incentive Program (SuSI):** <https://www.njcleanenergy.com/renewable-energy/programs/susi-program>

- **Basic Info on Solar PV in NJ:** [www.njcleanenergy.com/whysolar](http://www.njcleanenergy.com/whysolar)
- **NJ Solar Market FAQs:** [www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs](http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs).
- **Approved Solar Installers in the NJ Market:** [www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/?id=60&start=1](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1)

## 6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

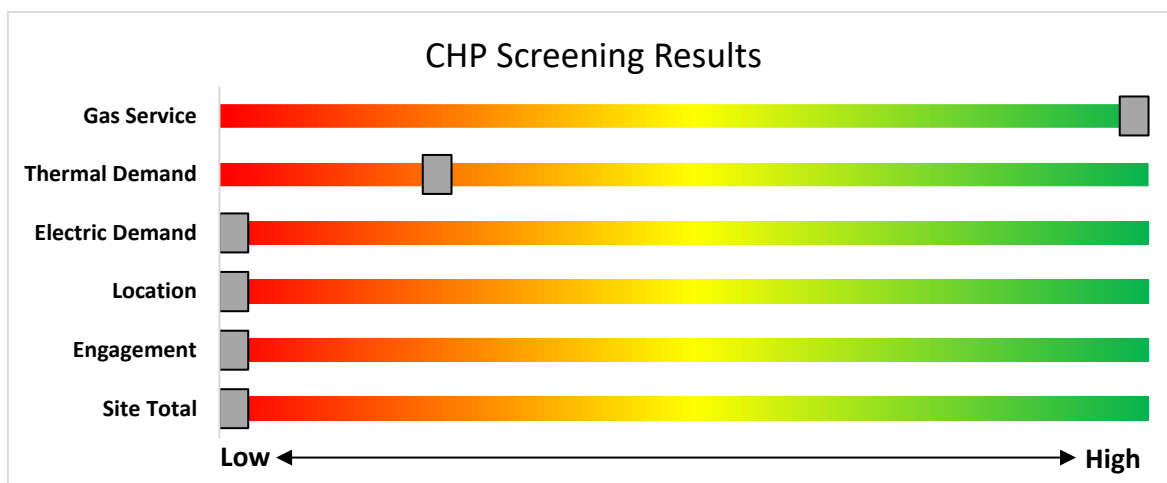


Figure 9 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation:  
[http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/)

## 7 ELECTRIC VEHICLES (EV)

All electric vehicles (EVs) have an electric motor instead of an internal combustion engine. EVs function by plugging into a charge point, taking electricity from the grid, and then storing it in rechargeable batteries. Although electricity production may contribute to air pollution, the U.S. EPA categorizes all-electric vehicles as zero-emission vehicles because they produce no direct exhaust or tailpipe emissions.

EVs are typically more expensive than similar conventional and hybrid vehicles, although some cost can be recovered through fuel savings, federal tax credit, or state incentives.

### 7.1 Electric Vehicle Charging

EV charging stations provide a means for electric vehicle operators to recharge their batteries at a facility. While many EV drivers charge at home, others do not have access to regular home charging, and the ability to charge at work or in public locations is critical to making EVs practical for more drivers. Charging can also be used for electric fleet vehicles, which can reduce fuel and maintenance costs for fleets that replace gas or diesel vehicles with EVs.

EV charging comes in three main types. For this assessment, the screening considers addition of Level 2 charging, which is most common at workplaces and other public locations. Depending on the site type and usage, other levels of charging power may be more appropriate.

The preliminary assessment of EV charging at the facility shows that there is medium potential for adding EV chargers to the facility's parking, based on potential costs of installation and other site factors.

The primary costs associated with installing EV charging are the charger hardware and the cost to extend power from the facility to parking spaces. This may include upgrades to electric panels to serve increased loads.

The type and size of the parking area impact the costs and feasibility of adding EV charging. Parking structure installations can be less costly than surface lot installations as power may be readily available, and equipment and wiring can be surface mounted. Parking lot installations often require trenching through concrete or asphalt surface. Large parking areas provide greater flexibility in charger siting than smaller lots.

The location and capacity of facility electric panels also impact charger installation costs. A Level 2 charger generally requires a dedicated 208-240V, 40 Amp circuit. The electric panel nearest the planned installation may not have available capacity and may need to be upgraded to serve new EV charging loads. Alternatively, chargers could be powered from a more distant panel. The distance from the panel to the location of charging stations ties directly to costs, as conduits, cables, and potential trenching costs all increase on a per-foot basis. The more charging stations planned, the more likely it is that additional electrical capacity will be needed.

Other factors to consider when planning for EV charging at a facility include who the intended users are, how long they park vehicles at the site, and whether they will need to pay for the electricity they use.



The graphic below displays the results of the EV charging assessment conducted as part of this audit. The position of each slider indicates the impact each factor has on the feasibility of installing EV charging at the site.

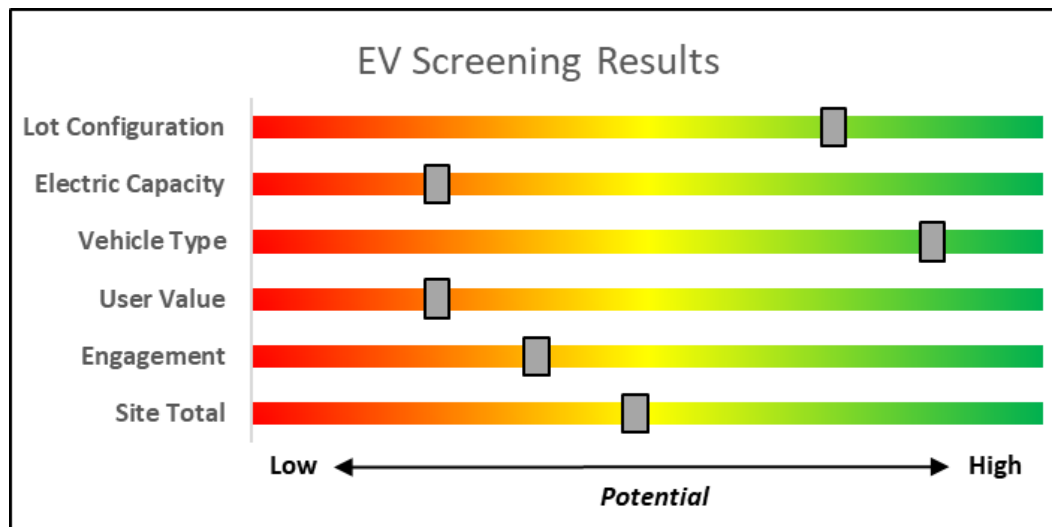


Figure 10 – EV Charger Screening

### Electric Vehicle Programs Available

New Jersey is leading the way on electric vehicle (EV) adoption on the East Coast. There are several programs designed to encourage EV adoption in New Jersey, which is crucial to reaching a 100% clean energy future.

NJCEP offers a variety of EV programs for vehicles, charging stations, and fleets. Certain EV charging stations that receive electric utility service from Atlantic City Electric Company (ACE) or Public Service Electric & Gas Company (PSE&G), may be eligible for additional electric vehicle charging incentives directly from the utility. Projects may be eligible for both the incentives offered by this BPU program and incentives offered by ACE or PSE&G, up to 90% of the combined charger purchase and installation costs. Please check ACE or PSE&G program eligibility requirements before purchasing EV charging equipment, as additional conditions on types of eligible chargers may apply for utility incentives.

Both Jersey Central Power & Light (JCP&L) and Rockland Electric (RECO) have filed proposals for EV charging programs. BPU staff is currently reviewing those proposals.

For more information and to keep up to date on all EV programs please visit <https://www.njcleanenergy.com/commercial-industrial/programs/electric-vehicle-programs>

## 8 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs and Utility Energy Efficiency Programs can help. Pick the program that works best for you. This section provides an overview of currently available incentive programs in.



---

**Program areas to be served by the Utilities:**

- Existing Buildings (residential, commercial, industrial, government)
- Efficient Products
  - HVAC
  - Appliance Rebates
  - Appliance Recycling

**Proposed New Programs & Features:**

- Dedicated multi-family program
- More financing options
- Quick home energy check-ups



---

**Program areas staying with NJCEP:**

- New Construction (residential, commercial, industrial, government)
- Large Energy Users
- Combined Heat & Power & Fuel Cells
- State Facilities
- Local Government Energy Audits
- Energy Savings Improvement Program
- Solar & Community Solar

## 8.1 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey's investor-owned gas and electric utilities to reduce their customers' use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

### **Prescriptive and Custom**

The Prescriptive and Custom rebate program through your utility provider offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

#### **Equipment Examples**

*Lighting*

*Lighting Controls*

*HVAC Equipment*

*Refrigeration*

*Gas Heating*

*Gas Cooling*

*Commercial Kitchen Equipment*

*Food Service Equipment*

*Variable Frequency Drives*

*Electronically Commutate Motors*

*Variable Frequency Drives*

*Plug Loads Controls*

*Washers and Dryers*

*Agricultural*

*Water Heating*

The Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type. The Custom program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives.

### **Direct Install**

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW or less over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls

#### **Incentives**

The program pays up to 70% of the total installed cost of eligible measures.

#### **How to Participate**

To participate in Direct Install, you will work with a participating contractor. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the Direct Install program, subject to program rules and eligibility, while the remaining percent of the cost is paid to the contractor by the customer.

## **Engineered Solutions**

The Engineered Solutions Program provides tailored energy-efficiency assistance and services to municipalities, universities, schools, hospitals and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. Customers receive expert guided services, including investment-grade energy auditing, engineering design, installation assistance, construction administration, commissioning, and measurement and verification (M&V) services to support the implementation of cost-effective and comprehensive efficiency projects. Engineered Solutions is generally a good option for medium to large sized facilities with a peak demand over 200 kW looking to implement as many measures as possible under a single project to achieve deep energy savings. Engineered Solutions has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Incentives for this program are based on project scope and energy savings achieved.

---

For more information on any of these programs, contact your local utility provider or visit <https://www.njcleanenergy.com/transition>.

## 8.2 New Jersey's Clean Energy Programs

Save money while saving the planet! New Jersey's Clean Energy Program is a statewide program that offers incentives, programs, and services that benefit New Jersey residents, businesses, educational, non-profit, and government entities to help them save energy, money, and the environment.

### **Large Energy Users**

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers that annually contribute at least \$200,000 to the NJCEP aggregate of all buildings/sites. This equates to roughly \$5 million in energy costs in the prior fiscal year.

#### **Incentives**

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually

#### **How to Participate**

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEEP). Once the FEEP is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at [www.njcleanenergy.com/LEUP](http://www.njcleanenergy.com/LEUP).

## **Combined Heat and Power**

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

### **Incentives**

Eligible Technologies	Size (Installed Rated Capacity) <sup>1</sup>	Incentive (\$/kW)	% of Total Cost Cap per Project <sup>3</sup>	\$ Cap per Project <sup>3</sup>		
Powered by non-renewable or renewable fuel source <sup>4</sup>	≤500 kW	\$2,000	30-40% <sup>2</sup>	\$2 million		
Gas Internal Combustion Engine	>500 kW - 1 MW	\$1,000				
Gas Combustion Turbine	> 1 MW - 3 MW	\$550	30%	\$3 million		
Microturbine	>3 MW	\$350				
Fuel Cells with Heat Recovery						
Waste Heat to Power*	<1 MW	\$1,000	30%	\$2 million		
	> 1MW	\$500		\$3 million		

\*Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

### **How to Participate**

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at [www.njcleanenergy.com/CHP](http://www.njcleanenergy.com/CHP).

## **Successor Solar Incentive Program (SuSI)**

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two sub-programs. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

### **Administratively Determined Incentive (ADI) Program**

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

Market Segments	Size MW dc	Incentive Value (\$/SREC II)	Public Entities Incentive Value - \$20 Adder (\$/SRECII)
Net Metered Residential	All types and sizes	\$90	N/A
Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects smaller than 1 MW	\$100	\$120
Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects 1 MW to 5 MW	\$90	\$110
Small Net Metered Non-Residential Ground Mount	Projects smaller than 1 MW	\$85	\$105
Large Net Metered Non-Residential Ground Mount	Projects 1 MW to 5 MW	\$80	\$100
LMI Community Solar	Up to 5 MW	\$90	N/A
Non-LMI Community Solar	Up to 5 MW	\$70	N/A
Interim Subsection (t)	All types and sizes	\$100	N/A

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations.

### **Competitive Solar Incentive Program**

The Competitive Solar Incentive (CSI) Program will provide competitively set incentives for grid supply projects and net metered non-residential projects greater than 5MW (dc). The program is currently under development. For updates, please continue to check the [Solar Proceedings](#) page on the New Jersey's Clean Energy Program website.

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state's Energy Master Plan.

If you are considering installing solar photovoltaics on your building, visit the following link for more information: <https://njcleanenergy.com/renewable-energy/programs/susi-program>.

## **Energy Savings Improvement Program**

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter into contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

### **How to Participate**

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.


After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at [www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

*ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.*

## 9 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

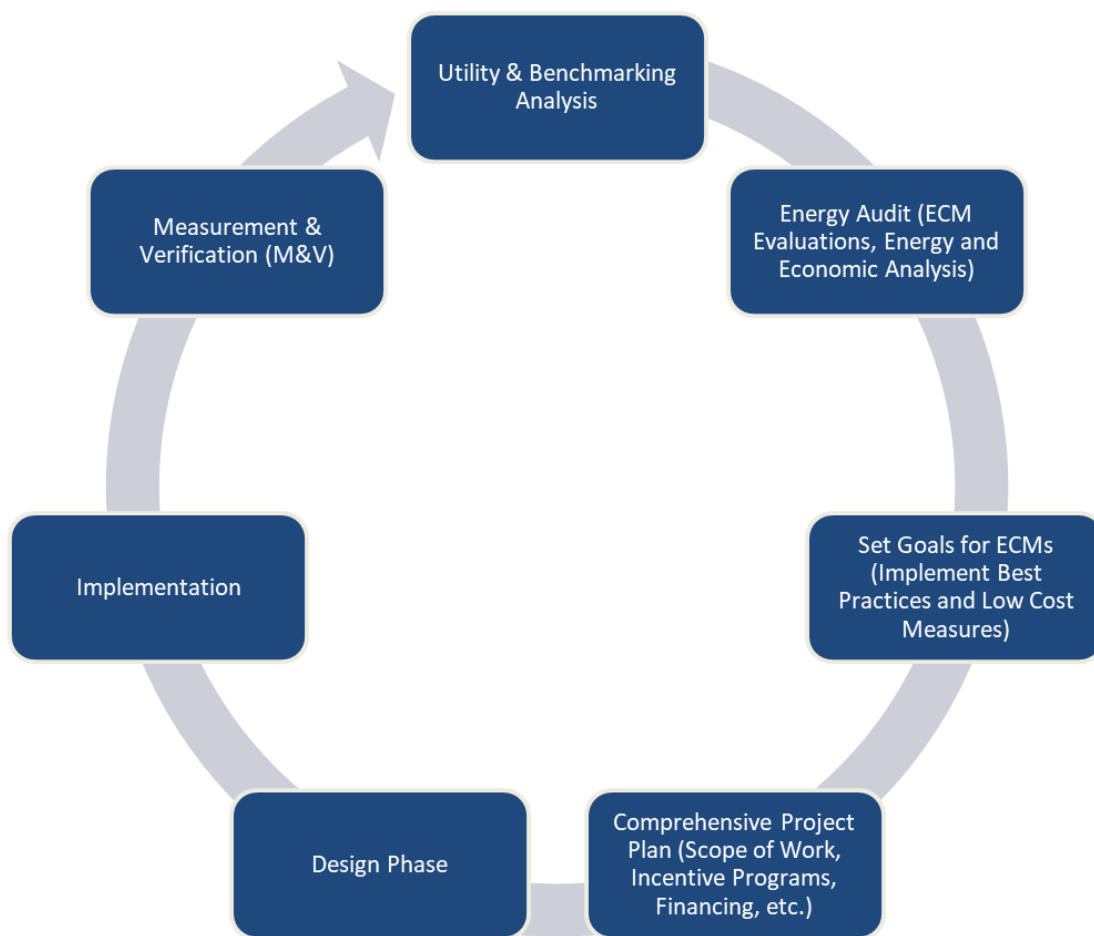

*Figure 11 – Project Development Cycle*

## 10 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 10.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website<sup>8</sup>.

### 10.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website<sup>9</sup>.

---

<sup>8</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

<sup>9</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).



APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Cafeteria	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Cafeteria	24	LED Lamps: (1) 15W A19 Screw-In Lamp	Wall Switch	S	15	1,950	2	None	Yes	24	LED Lamps: (1) 15W A19 Screw-In Lamp	Occupancy Sensor	15	1,346	0.1	239	0	\$50	\$540	\$70	9.4
Cafeteria	0	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	1,950	1, 2	Relamp	Yes	0	LED - Linear Tubes: (4) 2' Lamps	Occupancy Sensor	34	1,346	0.0	0	0	\$0	\$0	\$0	0.0
Cafeteria	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,950	1, 2	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,346	0.1	317	0	\$66	\$262	\$60	3.1
Dental clinic	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Dental clinic	2	LED Lamps: (1) 10W A19 Screw-In Lamp	Wall Switch	S	10	1,950	2	None	Yes	2	LED Lamps: (1) 10W A19 Screw-In Lamp	Occupancy Sensor	10	1,346	0.0	13	0	\$3	\$116	\$20	34.7
Dental clinic	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	1,950	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,346	0.0	91	0	\$19	\$181	\$32	7.8
Dental clinic	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,950	1	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	1,950	0.1	120	0	\$25	\$73	\$20	2.1
Elevator room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,950	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,950	0.0	71	0	\$15	\$37	\$10	1.8
Exterior 1	4	LED Lamps: (1) 10W A19 Screw-In Lamp	Timeclock		10	4,380		None	No	4	LED Lamps: (1) 10W A19 Screw-In Lamp	Timeclock	10	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior 1	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell		18	4,380		None	No	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	18	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Family success lobby	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,950	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,346	0.1	180	0	\$38	\$189	\$40	4.0
Family success offices	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Family success offices	9	LED Lamps: (1) 10W A19 Screw-In Lamp	Wall Switch	S	10	2,080	2	None	Yes	9	LED Lamps: (1) 10W A19 Screw-In Lamp	Occupancy Sensor	10	1,435	0.0	64	0	\$13	\$270	\$35	17.7
Family success offices	5	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,080	1, 2	Relamp	Yes	5	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,435	0.1	243	0	\$51	\$433	\$65	7.3
Family success offices	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	1	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,080	0.1	128	0	\$27	\$73	\$20	2.0
Game room	3	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	8,760	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	6,044	0.1	615	0	\$128	\$368	\$53	2.5
Game room	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	1, 2	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.2	508	0	\$106	\$489	\$95	3.7
Main hallway	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Main hallway	5	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,080	1, 2	Relamp	Yes	5	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,435	0.1	243	0	\$51	\$433	\$65	7.3
Main hallway	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	1	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,080	0.1	128	0	\$27	\$73	\$20	2.0
Mechanical 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,080	1, 2	Relamp	Yes	2	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,435	0.0	101	0	\$21	\$153	\$30	5.8
Restroom - Female 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	192	0	\$40	\$189	\$40	3.7
Restroom - Men's 1 (1)	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	192	0	\$40	\$189	\$40	3.7
Restroom - Unisex	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,044	0.1	809	0	\$168	\$189	\$40	0.9



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Restroom - Unisex (1)	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.1	192	0	\$40	\$189	\$40	3.7
Restroom - Unisex 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	76	0	\$16	\$37	\$10	1.7
Stairs	6	LED Lamps: (1) 15W A19 Screw-In Lamp	Wall Switch	S	15	8,760	3	None	Yes	6	LED Lamps: (1) 15W A19 Screw-In Lamp	High/Low Control	15	6,044	0.0	269	0	\$56	\$225	\$210	0.3
Stairs	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	1, 3	Relamp	Yes	1	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,044	0.0	378	0	\$79	\$495	\$45	5.7
Storage 2	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	345	0.1	46	0	\$10	\$189	\$40	15.5
Storage 3	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	1, 2	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	345	0.2	92	0	\$19	\$416	\$75	17.7
Storage 4	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	18	0	\$4	\$37	\$10	7.0
Parking Lot	3	LED Lamps: Pole mounted lantern style fixture	Timeclock		30	4,380		None	No	3	LED Lamps: Pole mounted lantern style fixture	Timeclock	30	4,380	0.0	0	0	\$0	\$0	\$0	0.0

Motor Inventory & Recommendations

		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Whole Building	1	Exhaust Fan	1.0	82.5%	No			W	2,340		No	82.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Whole Building	2	Exhaust Fan	0.3	72.4%	No			W	2,340		No	72.4%	No		0.0	0	0	\$0	\$0	\$0	0.0
Elevator Room	Whole Building	1	Other	30.0	92.4%	No			W	100		No	92.4%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Rooftop Unit Supply fan	2	Supply Fan	1.5	86.5%	No			W	2,431		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical Room	Whole Building	2	Heating Hot Water Pump	0.8	81.8%	No			W	1,161		No	81.8%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical Room	Whole Building	1	Combustion Air Fan	0.3	70.5%	No	Baldor Reliance		W	1,161		No	70.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Ceiling space	Vairious	2	Supply Fan	1.0	72.6%	No	<not visible>	<not visible>	W	2,431		No	72.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Ceiling space	Vairious	2	Supply Fan	1.5	82.6%	No	<not visible>	<not visible>	W	2,431		No	82.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Ceiling space	Vairious	1	Supply Fan	5.0	84.0%	No	<not visible>	<not visible>	W	2,431		No	84.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Whole Building	5	Exhaust Fan	0.5	72.6%	No	<not visible>	<not visible>	W	2,340		No	72.6%	No		0.0	0	0	\$0	\$0	\$0	0.0



Packaged HVAC Inventory & Recommendations

		Existing Conditions									Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Whole Building	2	Split-System	4.00		9.00		Rheem	RAKA-048JAZ	B	4	Yes	2	Split-System	4.00		16.00		2.3	3,500	0	\$739	\$14,830	\$840	18.9
Roof	Whole Building	2	Split-System	3.00		9.00		Rheem	RAKA-037JAZ	B	4	Yes	2	Split-System	3.00		16.00		1.8	2,625	0	\$554	\$11,034	\$630	18.8
Roof	Whole Building	1	Package Unit	6.00		10.00		ICP	ACA240HBA	B	4	Yes	1	Package Unit	6.00		14.00		1.0	1,543	0	\$326	\$8,645	\$474	25.1
Roof	Whole Building	1	Split-System	10.00		9.00		Rheem		B	4	Yes	1	Split-System	10.00		14.00		2.4	3,571	0	\$754	\$15,894	\$790	20.0

Space Heating Boiler Inventory & Recommendations

		Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Output Capacity per Unit (MBh)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Whole Building	1	Non-Condensing Hot Water Boiler	325	Weil-McLain		W	5	Yes	1	Non-Condensing Hot Water Boiler	325	85.00%	Et	0.0	0	27	\$386	\$12,947	\$569	32.0

DHW Inventory & Recommendations

		Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Manufacturer	Model	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Whole Building	1	Tankless Water Heater	Navian	NR 120	W		No						0.0	0	0	\$0	\$0	\$0	0.0

### Low-Flow Device Recommendations

Recommendation Inputs						Energy Impact & Financial Analysis						
Location	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Cafeteria	6	1	Faucet Aerator (Lavatory)	1.50	0.50	0.0	0	0	\$4	\$7	\$4	0.9
Dental clinic	6	7	Faucet Aerator (Lavatory)	1.50	0.50	0.0	0	2	\$28	\$50	\$25	0.9
Family success offices	6	1	Faucet Aerator (Lavatory)	1.00	0.50	0.0	0	0	\$2	\$7	\$4	1.8
Game room	6	1	Faucet Aerator (Lavatory)	1.50	0.50	0.0	0	0	\$4	\$7	\$4	0.9
Main hallway	6	1	Faucet Aerator (Lavatory)	1.50	0.50	0.0	0	0	\$4	\$7	\$4	0.9
Restroom - Female 1	6	2	Faucet Aerator (Lavatory)	1.00	0.50	0.0	0	0	\$4	\$14	\$7	1.8
Restroom - Men's 1 (1)	6	2	Faucet Aerator (Lavatory)	1.00	0.50	0.0	0	0	\$4	\$14	\$7	1.8
Restroom - Unisex	6	2	Faucet Aerator (Lavatory)	1.00	0.50	0.0	0	0	\$4	\$14	\$7	1.8
Restroom - Unisex (1)	6	2	Faucet Aerator (Lavatory)	1.00	0.50	0.0	0	0	\$4	\$14	\$7	1.8
Restroom - Unisex 2	6	1	Faucet Aerator (Lavatory)	1.00	0.50	0.0	0	0	\$2	\$7	\$4	1.8

### Commercial Refrigerator/Freezer Inventory & Recommendations

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Refrigerator/ Freezer Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Stand-Up Freezer, Solid Door (16 - 30 cu. ft.)	Traulson	G12011	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Stand-Up Refrigerator, Solid Door (31 - 50 cu. ft.)	Hobart	Q2	No		No	0.0	0	0	\$0	\$0	\$0	0.0

### Commercial Ice Maker Inventory & Recommendations

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Ice Maker Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Self-Contained Unit (<175 lbs/day), Batch	Manitowac	UDF0140A	No		No	0.0	0	0	\$0	\$0	\$0	0.0



**Cooking Equipment Inventory & Recommendations**


Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Equipment Type	Manufacturer	Model	High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Gas Rack Oven (Single)	Vulcan		No		No	0.0	0	0	\$0	\$0	\$0	0.0

**Vending Machine Inventory & Recommendations**

Existing Conditions		Proposed Conditions		Energy Impact & Financial Analysis							
Location	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Game room	1	Refrigerated	7	Yes	0.2	1,612	0	\$340	\$230	\$50	0.5
Main hallway	1	Refrigerated	7	Yes	0.2	1,612	0	\$340	\$230	\$50	0.5

## APPENDIX B: ENERGY STAR STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.



# ENERGY STAR® Statement of Energy Performance

## N/A

**ENERGY STAR®  
Score<sup>1</sup>**

### Hammonton Human Services

**Primary Property Type:** Other - Public Services  
**Gross Floor Area (ft²):** 15,500  
**Built:** 1980

**For Year Ending:** November 30, 2021  
**Date Generated:** May 31, 2023

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
<b>Property Address</b> Hammonton Human Services 310 Bellevue Avenue Hammonton, New Jersey 8037	<b>Property Owner</b> Atlantic County 1227 Drexel Avenue Atlantic City, NJ 08401 (609) 343-2284	<b>Primary Contact</b> Jerry Griffin 1227 Drexel Avenue Atlantic City, NJ 08401 (609) 343-2284 griffin_jerry@aclink.org	
<b>Property ID:</b> 23954919			

Energy Consumption and Energy Use Intensity (EUI)			
<b>Site EUI</b> 49.9 kBtu/ft²	<b>Annual Energy by Fuel</b>	<b>National Median Comparison</b>	
	Electric - Grid (kBtu) 295,999 (38%)	National Median Site EUI (kBtu/ft²)	51.9
	Natural Gas (kBtu) 477,440 (62%)	National Median Source EUI (kBtu/ft²)	89.3
		% Diff from National Median Source EUI	-4%
<b>Source EUI</b> 85.8 kBtu/ft²		<b>Annual Emissions</b>	
		Total (Location-Based) GHG Emissions (Metric Tons CO2e/year)	58

### Signature & Stamp of Verifying Professional

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**Licensed Professional**

\_\_\_\_\_  
( ) - \_\_\_\_\_  
\_\_\_\_\_



**Professional Engineer or Registered  
Architect Stamp  
(if applicable)**

## APPENDIX C: GLOSSARY

TERM	DEFINITION
<b>Blended Rate</b>	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
<b>Btu</b>	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
<b>CHP</b>	<i>Combined heat and power</i> . Also referred to as cogeneration.
<b>COP</b>	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
<b>Demand Response</b>	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
<b>DCV</b>	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
<b>US DOE</b>	<i>United States Department of Energy</i>
<b>EC Motor</b>	<i>Electronically commutated motor</i>
<b>ECM</b>	<i>Energy conservation measure</i>
<b>EER</b>	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
<b>EUI</b>	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
<b>Energy Efficiency</b>	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
<b>ENERGY STAR</b>	ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA.
<b>EPA</b>	<i>United States Environmental Protection Agency</i>
<b>Generation</b>	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
<b>GHG</b>	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
<b>gpf</b>	<i>Gallons per flush</i>

<b>gpm</b>	<i>Gallon per minute</i>
<b>HID</b>	<i>High intensity discharge</i> : high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
<b>hp</b>	<i>Horsepower</i>
<b>HPS</b>	<i>High-pressure sodium</i> : a type of HID lamp.
<b>HSPF</b>	<i>Heating seasonal performance factor</i> : a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
<b>HVAC</b>	<i>Heating, ventilating, and air conditioning</i>
<b>IHP 2014</b>	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
<b>IPLV</b>	<i>Integrated part load value</i> : a measure of the part load efficiency usually applied to chillers.
<b>kBtu</b>	One thousand British thermal units
<b>kW</b>	<i>Kilowatt</i> : equal to 1,000 Watts.
<b>kWh</b>	<i>Kilowatt-hour</i> : 1,000 Watts of power expended over one hour.
<b>LED</b>	<i>Light emitting diode</i> : a high-efficiency source of light with a long lamp life.
<b>LGEA</b>	<i>Local Government Energy Audit</i>
<b>Load</b>	The total power a building or system is using at any given time.
<b>Measure</b>	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
<b>MH</b>	<i>Metal halide</i> : a type of HID lamp.
<b>MBh</b>	<i>Thousand Btu per hour</i>
<b>MBtu</b>	<i>One thousand British thermal units</i>
<b>MMBtu</b>	<i>One million British thermal units</i>
<b>MV</b>	<i>Mercury Vapor</i> : a type of HID lamp.
<b>NJBPU</b>	<i>New Jersey Board of Public Utilities</i>
<b>NJCEP</b>	<i>New Jersey's Clean Energy Program</i> : NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment.
<b>psig</b>	Pounds per square inch gauge
<b>Plug Load</b>	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
<b>PV</b>	<i>Photovoltaic</i> : refers to an electronic device capable of converting incident light directly into electricity (direct current).

<b>SEER</b>	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
<b>SEP</b>	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR Portfolio Manager.
<b>Simple Payback</b>	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
<b>SREC (II)</b>	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
<b>T5, T8, T12</b>	A reference to a linear lamp diameter. The number represents increments of 1/8 <sup>th</sup> of an inch.
<b>Temperature Setpoint</b>	The temperature at which a temperature regulating device (thermostat, for example) has been set.
<b>therm</b>	100,000 Btu. Typically used as a measure of natural gas consumption.
<b>tons</b>	A unit of cooling capacity equal to 12,000 Btu/hr.
<b>Turnkey</b>	Provision of a complete product or service that is ready for immediate use.
<b>VAV</b>	<i>Variable air volume</i>
<b>VFD</b>	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
<b>WaterSense®</b>	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
<b>Watt (W)</b>	Unit of power commonly used to measure electricity use.