



Local Government Energy Audit Report

Hillside Avenue School

July 23, 2024

Prepared for:

Cranford Public Schools
125 Hillside Avenue
Cranford, New Jersey 07016

Prepared by:

TRC
317 George Street
New Brunswick, New Jersey 08901



Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based on previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2024 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product, or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks, or copyrights.

Table of Contents

1	Executive Summary	1
1.1	Planning Your Project.....	4
	Pick Your Installation Approach	4
	Options from Your Utility Company.....	4
	Options from New Jersey's Clean Energy Program	5
2	Existing Conditions	6
2.1	Site Overview	6
2.2	Building Occupancy.....	6
2.3	Building Envelope.....	6
2.4	Lighting Systems.....	7
2.5	Air Handling Systems	9
	Unit Ventilators.....	9
	Unitary Electric HVAC Equipment	9
	Air Handling Units (AHUs)	9
2.6	Heating Hot Water Systems.....	11
2.7	Chilled Water Systems	12
2.8	Building Automation System (BAS).....	13
2.9	Domestic Hot Water	13
2.10	Food Service Equipment	14
2.11	Refrigeration	15
2.12	Plug Load and Vending Machines	15
2.13	Water-Using Systems.....	16
3	Energy and Water Use and Costs.....	17
3.1	Electricity.....	19
3.2	Natural Gas	20
3.3	Water	21
3.4	Benchmarking	23
	Tracking your Energy Performance.....	24
3.5	Understanding Your Utility Bills	25
4	Energy Conservation Measures	26
4.1	Lighting.....	29


ECM 1: Retrofit Fixtures with LED Lamps.....	29
4.2 Lighting Controls	29
ECM 2: Install Occupancy Sensor Lighting Controls.....	30
ECM 3: Install High/Low Lighting Controls.....	30
4.3 Variable Frequency Drives (VFD)	31
ECM 4: Install VFDs on Constant Volume (CV) Fans	31
ECM 5: Install VFDs on Chilled Water Pumps	31
ECM 6: Install VFDs on Heating Water Pumps.....	32
4.4 Unitary HVAC	32
ECM 7: Install High Efficiency Air Conditioning Units	32
4.5 Gas-Fired Heating.....	32
ECM 8: Install High Efficiency Hot Water Boilers.....	32
4.6 HVAC Improvements.....	33
ECM 9: Implement Demand Control Ventilation (DCV).....	33
ECM 10: Install Pipe Insulation	34
4.7 Domestic Water Heating.....	34
ECM 11: Install Low-Flow DHW Devices	34
4.8 Food Service and Refrigeration Measures	35
ECM 12: Refrigerator/Freezer Case Electrically Commutated Motors	35
ECM 13: Refrigeration Controls	35
4.9 Measures for Future Consideration.....	35
Upgrade/Replace Building Automation System	36
Upgrade to a Heat Pump System.....	36
Replacing vs. Repairing a Built-up Air Handler	37
5 Energy Efficient Best Practices.....	39
Energy Tracking with ENERGY STAR Portfolio Manager	39
Lighting Maintenance	39
Motor Maintenance	39
Economizer Maintenance	39
Chiller Maintenance.....	40
HVAC Filter Cleaning and Replacement.....	40
Ductwork Maintenance	40
Boiler Maintenance.....	40
Optimize HVAC Equipment Schedules	41

Water Heater Maintenance	41
Compressed Air System Maintenance	41
Refrigeration Equipment Maintenance	42
Plug Load Controls	42
Procurement Strategies	42
6 Water Best Practices.....	43
Getting Started.....	43
Leak Detection and Repair	43
Toilets and Urinals	43
Faucets and Showerheads	44
Commercial Kitchen Equipment	45
7 On-Site Generation.....	46
7.1 Solar Photovoltaic	47
7.2 Combined Heat and Power	49
8 Electric Vehicles.....	50
8.1 EV Charging	50
9 Project Funding and Incentives	52
9.1 New Jersey's Clean Energy Program	53
9.2 Utility Energy Efficiency Programs	60
10 Project Development.....	62
11 Energy Purchasing and Procurement Strategies	63
11.1 Retail Electric Supply Options	63
11.2 Retail Natural Gas Supply Options	63
Appendix A: Equipment Inventory & Recommendations	A-1
Appendix B: ENERGY STAR Statement of Energy Performance.....	B-1
Appendix C: Glossary	C-1

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Hillside Avenue School. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.


BUILDING PERFORMANCE REPORT

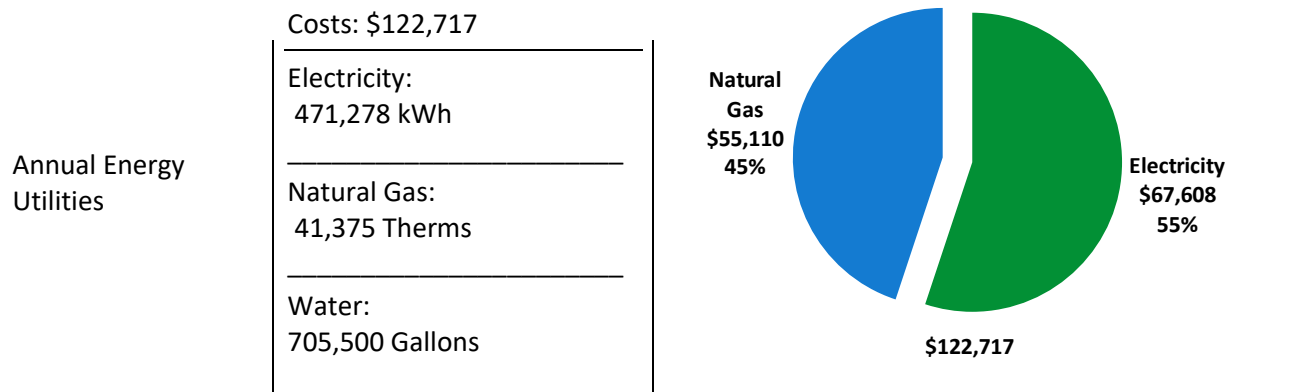

ENERGY STAR®
Benchmarking Score

70
(1-100 scale)

Congratulations, your building performs better than the national average. This report has suggestions about how to keep your building running efficiently, further improve performance, and lower your energy bills even more.

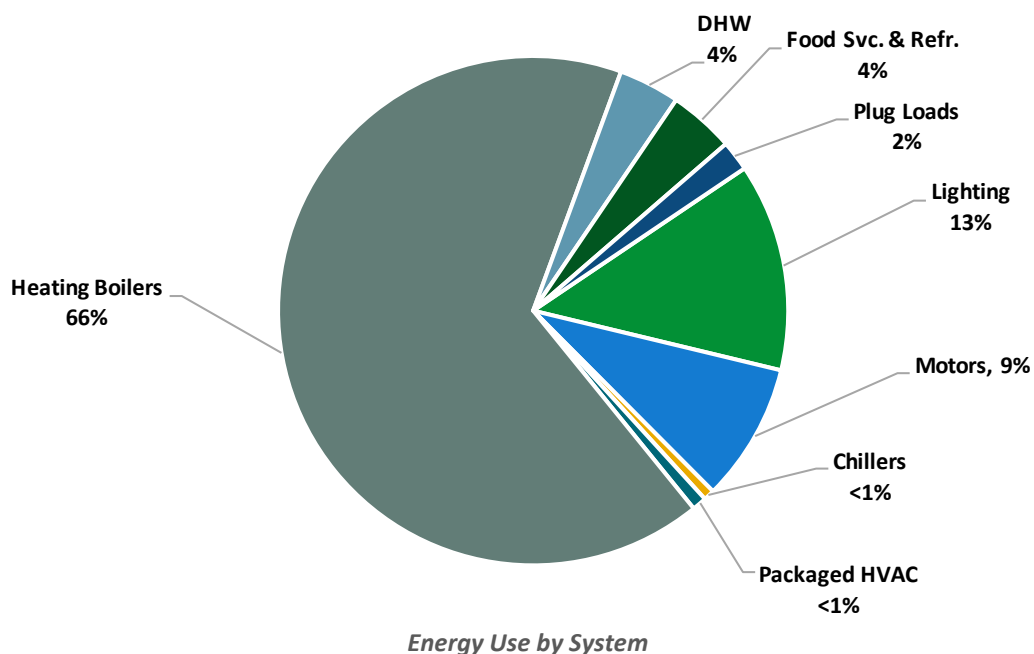


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (All Evaluated Measures)

Installation Cost	\$707,170
Potential Rebates & Incentives ¹	\$46,400
Annual Cost Savings	\$33,716
Annual Energy Savings	Electricity: 202,572 kWh Natural Gas: 3,495 Therms
Greenhouse Gas Emission Savings	122 Tons
Simple Payback	19.6 Years
Site Energy Savings (All Utilities)	18%

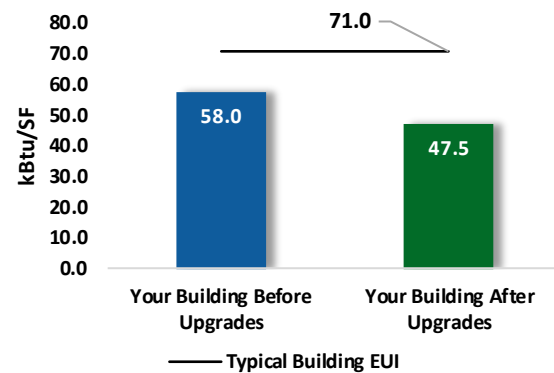

Scenario 2: Cost Effective Package²

Installation Cost	\$116,150
Potential Rebates & Incentives	\$23,140
Annual Cost Savings	\$22,700
Annual Energy Savings	Electricity: 159,267 kWh Natural Gas: -111 Therms
Greenhouse Gas Emission Savings	80 Tons
Simple Payback	4.1 Years
Site Energy Savings (all utilities)	9%

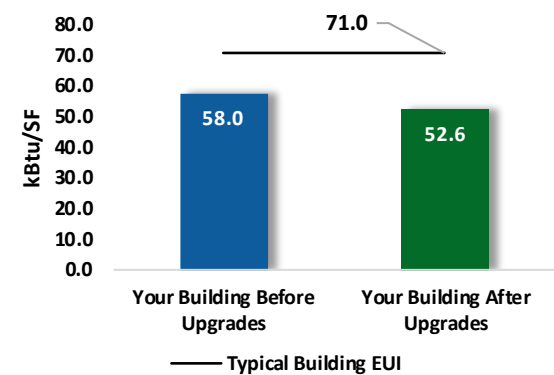

On-site Generation Potential

Photovoltaic	High
Combined Heat and Power	None

¹ Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			123,652	31.6	-26	\$17,394	\$68,020	\$13,530	\$54,490	3.1	121,489
ECM 1	Retrofit Fixtures with LED Lamps	Yes	123,652	31.6	-26	\$17,394	\$68,020	\$13,530	\$54,490	3.1	121,489
Lighting Control Measures			34,706	8.9	-7	\$4,882	\$46,640	\$9,400	\$37,240	7.6	34,099
ECM 2	Install Occupancy Sensor Lighting Controls	Yes	30,612	8.0	-6	\$4,306	\$39,600	\$4,420	\$35,180	8.2	30,077
ECM 3	Install High/Low Lighting Controls	Yes	4,094	0.9	-1	\$576	\$7,040	\$4,980	\$2,060	3.6	4,022
Variable Frequency Drive (VFD) Measures			39,207	10.5	0	\$5,624	\$236,700	\$4,500	\$232,200	41.3	39,481
ECM 4	Install VFDs on Constant Volume (CV) Fans	No	10,719	6.2	0	\$1,538	\$36,600	\$1,800	\$34,800	22.6	10,794
ECM 5	Install VFDs on Chilled Water Pumps	No	1,886	0.5	0	\$271	\$8,400	\$100	\$8,300	30.7	1,899
ECM 6	Install VFDs on Heating Water Pumps	No	26,602	3.8	0	\$3,816	\$191,700	\$2,600	\$189,100	49.6	26,788
Unitary HVAC Measures			2,419	1.4	0	\$347	\$12,000	\$0	\$12,000	34.6	2,435
ECM 7	Install High Efficiency Air Conditioning Units	No	2,419	1.4	0	\$347	\$12,000	\$0	\$12,000	34.6	2,435
Gas Heating (HVAC/Process) Replacement			0	0.0	337	\$4,490	\$323,700	\$18,600	\$305,100	68.0	39,470
ECM 8	Install High Efficiency Hot Water Boilers	No	0	0.0	337	\$4,490	\$323,700	\$18,600	\$305,100	68.0	39,470
HVAC System Improvements			0	0.0	39	\$517	\$14,770	\$40	\$14,730	28.5	4,547
ECM 9	Implement Demand Control Ventilation (DCV)	No	0	0.0	24	\$313	\$14,500	\$0	\$14,500	46.3	2,754
ECM 10	Install Pipe Insulation	Yes	0	0.0	15	\$204	\$270	\$40	\$230	1.1	1,792
Domestic Water Heating Upgrade			0	0.0	7	\$89	\$100	\$50	\$50	0.6	784
ECM 11	Install Low-Flow DHW Devices	Yes	0	0.0	7	\$89	\$100	\$50	\$50	0.6	784
Food Service & Refrigeration Measures			2,589	0.2	0	\$371	\$5,240	\$280	\$4,960	13.4	2,607
ECM 12	Refrigerator/Freezer Case Electrically Commutated Motors	Yes	909	0.1	0	\$130	\$1,120	\$120	\$1,000	7.7	916
ECM 13	Refrigeration Controls	No	1,680	0.0	0	\$241	\$4,120	\$160	\$3,960	16.4	1,692
TOTALS (COST EFFECTIVE MEASURES)			159,267	40.7	-11	\$22,700	\$116,150	\$23,140	\$93,010	4.1	159,081
TOTALS (ALL MEASURES)			202,572	52.6	350	\$33,716	\$707,170	\$46,400	\$660,770	19.6	244,913

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

All Evaluated Energy Improvements³

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

³ TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations.

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decision to make, such as:

- ◆ How will the project be funded/and or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

Utility-run energy efficiency programs and New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives *before* purchasing materials or starting installation.

Options from Your Utility Company

Prescriptive and Custom Rebates

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the Prescriptive and Custom Rebates program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval may be required for some incentives. Contact your utility company for more details prior to project installation.

Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized contractor. This program can provide incentives up to 70% or 80% of the cost of selected measures. A Direct Install contractor will assess and verify individual measure eligibility and perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Engineered Solutions

The Engineered Solutions program provides tailored energy-efficiency assistance and turnkey engineering services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. The program provides all professional services from audit, design, construction administration, to commissioning and measurement and verification for custom whole-building energy-efficiency projects. Engineered Solutions allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs.

For more details on these programs please contact your utility provider.

Options from New Jersey's Clean Energy Program

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is *required to participate in ESIP*.

Resiliency with Return on Investment through Combined Heat and Power (CHP)

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Successor Solar Incentive Program (SuSI)

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

Large Energy User Program (LEUP)

LEUP is designed to promote self-investment in energy efficiency for the largest energy consumers in the state. Customers in this category spend about \$5 million a year on energy bills. This program incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

For more details on these programs please visit [New Jersey's Clean Energy Program website](http://www.njcleanenergy.com).



2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) report for Hillside Avenue School. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On February 28, 2024, TRC performed an energy audit at Hillside Avenue School located in Cranford, New Jersey. TRC met with Mario Cunha to review the facility operations and help focus our investigation on specific energy-using systems.

Hillside Avenue School is a 1-story, 99,070 square foot building built in 1961. Spaces include classrooms, gymnasium, auditorium, offices, cafeteria, corridors, a commercial kitchen, and a mechanical space.

Recent Improvements and Facility Concerns

Over the last ten years, the facility has replaced all its existing T12 fluorescent fixtures with T8 fluorescent fixtures. Facility staff is interested in a new BAS to combine the control logic. Facility concerns include high energy bills and evaluation of BAS.

2.2 Building Occupancy

The facility is occupied Monday through Friday during regular business hours. Janitorial services are performed after hours.

The school is fully occupied from September through June. Typical weekday occupancy is 123 staff and 724 students. Summer occupancy includes continuing maintenance activities. There are no weekend activities.

The facility is occupied intermittently, as needed for maintenance and operations.

Building Name	Weekday/Weekend	Operating Schedule
Hillside Avenue School Class Hours	Weekday	8:00 AM - 3:00 PM
	Weekend	Closed
Hillside Avenue School Custodian Hours	Weekday	7:00 AM - 11:00 PM
	Weekend	Closed

Building Occupancy Schedule

2.3 Building Envelope

Building walls are concrete block over structural steel with a brick facade. The roof is mainly flat and covered with white membrane, and it is in fair condition. The roof over the gym is sloped.

The windows are double paned and have aluminum frames. The glass-to-frame seals are in fair condition. The operable window weather seals are in fair condition, showing little evidence of excessive wear. Exterior doors have aluminum frames and are in good condition with undamaged door seals.



Façade



Windows



Roof



Main Door

2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. Fixture types include 1- 2- 3- or 4-lamp, 2-foot and 4-foot-long surface mounted fixtures. Typically, T8 fluorescent lamps use electronic ballasts. Additionally, some areas in the school have compact fluorescent lamps (CFL) and a few have LED fixtures.

High bay gymnasium fixtures mainly incorporate 4-foot T8 linear fluorescent lamps.

All exit signs are LED units. Most fixtures are in fair condition. Interior lighting levels were generally sufficient.

Interior lighting fixtures are controlled by manual wall switches.



Classroom T8 fixtures



Corridor T8 fixtures



Auditorium recessed fixtures



Locker room linear fixtures

Exterior fixtures include LED pole light fixtures illuminating roadways and parking lots. These fixtures are controlled by a timeclock.



Exterior Pole light fixture

2.5 Air Handling Systems

Unit Ventilators

Unit ventilators provide heating and ventilation to classrooms and office areas. They are equipped with fractional hp supply fan motors, pneumatic controlled outside air dampers, and heating valves connected to the hot-water distribution system. The office area unit ventilators also provide cooling from the chilled water loop. This system appears to be in poor operating condition. The age of the system could not be verified during our site visit.

Unitary Electric HVAC Equipment

Some classrooms and faculty rooms are cooled with window air conditioning (AC) units. Based on visual inspection, the units are in fair condition and vary in capacity. The capacity of the units could not be verified during the time of our site visit, but they are assumed to average approximately 1.0 ton per unit. Some of the window AC units are ENERGY STAR certified.



Typical window AC unit

Air Handling Units (AHUs)

The facility is heated and ventilated by six air-handling units, each equipped with a supply fan and hot water coil. Units HV-1 and HV-2 are located in the roof level mechanical room, unit HV-3 is located in the gym storage room, unit HV-4 is ceiling hung in the boiler room, and units HV-5 and HV-6 are located above the stage on either side of the auditorium. HV-3 is configured as a 100% outside air unit and the other units are generally configured to provide outside air and return air with HV-1 and HV-2 sharing a common return fan. These are heating only units, and the heat source is provided by the hot water boiler.

- HV-1 and HV-3 serve the Gymnasium.
- HV-2 serves the Locker Room.
- HV-4 serves the Cafeteria.
- HV-5 and HV-6 serve the Auditorium.

HV-1 and HV-2 are equipped with a 7.5-hp and 1.5-hp, constant speed standard efficiency supply fan motors respectively, and the common return fan is a 5.0-hp constant speed standard efficiency motor located in the roof level mechanical room.

HV-3 is equipped with a 2.0-hp, constant speed standard efficiency supply fan motor.

HV-4 is equipped with a 3.0-hp, constant speed standard efficiency supply fan motor. This unit is in the boiler room and is not equipped with a return fan.

HV-5 and HV-6 are each equipped with a 3-hp, constant speed standard efficiency supply fan motor, and the return fans use 2.0-hp constant speed standard efficiency motors located in the auditorium.

Per the facility, the HVAC systems are controlled by the facility BAS. The audit team had a limited view of BAS functionality and was unable to confirm the control points for these units. Facility staff also indicated that several of the units were not running, including supply and return fans for HV-5 and the HV-2 supply fan. After further investigation of the units, the audit team discovered that HV-5 had been turned off by the facility and HV-2 had a broken fan belt. We recommend troubleshooting these units so that ventilation is provided as per the system design. Operating these units will increase energy use overall.



Cafeteria HV-4 unit



Auditorium HV-5 unit



Gymnasium HV-3 unit

2.6 Heating Hot Water Systems

Five Aerco 1,695 MBh output capacity condensing hot water boilers serve the building heating load. Based on recent combustion test reports, the boiler efficiency was measured to average 84.75 percent. The boilers are configured in an automated control scheme. Per our discussion with the facility staff, the facility operates multiple boilers under low load condition to get the best efficiency output from the boilers. Installed in 2010, they are in good condition. There is a service contract in place.

The boilers are configured in a constant flow primary distribution with two 20 hp constant speed hot water pumps operating with an automated lead-lag control scheme. The hydronic distribution system is a 2-pipe heating only system except for the office.

Unit ventilators located in the office are equipped to provide cooling during summer season. A separate 2 hp dual temperature pump circulates hot water and chilled water to these units using the same 2-pipe system. Seasonal changeover begins in October for the heating season and April for the cooling season.

The hot water loop has a hot water system reset schedule implemented. The boilers reset the hot water temperature from 180°F to 125°F between 10°F and 55°F depending on outside air conditions. Based on information gathered from the BAS during the audit, hot water was being supplied at 129.6°F with a setpoint of 135.9°F.



Hot water boilers



Hot water pumps



Air compressor for pneumatic valves



Unit ventilator

2.7 Chilled Water Systems

The chiller plant consists of a nominal 10-ton Technical Systems, R-22 air-cooled chiller. The chiller is configured in a primary 2-pipe distribution loop with one 2 hp constant speed dual temperature pump. The chiller is turned off from mid-October through March. The chiller supplies chilled water to the office area unit ventilators.

The chiller has an indoor evaporator and an outdoor, remote mounted air-cooled condenser installed on the roof to support heat rejection.



Chiller



Remote condenser




Dual temperature pump

2.8 Building Automation System (BAS)

An ALC BAS controls the boilers, and the air handlers. All other HVAC equipment is subject to local pneumatic based control. The BAS provides very minimal control over scheduling and space temperature.

The site staff expressed an interest in expanding the level of control provided by the BAS, replacing the BAS, and receiving additional training on operating the BAS.

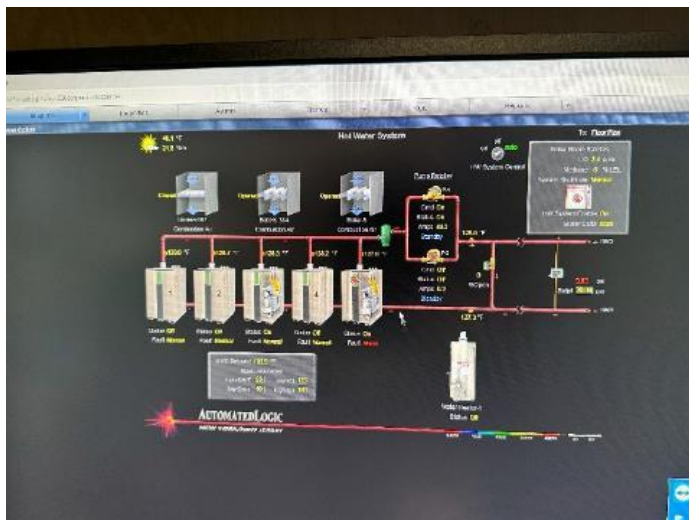

Hot water loop

2.9 Domestic Hot Water

Hot water is produced by one natural gas-fired, non-condensing 750 MBh water heater with an efficiency rating of 85 percent. Hot water produced by the water heater is stored in two storage tanks of approximately 257-gallon storage capacity. At the time of the site visit, the domestic water heater was set at 148°F.

There is one fractional hp circulation pump between the water heater and the storage tank and one other fractional hp circulation pump distributes water to end uses via a building-wide domestic hot water (DHW) loop. An Aquastat control located on the DHW loop prevents the motor from operating continuously. Aquastats have high and low limit temperature controls which trigger the pump operation.

The domestic hot water pipes are partially insulated and some sections of the supply and return line are missing insulation. The insulation is in fair condition.



Gas fired DHW heater



Recirculation pump

2.10 Food Service Equipment

The kitchen has a mix of gas and electric equipment that is used to prepare lunches for students. Most cooking is done using a gas-fired combination griddle and oven. Bulk prepared foods are held in several electric holding cabinets. Equipment is not high efficiency and is in good condition.

The dishwasher is a non-ENERGY STAR high temperature, door type unit.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.



Gas combination griddle and oven



Dishwasher

2.11 Refrigeration

The kitchen has two walk-in refrigerators for food storage. The two walk-in refrigerators have an estimated 1.5 ton and 1.0-ton compressor located above the unit. 1.5-ton refrigerator has two evaporator fan and the 1.0-ton refrigerator has one evaporator fan. There are no existing fan controls. There is also one stand-up refrigerator in the kitchen.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.



Walk-in cooler




Stand-up refrigerator

2.12 Plug Load and Vending Machines

You may wish to consider paying particular attention to minimizing your plug load usage. This report makes suggestions for ECMs in this area as well as energy efficient best practices.

Plug loads include general cafe and office equipment. There are classroom typical loads such as laptops, smart boards, projectors, fans and air purifiers. There are several residential style refrigerators throughout the building.

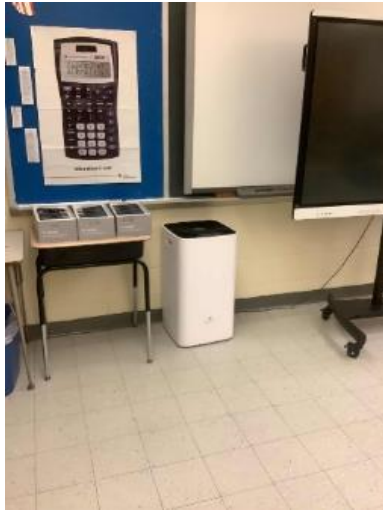

Air purifier



Refrigerator



Smart Board



Desktop

2.13 Water-Using Systems

Water is provided by a municipal water supply company.


Potable water is used for drinking, cleaning, and occasional landscaping. At the time of the site visit, the facility did not report any water leaks.

EPA WaterSense® has set maximum flow rates for sanitary fixtures. They are: 1.28 gallons per flush (gpf) for toilets, 0.5 gpf for urinals, 1.5 gallons per minute (gpm) for lavatory faucets, and 2.0 gpm for showerheads.

3 ENERGY AND WATER USE AND COSTS


Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	471,278 kWh	\$67,608
Natural Gas	41,375 Therms	\$55,110
Total		\$122,717

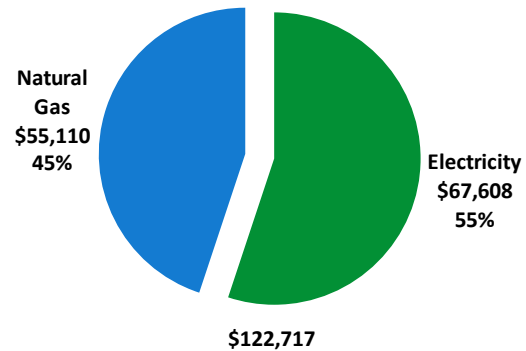

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.


The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.

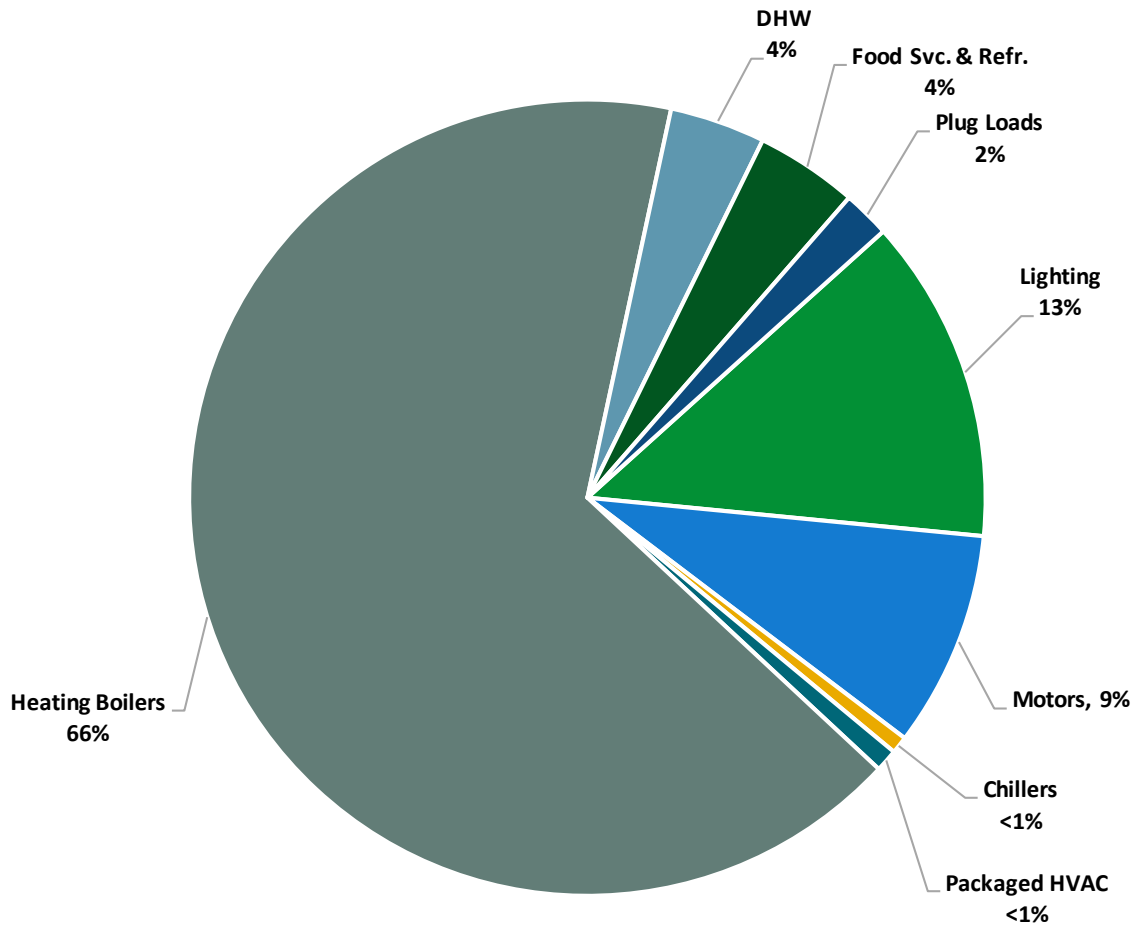

Energy Balance by System

3.1 Electricity

PSE&G delivers electricity under rate class Large Power & Lighting Secondary (LPLS), with electric production provided by Constellation and Direct Energy, a third-party supplier.

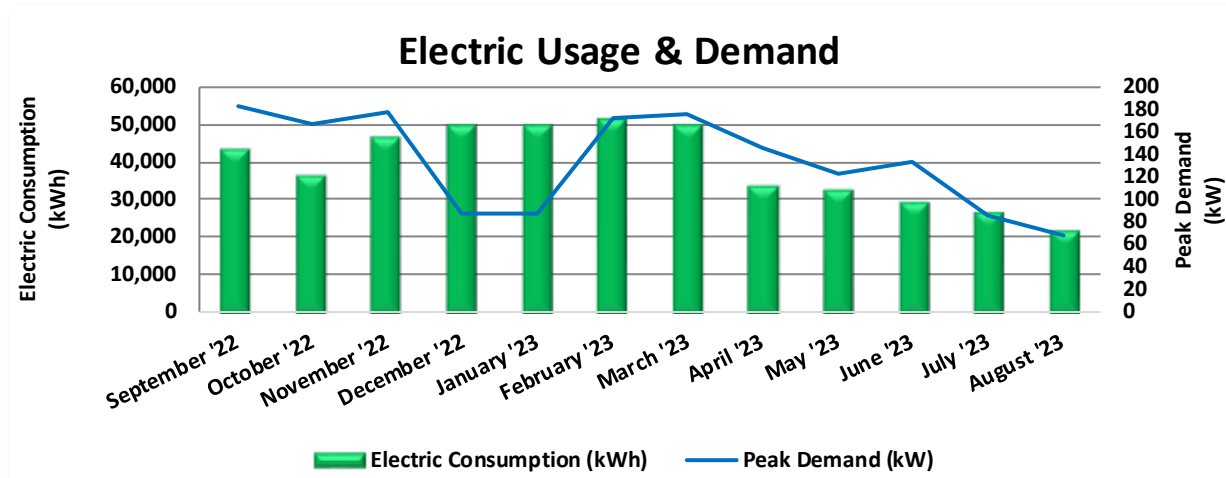


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
9/29/22	30	43,461	184	\$2,486	\$6,629
10/28/22	29	36,475	168	\$748	\$4,464
11/30/22	33	46,300	178	\$794	\$5,102
12/31/22	31	49,682	88	\$782	\$6,199
1/31/23	31	49,682	88	\$782	\$6,199
3/2/23	30	51,264	172	\$770	\$6,447
3/31/23	29	49,935	177	\$789	\$6,526
5/2/23	32	33,492	146	\$653	\$5,032
6/1/23	30	32,558	123	\$557	\$4,938
6/30/23	29	29,588	135	\$1,895	\$6,259
8/1/23	32	26,873	85	\$1,202	\$5,258
8/30/23	29	21,968	69	\$970	\$4,554
Totals	365	471,278	184	\$12,429	\$67,608
Annual	365	471,278	184	\$12,429	\$67,608

Notes:

- Peak demand of 184 kW occurred in September '22.
- Average demand over the past 12 months was 134 kW.
- The average electric cost over the past 12 months was \$0.143/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

3.2 Natural Gas

Elizabethtown Gas delivers natural gas under rate class General Delivery Service - Transportation (GDSADDQFT), with natural gas supply provided by Direct Energy Business Marketing, LLC (HESS), a third-party supplier.

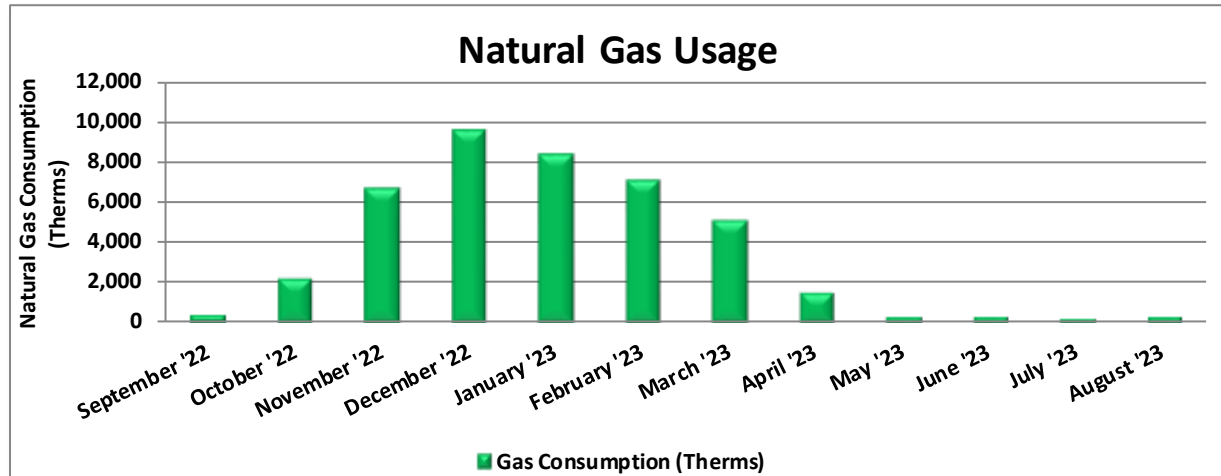


Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
10/10/22	31	327	\$1,159
11/8/22	29	2,138	\$3,246
12/8/22	30	6,686	\$8,332
1/10/23	33	9,531	\$12,401
2/8/23	29	8,326	\$10,129
3/9/23	29	7,050	\$8,211
4/11/23	33	5,093	\$6,452
5/5/23	24	1,467	\$1,703
6/8/23	34	315	\$1,002
7/11/23	33	262	\$958
8/9/23	29	186	\$894
9/11/23	33	221	\$925
Totals	367	41,601	\$55,412
Annual	365	41,375	\$55,110

Notes:

- The average gas cost for the past 12 months is \$1.332/therm, which is the blended rate used throughout the analysis.

3.3 Water


New Jersey American Water delivers water to the project site.

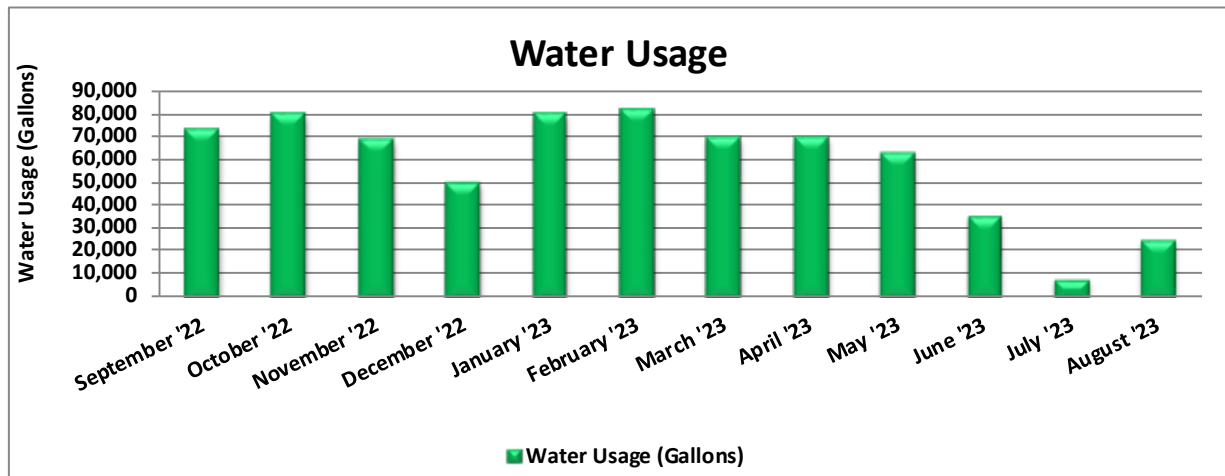

Water Billing Data			
Period Ending	Days in Period	Water Usage (gallons)	Water Cost
10/13/22	29	73,000	\$899
11/11/22	29	80,000	\$957
12/12/22	31	69,000	\$866
1/12/23	31	50,000	\$710
2/9/23	28	80,000	\$957
3/13/23	32	82,000	\$986
4/15/23	33	70,000	\$886
5/12/23	27	70,000	\$910
6/13/23	32	63,000	\$854
7/14/23	31	35,500	\$622
8/11/23	28	8,000	\$389
9/14/23	34	25,000	\$538
Totals	365	705,500	\$9,574
Annual	365	705,500	\$9,574

Notes:

- The average cost of water for the past 12 months is \$0.0136/gal.

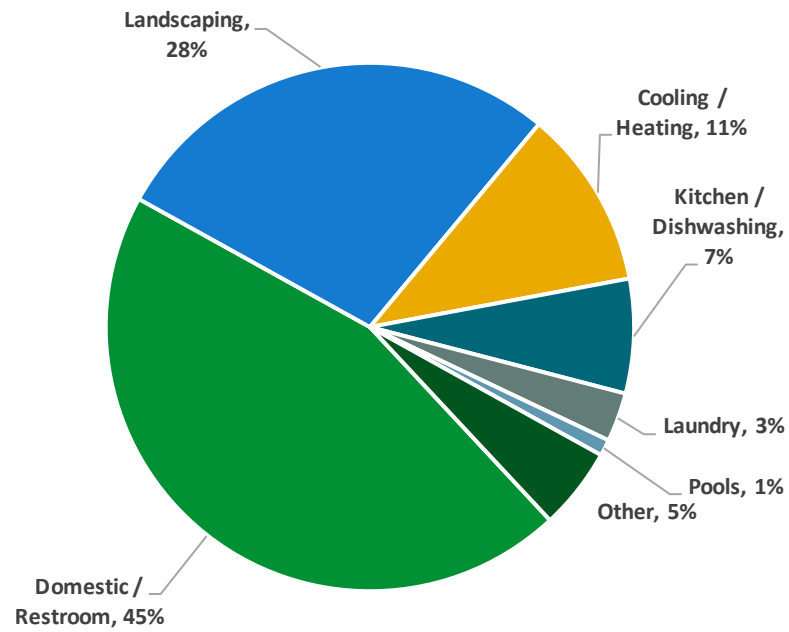

Typical Education Water End Use⁴


⁴ Chart is of typical water end use and not specific to the facility.

3.4 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) Portfolio Manager® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

Benchmarking Score	70
---------------------------	-----------

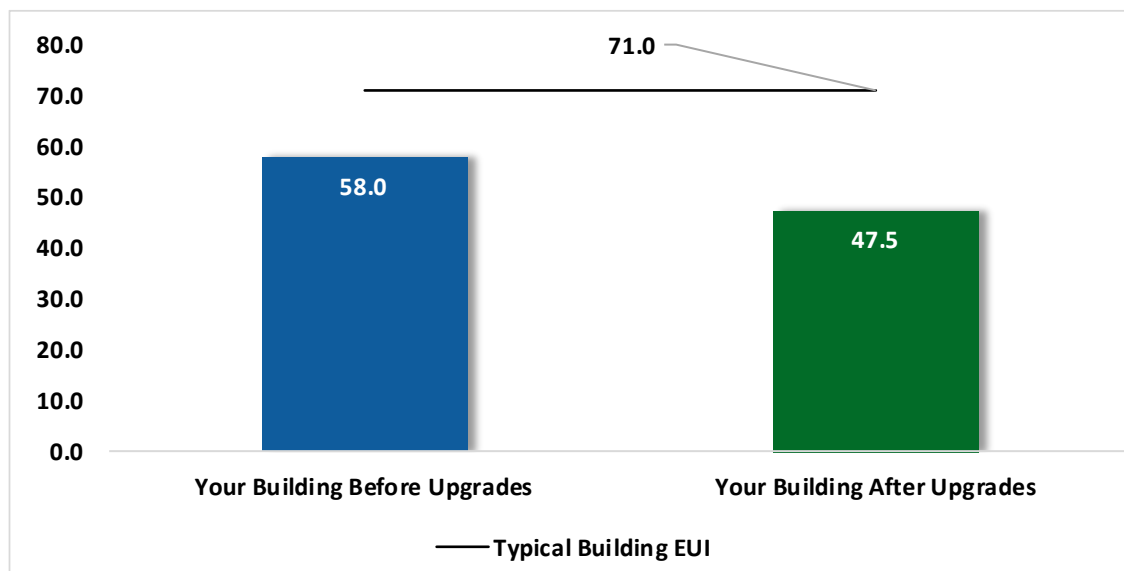


Energy Use Intensity Comparison⁵

Congratulations, your building performs better than the national average. This report has suggestions about how to keep your building running efficiently, further improve performance, and lower your energy bills even more.

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

⁵ Based on all evaluated ECMs

Water Benchmarking

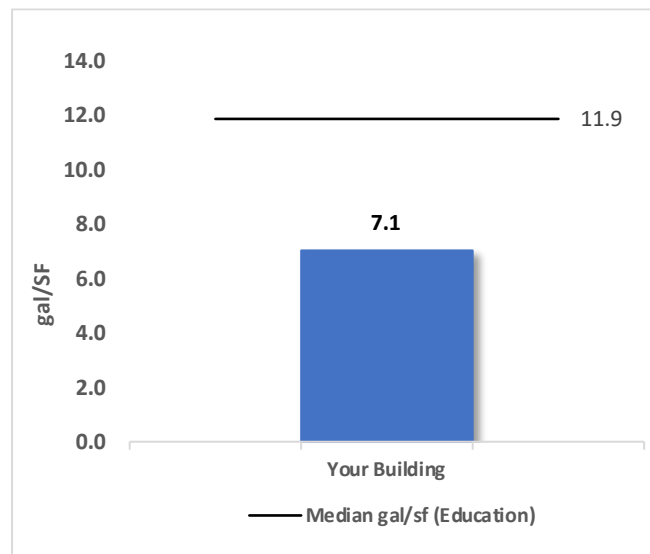

A benchmark is provided for your building's water use based on the annual water use in gallons per square foot of building area (gal/sf-yr). Your building is compared to other similar buildings based on average water usage as available from the 2012 Commercial Buildings Energy Consumption Survey (CBECS) and from the EPA ENERGY STAR DataTrends Water Use Tracking database.

Water use varies considerably depending mainly on the extent of outdoor water use and whether process water is used, such as for vehicle washing and for laboratory sterilizers. Cooling towers and steam boilers are also significant water users. Kitchens and sanitary fixtures may use varying amounts of water.

Tracking your Energy Performance

Keeping track of your energy and water use on a monthly basis is one of the best ways to keep utility costs in check and keep your facility operating efficiently. Update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager account for your facility and have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR Portfolio Manager to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR and Portfolio Manager, visit their [website](#).

3.5 Understanding Your Utility Bills

The State of New Jersey Department of the Public Advocate provides detailed information on how to read natural gas and electric bills. Your bills contain important information including account numbers, meter numbers, rate schedules, meter readings, and the supply and delivery charges. Gas and electric bills both provide comparisons of current energy consumption with prior usage.

Sample bills, with annotation, may be viewed at:

https://www.nj.gov/rpa/docs/Understanding_Electric_Bill.pdf

https://www.nj.gov/rpa/docs/Understanding_Gas_Bill.pdf

Why Utility Bills Vary

Utility bills vary from one month to another for many reasons. For this reason, assessing the effects of your energy savings efforts can be difficult.

Billing periods vary, typically ranging between 28 and 33 days. Electric bills provide the kilowatt-hours (kWh) used per month while gas bills provide therms (or hundreds of cubic feet - CCF) per month consumption information. Monthly consumption information can be helpful as a tool to assess your efforts to reduce energy, particularly when compared to monthly usage from a similar calendar period in a prior year.

Bills typically vary seasonally, often with more gas consumed in the winter for heating, and more electricity used in the summer when air conditioning is used. Facilities with electric heating may experience higher electricity use in the winter. Seasonal variance will be impacted by the type of heating and cooling systems used. Normal seasonal fluctuations are further impacted by the weather. Extremely cold or hot weathers causes HVAC equipment to run longer, increasing usage. Other monthly fluctuations in usage can be caused by changes in building occupancy. Utility bills provide a comparison of usage between the current period and comparable billing month period of the prior year. Year-to-year monthly use comparisons can point to trends with energy savings for measures/projects that were implemented within the timeframe, but these comparisons do not account for changing weather or occupancy patterns.

The price of fuel and purchased power used to produce and delivery electricity and gas fluctuates. Any increase or decrease in these costs will be reflected in your monthly bill. Additionally, billing rates occasionally change after justification and approval of the NJBPU. For this reason, it is more useful to review energy use rather than cost when assessing energy use trends or the impact of energy conservation measures implemented.

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives in this report are based on the previously run state rebate program SmartStart, which has been retired. Now, all investor-owned gas and electric utility companies are offering complementary energy efficiency programs directly to their customers. Some measures and proposed upgrades may be eligible for higher incentives than those shown below. The incentives in the summary tables should be used for high-level planning purposes. To verify incentives, reach out to your utility provider or visit the [NJCEP website](#) for more information.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$) *	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			123,652	31.6	-26	\$17,394	\$68,020	\$13,530	\$54,490	3.1	121,489
ECM 1	Retrofit Fixtures with LED Lamps	Yes	123,652	31.6	-26	\$17,394	\$68,020	\$13,530	\$54,490	3.1	121,489
Lighting Control Measures			34,706	8.9	-7	\$4,882	\$46,640	\$9,400	\$37,240	7.6	34,099
ECM 2	Install Occupancy Sensor Lighting Controls	Yes	30,612	8.0	-6	\$4,306	\$39,600	\$4,420	\$35,180	8.2	30,077
ECM 3	Install High/Low Lighting Controls	Yes	4,094	0.9	-1	\$576	\$7,040	\$4,980	\$2,060	3.6	4,022
Variable Frequency Drive (VFD) Measures			39,207	10.5	0	\$5,624	\$236,700	\$4,500	\$232,200	41.3	39,481
ECM 4	Install VFDs on Constant Volume (CV) Fans	No	10,719	6.2	0	\$1,538	\$36,600	\$1,800	\$34,800	22.6	10,794
ECM 5	Install VFDs on Chilled Water Pumps	No	1,886	0.5	0	\$271	\$8,400	\$100	\$8,300	30.7	1,899
ECM 6	Install VFDs on Heating Water Pumps	No	26,602	3.8	0	\$3,816	\$191,700	\$2,600	\$189,100	49.6	26,788
Unitary HVAC Measures			2,419	1.4	0	\$347	\$12,000	\$0	\$12,000	34.6	2,435
ECM 7	Install High Efficiency Air Conditioning Units	No	2,419	1.4	0	\$347	\$12,000	\$0	\$12,000	34.6	2,435
Gas Heating (HVAC/Process) Replacement			0	0.0	337	\$4,490	\$323,700	\$18,600	\$305,100	68.0	39,470
ECM 8	Install High Efficiency Hot Water Boilers	No	0	0.0	337	\$4,490	\$323,700	\$18,600	\$305,100	68.0	39,470
HVAC System Improvements			0	0.0	39	\$517	\$14,770	\$40	\$14,730	28.5	4,547
ECM 9	Implement Demand Control Ventilation (DCV)	No	0	0.0	24	\$313	\$14,500	\$0	\$14,500	46.3	2,754
ECM 10	Install Pipe Insulation	Yes	0	0.0	15	\$204	\$270	\$40	\$230	1.1	1,792
Domestic Water Heating Upgrade			0	0.0	7	\$89	\$100	\$50	\$50	0.6	784
ECM 11	Install Low-Flow DHW Devices	Yes	0	0.0	7	\$89	\$100	\$50	\$50	0.6	784
Food Service & Refrigeration Measures			2,589	0.2	0	\$371	\$5,240	\$280	\$4,960	13.4	2,607
ECM 12	Refrigerator/Freezer Case Electrically Commutated Motors	Yes	909	0.1	0	\$130	\$1,120	\$120	\$1,000	7.7	916
ECM 13	Refrigeration Controls	No	1,680	0.0	0	\$241	\$4,120	\$160	\$3,960	16.4	1,692
TOTALS			202,572	52.6	350	\$33,716	\$707,170	\$46,400	\$660,770	19.6	244,913

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		123,652	31.6	-26	\$17,394	\$68,020	\$13,530	\$54,490	3.1	121,489
ECM 1	Retrofit Fixtures with LED Lamps	123,652	31.6	-26	\$17,394	\$68,020	\$13,530	\$54,490	3.1	121,489
Lighting Control Measures		34,706	8.9	-7	\$4,882	\$46,640	\$9,400	\$37,240	7.6	34,099
ECM 2	Install Occupancy Sensor Lighting Controls	30,612	8.0	-6	\$4,306	\$39,600	\$4,420	\$35,180	8.2	30,077
ECM 3	Install High/Low Lighting Controls	4,094	0.9	-1	\$576	\$7,040	\$4,980	\$2,060	3.6	4,022
HVAC System Improvements		0	0.0	15	\$204	\$270	\$40	\$230	1.1	1,792
ECM 10	Install Pipe Insulation	0	0.0	15	\$204	\$270	\$40	\$230	1.1	1,792
Domestic Water Heating Upgrade		0	0.0	7	\$89	\$100	\$50	\$50	0.6	784
ECM 11	Install Low-Flow DHW Devices	0	0.0	7	\$89	\$100	\$50	\$50	0.6	784
Food Service & Refrigeration Measures		909	0.1	0	\$130	\$1,120	\$120	\$1,000	7.7	916
ECM 12	Refrigerator/Freezer Case Electrically Commutated Motors	909	0.1	0	\$130	\$1,120	\$120	\$1,000	7.7	916
TOTALS		159,267	40.7	-11	\$22,700	\$116,150	\$23,140	\$93,010	4.1	159,081

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		123,652	31.6	-26	\$17,394	\$68,020	\$13,530	\$54,490	3.1	121,489
ECM 1	Retrofit Fixtures with LED Lamps	123,652	31.6	-26	\$17,394	\$68,020	\$13,530	\$54,490	3.1	121,489

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

ECM 1: Retrofit Fixtures with LED Lamps

Replace fluorescent and CFL lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected Building Areas: all areas with fluorescent fixtures with T8 tubes and CFLs in locker rooms and auditorium

4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		34,706	8.9	-7	\$4,882	\$46,640	\$9,400	\$37,240	7.6	34,099
ECM 2	Install Occupancy Sensor Lighting Controls	30,612	8.0	-6	\$4,306	\$39,600	\$4,420	\$35,180	8.2	30,077
ECM 3	Install High/Low Lighting Controls	4,094	0.9	-1	\$576	\$7,040	\$4,980	\$2,060	3.6	4,022

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 2: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected Building Areas: offices, classrooms, gymnasium, library, restrooms, and storage rooms

ECM 3: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as occupants approach the area.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Affected Building Areas: corridors

4.3 Variable Frequency Drives (VFD)

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures		39,207	10.5	0	\$5,624	\$236,700	\$4,500	\$232,200	41.3	39,481
ECM 4	Install VFDs on Constant Volume (CV) Fans	10,719	6.2	0	\$1,538	\$36,600	\$1,800	\$34,800	22.6	10,794
ECM 5	Install VFDs on Chilled Water Pumps	1,886	0.5	0	\$271	\$8,400	\$100	\$8,300	30.7	1,899
ECM 6	Install VFDs on Heating Water Pumps	26,602	3.8	0	\$3,816	\$191,700	\$2,600	\$189,100	49.6	26,788

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

ECM 4: Install VFDs on Constant Volume (CV) Fans

We evaluated the installation of VFDs to control constant volume fan motor speeds. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

Affected Air Handlers: HV-5 and HV-6 serving the auditorium, HV-2 serving the locker room, HV-1 and HV-3 serving the gym, and HV-4 serving the cafeteria.

Note: According to facility staff, some of the fans are currently not operating. We have included the cost for installing the VFDs for the associated motors presuming these fans will be made operational. We have conservatively not included savings for the non-operational fans.

ECM 5: Install VFDs on Chilled Water Pumps

We evaluated the installation of VFDs to control chilled water/dual temperature pump. Two-way valves must serve the chilled water coils being served and the chilled water loop must have a differential pressure sensor installed. If three-way valves or a bypass leg are used in the chilled water distribution, they will need to be modified when this measure is implemented. As the chilled water valves close, the differential pressure increases, and the VFD modulates the pump speed to maintain a differential pressure setpoint.

For systems with variable chilled water flow through the chiller, the minimum flow to prevent the chiller from tripping off will need to be determined during the final project design. The control system should be programmed to maintain the minimum flow through the chiller and to prevent pump cavitation.

Energy savings result from reducing the pump motor speed (and power) as chilled water valves close. The magnitude of energy savings is based on the estimated amount of time that the system operates at reduced loads.

Affected Pumps: Evaluated for dual temperature pump serving the office unit ventilators.

ECM 6: Install VFDs on Heating Water Pumps

We evaluated the installation of variable frequency drives (VFD) to control heating water pumps. Two-way valves must serve the hot water coils, and the hot water loop must have a differential pressure sensor installed. If three-way valves or a bypass leg are used in the hot water distribution, they will need to be modified when this measure is implemented. As the hot water valves close, the differential pressure increases and the VFD modulates the pump speed to maintain a differential pressure setpoint.

Energy savings result from reducing pump motor speed (and power) as hot water valves close. The magnitude of energy savings is based on the estimated amount of time that the system will operate at reduced load.

Affected Pumps: heating hot water pumps

4.4 Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Unitary HVAC Measures		2,419	1.4	0	\$347	\$12,000	\$0	\$12,000	34.6	2,435
ECM 7	Install High Efficiency Air Conditioning Units	2,419	1.4	0	\$347	\$12,000	\$0	\$12,000	34.6	2,435

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the window AC is eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

ECM 7: Install High Efficiency Air Conditioning Units

We evaluated replacing standard efficiency packaged air conditioning units with high efficiency packaged air conditioning units. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling and heating load, and the estimated annual operating hours.

Affected Units: evaluated for window AC units serving the classrooms and office spaces

4.5 Gas-Fired Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Gas Heating (HVAC/Process) Replacement		0	0.0	337	\$4,490	\$323,700	\$18,600	\$305,100	68.0	39,470
ECM 8	Install High Efficiency Hot Water Boilers	0	0.0	337	\$4,490	\$323,700	\$18,600	\$305,100	68.0	39,470

ECM 8: Install High Efficiency Hot Water Boilers

We evaluated replacing older inefficient hot water boilers with high efficiency hot water boilers. Energy savings results from improved combustion efficiency and reduced standby losses at low loads.

The most notable efficiency improvement is condensing hydronic boilers that can achieve over 90% efficiency under the proper conditions. Condensing hydronic boilers typically operate at efficiencies between 85% and 87% (comparable to other high efficiency boilers) when the return water temperature is above 130°F. The boiler efficiency increases as the return water temperature drops below 130°F. Therefore, condensing hydronic boilers are evaluated when the return water temperature is less than 130°F during most of the operating hours.

For the purposes of this analysis, we evaluated the replacement of boilers on a one-for-one basis with equipment of the same capacity. We recommend that you work with your mechanical design team to select boilers that are sized appropriately for the heating load. In many cases installing multiple modular boilers, rather than one or two large boilers, will result in higher overall plant efficiency while providing additional system redundancy.

Replacing the boilers has a long payback and may not be justifiable based simply on energy considerations. However, the boilers are nearing the end of their normal useful life. Typically, the marginal cost of purchasing high efficiency boilers can be justified by the marginal savings from the improved efficiency. In this case, the measured boiler efficiency fell below performance expectations. When the boiler is eventually replaced, consider purchasing boilers that exceed the minimum efficiency required by building codes. We also recommend working with your mechanical design team to determine whether the heating system can operate with return water temperatures below 130°F, which would allow the use of condensing boilers.

4.6 HVAC Improvements

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
HVAC System Improvements		0	0.0	39	\$517	\$14,770	\$40	\$14,730	28.5	4,547
ECM 9	Implement Demand Control Ventilation (DCV)	0	0.0	24	\$313	\$14,500	\$0	\$14,500	46.3	2,754
ECM 10	Install Pipe Insulation	0	0.0	15	\$204	\$270	\$40	\$230	1.1	1,792

ECM 9: Implement Demand Control Ventilation (DCV)

Demand control ventilation (DCV) is a control strategy that monitors the indoor air's carbon dioxide (CO₂) content to measure room occupancy. This data is used to regulate the amount of outdoor air provided to the space for ventilation.

Standard ventilation systems often provide outside air based on a space's estimated maximum occupancy but not actual occupancy. During low occupancy periods, the space may then be over ventilated. This wastes energy through heating and cooling the excess outside air flow. DCV reduces unnecessary outdoor air intake by regulating ventilation based on actual occupancy levels. DCV is most suited for facilities where occupancy levels vary significantly from hour to hour and day to day.

Energy savings associated with DCV are based on hours of operation, space occupancy, outside air reduction, and other factors. Energy savings results from eliminating unnecessary ventilation and space conditioning. Implementation of this measure is dependent upon having a building automation system (BAS) or other smart building control system connected to the space conditioning equipment serving the noted areas.

Affected Building Areas: evaluated for HV-5 and HV-6 serving the auditorium, HV-2 serving the locker room, HV-1 serving the gym, and HV-4 serving the cafeteria.

Note: According to facility staff, some of the fans are currently not operating. We have included the cost for implementing DCV for the associated motors presuming these fans will be made operational. We have conservatively not included savings for the areas served by non-operational fans.

ECM 10: Install Pipe Insulation

Install insulation on domestic hot water system piping. Distribution system thermal losses are dependent on system fluid temperature, the size of the distribution system, and the extent and condition of piping insulation. When the insulation has been damaged due to exposure to water, when the insulation has been removed from some areas of the pipe, or when valves have not been properly insulated, system thermal efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

Affected Systems: domestic hot water piping

4.7 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade		0	0.0	7	\$89	\$100	\$50	\$50	0.6	784
ECM 11	Install Low-Flow DHW Devices	0	0.0	7	\$89	\$100	\$50	\$50	0.6	784

ECM 11: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing.

4.8 Food Service and Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Food Service & Refrigeration Measures		2,589	0.2	0	\$371	\$5,240	\$280	\$4,960	13.4	2,607
ECM 12	Refrigerator/Freezer Case Electrically Commutated Motors	909	0.1	0	\$130	\$1,120	\$120	\$1,000	7.7	916
ECM 13	Refrigeration Controls	1,680	0.0	0	\$241	\$4,120	\$160	\$3,960	16.4	1,692

ECM 12: Refrigerator/Freezer Case Electrically Commutated Motors

Replace shaded pole or permanent split capacitor (PSC) motors with electronically commutated (EC) motors in walk-in coolers. Fractional horsepower EC motors are significantly more efficient than mechanically commutated, brushed motors, particularly at low speeds or partial load. By using variable-speed technology, EC motors can optimize fan usage. Because these motors are brushless and use DC power, losses due to friction and phase shifting are eliminated.

Savings for this measure consider both the increased efficiency of the motor as well as the reduction in refrigeration load due to motor heat loss.

ECM 13: Refrigeration Controls

We evaluated the installation of additional controls to optimize the operation of walk-in coolers and freezers.

Many walk-in coolers and freezers have evaporator fans that run continuously. The measure adds a control system feature to automatically shut off evaporator fans when not needed.

Energy savings for each of the control measures account for reduction in compressor and fan operating hours as well as reduction in the refrigeration heat load as appropriate.

4.9 Measures for Future Consideration

There are additional opportunities for improvement that Cranford Public Schools may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment, and/or include significant system reconfiguration. These measure(s) are therefore beyond the scope of this energy audit. These measure(s) are described here to support a whole building approach to energy efficiency and sustainability.

Cranford Public Schools may wish to consider the Energy Savings Improvement Program (ESIP) or other whole building approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to:

- Evaluate these measures further.
- Develop firm costs.
- Determine measure savings.
- Prepare detailed implementation plans.

Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

Upgrade/Replace Building Automation System

Based on our site survey and on conversations with facility staff, it appears that the existing building automation system (BAS) is substantially limited in its capabilities, means of control, monitoring/reporting function, or condition relative to new systems available in the marketplace. A substantial upgrade to your site's BAS could increase the efficiency of your building HVAC system operation.

The current generation BAS typically provides building systems with a network of temperature and pressure sensors that obtain feedback about field conditions and provide signals to control systems to adjust system operation for optimal functioning. Thirty years ago, most control systems were pneumatic systems driven by compressed air, with pneumatic thermostats and air driven actuators for valves and dampers. Pneumatics controls have largely been replaced by direct digital control (DDC) systems, but many pneumatic systems remain. Contemporary DDC systems afford tighter controls and enhanced monitoring and trending capabilities as compared to the older systems.

A controls upgrade would enable automated equipment start and stop times, temperature setpoints, and lockouts and deadbands to be programmed remotely using a graphic interface. Controls can be configured to optimize ventilation and outside air intake by adjusting economizer position, damper function, and fan speed. Existing chilled and hot water distribution system controls are typically tied in, including associated pumps and valves. Coordinated control of HVAC systems is dependent on a network of sensors and status points. A comprehensive building control system provides monitoring and control for all HVAC systems, so operators can adjust system programming for optimal comfort and energy savings.

It is recommended that an HVAC engineer or contractor who specializes in BAS be contacted for a detailed evaluation and implementation costs. A controls expert will be able to tell you to what extent an existing system can be refurbished or expanded, what sensors should be replaced, what additional HVAC systems could be controlled, and what monitoring and graphic capabilities can be added. For the purposes of this report, the potential energy savings and measure costs were estimated based on industry standards and previous project experience. Further analysis should be conducted for the feasibility of this measure. This is not an investment grade analysis, nor should be used as a basis for design and construction.

Upgrade to a Heat Pump System

Electric resistance heating units work by passing an electric current through wires to heat them. The system is 100% efficient since for every unit of electricity consumed, one unit of heat is produced.

But there is a way to convert electricity to create heat at better than a 1:1 ratio. Heat pumps operate on a more efficient principle, the refrigeration cycle. Instead of directly converting electricity to heat, electricity does the work, via a compressor, of moving refrigerant through a system that transfers heat from a cooler place to a warmer place. That system can move three to five as much energy as is available using electric resistance heating methods. Heat pumps work in a similar manner to an air conditioner, except they reverse the cooling process to circulate warm air instead of cold air. Also, heat pumps are generally capable of dispensing refrigerated air as they can typically be operated in air conditioning mode.

An electric furnace or boiler has no flue loss through a chimney. The AFUE rating for an all-electric furnace or boiler is between 95% and 100%. The lower values are for units installed outdoors because they have greater jacket heat loss. However, despite their high efficiency, the higher cost of electricity in most parts of the country makes all-electric furnaces or boilers an uneconomic choice. If you are interested in electric heating, consider installing a heat pump system.

Electric resistance heat, including electric furnaces and baseboard heaters, can be inexpensive to install but often expensive to run. Facilities with these systems can save substantial energy at a moderate cost by installing a heat pump when they replace a central air conditioner.

Even in buildings without central air-conditioning, there are opportunities to save energy when an existing electric furnace needs to be replaced, as well as opportunities to install ductless electric heat pumps in buildings with baseboard electric heaters and electric fan coils. Unit ventilators with built-in electric resistance heaters can be replaced with unit ventilators with integrated heat pumps.

Electric heat pumps have high coefficient of performance (COP) ratings and are substantially more efficient than traditional electric heating systems. Further investigation is required to determine whether installing a heat pump system is a cost-effective solution when replacing existing electrical heating systems.

Replacing vs. Repairing a Built-up Air Handler

The facility staff asked for guidance regarding replacing versus continuing to repair the old built-up air handling units (AHUs) at this site.

All equipment will eventually reach the end of its useful life (EUL) at which time it will need to be replaced. The difficulty is determining when a built-up AHU, which is basically multiple independent components in one housing, has reached its EUL. Three indications that an AHU has reached its EUL are:

- Replacement parts are no longer available or require custom orders.
- Critical parts of the AHU can no longer be repaired.
- If there is significant corrosion in the frames or walls of the AHU. Indications may be visible holes in pressurized portions of the AHU, difficulty repairing structural members due to physical degradation, or corrosion is impacting the quality of the airstream.

Some external factors that may weigh in favor of replacing an AHU rather than repairing or replacing the components are:

- Conditions within the space or the use of the space served by the AHU have changed and the AHU can no longer meet the ventilation or thermal requirements.
- The AHU can no longer meet current code requirements, particularly for indoor air quality.
- The life cycle cost of replacing the AHU is less than the life cycle cost of continuing to repair and replace components of the AHU.

Replacing an AHU often involves more than just the physical unit. Some potential complications of replacing an AHU include:

- Required electrical infrastructure upgrades.
- Control system upgrades to fully utilize expanded onboard features.
- Structural supports if the new unit is heavier.
- For roof mounted units, reconfiguration of roof penetrations and associated roof repairs if the new unit footprint differs from the original.
- For interior units, difficulties in physically removing and/or installing the units due to space constraints.
- Duct testing may be required for new units. New transitional ductwork may be required and additional repairs to existing ductwork may be warranted.
- Replacing an AHU typically requires a longer shut-down period than just repairing or replacing components of an AHU.

Repair Strategies

If the decision is made to replace AHU components, we recommend considering the following:

- If fans need to be replaced, consider using a plenum style fan array which consists of multiple fans in the cross section of the AHU. A fan array provides built in redundancy since there are multiple fans rather than a single fan and can provide more even flow across heating and cooling coils which will improve the effectiveness of the coils. Fan arrays also typically use direct drive fans with sealed bearings, greatly diminishing fan maintenance requirements.
- Consider replacing coils with more effective coils and drip pans.
- Where possible improve access to the components to facilitate maintenance.
- While making repairs, consider replacing other components which are at or beyond their useful life.

Code Compliance

New Jersey uses the ASHRAE Standard 90.1-2019 as the state energy code for commercial buildings (<https://www.energycodes.gov/status/states/new-jersey>). Section 6.1.1.3.1 of Standard 90.1-2019 addresses replacement of HVAC equipment and incorporates key electrical safety and air quality elements. Additional federal, state, and local codes may apply. In summary, ASHRAE compliance requirements are notable with expanded requirements for controls and fan efficiency as compared to prior code versions. While many of the unit code requirements are met at the point of purchase, expanded external controls may be required to fully meet code performance metrics.

The Standard excludes code compliance requirements for repairs or modifications as noted:

1. for *equipment* that is being modified or repaired but not replaced, provided that such modifications and/or *repairs* will not result in an increase in the annual *energy* consumption of the *equipment* using the same *energy* type;
2. where a replacement or *alteration of equipment* requires extensive revisions to other *systems, equipment*, or elements of a *building*, and such replaced or altered *equipment* is a like-for-like replacement;
3. for a refrigerant change of *existing equipment*;
4. for the relocation of *existing equipment*;
5. for ducts and *piping* where there is insufficient *space* or access to meet these requirements.

Therefore, in general if an air handler or a component of an air handler is being replaced it must meet the current energy code. Regarding air handlers Standard 90.1-2019 specifically addresses fans, fan control, motors, economizers, furnaces, duct furnaces, exhaust air energy recovery, controls, ductwork and piping but does not specifically address coils or control valves.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5%–20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR Portfolio Manager



You've heard it before—you cannot manage what you do not measure. ENERGY STAR Portfolio Manager is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions⁶. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Lighting Maintenance



Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.

In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Economizer Maintenance

Economizers can significantly reduce cooling system load. A malfunctioning economizer can increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air. Common economizer malfunctions include broken outdoor thermostat or enthalpy control or dampers that are stuck or improperly adjusted.

⁶ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>

Periodic inspection and maintenance will keep economizers working in sync with the heating and cooling system. This maintenance should be part of annual system maintenance, and it should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position.

Chiller Maintenance

Service chillers regularly to keep them operating properly. Chillers are responsible for a substantial portion of a commercial building's overall energy usage, and when they do not work well, there is usually a noticeable increase in energy bills and increased occupant complaints. Regular diagnostics and service can save five to ten percent of the cost of operating your chiller. If you already have a maintenance contract in place, your existing service company should be able to provide these services.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Ductwork Maintenance

Duct maintenance has two primary goals: keep the ducts clean to avoid air quality problems and seal leaks to save energy. Check for cleanliness, obstructions that block airflow, water damage, and leaks. Ducts should be inspected at least every two years.

The biggest symptoms of clogged air ducts are differing temperatures throughout the building and areas with limited airflow from supply registers. If a particular air duct is clogged, then air flow will only be cut off to some rooms in the building—not all of them. The reduced airflow will make it more difficult for those areas to reach the temperature setpoint, which will cause the HVAC system to run longer to cool or heat that area properly. If you suspect clogged air ducts, ensure that all areas in front of supply registers are clear of items that may block or restrict air flow, and you should check for fire dampers or balancing dampers that have failed closed.

Duct leakage in commercial buildings can account for 5%–25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Check ductwork for leakage. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.

Distribution system losses are dependent on air system temperature, the size of the distribution system, and the level of insulation of the ductwork. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is missing or worn, the system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

Boiler Maintenance

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely and efficiently. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the boiler tubes to improve heat transfer.

Optimize HVAC Equipment Schedules

Energy management systems (BAS) typically provide advanced controls for building HVAC systems, including chillers, boilers, air handling units, rooftop units and exhaust fans. The BAS monitors and reports operational status, schedules equipment start and stop times, locks out equipment operation based on outside air or space temperature, and often optimizes damper and valve operation based on complex algorithms. These BAS features, when in proper adjustment, can improve comfort for building occupants and save substantial energy.

Know your BAS scheduling capabilities. Regularly monitor HVAC equipment operating schedules and match them to building operating hours to eliminate unnecessary equipment operation and save energy. Monitoring should be performed often at sites with frequently changing usage patterns – daily in some cases. We recommend using the optimal start feature of the BAS (if available) to optimize the building warmup sequence. Most BAS scheduling programs provide for holiday schedules, which can be used during reduced use or shutdown periods. Finally, many systems are equipped with a one-time override function, which can be used to provide additional space conditioning due to a one-time, special event. When available this override feature should be used rather than changing the base operating schedule.

Water Heater Maintenance

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Compressed Air System Maintenance

Compressed air systems require periodic maintenance to operate at peak efficiency. A maintenance plan for compressed air systems should include:

- Inspection, cleaning, and replacement of inlet filter cartridges.
- Cleaning of drain traps.
- Daily inspection of lubricant levels to reduce unwanted friction.
- Inspection of belt condition and tension.
- Check for leaks and adjust loose connections.
- Overall system cleaning.

- Reduce pressure setting to minimum needed for air operated equipment.
- Turn off compressor if not routinely needed.
- Use low pressure blower air rather than high pressure compressed air.

Contact a qualified technician for help with setting up periodic maintenance schedule.


Refrigeration Equipment Maintenance

Preventative maintenance keeps commercial refrigeration equipment running reliably and efficiently. Commercial refrigerators and freezers are mission-critical equipment that can cost a fortune when they go down. Even when they appear to be working properly, refrigeration units can be consuming too much energy. Have walk-in refrigeration and freezer and other commercial systems serviced at least annually. This practice will allow systems to perform to their highest capabilities and will help identify system issues if they exist.

Maintaining your commercial refrigeration equipment can save between five and ten percent on energy costs. When condenser coils are dirty, your commercial refrigerators and freezers work harder to maintain the temperature inside. Worn gaskets, hinges, door handles or faulty seals cause cold air to leak from the unit, forcing the unit to run longer and use more electricity.

Regular cleaning and maintenance also help your commercial refrigeration equipment to last longer.

Plug Load Controls



Reducing plug loads is a common way to decrease your electrical use. Limiting the energy use of plug loads can include increasing occupant awareness, removing under-used equipment, installing hardware controls, and using software controls. Consider enabling the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips⁷. Your local utility may offer incentives or rebates for this equipment.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR products where available.

⁷ For additional information refer to “Assessing and Reducing Plug and Process Loads in Office Buildings” <http://www.nrel.gov/docs/fy13osti/54175.pdf>, or “Plug Load Best Practices Guide” <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

6 WATER BEST PRACTICES

Getting Started



The commercial and institutional sector is the second largest consumer of publicly supplied water in the United States, accounting for 17% of the withdrawals from public water supplies⁸. In New Jersey, excluding water used for power generation, approximately 80% of total water use was attributed to potable supply during the period of 2009 to 2018. Water withdrawals for potable supply have not changed noticeably during the period from 1990 to 2018⁹.

Water management planning serves as the foundation for any successful water reduction effort. It is the first step a commercial or institutional facility owner or manager should take to achieve and sustain long-term water savings. Understanding how water is used within a facility is critical for the water management planning process. A water assessment provides a comprehensive account of all known water uses at the facility. It allows the water management team to establish a baseline from which progress and program success can be measured. It also enables the water management team to set achievable goals and identify and prioritize specific projects based on the relative savings opportunities and project cost-effectiveness.

Water conservation devices may significantly reduce your water and sewer usage costs. Any reduction in water use reduces grid-level electricity use since a significant amount of electricity is used to treat and deliver water from reservoirs to end users.

For more information regarding water conservation or additional details regarding the practices shown below go to the EPA's WaterSense website¹⁰ or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"¹¹ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Leak Detection and Repair

Identifying and repairing leaks and other water use anomalies within a facility's water distribution system or from processes or equipment can keep a facility from wasting significant quantities of water. Examples of common leaks include leaking toilets and faucets, drip irrigation malfunctions, stuck float valves, and broken distribution lines. Reading meters, installing failure abatement technologies, and conducting visual and auditory inspections are important best practices to detect leaks. Train building occupants, employees, and visitors to report any leaks that they detect. To reduce unnecessary water loss, detected leaks should be repaired quickly. Repairing leaks in water distribution that is pressurized by on-site pumps or in heated or chilled water piping will also reduce energy use.

Toilets and Urinals

Toilets and urinals are considered sanitary fixtures and are found in most facilities. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously flushing, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment

⁸ Estimated from analyzing data in: [Solley, Wayne B., et al, "Estimated Use of Water in the United States in 1995", U.S Geological Survey Circular 1200, \(1998\)](#)

⁹ <https://dep.nj.gov/wp-content/uploads/dsr/trends-water-supply.pdf>

¹⁰ <https://www.epa.gov/watersense>

¹¹ <https://www.epa.gov/watersense/watersense-work-0>

and the frequency of use, it may be cost effective to replace older inefficient fixtures with current generation WaterSense labeled equipment.

Commercial facilities typically use tank toilets or wall-mount flushometers. Educate and inform users with restroom signage and other means to avoid flushing inappropriate objects. For tank toilets, periodically check to ensure fill valves are working properly and that water level is set correctly. Annually test toilets to ensure the flappers are not worn or allowing water to seep from the tank into the bowl and down the sewer. Control stops and piston valves on flushometer toilets should be checked at least annually.

Most urinals use water to flush liquid. These standard single-user fixtures are present in most facilities. Non-water urinals use a specially designed trap that allows liquid waste to drain out of the fixture through a trap seal, and into the drainage system. Flushing urinals should be inspected at least annually for proper valve and sensor operation. For non-water urinals, follow maintenance practices as directed by the manufacturer to ensure products perform as expected. Non-water urinals can be considered during urinal replacement, however, review the condition and design of the existing plumbing system and the expected usage patterns to ensure that these products will provide the anticipated performance.

Faucets and Showerheads

Faucets and showerheads are sanitary fixtures that generally dispense heated water. Reducing water use by these fixtures translates into a reduction of site fuel or electric use depending on how water is heated. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously dripping, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment and the frequency of use, it may be cost effective to replace older fixtures with current generation WaterSense labeled equipment.

Faucets are used for a variety of purposes, and standard flow rates are dictated by the intended use. Public use lavatory faucets and kitchen faucets are subject to maximum flow rates while service sinks are not. Periodically inspect faucet aerators for scale buildup to ensure flow is not being restricted. Clean or replace the aerator or other spout end device as needed. Check and adjust automatic sensors (where installed) to ensure they are operating properly to avoid faucets running longer than necessary. Post materials in restrooms and kitchens to ensure user awareness of the facility's water-efficiency goals. Remind users to turn off the tap when they are done and to consider turning the tap off during sanitation activities when it is not being used. Consider installing lavatory and kitchen faucet fixtures with reduced flow. Federal standards limit kitchen and restroom faucet flows to 2.2 gpm. To qualify for a WaterSense label a faucet cannot exceed 1.5 gpm.

Effective in 1992, the maximum allowable flow rate for all showerheads sold in the United States is 2.5 gpm. Since this standard was enacted, many showerheads have been designed to use even less water. WaterSense labeled equipment is designed to use 2.0 gpm, or less. For optimum showerhead efficiency, the system pressure should be tested to make sure that it is between 20 and 80 pounds per square inch (psi). Verify that plumbing lines are routed through a shower valve to prevent water pressure fluctuations. Periodically inspect showerheads for scale buildup to ensure flow is not being restricted. In general, replace showerheads with 2.5 gpm flow rates or higher with WaterSense labeled models. Note: Use of poor performing replacement reduced flow showerheads may result in increased use if the duration of use is increased to compensate for reduced performance. WaterSense labeled showerheads are independently certified to meet or exceed minimum performance requirements for spray coverage and force.

Commercial Kitchen Equipment

Commercial and institutional sectors, including hospitals, offices, and schools, have substantial kitchen water use. Water in food service is used for steam cooking, spray/flow cleaning, dish washing, and ice making. In most commercial kitchens, the commercial dishwasher and pre-rinse spray valve account for over two-thirds of the water use. Newer technologies and better practices are available that can significantly reduce commercial kitchen equipment water and energy use. For example, ENERGY STAR qualified dishwashers and steam cookers are at least 10% more water-efficient and 15% more energy-efficient than standard models. With some models saving significantly more.

Cooking equipment includes combination ovens, steam cookers, and steam kettles. For efficient steam cooking operation, fill vessels to capacity when possible, set temperatures optimally for the process, and keep doors and lids closed while cooking. Replace gaskets to ensure proper sealing and repair leaks. When replacing combination ovens, select connectionless equipment; replace steam cookers with ENERGY STAR rated steam cookers.

Spray/flow cleaning equipment includes dipper wells, pre-rinse spray valves, food disposals, and wash down sprayers. Turn off water when service periods are slow and keep flow rates to minimum level. Train users to scrape food rather than rely on water pressure. Inspect for leaks and scaling. Test system pressure to ensure it is between 20 and 80 pounds per square inch (psi) for optimum flow and performance of spray equipment. For dipper wells, consider installing in-line flow restrictors to reduce flow. Pre-rinse spray valves can be replaced with new assemblies which use 1.3 gpm or less. Washdown sprayers can be equipped with self-closing nozzles or consider mopping/sweeping as an alternative.

Dishwashers range in type and include undercounter, stationary/hood, conveyor, and flight-type models. Only run dishwashers when they are full, and fill racks to maximum capacity. Be sure to replace damaged dishwasher racks. Educate staff to scrape dishes prior to loading. Ensure that final rinse pressure and water temperature are within the manufacturer's recommendations. Operate the dishwasher close to or at the minimum flow rate and set rinse cycle time to the manufacturer's minimum recommended settings. Make sure that manual fill valves close completely after the wash tank is filled. Find and repair any leaks. Inspect valves and rinse nozzles for proper operation and repair worn nozzles. Look for ENERGY STAR qualified models when purchasing or leasing a new commercial dishwasher or replacing an existing unit. Consider your kitchen throughput to select an appropriately sized commercial dishwasher since an oversized dishwasher will waste water if the machine is not loaded to capacity.

7 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


7.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has high potential for installing a PV array.

The amount of free area, ease of installation (location), and the lack of shading elements contribute to the high potential. A PV array located on the roof may be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

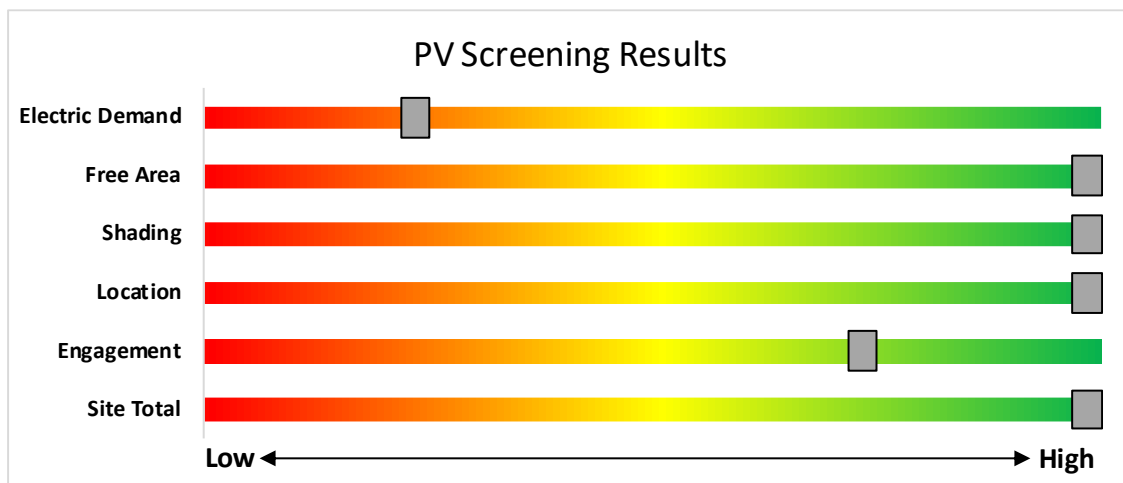

Potential	High	
System Potential	134	kW DC STC
Electric Generation	159,644	kWh/yr
Displaced Cost	\$22,900	/yr
Installed Cost	\$348,400	

Photovoltaic Screening

Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners must register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- ◆ **Successor Solar Incentive Program (SuSI):** <https://www.njcleanenergy.com/renewable-energy/programs/susi-program>
- ◆ **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- ◆ **NJ Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs
- ◆ **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

7.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.


CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

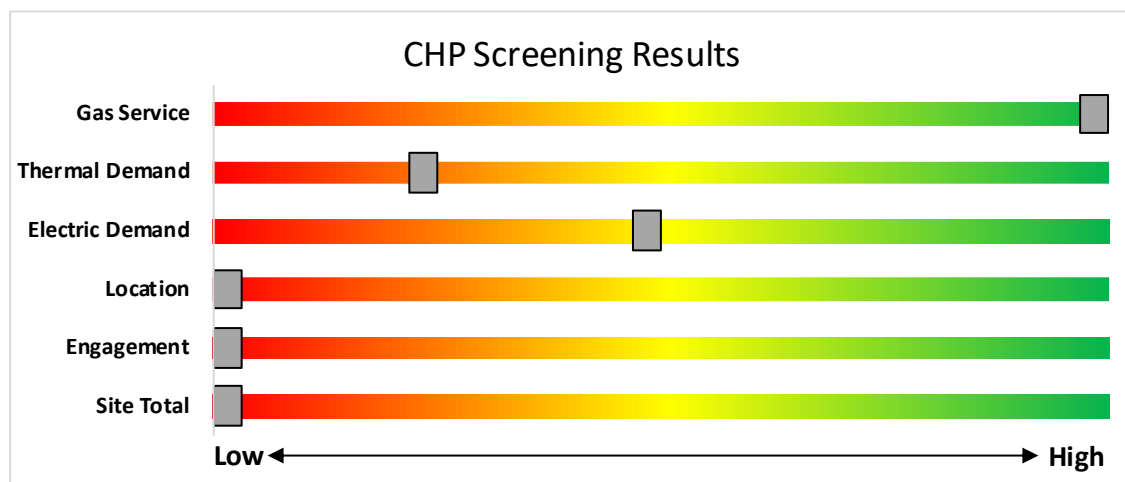

Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation:
http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/

8 ELECTRIC VEHICLES

All electric vehicles (EVs) have an electric motor instead of an internal combustion engine. EVs function by plugging into a charge point, taking electricity from the grid, and then storing it in rechargeable batteries. Although electricity production may contribute to air pollution, the U.S. EPA categorizes all-electric vehicles as zero-emission vehicles because they produce no direct exhaust or tailpipe emissions.

EVs are typically more expensive than similar conventional and hybrid vehicles, although some cost can be recovered through fuel savings, federal tax credit, or state incentives.

8.1 EV Charging

EV charging stations provide a means for electric vehicle operators to recharge their batteries at a facility. While many EV drivers charge at home, others do not have access to regular home charging, and the ability to charge at work or in public locations is critical to making EVs practical for more drivers. Charging can also be used for electric fleet vehicles, which can reduce fuel and maintenance costs for fleets that replace gas or diesel vehicles with EVs.

EV charging comes in three main types. For this assessment, the screening considers addition of Level 2 charging, which is most common at workplaces and other public locations. Depending on the site type and usage, other levels of charging power may be more appropriate.

The preliminary assessment of EV charging at the facility shows that there is high potential for adding EV chargers to the facility's parking, based on potential costs of installation and other site factors.

The primary costs associated with installing EV charging are the charger hardware and the cost to extend power from the facility to parking spaces. This may include upgrades to electric panels to serve increased loads.


The type and size of the parking area impact the costs and feasibility of adding EV charging. Parking structure installations can be less costly than surface lot installations as power may be readily available, and equipment and wiring can be surface mounted. Parking lot installations often require trenching through concrete or asphalt surface. Large parking areas provide greater flexibility in charger siting than smaller lots.

The location and capacity of facility electric panels also impact charger installation costs. A Level 2 charger generally requires a dedicated 208-240V, 40 Amp circuit. The electric panel nearest the planned installation may not have available capacity and may need to be upgraded to serve new EV charging loads. Alternatively, chargers could be powered from a more distant panel. The distance from the panel to the location of charging stations ties directly to costs, as conduits, cables, and potential trenching costs all increase on a per-foot basis. The more charging stations planned, the more likely it is that additional electrical capacity will be needed.

Other factors to consider when planning for EV charging at a facility include who the intended users are, how long they park vehicles at the site, and whether they will need to pay for the electricity they use.



The graphic below displays the results of the EV charging assessment conducted as part of this audit. The position of each slider indicates the impact each factor has on the feasibility of installing EV charging at the site.

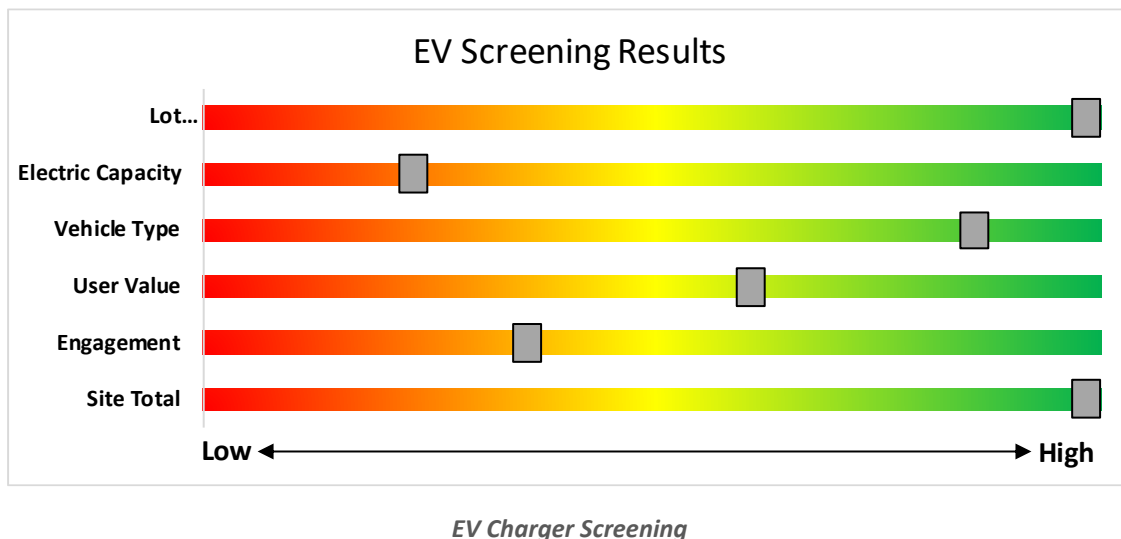

Electric Vehicle Programs Available

New Jersey is leading the way on electric vehicle (EV) adoption on the East Coast. There are several programs designed to encourage EV adoption in New Jersey, which is crucial to reaching a 100% clean energy future.

NJCEP offers a variety of EV programs for vehicles, charging stations, and fleets. Certain EV charging stations that receive electric utility service from Atlantic City Electric Company (ACE), Public Service Electric and Gas Company (PSE&G) or Jersey Central Power and Light (JCP&L), may be eligible for additional electric vehicle charging incentives directly from the utility. Projects may be eligible for both the incentives offered by this BPU program and incentives offered by ACE, PSE&G or JCP&L, up to 90% of the combined charger purchase and installation costs. Please check ACE, PSE&G or JCP&L program eligibility requirements before purchasing EV charging equipment, as additional conditions on types of eligible chargers may apply for utility incentives.

EV Charging incentive information is available from Atlantic City Electric, PSE&G and JCP&L. For more information and to keep up to date on all EV programs please visit <https://www.njcleanenergy.com/commercial-industrial/programs/electric-vehicle-programs>

9 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs and Utility Energy Efficiency Programs can help. Pick the program that works best for you. This section provides an overview of currently available incentive programs in New Jersey.

NJBPU and NJCEP Administered Programs



- New Construction (residential, commercial, industrial, government)
- Large Energy Users
- Energy Savings Improvement Program (financing)
- State Facilities Initiative*
- Local Government Energy Audits
- Combined Heat & Power & Fuel Cells

*State facilities are also eligible for utility programs

Utility Administered Programs



- Existing buildings (residential, commercial, industrial, government)
- Efficient Products
 - Lighting & Marketplace
 - HVAC
 - Appliance Rebates
 - Appliance Recycling

9.1 New Jersey's Clean Energy Program

Save money while saving the planet! New Jersey's Clean Energy Program is a statewide program that offers incentives, programs, and services that benefit New Jersey residents, businesses, educational, non-profit, and government entities to help them save energy, money, and the environment.

Large Energy Users

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers. To qualify entities must have incurred at least \$5 million in total energy costs in the prior fiscal year.

Incentives

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually

How to Participate

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEED). Once the FEED is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at <http://www.njcleanenergy.com/LEUP>.

Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation. ≤

Incentives¹²

Eligible Technology	Size (Installed Rated Capacity)	Incentive (\$/Watt) ⁵	% of Total Cost Cap per Project	\$ Cap per Project
CHPs powered by non-renewable or renewable fuel source, or a combination: ⁴ - Gas Internal Combustion Engine - Gas Combustion Turbine - Microturbine	≤500 kW ¹	\$2.00	30-40% ²	\$2 million
	>500 kW - 1 MW ¹	\$1.00		
	> 1 MW - 3 MW ¹	\$0.55	30%	\$3 million
	>3 MW ¹	\$0.35		
Fuel Cells ≥60%				
Fuel Cells ≥40%	Same as above ¹	Applicable amount above	30%	\$1 million
Waste Heat to Power (WHP) ³ Powered by non-renewable fuel source. Heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine)	≤1MW ¹	\$1.00	30%	\$2 million
	> 1MW ¹	\$.50	30%	\$3 million

¹²

¹ Incentives are tiered, which means the incentive levels vary based upon the installed rated capacity, as listed in the chart above. For example, a 4 MW CHP system would receive \$2.00/watt for the first 500 kW, \$1.00/watt for the second 500 kW, \$0.55/watt for the next 2 MW and \$0.35/watt for the last 1 MW (up to the caps listed).

² The maximum incentive will be limited to 30% of total project. For CHP projects up to 1 MW, this cap will be increased to 40% where a cooling application is used or included with the CHP system (e.g. absorption chiller).

³ Projects will be eligible for incentives shown above, not to exceed the lesser of % of total project cost per project cap or maximum \$ per project cap. Projects installing CHP or FC with WHP will be eligible for incentive shown above, not to exceed the lesser caps of the CHP or FC incentive. Minimum efficiency will be calculated based on annual total electricity generated, utilized waste heat at the host site (i.e. not lost/rejected), and energy input.

⁴ Systems fueled by a Class 1 Renewable Fuel Source, as defined by N.J.A.C. 14:8-2.5, are eligible for a 30% incentive bonus. If the fuel is mixed, the bonus will be prorated accordingly. For example, if the mix is 60/40 (60% being a Class 1 renewable), the bonus will be 18%. This bonus will be included in the final performance incentive payment, based on system performance and fuel mix consumption data. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.

⁵ CHP-FC systems located at Critical Facility and incorporating blackstart and islanding technology are eligible for a 25% incentive bonus. This bonus incentive will be paid with the second/Installation incentive payment. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.



How to Participate

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at <http://www.njcleanenergy.com/CHP>.

Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects must register their projects prior to the start of construction to establish the project's eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two sub-programs. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

Administratively Determined Incentive (ADI) Program

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

Market Segments	Size MW dc	Incentive Value (\$/SREC II)	Public Entities Incentive Value - \$20 Adder (\$/SRECII)
Net Metered Residential	All types and sizes	\$90	N/A
Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects smaller than 1 MW	\$100	\$120
Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects 1 MW to 5 MW	\$90	\$110
Small Net Metered Non-Residential Ground Mount	Projects smaller than 1 MW	\$85	\$105
Large Net Metered Non-Residential Ground Mount	Projects 1 MW to 5 MW	\$80	\$100
LMI Community Solar	Up to 5 MW	\$90	N/A
Non-LMI Community Solar	Up to 5 MW	\$70	N/A
Interim Subsection (t)	All types and sizes	\$100	N/A

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations.

Competitive Solar Incentive (CSI) Program

The CSI Program opened on April 15, 2023, and will serve as the permanent program within the SuSI Program providing incentives to larger solar facilities. The CSI Program is open to qualifying grid supply solar facilities, non-residential net metered solar installations with a capacity greater than five (5) megawatts ("MW"), and to eligible grid supply solar facilities installed in combination with energy storage.

CSI eligible facilities will only be allowed to register in the CSI program upon award of a bid pursuant to N.J.A.C. 14:8-11.10.

The CSI program structure has separate categories, or tranches, to ensure that a range of solar project types, including those on preferred sites, are able to participate despite potentially different project cost profiles. The Board has approved four tranches for grid supply and large net metered solar and an additional fifth tranche for storage in combination with grid supply solar. The following table lists procurement targets for the first solicitation:

Tranche	Project Type	MW (dc) Targets
Tranche 1.	Basic Grid Supply	140
Tranche 2.	Grid Supply on the Built Environment	80
Tranche 3.	Grid Supply on Contaminated Sites and Landfills	40
Tranche 4.	Net Metered Non- Residential	40
Tranche 5.	*Storage Paired with Grid	160 MWh

*The storage tranche of 160 MWh corresponds to a 4-hour storage pairing of 40 MW of solar

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state's Energy Master Plan.

If you are considering installing solar on your building, visit the following link for more information:
<https://njcleanenergy.com/renewable-energy/programs/susi-program>

Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

Demand Response (DR) Energy Aggregator

Demand Response Energy Aggregator is a program designed to reduce the electric load when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Grid operators call upon curtailment service providers and commercial facilities to reduce electric usage during times of peak demand, making the grid more reliable and reducing transmission costs for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail its electric usage.

Typically, an electric customer must be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with greater capability to quickly curtail their demand during peak hours receive higher payments. Customers with back-up generators on site may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in DR programs often find it to be a valuable source of revenue for their facility, because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature setpoints on thermostats (so that air conditioning units run less frequently) or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a DR activity in most situations.

The first step toward participation in a DR program is to contact a curtailment service provider. A list of these providers is available on the website of the independent system operator, PJM, and it includes contact information for each company, as well as the states where they have active business¹³. PJM also posts training materials for program members interested in specific rules and requirements regarding DR activity along with a variety of other DR program information¹⁴.

Curtailment service providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities, and they may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

¹³ <http://www.pjm.com/markets-and-operations/demand-response.aspx>.

¹⁴ <http://www.pjm.com/training/training-events.aspx>.

9.2 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey's investor-owned gas and electric utilities to reduce their customers' use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

Prescriptive and Custom

The Prescriptive and Custom rebate program through your utility provider offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

Equipment Examples

Lighting

Lighting Controls

HVAC Equipment

Refrigeration

Gas Heating

Gas Cooling

Commercial Kitchen Equipment

Food Service Equipment

Variable Frequency Drives

Electronically Commutate Motors

Variable Frequency Drives

Plug Loads Controls

Washers and Dryers

Agricultural

Water Heating

The Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type. The Custom program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives.

Direct Install

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW or less over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures.

How to Participate

To participate in Direct Install, you will work with a participating contractor. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the Direct Install program, subject to program rules and eligibility, while the remaining percent of the cost is paid to the contractor by the customer.


Engineered Solutions

The Engineered Solutions Program provides tailored energy-efficiency assistance and services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. Customers receive expert guided services, including investment-grade energy auditing, engineering design, installation assistance, construction administration, commissioning, and measurement and verification (M&V) services to support the implementation of cost-effective and comprehensive efficiency projects. Engineered Solutions is generally a good option for medium to large sized facilities with a peak demand over 200 kW looking to implement as many measures as possible under a single project to achieve deep energy savings. Engineered Solutions has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Incentives for this program are based on project scope and energy savings achieved.

For more information on any of these programs, contact your local utility provider or visit <https://www.njcleanenergy.com/transition>.

10 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

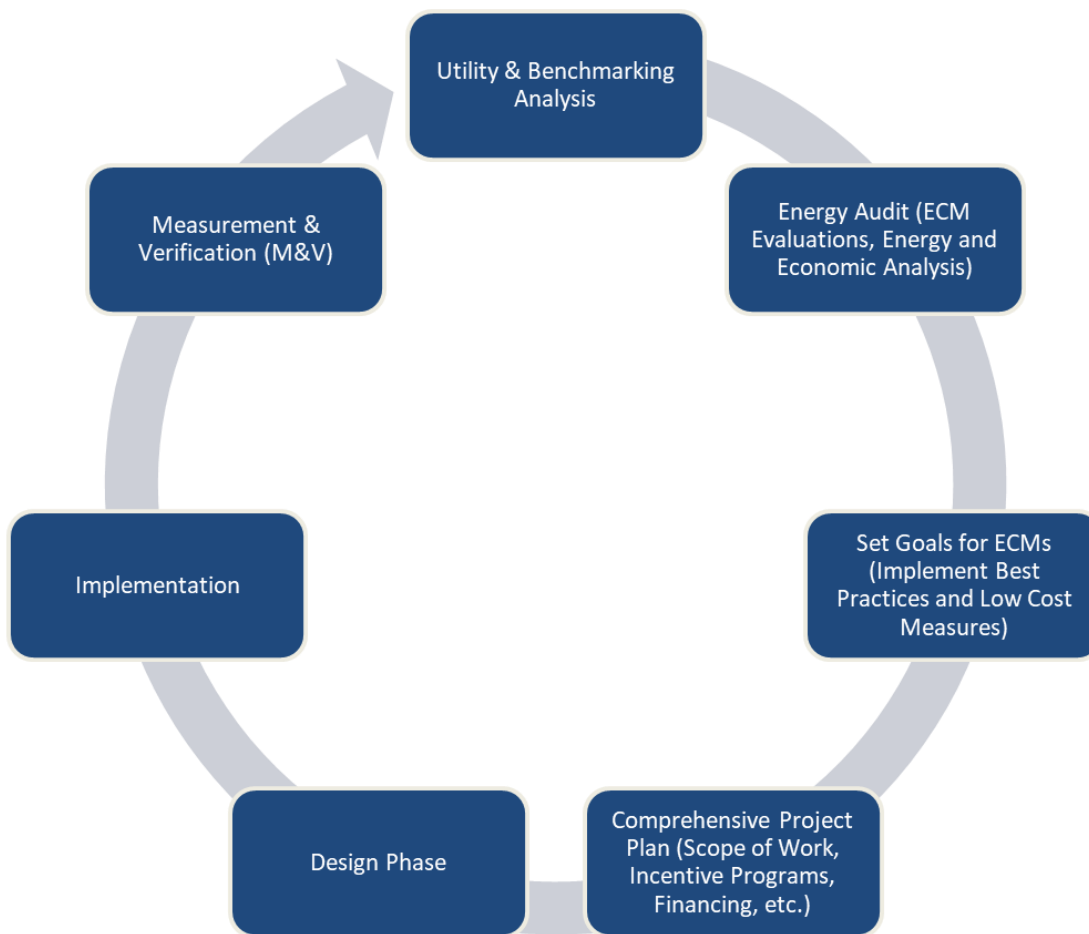

Project Development Cycle

11 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

11.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website¹⁵.

11.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website¹⁶.

¹⁵ www.state.nj.us/bpu/commercial/shopping.html

¹⁶ www.state.nj.us/bpu/commercial/shopping.html



APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 1	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.4	1,684	0	\$237	\$1,040	\$180	3.6
Classroom 10	9	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,604	1, 2	Relamp	Yes	9	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,797	0.4	1,624	0	\$228	\$900	\$180	3.2
Classroom 11	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom 14	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 15	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom 16	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom 17	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom 19	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 2	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 20	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 22	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom 24	31	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,604	1, 2	Relamp	Yes	31	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	1,797	0.5	1,889	0	\$266	\$2,170	\$300	7.0
Classroom 25	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 26	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom 27	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 29	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 3	9	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,604	1, 2	Relamp	Yes	9	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,797	0.4	1,624	0	\$228	\$900	\$180	3.2
Classroom 30	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 31	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 32	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 33	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 34	26	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	26	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.8	3,127	-1	\$440	\$1,970	\$330	3.7
Classroom 36	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 37	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 38	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 39	9	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,604	1, 2	Relamp	Yes	9	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,797	0.4	1,624	0	\$228	\$900	\$180	3.2
Classroom 4	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom 40	27	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	27	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.8	3,247	-1	\$457	\$2,030	\$340	3.7
Classroom 41	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.7	2,887	-1	\$406	\$1,870	\$310	3.8
Classroom 42	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 43	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.3	1,082	0	\$152	\$790	\$130	4.3
Classroom 44	9	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,604	1, 2	Relamp	Yes	9	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,797	0.5	1,907	0	\$268	\$1,130	\$220	3.4
Classroom 45	6	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,604	1, 2	Relamp	Yes	6	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,797	0.3	1,271	0	\$179	\$860	\$160	3.9
Classroom 45A	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,604	1, 2	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,797	0.2	636	0	\$89	\$600	\$100	5.6
Classroom 45B	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,604	1, 2	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,797	0.2	636	0	\$89	\$600	\$100	5.6
Classroom 46	2	LED - Fixtures: Linear Strip	Wall Switch	S	15	2,604	2	None	Yes	2	LED - Fixtures: Linear Strip	Occupancy Sensor	15	1,797	0.0	26	0	\$4	\$150	\$20	35.9
Classroom 46	20	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,604	1, 2	Relamp	Yes	20	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,797	1.1	4,238	-1	\$596	\$2,430	\$470	3.3
Classroom 47	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.1	241	0	\$34	\$250	\$40	6.2
Classroom 47	15	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,604	1, 2	Relamp	Yes	15	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,797	0.8	3,179	-1	\$447	\$1,660	\$340	3.0
Classroom 48	12	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,604	1, 2	Relamp	Yes	12	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,797	0.6	2,543	-1	\$358	\$1,390	\$280	3.1
Classroom 49	27	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	27	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.8	3,247	-1	\$457	\$2,030	\$340	3.7
Classroom 5	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.5	2,165	0	\$305	\$1,570	\$250	4.3
Classroom 6	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom 7	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom 8	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Classroom kindergarten	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,604	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,797	0.6	2,526	-1	\$355	\$1,720	\$280	4.1
Corridor 1	13	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	13	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 1	7	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,976	1, 3	Relamp	Yes	7	LED - Linear Tubes: (2) 2' Lamps	High/Low Control	17	2,053	0.1	487	0	\$69	\$830	\$290	7.9
Corridor 1	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,976	1, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,053	0.1	412	0	\$58	\$430	\$140	5.0
Corridor 1	132	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,976	1, 3	Relamp	Yes	132	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,053	4.0	18,145	-4	\$2,552	\$12,870	\$5,940	2.7



Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Dining Area 1	4	Exit Signs: LED - 2 W Lamp	None	S	6	8,760		None	No	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Dining Area 1	60	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,232	1, 2	Relamp	Yes	60	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,540	1.8	6,186	-1	\$870	\$4,350	\$740	4.1
Electrical storage room	2	LED - Fixtures: Linear Strip	Wall Switch	S	29	1,488	2	None	Yes	2	LED - Fixtures: Linear Strip	Occupancy Sensor	29	1,027	0.0	29	0	\$4	\$150	\$20	31.4
Exterior 2	13	LED - Fixtures: Cobrahead Pole Mount	Timeclock	S	90	4,380		None	No	13	LED - Fixtures: Cobrahead Pole Mount	Timeclock	90	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Gymnasium	4	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	4	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Gymnasium	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,790	1, 2	Relamp	Yes	2	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,925	0.0	135	0	\$19	\$200	\$30	9.0
Gymnasium	36	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,790	1, 2	Relamp	Yes	36	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,925	1.6	6,959	-1	\$979	\$3,270	\$650	2.7
Janitorial - custodian	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial - custodian	8	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	1,674	1, 2	Relamp	Yes	8	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,155	0.1	324	0	\$46	\$530	\$80	9.9
Janitorial - custodian	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,674	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,155	0.1	232	0	\$33	\$480	\$70	12.6
Kitchen 1	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,232	1, 2	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,540	0.2	515	0	\$73	\$580	\$90	6.8
Kitchen 1	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,232	1, 2	Relamp	Yes	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,540	0.5	1,546	0	\$218	\$1,090	\$190	4.1
Kitchen 1	8	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,232	1, 2	Relamp	Yes	8	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,540	0.4	1,453	0	\$204	\$1,040	\$200	4.1
Library	10	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,790	1, 2	Relamp	Yes	10	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,925	0.5	2,270	0	\$319	\$1,210	\$240	3.0
Library	45	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,790	1, 2	Relamp	Yes	45	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,925	1.4	5,799	-1	\$816	\$3,270	\$560	3.3
Library	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,790	1, 2	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,925	0.2	1,031	0	\$145	\$730	\$120	4.2
Locker Room Female	2	Compact Fluorescent: (1) 23W Spiral Plug-In Lamp	Wall Switch	S	23	1,488	1, 2	Relamp	Yes	2	LED Lamps: 12W Plug-In Lamp Lamps	Occupancy Sensor	12	1,027	0.0	48	0	\$7	\$230	\$20	31.0
Locker Room Female	1	Compact Fluorescent: (3) 23W Spiral Plug-In Lamps	Wall Switch	S	69	1,488	1	Relamp	No	1	LED Lamps: 12W Plug-In Lamp Lamps	Wall Switch	36	1,488	0.0	54	0	\$8	\$40	\$0	5.3
Locker Room Female	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Locker Room Female	6	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	1,488	1, 2	Relamp	Yes	6	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,027	0.1	216	0	\$30	\$480	\$70	13.5
Locker Room Female	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,488	1, 2	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,027	0.2	550	0	\$77	\$730	\$120	7.9
Locker Room Female	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,488	1, 2	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,027	0.3	619	0	\$87	\$790	\$130	7.6
Locker Room Male	2	Compact Fluorescent: (1) 23W Spiral Plug-In Lamp	Wall Switch	S	23	1,488	1, 2	Relamp	Yes	2	LED Lamps: 12W Plug-In Lamp Lamps	Occupancy Sensor	12	1,027	0.0	48	0	\$7	\$230	\$20	31.0
Locker Room Male	1	Compact Fluorescent: (3) 23W Spiral Plug-In Lamps	Wall Switch	S	69	1,488	1	Relamp	No	1	LED Lamps: 12W Plug-In Lamp Lamps	Wall Switch	36	1,488	0.0	54	0	\$8	\$40	\$0	5.3
Locker Room Male	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0

	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Locker Room Male	6	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	1,488	1, 2	Relamp	Yes	6	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,027	0.1	216	0	\$30	\$480	\$70	13.5
Locker Room Male	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,488	1, 2	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,027	0.2	481	0	\$68	\$680	\$110	8.4
Locker Room Male	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,488	1, 2	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,027	0.3	619	0	\$87	\$790	\$130	7.6
Mechanical - Boiler	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Boiler	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,840	1, 2	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,650	0.3	1,596	0	\$225	\$790	\$130	2.9
Office - Admin	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	2,160	1, 2	Relamp	Yes	2	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,490	0.0	105	0	\$15	\$200	\$30	11.6
Office - Admin	35	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,160	1, 2	Relamp	Yes	35	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,490	1.1	3,492	-1	\$491	\$2,760	\$460	4.7
Office - Admin	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,160	1, 2	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,490	0.1	449	0	\$63	\$520	\$90	6.8
Office 28	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,160	1, 2	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,490	0.2	499	0	\$70	\$580	\$90	7.0
Restroom - Female	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,840	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,840	0.0	139	0	\$20	\$50	\$10	2.0
Restroom - Female	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,840	1, 2	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,650	0.1	625	0	\$88	\$330	\$60	3.1
Restroom - Male 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,840	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,840	0.0	139	0	\$20	\$50	\$10	2.0
Restroom - Male 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,840	1, 2	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,650	0.1	625	0	\$88	\$330	\$60	3.1
Server Room 1	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,488	1, 2	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,027	0.2	484	0	\$68	\$680	\$120	8.2
Storage 3	2	Compact Fluorescent: (1) 23W Spiral Plug-In Lamp	Wall Switch	S	23	1,488	1, 2	Relamp	Yes	2	LED Lamps: 12W Plug-In Lamp	Occupancy Sensor	12	1,027	0.0	48	0	\$7	\$230	\$20	31.0
Storage 5	1	LED Lamps: (1) 5W A15 Screw-In Lamp	Wall Switch	S	5	1,488		None	No	1	LED Lamps: (1) 5W A15 Screw-In Lamp	Wall Switch	5	1,488	0.0	0	0	\$0	\$0	\$0	0.0
Storage Stage	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	1,488	1, 2	Relamp	Yes	2	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,027	0.0	72	0	\$10	\$200	\$30	16.8
Theater 1	4	Compact Fluorescent: (1) 13W Biaxial Plug-In Lamp	Wall Switch	S	13	1,488	1, 2	Relamp	Yes	4	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	8	1,027	0.0	49	0	\$7	\$380	\$40	49.4
Theater 1	8	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	8	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Theater 1	48	Incandescent: (1) 38W PAR38 Screw-In Lamp	Wall Switch	S	38	1,488	1, 2	Relamp	Yes	48	LED Lamps: PAR38 Lamps	Occupancy Sensor	23	1,027	0.8	1,739	0	\$245	\$3,140	\$280	11.7
Theater 1	7	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	1,488	1, 2	Relamp	Yes	7	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,027	0.1	252	0	\$35	\$510	\$80	12.1
Theater 1	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,488	1, 2	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,027	0.2	481	0	\$68	\$680	\$110	8.4



Motor Inventory & Recommendations

		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - Boiler	Air Compressor	1	Air Compressor	5.00	87.5%	No	Baldor	M3218T-8	W	650		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Storage 1	Dual Temp Pump	1	Other	2.00	84.0%	No	Marathon Electric	9VE145TTDR5633AE	W	2,745	5	No	85.5%	Yes	1	0.5	1,886	0	\$271	\$8,400	\$100	30.7
Exterior Roof	Exhaust Fan	14	Exhaust Fan	0.33	65.0%	No	-	-	B	5,840		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Common Return for HV-1 and HV-2	1	Return Fan	5.00	87.5%	No	-	-	B	2,232		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Kitchen	1	Kitchen Hood Exhaust Fan	0.33	65.0%	No	-	-	B	5,250		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Locker	1	Exhaust Fan	0.33	65.0%	No	-	-	B	5,840		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Storage 3	Exhaust Fan	5	Exhaust Fan	0.25	65.0%	No	-	-	B	5,840		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Storage Stage	Exhaust Fan	3	Exhaust Fan	0.25	65.0%	No	GE	-	B	5,840		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Boiler	Heating Hot Water Pump	2	Heating Hot Water Pump	20.00	91.7%	No	Marathon	256TTDC6026AA	W	2,180	6	No	91.7%	Yes	2	3.8	26,602	0	\$3,816	\$191,700	\$2,600	49.6
Theater 1	Return Fan HV-5	1	Return Fan	2.00	84.0%	No	-	-	B	0	4	No	85.5%	Yes	1	0.6	0	0	\$0	\$5,100	\$100	0.0
Theater 1	Return Fan HV-6	1	Return Fan	2.00	84.0%	No	A.O. Smith	-	B	2,232	4	No	85.5%	Yes	1	0.6	1,534	0	\$220	\$5,100	\$100	22.7
Classroom 1	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 10	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 11	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 14	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 15	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 16	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 17	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 19	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 2	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0



		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 20	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 22	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 24	Unit Ventilator	2	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 25	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 26	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 27	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 29	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 3	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 30	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 31	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 32	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 33	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 34	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 36	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 37	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 38	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 39	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 4	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 40	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 41	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0



		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 42	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 43	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 44	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 45	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 46	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 47	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 48	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 49	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 5	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 6	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 7	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom 8	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Classroom kindergarten	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Corridor 1	Unit Ventilator	13	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Supply Fan HV-1 Gym	1	Supply Fan	7.50	88.5%	No	-	-	B	2,232	4	No	91.0%	Yes	1	2.2	5,553	0	\$797	\$6,700	\$1,000	7.2
Exterior Roof	Supply Fan HV-2 Locker Room	1	Supply Fan	1.50	82.0%	No	-	5K184AG215	B	0	4	No	86.5%	Yes	1	0.4	0	0	\$0	\$4,400	\$100	0.0
Gymnasium	Supply Fan HV-3	1	Supply Fan	2.00	85.5%	No	Wagner	-	B	2,232	4	No	86.5%	Yes	1	0.6	1,491	0	\$214	\$4,700	\$100	21.5
Janitorial - custodian	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	Century	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Library	Supply Fan	2	Supply Fan	0.08	65.0%	No	-	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0



		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - Boiler	Supply Fan HV-Cafeteria	1	Supply Fan	3.00	87.5%	No	Wagner	-	B	2,232		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Office - Admin	Unit Ventilator	6	Supply Fan	0.17	65.0%	No	-	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Server Room 1	Unit Ventilator	1	Supply Fan	0.08	65.0%	No	-	-	B	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Theater 1	Supply Fan HV-5	1	Supply Fan	3.00	87.5%	No	-	-	B	0	4	No	87.5%	Yes	1	0.9	0	0	\$0	\$5,300	\$200	0.0
Theater 1	Supply Fan HV-6	1	Supply Fan	3.00	87.5%	No	-	-	B	2,232	4	No	87.5%	Yes	1	0.9	2,141	0	\$307	\$5,300	\$200	16.6
Mechanical - Boiler	Water Supply Pump - Tanks	1	DHW Circulation Pump	0.40	65.0%	No	-	-	W	6,132		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Boiler	Recirculation Pump	1	DHW Circulation Pump	0.50	65.0%	No	-	-	W	6,132		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

Packaged HVAC Inventory & Recommendations

		Existing Conditions									Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 1	Classroom 1	1	Window AC	1.00		9.70		-	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 10	Classroom 10	1	Window AC	1.00		9.70		GE	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 11	Classroom 11	1	Window AC	1.00		9.70		-	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 15	Classroom 15	1	Window AC	1.00		11.20		Frigidaire	-	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Classroom 2	Classroom 2	1	Window AC	1.00		9.70		-	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 3	Classroom 3	1	Window AC	1.00		11.20		Frigidaire	-	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Classroom 44	Classroom 44	1	Window AC	1.00		9.70		Friedrich	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 45	Classroom 45	1	Window AC	1.00		9.70		Friedrich	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 45A	Classroom 45A	1	Window AC	1.00		9.70		-	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 45B	Classroom 45B	1	Window AC	1.00		9.70		-	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 48	Classroom 48	1	Window AC	1.00		9.70		-	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 6	Classroom 6	1	Window AC	1.00		9.70		-	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom 7	Classroom 7	1	Window AC	1.00		9.70		-	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Classroom kindergarten	Classroom kindergarten	1	Window AC	1.00		9.70		-	-	B	7	Yes	1	Window AC	1.00		12.00		0.1	202	0	\$29	\$1,000	\$0	34.6
Kitchen 1	Kitchen 1	1	Window AC	1.00		11.20		Frigidaire	-	W		No							0.0	0	0	\$0	\$0	\$0	0.0



Electric Chiller Inventory & Recommendations

		Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Storage 1	Office Unit Ventilators	1	Air-Cooled Reciprocating Chiller	9.82	Technical Systems	33AOLD20	W		No							0.0	0	0	\$0	\$0	\$0	0.0

Space Heating Boiler Inventory & Recommendations

		Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Output Capacity per Unit (MBh)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - Boiler	Unit Ventilators and AHUs	5	Condensing Hot Water Boiler	1,695	Aerco	Benchmark 2.0	W	8	Yes	5	Condensing Hot Water Boiler	1,695	93.00%	Et	0.0	0	337	\$4,490	\$323,700	\$18,600	68.0

Demand Control Ventilation Recommendations

		Recommendation Inputs					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Affected	ECM #	Number of Zones	Cooling Capacity of Controlled System (Tons)	Electric Heating Capacity of Controlled System (kBtu/hr)	Output Heating Capacity of Controlled System (MBh)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Theater 1	Theater 1 HV-5	9	2.00	0.00	0.00	155.52	0.0	0	0	\$0	\$2,900	\$0	0.0
Theater 1	Theater 1 HV-6	9	2.00	0.00	0.00	155.52	0.0	0	8	\$110	\$2,900	\$0	26.3
Roof	Gym HV-1	9	2.00	0.00	0.00	157.44	0.0	0	8	\$111	\$2,900	\$0	26.0
Roof	Locker Room HV-2	9	2.00	0.00	0.00	92.16	0.0	0	0	\$0	\$2,900	\$0	0.0
Boiler Room	Cafeteria HV-4	9	2.00	0.00	0.00	129.60	0.0	0	7	\$92	\$2,900	\$0	31.6

Pipe Insulation Recommendations

		Recommendation Inputs			Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Affected	ECM #	Length of Uninsulated Pipe (ft)	Pipe Diameter (in)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - Boiler	Main Building DHW	10	20	2.00	0.0	0	15	\$204	\$270	\$40	1.1

DHW Inventory & Recommendations

		Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Manufacturer	Model	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - Boiler	Main Building DHW	1	Indirect System	Powerfin	PFN0752	W		No						0.0	0	0	\$0	\$0	\$0	0.0

Low-Flow Device Recommendations

		Recommendation Inputs				Energy Impact & Financial Analysis						
Location	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Restroom	11	12	Faucet Aerator (Lavatory)	1.50	0.50	0.0	0	7	\$89	\$100	\$50	0.6

Walk-In Cooler/Freezer Inventory & Recommendations

	Existing Conditions				Proposed Conditions				Energy Impact & Financial Analysis						
Location	Cooler/ Freezer Quantit y	Case Type/Temperature	Manufacturer	Model	ECM #	Install EC Evaporator Fan Motors?	Install Electric Defrost Control?	Install Evaporator Fan Control?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Cooler (35F to 55F)	N/A	N/A	12, 13	Yes	No	Yes	0.1	1,207	0	\$173	\$2,430	\$120	13.3
Kitchen	1	Cooler (35F to 55F)	N/A	N/A	12, 13	Yes	No	Yes	0.1	1,382	0	\$198	\$2,810	\$160	13.4

Commercial Refrigerator/Freezer Inventory & Recommendations

	Existing Conditions					Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Refrigerator/ Freezer Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Stand-Up Refrigerator, Solid Door (31 - 50 cu. ft.)	Everest		Yes		No	0.0	0	0	\$0	\$0	\$0	0.0



Cooking Equipment Inventory & Recommendations

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Equipment Type	Manufacturer	Model	High Efficiency Equipement?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Gas Combination Oven/Steam Cooker (<15 Pans)	Vulcan	6745A	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Gas Griddle (3 Feet Width)	Vulcan	6745A	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Electric Convection Oven (Full Size)	Olympi Silver	N/A	No		No	0.0	0	0	\$0	\$0	\$0	0.0

Dishwasher Inventory & Recommendations


Existing Conditions								Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Dishwasher Type	Manufacturer	Model	Water Heater Fuel Type	Booster Heater Fuel Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Payback w/ Incentives in Years
Kitchen	1	Multi-Tank Conveyor (High Temp)	Jackson	N/A	Natural Gas	None	No		No	0.0	0	0	\$0	\$0	\$0	0.0

Plug Load Inventory

Existing Conditions						
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?	Manufacturer	Model
Office	1	Coffee Machine	75	No	-	-
Classroom/Office	19	Desktop	100	No	Dell/Hp	-
Gym	6	Fan (Ceiling)	90	No	-	-
Classroom	1	Fan (Large)	90	No	-	-
Classroom	43	Laptop	54	No	Dell	-
Kitchen/Office	5	Microwave	1,000	No	-	-
Classroom	43	Air purifier	68	No	Medify Air	-
Classroom	46	Smart Board	114	Yes	Smart	-
Office	7	Printer (Medium/Small)	150	No	Hp	-
Office	3	Printer/Copier (Large)	600	No	Xerox	-
Classroom	8	Projector	300	No	Epson	-
Office	1	Refrigerator (Mini)	325	No	-	-
Office	4	Refrigerator (Residential)	650	No	-	-
Kitchen 1	1	Toaster	800	No	-	-
Kitchen 1	1	Toaster Oven	1,200	No	-	-

APPENDIX B: ENERGY STAR STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of site energy and source energy. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.



ENERGY STAR® Statement of Energy Performance

70

ENERGY STAR®
Score¹

Hillside Avenue School

Primary Property Type: K-12 School
Gross Floor Area (ft²): 99,070
Built: 1961

For Year Ending: August 31, 2023
Date Generated: May 20, 2024

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
Property Address Hillside Avenue School 125 Hillside Avenue Cranford, New Jersey 07016	Property Owner Cranford Public Schools 132 Thomas Street Cranford, NJ 07016 (908) 709-6213	Primary Contact Robert Carfagno 132 Thomas Street Cranford, NJ 07016 (908) 709-6213 carfagno@cranfordschools.org	
Property ID: 32316053			

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI	Annual Energy by Fuel	National Median Comparison	
57.2 kBtu/ft²	Electric - Grid (kBtu) 1,510,354 (27%)	National Median Site EUI (kBtu/ft²)	71
	Natural Gas (kBtu) 4,159,095 (73%)	National Median Source EUI (kBtu/ft²)	107.6
		% Diff from National Median Source EUI	-19%
Source EUI		Annual Emissions	
86.8 kBtu/ft²		Total (Location-Based) GHG Emissions (Metric Tons CO2e/year)	357

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: _____ Date: _____

Licensed Professional

() - _____



Professional Engineer or Registered
Architect Stamp
(if applicable)

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
Btu	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
CHP	<i>Combined heat and power</i> . Also referred to as cogeneration.
COP	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
DCV	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
US DOE	<i>United States Department of Energy</i>
EC Motor	<i>Electronically commutated motor</i>
ECM	<i>Energy conservation measure</i>
EER	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
EUI	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
ENERGY STAR	ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA.
EPA	<i>United States Environmental Protection Agency</i>
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
GHG	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
gpf	<i>Gallons per flush</i>

gpm	<i>Gallon per minute</i>
HID	<i>High intensity discharge:</i> high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
hp	<i>Horsepower</i>
HPS	<i>High-pressure sodium:</i> a type of HID lamp.
HSPF	<i>Heating seasonal performance factor:</i> a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
HVAC	<i>Heating, ventilating, and air conditioning</i>
IHP 2014	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
IPLV	<i>Integrated part load value:</i> a measure of the part load efficiency usually applied to chillers.
kBtu	One thousand British thermal units
kW	<i>Kilowatt:</i> equal to 1,000 Watts.
kWh	<i>Kilowatt-hour:</i> 1,000 Watts of power expended over one hour.
LED	<i>Light emitting diode:</i> a high-efficiency source of light with a long lamp life.
LGEA	<i>Local Government Energy Audit</i>
Load	The total power a building or system is using at any given time.
Measure	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
MH	<i>Metal halide:</i> a type of HID lamp.
MBh	<i>Thousand Btu per hour</i>
MBtu	<i>One thousand British thermal units</i>
MMBtu	<i>One million British thermal units</i>
MV	<i>Mercury Vapor:</i> a type of HID lamp.
NJBPU	<i>New Jersey Board of Public Utilities</i>
NJCEP	<i>New Jersey's Clean Energy Program:</i> NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment.
psig	<i>Pounds per square inch gauge</i>
Plug Load	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
PV	<i>Photovoltaic:</i> refers to an electronic device capable of converting incident light directly into electricity (direct current).

SEER	<i>Seasonal energy efficiency ratio:</i> a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
SEP	<i>Statement of energy performance:</i> a summary document from the ENERGY STAR Portfolio Manager.
Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
SREC (II)	<i>Solar renewable energy credit:</i> a credit you can earn from the state for energy produced from a photovoltaic array.
T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
therm	100,000 Btu. Typically used as a measure of natural gas consumption.
tons	A unit of cooling capacity equal to 12,000 Btu/hr.
Turnkey	Provision of a complete product or service that is ready for immediate use.
VAV	<i>Variable air volume</i>
VFD	<i>Variable frequency drive:</i> a controller used to vary the speed of an electric motor.
WaterSense®	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
Watt (W)	Unit of power commonly used to measure electricity use.