



Local Government Energy Audit Report

Chatham Township Fire Station 2

Enter Date

Prepared for:

Chatham Township Volunteer Fire
Department

172 Southern Boulevard

Chatham, New Jersey 07928

Prepared by:

TRC

317 George Street

New Brunswick, New Jersey 08901

Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based on previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2023 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Table of Contents


| | | |
|------------|--|-----------|
| 1 | Executive Summary | 1 |
| 1.1 | Planning Your Project | 4 |
| | Pick Your Installation Approach | 4 |
| | Options from Your Utility Company..... | 4 |
| | <i>Prescriptive and Custom Rebates</i> | 4 |
| | <i>Direct Install</i> | 4 |
| | <i>Engineered Solutions</i> | 4 |
| | Options from New Jersey's Clean Energy Program..... | 5 |
| 2 | Existing Conditions | 6 |
| 2.1 | Site Overview..... | 6 |
| 2.2 | Building Occupancy | 6 |
| 2.3 | Building Envelope | 6 |
| 2.4 | Lighting Systems..... | 7 |
| 2.5 | Air Handling Systems..... | 10 |
| | Air Handling Units (AHUs) | 10 |
| 2.6 | Heating Hot Water Systems | 11 |
| 2.7 | Domestic Hot Water..... | 12 |
| 2.8 | Food Service Equipment..... | 12 |
| 2.9 | Plug and Process Loads | 12 |
| 2.10 | Water-Using Systems | 13 |
| 3 | Energy Use and Costs | 14 |
| 3.1 | Electricity..... | 16 |
| 3.2 | Natural Gas..... | 17 |
| 3.3 | Benchmarking..... | 18 |
| | Tracking Your Energy Performance..... | 19 |
| 4 | Energy Conservation Measures | 20 |
| 4.1 | Lighting..... | 23 |
| | ECM 1: Install LED Fixtures | 23 |
| | ECM 2: Retrofit Fixtures with LED Lamps..... | 23 |
| 4.2 | Lighting Controls..... | 24 |
| | ECM 3: Install Occupancy Sensor Lighting Controls | 24 |
| | ECM 4: Install High/Low Lighting Controls | 24 |
| 4.3 | Variable Frequency Drives (VFD)..... | 25 |
| | ECM 5: Install VFDs and CO Sensing on Truck Bay Exhaust System | 25 |
| 4.4 | HVAC Improvements | 25 |
| | ECM 6: Install Pipe Insulation..... | 25 |
| 4.5 | Domestic Water Heating | 26 |
| | ECM 7: Install Low-Flow DHW Devices..... | 26 |

| | | |
|-----------|--|------------|
| 5 | Energy Efficient Best Practices | 27 |
| | Energy Tracking with ENERGY STAR Portfolio Manager..... | 27 |
| | Weatherization..... | 27 |
| | Doors and Windows..... | 27 |
| | Lighting Maintenance..... | 28 |
| | Motor Controls..... | 28 |
| | Motor Maintenance..... | 28 |
| | AC System Evaporator/Condenser Coil Cleaning..... | 28 |
| | HVAC Filter Cleaning and Replacement..... | 28 |
| | Ductwork Maintenance..... | 28 |
| | Boiler Maintenance..... | 29 |
| | Water Heater Maintenance..... | 29 |
| | Compressed Air System Maintenance..... | 30 |
| | Water Conservation..... | 30 |
| | Procurement Strategies..... | 31 |
| 6 | On-site Generation | 32 |
| 6.1 | Solar Photovoltaic..... | 33 |
| 6.2 | Combined Heat and Power..... | 35 |
| 7 | Electric Vehicles (EV) | 36 |
| 7.1 | Electric Vehicle Charging..... | 37 |
| 8 | Project Funding and Incentives | 39 |
| 8.1 | Utility Energy Efficiency Programs..... | 40 |
| | Prescriptive and Custom..... | 40 |
| | Direct Install..... | 40 |
| | Engineered Solutions..... | 41 |
| 8.2 | New Jersey’s Clean Energy Programs..... | 42 |
| | Large Energy Users..... | 42 |
| | Combined Heat and Power..... | 43 |
| | Successor Solar Incentive Program (SuSI)..... | 44 |
| | Energy Savings Improvement Program..... | 45 |
| 9 | Project Development | 46 |
| 10 | Energy Purchasing and Procurement Strategies | 47 |
| 10.1 | Retail Electric Supply Options..... | 47 |
| 10.2 | Retail Natural Gas Supply Options..... | 47 |
| | Appendix A: Equipment Inventory & Recommendations | A-1 |
| | Appendix B: ENERGY STAR Statement of Energy Performance | B-1 |
| | Appendix C: Glossary | C-1 |

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Chatham Township Fire Station 2. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT

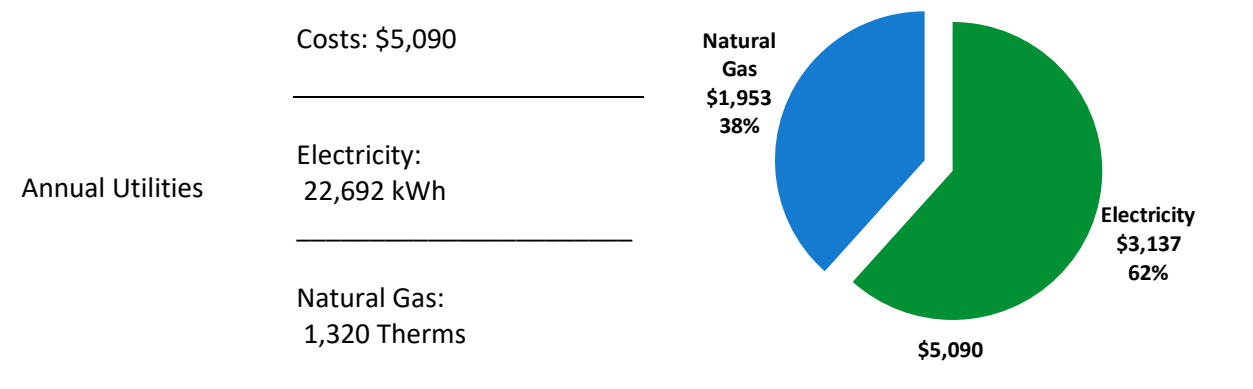

| | | |
|------------------------------------|-----------------------------|--|
| ENERGY STAR® Benchmarking Score | N/A <i>(1-100 scale)</i> | A standard energy use benchmark is not available for this facility type. This report contains suggestions about how to improve building performance and reduce energy costs. |
|------------------------------------|-----------------------------|--|

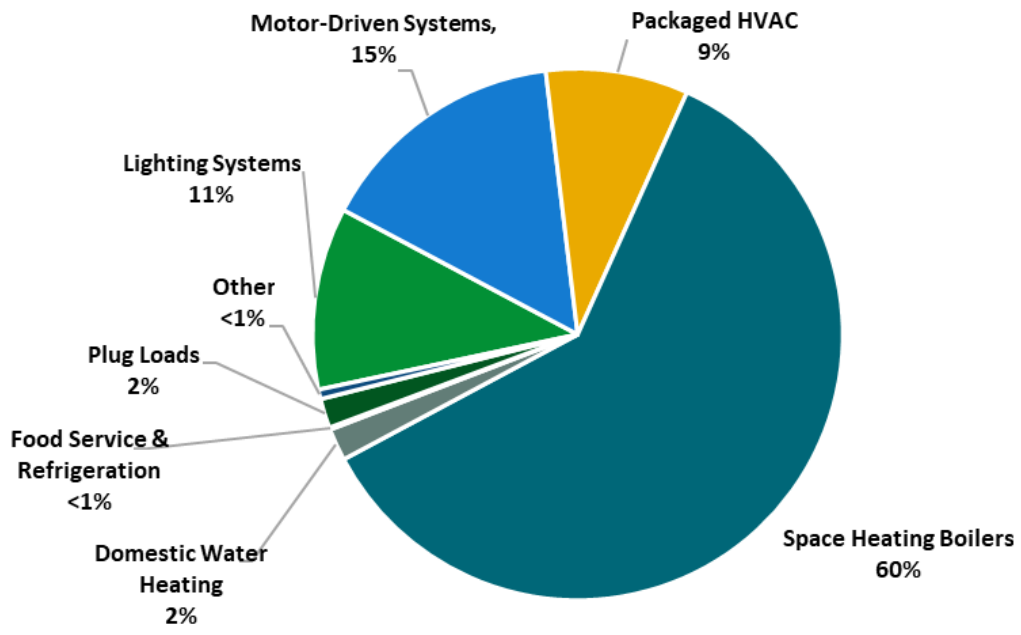


Figure 1 - Energy Use by System


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (All Evaluated Measures)

| | |
|---|---|
| Installation Cost | \$12,260 |
| Potential Rebates & Incentives ¹ | \$1,911 |
| Annual Cost Savings | \$1,245 |
| Annual Energy Savings | Electricity: 7,204 kWh Natural Gas: 168 Therms |
| Greenhouse Gas Emission Savings | 5 Tons |
| Simple Payback | 8.3 Years |
| Site Energy Savings (All Utilities) | 20% |

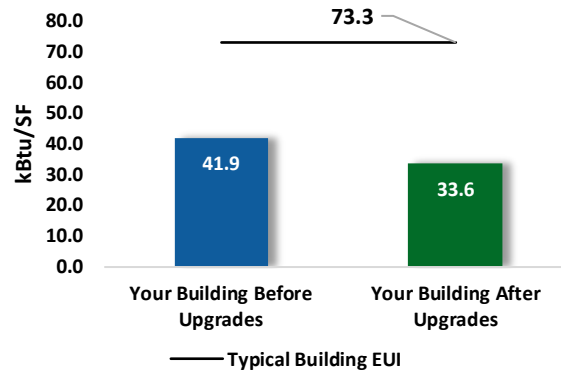

Scenario 2: Cost Effective Package²

| | |
|-------------------------------------|---|
| Installation Cost | \$12,144 |
| Potential Rebates & Incentives | \$1,891 |
| Annual Cost Savings | \$1,243 |
| Annual Energy Savings | Electricity: 7,194 kWh Natural Gas: 168 Therms |
| Greenhouse Gas Emission Savings | 5 Tons |
| Simple Payback | 8.2 Years |
| Site Energy Savings (all utilities) | 20% |

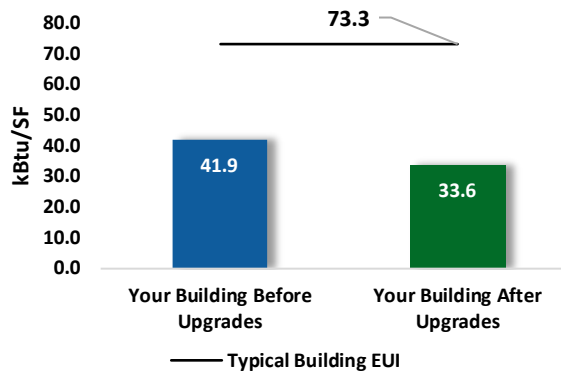

On-site Generation Potential

| | |
|-------------------------|------|
| Photovoltaic | None |
| Combined Heat and Power | None |

¹ Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

| # | Energy Conservation Measure | Cost Effective? | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|--|---|-----------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| Lighting Upgrades | | | 3,175 | 1.8 | -1 | \$431 | \$2,718 | \$740 | \$1,978 | 4.6 | 3,137 |
| ECM 1 | Install LED Fixtures | Yes | 686 | 0.0 | 0 | \$95 | \$444 | \$155 | \$289 | 3.0 | 691 |
| ECM 2 | Retrofit Fixtures with LED Lamps | Yes | 2,488 | 1.8 | -1 | \$336 | \$2,274 | \$585 | \$1,689 | 5.0 | 2,445 |
| Lighting Control Measures | | | 479 | 0.2 | 0 | \$65 | \$1,016 | \$825 | \$191 | 3.0 | 470 |
| ECM 3 | Install Occupancy Sensor Lighting Controls | No | 10 | 0.0 | 0 | \$1 | \$116 | \$20 | \$96 | 73.2 | 10 |
| ECM 4 | Install High/Low Lighting Controls | Yes | 469 | 0.2 | 0 | \$63 | \$900 | \$805 | \$95 | 1.5 | 460 |
| Variable Frequency Drive (VFD) Measures | | | 3,550 | 1.6 | 0 | \$491 | \$8,062 | \$275 | \$7,787 | 15.9 | 3,575 |
| ECM 5 | Install VFDs and CO Sensing on Truck Bay Exhaust System | Yes | 3,550 | 1.6 | 0 | \$491 | \$8,062 | \$275 | \$7,787 | 15.9 | 3,575 |
| HVAC System Improvements | | | 0 | 0.0 | 17 | \$248 | \$436 | \$58 | \$378 | 1.5 | 1,965 |
| ECM 6 | Install Pipe Insulation | Yes | 0 | 0.0 | 17 | \$248 | \$436 | \$58 | \$378 | 1.5 | 1,965 |
| Domestic Water Heating Upgrade | | | 0 | 0.0 | 1 | \$10 | \$29 | \$13 | \$16 | 1.7 | 76 |
| ECM 7 | Install Low-Flow DHW Devices | Yes | 0 | 0.0 | 1 | \$10 | \$29 | \$13 | \$16 | 1.7 | 76 |
| TOTALS (COST EFFECTIVE MEASURES) | | | 7,194 | 3.6 | 17 | \$1,243 | \$12,144 | \$1,891 | \$10,254 | 8.2 | 9,213 |
| TOTALS (ALL MEASURES) | | | 7,204 | 3.6 | 17 | \$1,245 | \$12,260 | \$1,911 | \$10,350 | 8.3 | 9,223 |

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

Utility-run energy efficiency programs and New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives *before* purchasing materials or starting installation.

Options from Your Utility Company

Prescriptive and Custom Rebates

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the Prescriptive and Custom Rebates program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval may be required for some incentives. Contact your utility company for more details prior to project installation.

Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized contractor. This program can provide incentives up to 70% or 80% of the cost of selected measures. A Direct Install contractor will assess and verify individual measure eligibility and perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Engineered Solutions

The Engineered Solutions program provides tailored energy-efficiency assistance and turnkey engineering services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. The program provides all professional services from audit, design, construction administration, to commissioning and measurement and verification for custom whole-building energy-efficiency projects. Engineered Solutions allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs.

For more details on these programs please contact your utility provider.

Options from New Jersey's Clean Energy Program

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat and Power (CHP)

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Successor Solar Incentive Program (SuSI)

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

Large Energy User Program (LEUP)

LEUP is designed to promote self-investment in energy efficiency. It incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

For more details on these programs please visit [New Jersey's Clean Energy Program website](#) .



2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Chatham Township Fire Station 2. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

New Jersey. TRC met with Fire Department President Richard Gentles to review the facility operations and help focus our investigation on specific energy-using systems.

Chatham Township Fire Station 2 is a two-story, 5,000 square foot building built in 2010. Spaces include garage, office, kitchen, bunk room, office, restrooms, stairwell, closets, and small mechanical space.

2.2 Building Occupancy

The facility is occupied sporadically Monday through Sunday at all hours. It is used on an as-needed basis as emergencies arise. Wednesday afternoons, the offices and garage are occupied regularly by staff even when no emergency is called. The fire station responds to approximately 400 calls annually. All staff are volunteers.

The facility is occupied intermittently as needed for maintenance and operations.

| Building Name | Weekday/Weekend | Operating Schedule |
|---------------------------------|-----------------|---------------------|
| Chatham Township Fire Station 2 | Weekday | 12:00 AM - 12:00 AM |
| | Weekend | 12:00 AM - 12:00 AM |

Figure 3 - Building Occupancy Schedule

2.3 Building Envelope

Building walls are made of concrete masonry units (CMUs) with a brick veneer and either gypsum drywall or painted CMU interior finish. The roof is pitched with a metal deck covered with asphalt shingles. Roof encloses conditioned space. There is an insulated drop ceiling and crawl space between the roof and part of the second floor.

The windows are double paned and have aluminum frames with a thermal break. The glass-to-frame seals are in good condition. The operable window weather seals are in good condition, showing little evidence of excessive wear. Exterior doors have aluminum frames and are in good condition with undamaged door seals. Degraded window and door seals increase drafts and outside air infiltration. There are three motorized garage doors for the fire trucks.



Front of Building



Front Door



Side View of Building and Roof



Window Seals

2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps, mainly surface-mounted vapor tight fixtures, either 4-foot with 2-lamps or 8-foot with 4-lamps. Other fixture types include 2-lamp and 3-lamp, 4-foot-long recessed fixtures, both parabolic and prismatic. There are also several 4-foot stairwell wraps.

There are a few recessed cans with 2-lamp 13-Watt compact fluorescent lamps (CFL) twin plug-ins. The attic crawl space has a 100-Watt A19 incandescent lamp. All exit signs are LED.

Fixtures and lenses are in good condition with little to no yellowing. Interior lighting levels were generally sufficient.

Most lighting is controlled by wall or ceiling occupancy sensors.



Surface Mounted Vapor Tight



Recessed Parabolic



Recessed Prismatic




Surface Mounted Vapor Tight



Incandescent



CFL twins – Recessed Can

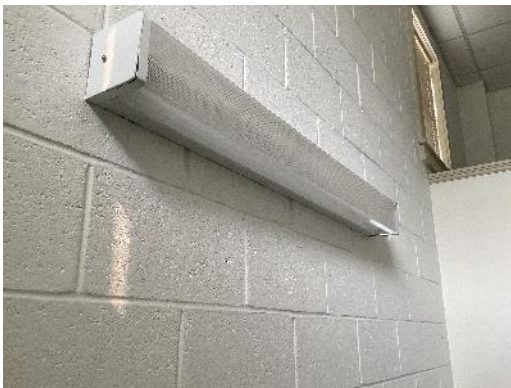

Stairwell Wrap



Recessed Parabolic



Wall-Mounted Occupancy Sensor

LED exterior fixtures include downward pointing floodlights mounted above the front garage doors and some wall packs. There are also some HID wall packs and CFL twin plug-in recessed canopy lights.

The parking lot has a pole-mounted acorn top LED fixture, and there are LED architectural floodlights for the sign and flag. Exterior fixtures are controlled by a timeclock.



LED Above Garage Door



LED Wall Pack



Recessed Canopy Light



HID Wall Pack



Parking Lot Pole Light



LED Flag Light



LED Sign Lights

2.5 Air Handling Systems

Air Handling Units (AHUs)

The building is conditioned by a split-system air-source heat pump. The AHU is connected to ductwork above the drop ceiling and is equipped with a supply fan motor, heating hot water coil, and a refrigerant coil for cooling. It is physically located above the ceiling of the bunk room. The unit has two supply fans with fractional hp motors. This unit serves the bunk room, kitchen, and restroom areas. There is a heat pump terminal unit in the office for cooling only connected to the same outdoor compressor.

This system includes an outdoor condensing unit that has a cooling capacity of 5 tons. It is new and in good condition. This is a split air-conditioning (AC) system configuration. The heating coil is supplied by the hot water boiler, which is described in the section that follows.

Heating and cooling are controlled by Ecobee thermostats, which are controlled manually on location or remotely by the Department Chief on his phone when it is known that the station is about to be occupied. The office terminal AC unit is controlled locally by a remote control.



AHU



Outdoor Condensing Unit



Office Terminal Unit



Ecobee Smart Thermostat

2.6 Heating Hot Water Systems

One Munchkin 373.07 MBh condensing hot water boiler serves the building's heating load. The burners are fully modulating with a nominal efficiency of 93.5%. Manufactured in 2009, it is in good condition.

The hydronic distribution system is a heating-only system.

The boiler provides hot water to fin tube radiators and to heating hot water coils in the attic AHU. All major areas with the exception of the truck bay are heated this way.

The boiler serves a primary-only distribution system with only one, 0.4 hp constant speed heating hot water pump. There is about 20 feet of 2-inch uninsulated heating hot water piping.

While heating is primarily controlled via the Ecobee thermostats, the radiators also have a dial controller.



Boiler



Heating Hot Water Pump and Uninsulated Pipes



Baseboard Radiator in Kitchen



Baseboard Radiator in Office

2.7 Domestic Hot Water

Hot water is produced by a Rheem 40 gallon, 36 MBh gas-fired storage water heater with an efficiency rating of 90%. The unit is from 2017 and is in good condition.

One, 0.125 hp circulation pump distributes water to end uses. The circulation pump operates continuously.

The domestic hot water pipes are not insulated amounting to about 9 feet of 1-inch diameter of exposed domestic hot water piping.



Hot Water Heater



DHW Circulation Pump

2.8 Food Service Equipment

The kitchen has a residential-style gas range that is used to prepare communal meals for the team of volunteer firefighters. Equipment is not high efficiency and is in fair condition.

The dishwasher is a non-ENERGY STAR residential door type unit with a drying cycle.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.

2.9 Plug and Process Loads

The location is doing a great job managing the electrical plug loads. This report makes additional suggestions for ECMs in this area as well as energy efficient best practices.

There is one desktop workstation, microwave, residential-style refrigerator, fax machine, wi-fi equipment, and several televisions.

There is also some shop equipment and an industrial exhaust system of fans that operate in the truck bay with motors ranging from 1 hp to 3 hp.

There is a relatively new 5 hp Quincy air compressor used for the trucks' air brakes. Each garage door in the truck bay also has a garage door motor.




Office Plug Load



Kitchen Plug Load



Air Compressor

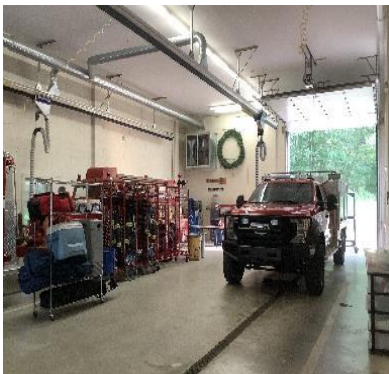

Truck Bay Exhaust Fans and Lines



Truck Exhaust Venting System



Garage Door Motor

2.10 Water-Using Systems

There are two restrooms with toilets, sinks, and a shower. Faucet flow rates are at 2.2 gallons per minute (gpm). The dishwasher also uses domestic hot water.



Restroom Faucet




Kitchen Sink

3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

| Utility Summary | | |
|-----------------|--------------|----------------|
| Fuel | Usage | Cost |
| Electricity | 22,692 kWh | \$3,137 |
| Natural Gas | 1,320 Therms | \$1,953 |
| Total | | \$5,090 |

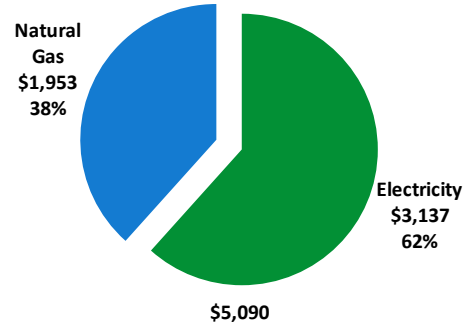

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


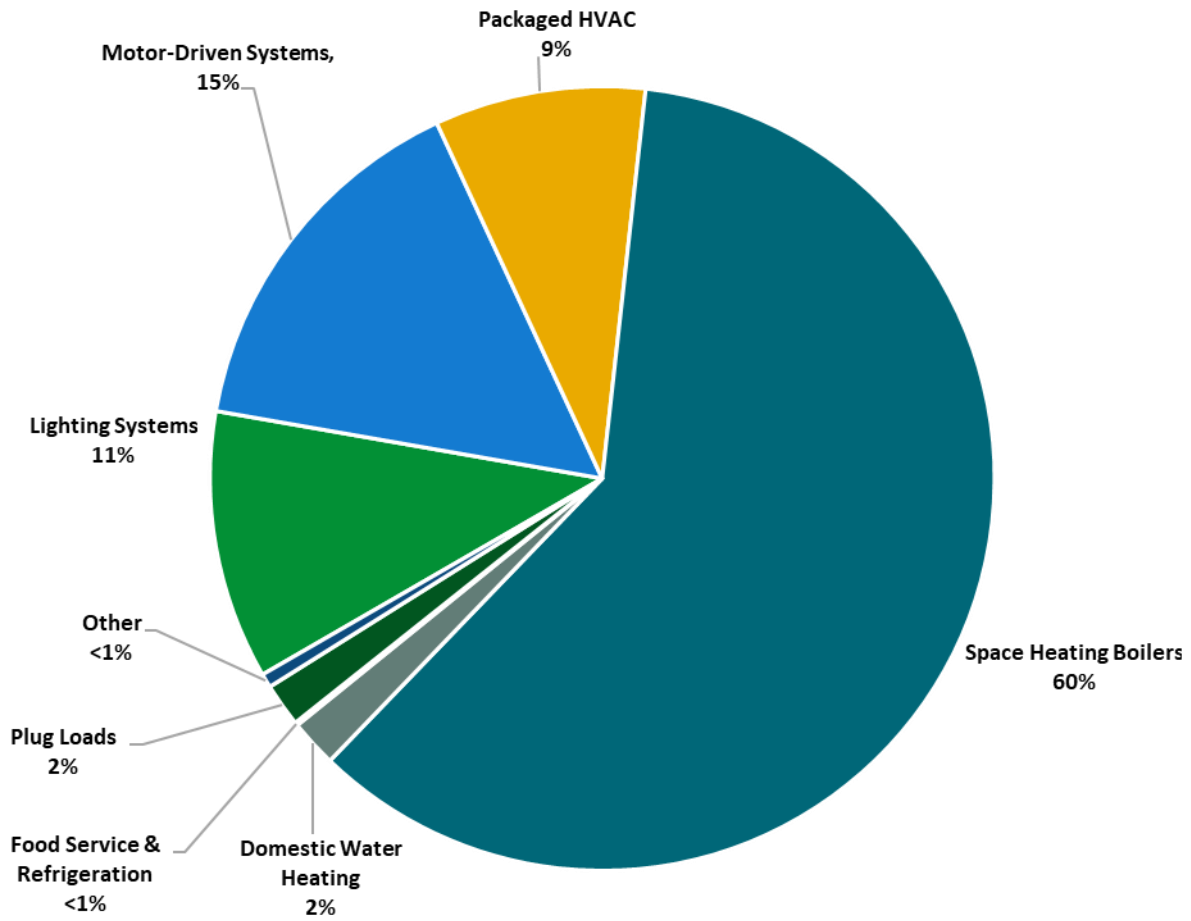


Figure 4 - Energy Balance

3.1 Electricity

JCP&L delivers electricity under rate class General Service Secondary JC_GS1_01F.

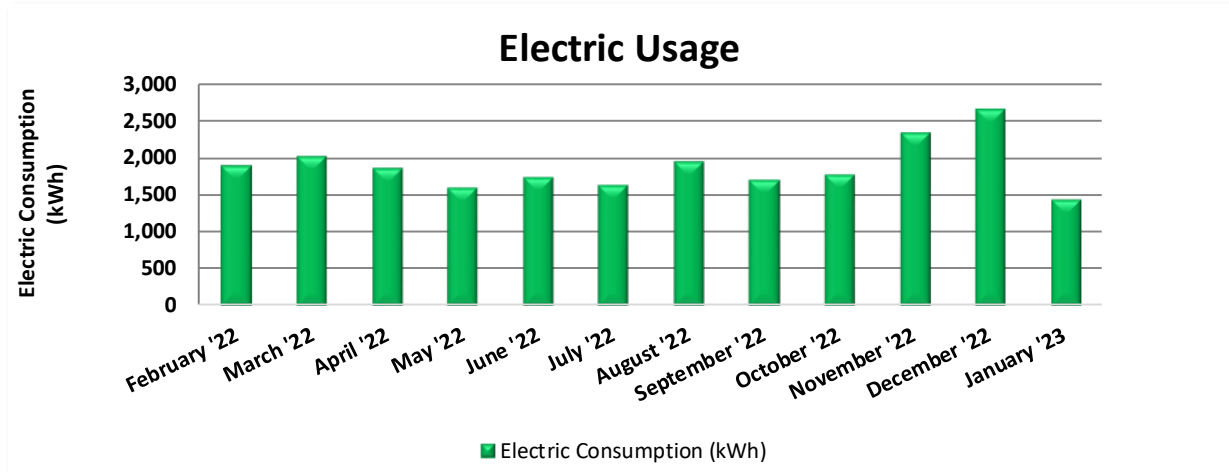


| Electric Billing Data | | | | | |
|-----------------------|----------------|----------------------|-------------|-------------|---------------------|
| Period Ending | Days in Period | Electric Usage (kWh) | Demand (kW) | Demand Cost | Total Electric Cost |
| 3/10/22 | 29 | 1,898 | | | \$269 |
| 4/10/22 | 31 | 2,029 | | | \$284 |
| 5/12/22 | 32 | 1,871 | | | \$267 |
| 6/10/22 | 29 | 1,602 | | | \$235 |
| 7/13/22 | 33 | 1,743 | | | \$238 |
| 8/10/22 | 28 | 1,645 | | | \$228 |
| 9/13/22 | 34 | 1,948 | | | \$263 |
| 10/12/22 | 29 | 1,713 | | | \$241 |
| 11/9/22 | 28 | 1,787 | | | \$250 |
| 12/9/22 | 30 | 2,348 | | | \$309 |
| 1/11/23 | 33 | 2,673 | | | \$341 |
| 2/9/23 | 29 | 1,435 | | | \$211 |
| Totals | 365 | 22,692 | 0 | \$0 | \$3,137 |
| Annual | 365 | 22,692 | 0 | \$0 | \$3,137 |

Notes:

- Billing demand not recorded for this account
- The average electric cost over the past 12 months was \$0.138/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

3.2 Natural Gas

PSE&G delivers natural gas under rate class General Service Gas Heating - GSG (HTG).

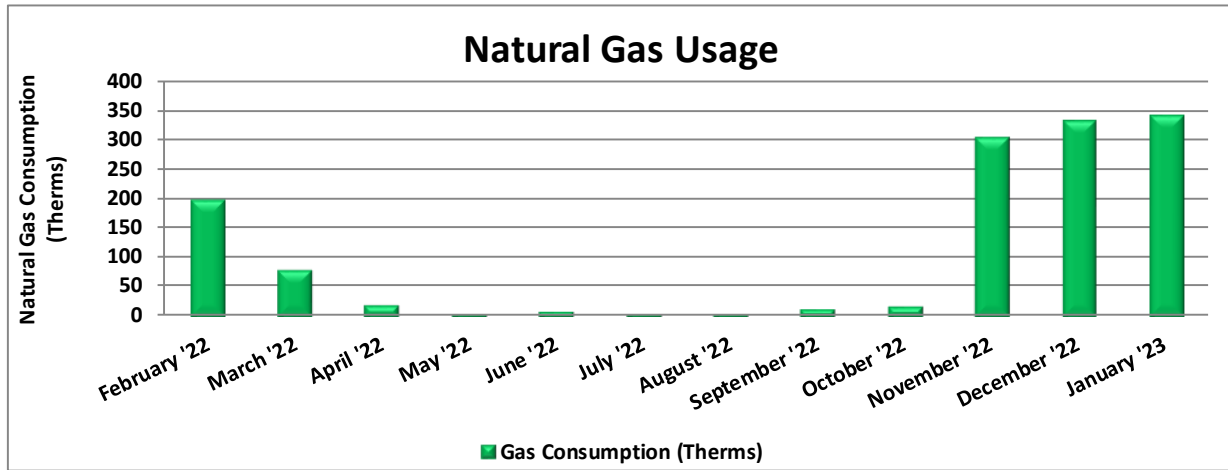

| Gas Billing Data | | | |
|------------------|----------------|----------------------------|------------------|
| Period Ending | Days in Period | Natural Gas Usage (Therms) | Natural Gas Cost |
| 3/16/22 | 30 | 198 | \$267 |
| 4/14/22 | 29 | 80 | \$114 |
| 5/16/22 | 32 | 19 | \$43 |
| 6/15/22 | 30 | 5 | \$27 |
| 7/15/22 | 30 | 8 | \$31 |
| 8/15/22 | 31 | 4 | \$25 |
| 9/14/22 | 30 | 4 | \$26 |
| 10/13/22 | 29 | 14 | \$40 |
| 11/12/22 | 30 | 17 | \$42 |
| 12/14/22 | 32 | 305 | \$438 |
| 1/17/23 | 34 | 334 | \$476 |
| 2/17/23 | 31 | 343 | \$439 |
| Totals | 368 | 1,331 | \$1,969 |
| Annual | 365 | 1,320 | \$1,953 |

Notes:

- The average gas cost for the past 12 months is \$1.479/therm, which is the blended rate used throughout the analysis.
- There is a natural gas back-up generator on the property that gets tested regularly and used in emergencies.

3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*[®] software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

| | |
|---------------------------|------------|
| Benchmarking Score | N/A |
|---------------------------|------------|

Due to its unique characteristics, this building type is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

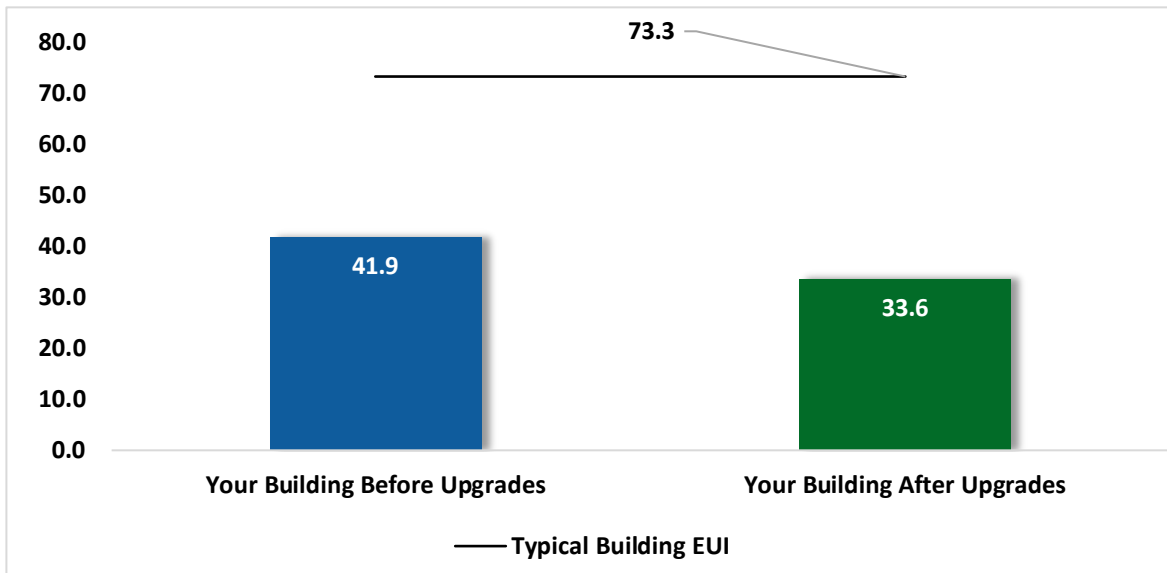


Figure 5 - Energy Use Intensity Comparison³

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

³ Based on all evaluated ECMs



Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager account for your facility and have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR Portfolio Manager to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR and Portfolio Manager, visit their [website](#).

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives in this report are based on the previously run state rebate program SmartStart, which has been retired. Now, all investor-owned gas and electric utility companies are offering complementary energy efficiency programs directly to their customers. Some measures and proposed upgrades may be eligible for higher incentives than those shown below. The incentives in the summary tables should be used for high-level planning purposes. To verify incentives, reach out to your utility provider or visit the [NJCEP website](#) for more information.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.

| # | Energy Conservation Measure | Cost Effective? | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|--|---|-----------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| Lighting Upgrades | | | 3,175 | 1.8 | -1 | \$431 | \$2,718 | \$740 | \$1,978 | 4.6 | 3,137 |
| ECM 1 | Install LED Fixtures | Yes | 686 | 0.0 | 0 | \$95 | \$444 | \$155 | \$289 | 3.0 | 691 |
| ECM 2 | Retrofit Fixtures with LED Lamps | Yes | 2,488 | 1.8 | -1 | \$336 | \$2,274 | \$585 | \$1,689 | 5.0 | 2,445 |
| Lighting Control Measures | | | 479 | 0.2 | 0 | \$65 | \$1,016 | \$825 | \$191 | 3.0 | 470 |
| ECM 3 | Install Occupancy Sensor Lighting Controls | No | 10 | 0.0 | 0 | \$1 | \$116 | \$20 | \$96 | 73.2 | 10 |
| ECM 4 | Install High/Low Lighting Controls | Yes | 469 | 0.2 | 0 | \$63 | \$900 | \$805 | \$95 | 1.5 | 460 |
| Variable Frequency Drive (VFD) Measures | | | 3,550 | 1.6 | 0 | \$491 | \$8,062 | \$275 | \$7,787 | 15.9 | 3,575 |
| ECM 5 | Install VFDs and CO Sensing on Truck Bay Exhaust System | Yes | 3,550 | 1.6 | 0 | \$491 | \$8,062 | \$275 | \$7,787 | 15.9 | 3,575 |
| HVAC System Improvements | | | 0 | 0.0 | 17 | \$248 | \$436 | \$58 | \$378 | 1.5 | 1,965 |
| ECM 6 | Install Pipe Insulation | Yes | 0 | 0.0 | 17 | \$248 | \$436 | \$58 | \$378 | 1.5 | 1,965 |
| Domestic Water Heating Upgrade | | | 0 | 0.0 | 1 | \$10 | \$29 | \$13 | \$16 | 1.7 | 76 |
| ECM 7 | Install Low-Flow DHW Devices | Yes | 0 | 0.0 | 1 | \$10 | \$29 | \$13 | \$16 | 1.7 | 76 |
| TOTALS | | | 7,204 | 3.6 | 17 | \$1,245 | \$12,260 | \$1,911 | \$10,350 | 8.3 | 9,223 |

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 6 – All Evaluated ECMs

| # | Energy Conservation Measure | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|--|---|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| Lighting Upgrades | | 3,175 | 1.8 | -1 | \$431 | \$2,718 | \$740 | \$1,978 | 4.6 | 3,137 |
| ECM 1 | Install LED Fixtures | 686 | 0.0 | 0 | \$95 | \$444 | \$155 | \$289 | 3.0 | 691 |
| ECM 2 | Retrofit Fixtures with LED Lamps | 2,488 | 1.8 | -1 | \$336 | \$2,274 | \$585 | \$1,689 | 5.0 | 2,445 |
| Lighting Control Measures | | 469 | 0.2 | 0 | \$63 | \$900 | \$805 | \$95 | 1.5 | 460 |
| ECM 4 | Install High/Low Lighting Controls | 469 | 0.2 | 0 | \$63 | \$900 | \$805 | \$95 | 1.5 | 460 |
| Variable Frequency Drive (VFD) Measures | | 3,550 | 1.6 | 0 | \$491 | \$8,062 | \$275 | \$7,787 | 15.9 | 3,575 |
| ECM 5 | Install VFDs and CO Sensing on Truck Bay Exhaust System | 3,550 | 1.6 | 0 | \$491 | \$8,062 | \$275 | \$7,787 | 15.9 | 3,575 |
| HVAC System Improvements | | 0 | 0.0 | 17 | \$248 | \$436 | \$58 | \$378 | 1.5 | 1,965 |
| ECM 6 | Install Pipe Insulation | 0 | 0.0 | 17 | \$248 | \$436 | \$58 | \$378 | 1.5 | 1,965 |
| Domestic Water Heating Upgrade | | 0 | 0.0 | 1 | \$10 | \$29 | \$13 | \$16 | 1.7 | 76 |
| ECM 7 | Install Low-Flow DHW Devices | 0 | 0.0 | 1 | \$10 | \$29 | \$13 | \$16 | 1.7 | 76 |
| TOTALS | | 7,194 | 3.6 | 17 | \$1,243 | \$12,144 | \$1,891 | \$10,254 | 8.2 | 9,213 |

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – Cost Effective ECMs

4.1 Lighting

| # | Energy Conservation Measure | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|--------------------------|----------------------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| Lighting Upgrades | | 3,175 | 1.8 | -1 | \$431 | \$2,718 | \$740 | \$1,978 | 4.6 | 3,137 |
| ECM 1 | Install LED Fixtures | 686 | 0.0 | 0 | \$95 | \$444 | \$155 | \$289 | 3.0 | 691 |
| ECM 2 | Retrofit Fixtures with LED Lamps | 2,488 | 1.8 | -1 | \$336 | \$2,274 | \$585 | \$1,689 | 5.0 | 2,445 |

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

ECM 1: Install LED Fixtures

Replace existing fixtures containing HID lamps with new LED light fixtures. This measure saves energy by installing LEDs, which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixtures.

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

Affected Building Areas: exterior fixtures

ECM 2: Retrofit Fixtures with LED Lamps

Replace fluorescent, CFL, and incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected Building Areas: all areas with fluorescent fixtures with T8 tubes and CFL recessed can lights (exterior and interior)

4.2 Lighting Controls

| # | Energy Conservation Measure | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|----------------------------------|--|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| Lighting Control Measures | | 479 | 0.2 | 0 | \$65 | \$1,016 | \$825 | \$191 | 3.0 | 470 |
| ECM 3 | Install Occupancy Sensor Lighting Controls | 10 | 0.0 | 0 | \$1 | \$116 | \$20 | \$96 | 73.2 | 10 |
| ECM 4 | Install High/Low Lighting Controls | 469 | 0.2 | 0 | \$63 | \$900 | \$805 | \$95 | 1.5 | 460 |

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 3: Install Occupancy Sensor Lighting Controls

Evaluate install of occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours. While the payback is projected to be long, this is an area where lights could be left on inadvertently.

Affected Building Areas: boiler room

ECM 4: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as occupants approach the area.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

4.3 Variable Frequency Drives (VFD)

| # | Energy Conservation Measure | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|--|---|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| Variable Frequency Drive (VFD) Measures | | 3,550 | 1.6 | 0 | \$491 | \$8,062 | \$275 | \$7,787 | 15.9 | 3,575 |
| ECM 5 | Install VFDs and CO Sensing on Truck Bay Exhaust System | 3,550 | 1.6 | 0 | \$491 | \$8,062 | \$275 | \$7,787 | 15.9 | 3,575 |

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

ECM 5: Install VFDs and CO Sensing on Truck Bay Exhaust System

Install carbon monoxide (CO) sensors and VFDs and controls to modulate truck bay exhaust fans so they operate when CO is present and ramp down as CO levels dissipate. Be sure your fan control strategy incorporates the proper sensor inputs in order to be fully functional.

Energy savings result from reducing the exhaust fan motor speeds (and power) when conditions allow for reduced ventilation.

4.4 HVAC Improvements

| # | Energy Conservation Measure | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|---------------------------------|-----------------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| HVAC System Improvements | | 0 | 0.0 | 17 | \$248 | \$436 | \$58 | \$378 | 1.5 | 1,965 |
| ECM 6 | Install Pipe Insulation | 0 | 0.0 | 17 | \$248 | \$436 | \$58 | \$378 | 1.5 | 1,965 |

ECM 6: Install Pipe Insulation

Install insulation on heating water and domestic hot water system piping. Distribution system losses are dependent on system fluid temperature, the size of the distribution system, and the level of insulation of the piping. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is exposed to water, when the insulation has been removed from some areas of the pipe, or when valves have not been properly insulated system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

Affected Systems: hot water and domestic hot water piping

4.5 Domestic Water Heating

| # | Energy Conservation Measure | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO ₂ e Emissions Reduction (lbs) |
|---------------------------------------|------------------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| Domestic Water Heating Upgrade | | 0 | 0.0 | 1 | \$10 | \$29 | \$13 | \$16 | 1.7 | 76 |
| ECM 7 | Install Low-Flow DHW Devices | 0 | 0.0 | 1 | \$10 | \$29 | \$13 | \$16 | 1.7 | 76 |

ECM 7: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

| Device | Flow Rate |
|---------------------------------|-----------|
| Faucet aerators (lavatory) | 0.5 gpm |
| Faucet aerator (kitchen) | 1.5 gpm |
| Showerhead | 2.0 gpm |
| Pre-rinse spray valve (kitchen) | 1.28 gpm |

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing.

Additional cost savings may result from reduced water usage.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5%–20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR Portfolio Manager



You've heard it before—you cannot manage what you do not measure. ENERGY STAR Portfolio Manager is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions⁴. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Weatherization

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. Materials used may include caulk, polyurethane foam, and other weather-stripping materials. There is an energy savings opportunity by reducing the uncontrolled air exchange between the outside and inside of the building. Blower door assisted comprehensive building air sealing will reduce the amount of air exchange, which will in turn reduce the load on the buildings heating and cooling equipment, providing energy savings and increased occupant comfort.

Doors and Windows

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

⁴ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.

Lighting Maintenance



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.
- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

Motor Controls

Electric motors often run unnecessarily, and this is an overlooked opportunity to save energy. These motors should be identified and turned off when appropriate. For example, exhaust fans often run unnecessarily when ventilation requirements are already met. Whenever possible, use automatic devices such as twist timers or occupancy sensors to turn off motors when they are not needed.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Ductwork Maintenance

Duct maintenance has two primary goals: keep the ducts clean to avoid air quality problems and seal leaks to save energy. Check for cleanliness, obstructions that block airflow, water damage, and leaks. Ducts should be inspected at least every two years.

The biggest symptoms of clogged air ducts are differing temperatures throughout the building and areas with limited airflow from supply registers. If a particular air duct is clogged, then air flow will only be cut off to some rooms in the building—not all of them. The reduced airflow will make it more difficult for those areas to reach the temperature setpoint, which will cause the HVAC system to run longer to cool or heat that area properly. If you suspect clogged air ducts, ensure that all areas in front of supply registers are clear of items that may block or restrict air flow, and you should check for fire dampers or balancing dampers that have failed closed.

Duct leakage in commercial buildings can account for 5%–25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Check ductwork for leakage. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.

Distribution system losses are dependent on-air system temperature, the size of the distribution system, and the level of insulation of the ductwork. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is missing or worn, the system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

Boiler Maintenance

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely and efficiently. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the boiler tubes to improve heat transfer.

Water Heater Maintenance

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Compressed Air System Maintenance

Compressed air systems require periodic maintenance to operate at peak efficiency. A maintenance plan for compressed air systems should include:

- Inspection, cleaning, and replacement of inlet filter cartridges.
- Cleaning of drain traps.
- Daily inspection of lubricant levels to reduce unwanted friction.
- Inspection of belt condition and tension.
- Check for leaks and adjust loose connections.
- Overall system cleaning.
- Reduce pressure setting to minimum needed for air operated equipment.
- Turn off compressor if not routinely needed.
- Use low pressure blower air rather than high pressure compressed air.

Contact a qualified technician for help with setting up periodic maintenance schedule.

Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense® ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense website⁵ or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"⁶ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

⁵ <https://www.epa.gov/watersense>.

⁶ <https://www.epa.gov/watersense/watersense-work-0>.



Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR or WaterSense products where available.

6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has no potential for installing a PV array.

This facility does not appear to meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as sufficient and sustained electric demand and sufficient flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

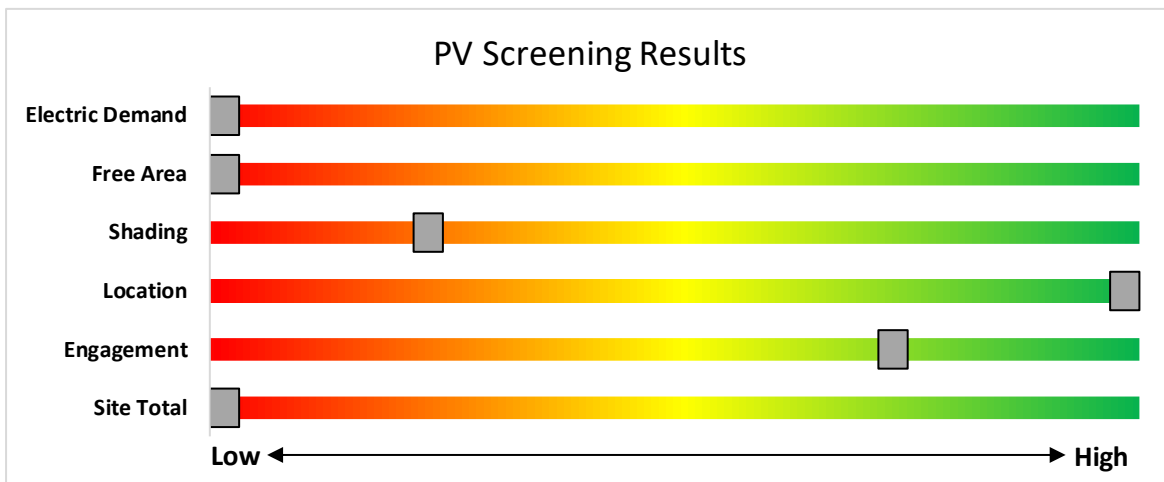


Figure 8 - Photovoltaic Screening

Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners *must* register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

Successor Solar Incentive Program (SuSI): <https://www.njcleanenergy.com/renewable-energy/programs/susi-program>

- **Basic Info on Solar PV in NJ:** www.njcleanenergy.com/whysolar
- **NJ Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs.
- **Approved Solar Installers in the NJ Market:** www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

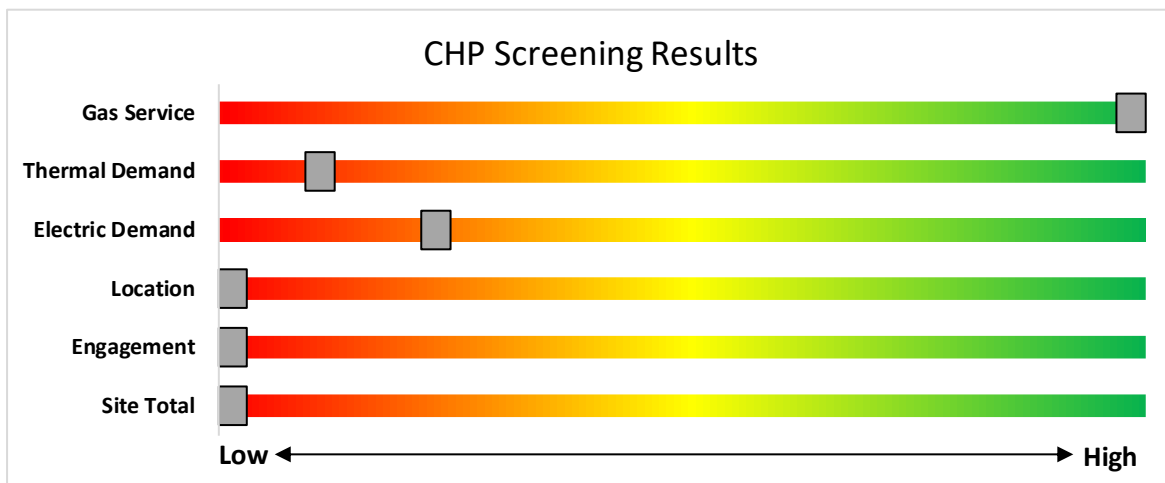


Figure 9 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/

7 ELECTRIC VEHICLES (EV)

All electric vehicles (EVs) have an electric motor instead of an internal combustion engine. EVs function by plugging into a charge point, taking electricity from the grid, and then storing it in rechargeable batteries. Although electricity production may contribute to air pollution, the U.S. EPA categorizes all-electric vehicles as zero-emission vehicles because they produce no direct exhaust or tailpipe emissions.

EVs are typically more expensive than similar conventional and hybrid vehicles, although some cost can be recovered through fuel savings, federal tax credit, or state incentives.

7.1 Electric Vehicle Charging

EV charging stations provide a means for electric vehicle operators to recharge their batteries at a facility. While many EV drivers charge at home, others do not have access to regular home charging, and the ability to charge at work or in public locations is critical to making EVs practical for more drivers. Charging can also be used for electric fleet vehicles, which can reduce fuel and maintenance costs for fleets that replace gas or diesel vehicles with EVs.

EV charging comes in three main types. For this assessment, the screening considers addition of Level 2 charging, which is most common at workplaces and other public locations. Depending on the site type and usage, other levels of charging power may be more appropriate.

The preliminary assessment of EV charging at the facility shows that there is medium potential for adding EV chargers to the facility's parking, based on potential costs of installation and other site factors.


The primary costs associated with installing EV charging are the charger hardware and the cost to extend power from the facility to parking spaces. This may include upgrades to electric panels to serve increased loads.

The type and size of the parking area impact the costs and feasibility of adding EV charging. Parking structure installations can be less costly than surface lot installations as power may be readily available, and equipment and wiring can be surface mounted. Parking lot installations often require trenching through concrete or asphalt surface. Large parking areas provide greater flexibility in charger siting than smaller lots.

The location and capacity of facility electric panels also impact charger installation costs. A Level 2 charger generally requires a dedicated 208-240V, 40 Amp circuit. The electric panel nearest the planned installation may not have available capacity and may need to be upgraded to serve new EV charging loads. Alternatively, chargers could be powered from a more distant panel. The distance from the panel to the location of charging stations ties directly to costs, as conduits, cables, and potential trenching costs all increase on a per-foot basis. The more charging stations planned, the more likely it is that additional electrical capacity will be needed.

Other factors to consider when planning for EV charging at a facility include who the intended users are, how long they park vehicles at the site, and whether they will need to pay for the electricity they use.

The graphic below displays the results of the EV charging assessment conducted as part of this audit. The position of each slider indicates the impact each factor has on the feasibility of installing EV charging at the site.

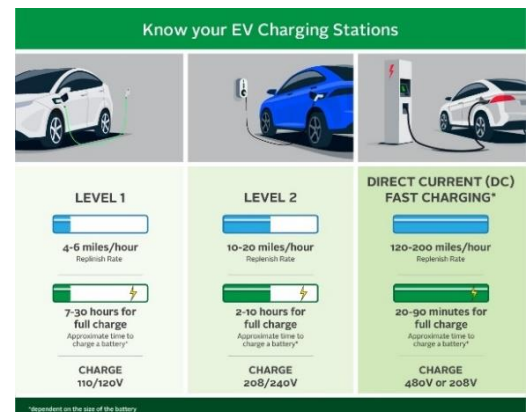

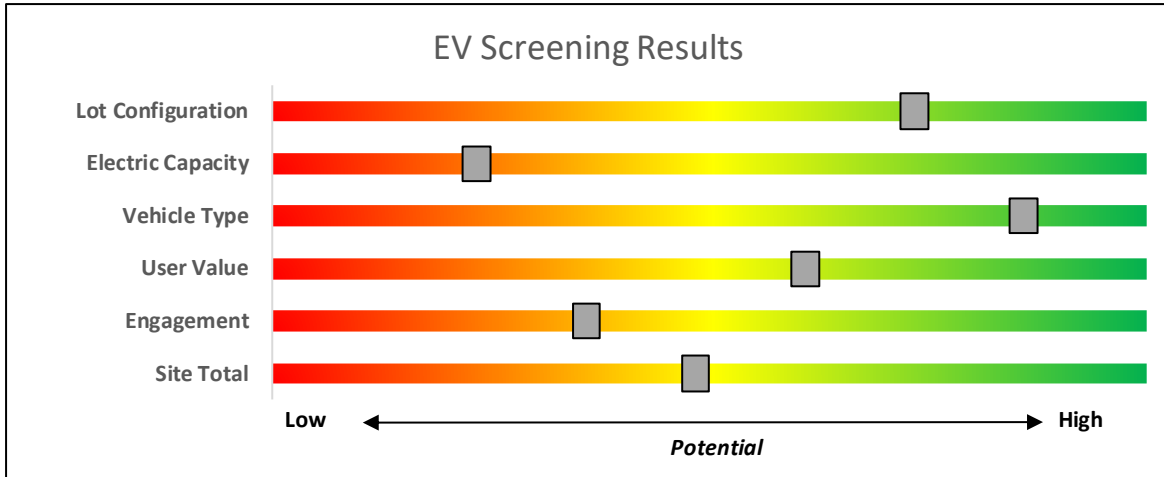


Figure 10 – EV Charger Screening

Electric Vehicle Programs Available

New Jersey is leading the way on electric vehicle (EV) adoption on the East Coast. There are several programs designed to encourage EV adoption in New Jersey, which is crucial to reaching a 100% clean energy future.

NJCEP offers a variety of EV programs for vehicles, charging stations, and fleets. Certain EV charging stations that receive electric utility service from Atlantic City Electric Company (ACE) or Public Service Electric & Gas Company (PSE&G), may be eligible for additional electric vehicle charging incentives directly from the utility. Projects may be eligible for both the incentives offered by this BPU program and incentives offered by ACE or PSE&G, up to 90% of the combined charger purchase and installation costs. Please check ACE or PSE&G program eligibility requirements before purchasing EV charging equipment, as additional conditions on types of eligible chargers may apply for utility incentives.

Both Jersey Central Power & Light (JCP&L) and Rockland Electric (RECO) have filed proposals for EV charging programs. BPU staff is currently reviewing those proposals.

For more information and to keep up to date on all EV programs please visit <https://www.njcleanenergy.com/commercial-industrial/programs/electric-vehicle-programs>

8 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs and Utility Energy Efficiency Programs can help. Pick the program that works best for you. This section provides an overview of currently available incentive programs in.

Program areas to be served by the Utilities:

- Existing Buildings (residential, commercial, industrial, government)
- Efficient Products
 - HVAC
 - Appliance Rebates
 - Appliance Recycling

Proposed New Programs & Features:

- Dedicated multi-family program
- More financing options
- Quick home energy check-ups

Program areas staying with NJCEP:

- New Construction (residential, commercial, industrial, government)
- Large Energy Users
- Combined Heat & Power & Fuel Cells
- State Facilities
- Local Government Energy Audits
- Energy Savings Improvement Program
- Solar & Community Solar

8.1 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey's investor-owned gas and electric utilities to reduce their customers' use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

Prescriptive and Custom

The Prescriptive and Custom rebate program through your utility provider offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

Equipment Examples

| | |
|-------------------------------------|--|
| <i>Lighting</i> | <i>Variable Frequency Drives</i> |
| <i>Lighting Controls</i> | <i>Electronically Commutate Motors</i> |
| <i>HVAC Equipment</i> | <i>Variable Frequency Drives</i> |
| <i>Refrigeration</i> | <i>Plug Loads Controls</i> |
| <i>Gas Heating</i> | <i>Washers and Dryers</i> |
| <i>Gas Cooling</i> | <i>Agricultural</i> |
| <i>Commercial Kitchen Equipment</i> | <i>Water Heating</i> |
| <i>Food Service Equipment</i> | |

The Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type. The Custom program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives.

Direct Install

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW or less over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls

Incentives

The program pays up to 70% of the total installed cost of eligible measures.

How to Participate

To participate in Direct Install, you will work with a participating contractor. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the Direct Install program, subject to program rules and eligibility, while the remaining percent of the cost is paid to the contractor by the customer.

Engineered Solutions

The Engineered Solutions Program provides tailored energy-efficiency assistance and services to municipalities, universities, schools, hospitals and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. Customers receive expert guided services, including investment-grade energy auditing, engineering design, installation assistance, construction administration, commissioning, and measurement and verification (M&V) services to support the implementation of cost-effective and comprehensive efficiency projects. Engineered Solutions is generally a good option for medium to large sized facilities with a peak demand over 200 kW looking to implement as many measures as possible under a single project to achieve deep energy savings. Engineered Solutions has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Incentives for this program are based on project scope and energy savings achieved.

For more information on any of these programs, contact your local utility provider or visit <https://www.njcleanenergy.com/transition>.

8.2 New Jersey's Clean Energy Programs

Save money while saving the planet! New Jersey's Clean Energy Program is a statewide program that offers incentives, programs, and services that benefit New Jersey residents, businesses, educational, non-profit, and government entities to help them save energy, money, and the environment.

Large Energy Users

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers that annually contribute at least \$200,000 to the NJCEP aggregate of all buildings/sites. This equates to roughly \$5 million in energy costs in the prior fiscal year.

Incentives

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually

How to Participate

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEEP). Once the FEEP is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at www.njcleanenergy.com/LEUP.

Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

Incentives

| Eligible Technologies | Size (Installed Rated Capacity) ¹ | Incentive (\$/kW) | % of Total Cost Cap per Project ³ | \$ Cap per Project ³ |
|--|--|-------------------|--|---------------------------------|
| Powered by non-renewable or renewable fuel source ⁴ | ≤500 kW | \$2,000 | 30-40% ² | \$2 million |
| | Gas Internal Combustion Engine | >500 kW - 1 MW | | |
| Gas Combustion Turbine | > 1 MW - 3 MW | \$550 | 30% | \$3 million |
| Microturbine | >3 MW | \$350 | | |
| Fuel Cells with Heat Recovery | | | | |
| Waste Heat to Power* | <1 MW | \$1,000 | 30% | \$2 million |
| | > 1MW | \$500 | | \$3 million |

*Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

How to Participate

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at www.njcleanenergy.com/CHP.

Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two sub-programs. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

Administratively Determined Incentive (ADI) Program

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

| Market Segments | Size MW dc | Incentive Value (\$/SREC II) | Public Entities Incentive Value - \$20 Adder (\$/SRECII) |
|--|----------------------------|------------------------------|--|
| Net Metered Residential | All types and sizes | \$90 | N/A |
| Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar | Projects smaller than 1 MW | \$100 | \$120 |
| Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar | Projects 1 MW to 5 MW | \$90 | \$110 |
| Small Net Metered Non-Residential Ground Mount | Projects smaller than 1 MW | \$85 | \$105 |
| Large Net Metered Non-Residential Ground Mount | Projects 1 MW to 5 MW | \$80 | \$100 |
| LMI Community Solar | Up to 5 MW | \$90 | N/A |
| Non-LMI Community Solar | Up to 5 MW | \$70 | N/A |
| Interim Subsection (t) | All types and sizes | \$100 | N/A |

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations.

Competitive Solar Incentive Program

The Competitive Solar Incentive (CSI) Program will provide competitively set incentives for grid supply projects and net metered non-residential projects greater than 5MW (dc). The program is currently under development. For updates, please continue to check the [Solar Proceedings](#) page on the New Jersey's Clean Energy Program website.

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state's Energy Master Plan.

If you are considering installing solar photovoltaics on your building, visit the following link for more information: <https://njcleanenergy.com/renewable-energy/programs/susi-program>.

Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter into contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

9 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

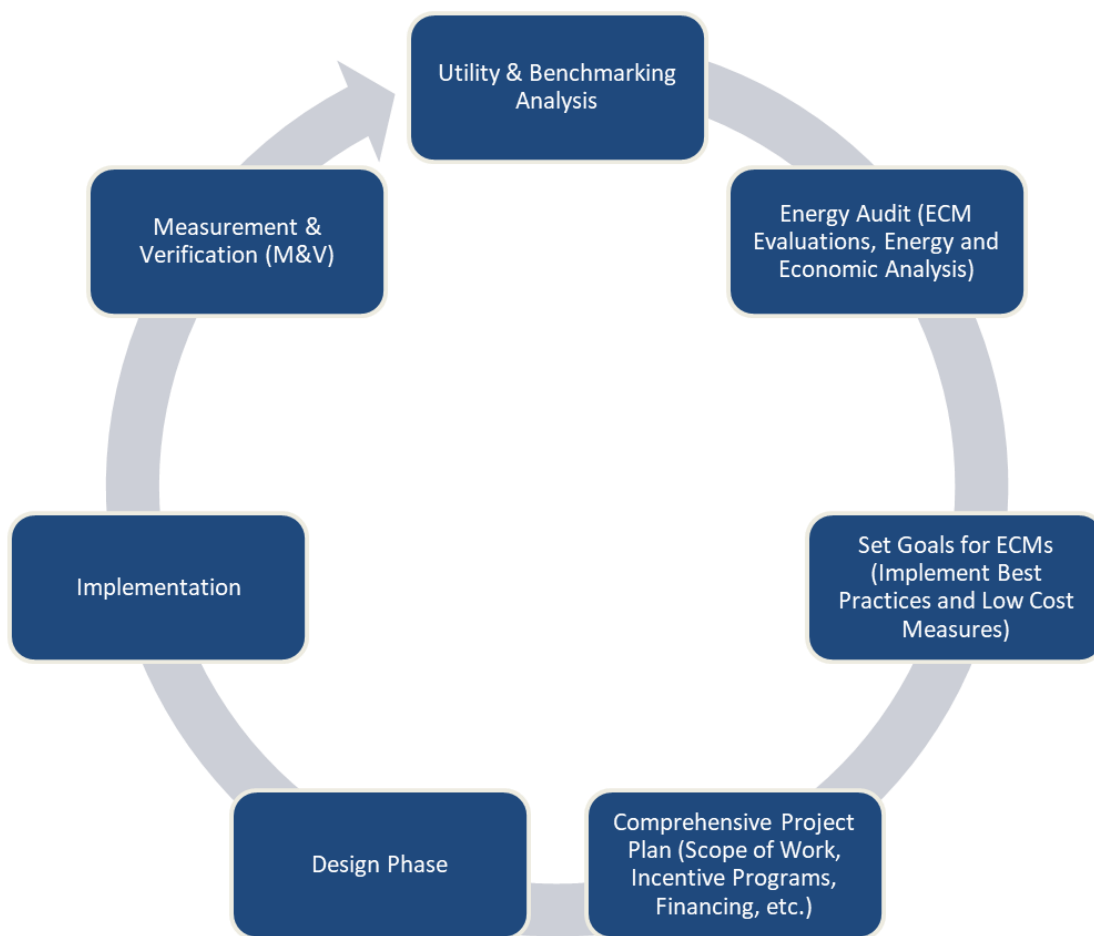


Figure 11 – Project Development Cycle

10 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

10.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website⁷.

10.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website⁸.

⁷ www.state.nj.us/bpu/commercial/shopping.html.

⁸ www.state.nj.us/bpu/commercial/shopping.html.

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

| Location | Existing Conditions | | | | | | Proposed Conditions | | | | | | | | Energy Impact & Financial Analysis | | | | | | |
|------------|---------------------|---|------------------|-------------|-------------------|------------------------|---------------------|------------------------|---------------|------------------|---|------------------|-------------------|------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| | Fixture Quantity | Fixture Description | Control System | Light Level | Watts per Fixture | Annual Operating Hours | ECM # | Fixture Recommendation | Add Controls? | Fixture Quantity | Fixture Description | Control System | Watts per Fixture | Annual Operating Hours | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Closet 1 | 1 | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch | S | 62 | 200 | 2 | Relamp | No | 1 | LED - Linear Tubes: (2) 4' Lamps | Wall Switch | 29 | 200 | 0.0 | 7 | 0 | \$1 | \$37 | \$10 | 27.5 |
| Closet 2 | 1 | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch | S | 62 | 200 | 2 | Relamp | No | 1 | LED - Linear Tubes: (2) 4' Lamps | Wall Switch | 29 | 200 | 0.0 | 7 | 0 | \$1 | \$37 | \$10 | 27.5 |
| Exterior 1 | 2 | Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp | Timeclock | | 26 | 4,745 | 2 | Relamp | No | 2 | LED Lamps: GX23 (Plug-In) Lamps | Timeclock | 19 | 4,745 | 0.0 | 66 | 0 | \$9 | \$25 | \$2 | 2.5 |
| Exterior 1 | 1 | High-Pressure Sodium: (1) 100W Lamp | Timeclock | | 138 | 4,745 | 1 | Fixture Replacement | No | 1 | LED - Fixtures: Outdoor Pole/Arm-Mounted Area/Roadway Fixture | Timeclock | 30 | 4,745 | 0.0 | 512 | 0 | \$71 | \$250 | \$100 | 2.1 |
| Exterior 1 | 4 | LED - Fixtures: Architectural Flood/Spot Luminaire | Timeclock | | 15 | 4,745 | | None | No | 4 | LED - Fixtures: Architectural Flood/Spot Luminaire | Timeclock | 15 | 4,745 | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Exterior 1 | 2 | LED - Fixtures: Outdoor Wall-Mounted Area Fixture | Timeclock | | 30 | 4,745 | | None | No | 2 | LED - Fixtures: Outdoor Wall-Mounted Area Fixture | Timeclock | 30 | 4,745 | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Exterior 1 | 1 | LED - Fixtures: Flood Fixture | Timeclock | | 40 | 4,745 | | None | No | 1 | LED - Fixtures: Flood Fixture | Timeclock | 40 | 4,745 | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Exterior 1 | 1 | LED - Fixtures: Outdoor Pole/Arm-Mounted Decorative Fixture | Timeclock | | 30 | 4,745 | | None | No | 1 | LED - Fixtures: Outdoor Pole/Arm-Mounted Decorative Fixture | Timeclock | 30 | 4,745 | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Exterior 1 | 1 | LED - Fixtures: Wall Pack | Timeclock | | 20 | 4,745 | | None | No | 1 | LED - Fixtures: Wall Pack | Timeclock | 20 | 4,745 | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Exterior 1 | 1 | Metal Halide: (1) 150W Lamp | Wall Switch | | 190 | 1,200 | 1 | Fixture Replacement | No | 1 | LED - Fixtures: Wall-Wash Lights | Wall Switch | 45 | 1,200 | 0.0 | 174 | 0 | \$24 | \$194 | \$55 | 5.8 |
| Garage | 3 | Compact Fluorescent: (2) 26W Biaxial Plug-In Lamps | Wall Switch | S | 52 | 1,800 | 2, 4 | Relamp | Yes | 3 | LED Lamps: GX23 (Plug-In) Lamps | High/Low Control | 37 | 1,242 | 0.1 | 154 | 0 | \$21 | \$75 | \$6 | 3.3 |
| Garage | 2 | Exit Signs: LED - 2 W Lamp | None | | 6 | 8,760 | | None | No | 2 | Exit Signs: LED - 2 W Lamp | None | 6 | 8,760 | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Garage | 23 | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch | S | 62 | 1,800 | 2, 4 | Relamp | Yes | 23 | LED - Linear Tubes: (2) 4' Lamps | High/Low Control | 29 | 1,242 | 0.9 | 1,877 | 0 | \$254 | \$1,740 | \$1,035 | 2.8 |
| Kitchen | 1 | Exit Signs: LED - 2 W Lamp | None | | 6 | 8,760 | | None | No | 1 | Exit Signs: LED - 2 W Lamp | None | 6 | 8,760 | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Kitchen | 9 | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Occupancy Sensor | S | 62 | 1,000 | 2 | Relamp | No | 9 | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29 | 1,000 | 0.3 | 321 | 0 | \$43 | \$329 | \$90 | 5.5 |
| Main foyer | 3 | Compact Fluorescent: (2) 26W Biaxial Plug-In Lamps | Occupancy Sensor | S | 52 | 1,000 | 2 | Relamp | No | 3 | LED Lamps: GX23 (Plug-In) Lamps | Occupancy Sensor | 37 | 1,000 | 0.0 | 49 | 0 | \$7 | \$75 | \$6 | 10.5 |
| Mechanical | 2 | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch | S | 62 | 500 | 2, 3 | Relamp | Yes | 2 | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29 | 345 | 0.1 | 45 | 0 | \$6 | \$189 | \$40 | 24.3 |
| Office | 4 | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Occupancy Sensor | S | 62 | 1,000 | 2 | Relamp | No | 4 | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29 | 1,000 | 0.1 | 143 | 0 | \$19 | \$146 | \$40 | 5.5 |
| Restroom | 3 | Linear Fluorescent - T8: 4' T8 (32W) - 3L | Occupancy Sensor | S | 93 | 400 | 2 | Relamp | No | 3 | LED - Linear Tubes: (3) 4' Lamps | Occupancy Sensor | 44 | 400 | 0.1 | 64 | 0 | \$9 | \$164 | \$45 | 13.8 |
| Bunk Room | 1 | Exit Signs: LED - 2 W Lamp | None | | 6 | 8,760 | | None | No | 1 | Exit Signs: LED - 2 W Lamp | None | 6 | 8,760 | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Bunk Room | 4 | Linear Fluorescent - T8: 4' T8 (32W) - 4L | Occupancy Sensor | S | 114 | 400 | 2 | Relamp | No | 4 | LED - Linear Tubes: (4) 4' Lamps | Occupancy Sensor | 58 | 400 | 0.2 | 97 | 0 | \$13 | \$292 | \$80 | 16.2 |
| Foyer | 1 | Linear Fluorescent - T8: 4' T8 (32W) - 3L | Occupancy Sensor | S | 93 | 1,000 | 2 | Relamp | No | 1 | LED - Linear Tubes: (3) 4' Lamps | Occupancy Sensor | 44 | 1,000 | 0.0 | 53 | 0 | \$7 | \$55 | \$15 | 5.5 |
| Restroom 2 | 1 | Linear Fluorescent - T8: 4' T8 (32W) - 3L | Occupancy Sensor | S | 93 | 400 | 2 | Relamp | No | 1 | LED - Linear Tubes: (3) 4' Lamps | Occupancy Sensor | 44 | 400 | 0.0 | 21 | 0 | \$3 | \$55 | \$15 | 13.8 |
| Attic | 1 | Incandescent: (1) 100W A19 Screw-In Lamp | Wall Switch | S | 100 | 50 | 2 | Relamp | No | 1 | LED Lamps: A19 Lamps | Wall Switch | 15 | 50 | 0.1 | 5 | 0 | \$1 | \$17 | \$1 | 26.2 |
| Stairs 1 | 3 | Linear Fluorescent - T8: 4' T8 (32W) - 1L | Occupancy Sensor | | 32 | 1,000 | 2 | Relamp | No | 3 | LED - Linear Tubes: (1) 4' Lamp | Occupancy Sensor | 15 | 1,000 | 0.0 | 57 | 0 | \$8 | \$55 | \$15 | 5.2 |

Motor Inventory & Recommendations

| | | Existing Conditions | | | | | | | | | Proposed Conditions | | | | | Energy Impact & Financial Analysis | | | | | | |
|------------|---------------------------------------|---------------------|------------------------|--------------|----------------------|--------------|----------------|------------|-----------------------|------------------------|---------------------|---------------------------------|----------------------|---------------|----------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| Location | Area(s)/System(s) Served | Motor Quantity | Motor Application | HP Per Motor | Full Load Efficiency | VFD Control? | Manufacturer | Model | Remaining Useful Life | Annual Operating Hours | ECM # | Install High Efficiency Motors? | Full Load Efficiency | Install VFDs? | Number of VFDs | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Garage | Garage | 1 | Air Compressor | 5.0 | 82.5% | No | Quincy | 251C80VCBM | W | 700 | | No | 82.5% | No | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Mechanical | Entire building DHW | 1 | DHW Circulation Pump | 0.1 | 65.0% | No | Fasco | 702112498 | W | 8,760 | | No | 65.0% | No | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Mechanical | Bunk Room, Office, Kitchen, Restrooms | 1 | Heating Hot Water Pump | 0.4 | 74.0% | No | Bell & Gossett | PL-55 | W | 1,200 | | No | 74.0% | No | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Garage | Garage | 1 | Exhaust Fan | 3.0 | 70.0% | No | | | W | 2,000 | 5 | No | 89.5% | Yes | 1 | 1.2 | 3,338 | 0 | \$462 | \$4,555 | \$200 | 9.4 |
| Garage | Garage | 1 | Exhaust Fan | 1.0 | 70.0% | No | | | W | 400 | 5 | No | 85.5% | Yes | 1 | 0.4 | 212 | 0 | \$29 | \$3,508 | \$75 | 117.1 |
| Restroom | Restroom | 1 | Exhaust Fan | 0.0 | 65.0% | No | | | W | 200 | | No | 65.0% | No | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Restroom 2 | Restroom 2 | 1 | Exhaust Fan | 0.0 | 65.0% | No | | | W | 200 | | No | 65.0% | No | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Garage | Garage Doors | 3 | Other | 0.3 | 65.0% | No | | | W | 10 | | No | 65.0% | No | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |
| Exterior | Bunk Room, Office, Kitchen, Restrooms | 2 | Supply Fan | 0.3 | 65.0% | No | | | W | 1,200 | | No | 65.0% | No | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |

Packaged HVAC Inventory & Recommendations

| | | Existing Conditions | | | | | | | | | Proposed Conditions | | | | | | | | Energy Impact & Financial Analysis | | | | | | | |
|----------|---------------------------------------|---------------------|----------------------------|----------------------------------|---------------------------------|---|-------------------------|---------------------|------------|-----------------------|---------------------|---------------------------------|-----------------|-------------|----------------------------------|---------------------------------|---|-------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|-----|
| Location | Area(s)/System(s) Served | System Quantity | System Type | Cooling Capacity per Unit (Tons) | Heating Capacity per Unit (MBh) | Cooling Mode Efficiency (SEER/IEER/EER) | Heating Mode Efficiency | Manufacturer | Model | Remaining Useful Life | ECM # | Install High Efficiency System? | System Quantity | System Type | Cooling Capacity per Unit (Tons) | Heating Capacity per Unit (MBh) | Cooling Mode Efficiency (SEER/IEER/EER) | Heating Mode Efficiency | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years | |
| Exterior | Bunk Room, Office, Kitchen, Restrooms | 1 | Split-System Air-Source HP | 5.00 | 66.00 | 12.50 | 10.5 HSPF | Mitsubishi Electric | MXZ-8C60NA | W | | No | | | | | | | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |

Space Heating Boiler Inventory & Recommendations

| | | Existing Conditions | | | | | | Proposed Conditions | | | | | | Energy Impact & Financial Analysis | | | | | | | |
|------------|--|---------------------|-----------------------------|--------------------------------|--------------|---------|-----------------------|---------------------|---------------------------------|-----------------|-------------|--------------------------------|--------------------|------------------------------------|-----------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| Location | Area(s)/System(s) Served | System Quantity | System Type | Output Capacity per Unit (MBh) | Manufacturer | Model | Remaining Useful Life | ECM # | Install High Efficiency System? | System Quantity | System Type | Output Capacity per Unit (MBh) | Heating Efficiency | Heating Efficiency Units | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Mechanical | Bunk Room, Office, Kitchen, Restrooms, Corridors | 1 | Condensing Hot Water Boiler | 373 | Munchkin | 399M R2 | W | | No | | | | | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |

Pipe Insulation Recommendations

| Location | Area(s)/System(s) Affected | Recommendation Inputs | | | Energy Impact & Financial Analysis | | | | | | |
|------------|----------------------------|-----------------------|---------------------------------|--------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| | | ECM # | Length of Uninsulated Pipe (ft) | Pipe Diameter (in) | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Mechanical | Storage Water Heater | 6 | 9 | 1.00 | 0.0 | 0 | 0 | \$6 | \$107 | \$18 | 14.9 |
| Mechanical | Boiler | 6 | 20 | 2.00 | 0.0 | 0 | 16 | \$242 | \$328 | \$40 | 1.2 |

DHW Inventory & Recommendations

| Location | Area(s)/System(s) Served | Existing Conditions | | | | | Proposed Conditions | | | | | | | Energy Impact & Financial Analysis | | | | | | |
|------------|-----------------------------|---------------------|--------------------------------------|--------------|---------------------|-----------------------|---------------------|----------|-----------------|-------------|-----------|-------------------|------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| | | System Quantity | System Type | Manufacturer | Model | Remaining Useful Life | ECM # | Replace? | System Quantity | System Type | Fuel Type | System Efficiency | Efficiency Units | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Mechanical | Building's hot water supply | 1 | Storage Tank Water Heater (≤ 50 Gal) | Rheem | PROG40S-36N RH67 PV | W | | No | | | | | | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |

Low-Flow Device Recommendations

| Location | Recommendation Inputs | | | | | Energy Impact & Financial Analysis | | | | | | |
|------------|-----------------------|-----------------|---------------------------|--------------------------|--------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| | ECM # | Device Quantity | Device Type | Existing Flow Rate (gpm) | Proposed Flow Rate (gpm) | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Kitchen | 7 | 1 | Faucet Aerator (Kitchen) | 2.20 | 1.50 | 0.0 | 0 | 0 | \$1 | \$7 | \$2 | 4.5 |
| Restroom | 7 | 2 | Faucet Aerator (Lavatory) | 2.20 | 0.50 | 0.0 | 0 | 0 | \$6 | \$14 | \$7 | 1.3 |
| Restroom 2 | 7 | 1 | Faucet Aerator (Lavatory) | 2.20 | 0.50 | 0.0 | 0 | 0 | \$3 | \$7 | \$4 | 1.3 |

Cooking Equipment Inventory & Recommendations

| Location | Existing Conditions | | | | | Proposed Conditions | | Energy Impact & Financial Analysis | | | | | | |
|----------|---------------------|----------------|--------------------------|--------------|----------------------------|---------------------|------------------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| | Quantity | Equipment Type | Manufacturer | Model | High Efficiency Equipment? | ECM # | Install High Efficiency Equipment? | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Kitchen | 1 | Range | General Electric Company | JGB280DEN4BB | No | | No | 0.0 | 0 | 0 | \$0 | \$0 | \$0 | 0.0 |

Plug Load Inventory

| Existing Conditions | | | | | | |
|---------------------|----------|----------------------------|-----------------|------------------------|--------------------------|--------------|
| Location | Quantity | Equipment Description | Energy Rate (W) | ENERGY STAR Qualified? | Manufacturer | Model |
| Office | 1 | Desktop | 220 | No | | |
| Kitchen | 1 | Dishwasher (Undercounter) | 1,100 | No | General Electric Company | GLD4406R00BB |
| Kitchen | 1 | Microwave | 1,580 | No | General Electric Company | JVM1740DM1BB |
| Kitchen | 1 | Refrigerator (Residential) | 300 | No | | |
| Office | 1 | Fax Machine | 20 | No | | |
| Kitchen | 1 | Television | 120 | No | | |
| Office | 1 | Television | 100 | No | | |
| Office | 1 | Modem/Router | 8 | No | | |

Miscellaneous Fuel Inventory

| Existing Conditions | | | | | | |
|---------------------|----------|-----------------------|-------------------------------|------------------------|----------------------|-------|
| Location | Quantity | Equipment Description | Input Capacity per Unit (MBh) | ENERGY STAR Qualified? | Manufacturer | Model |
| Exterior | 1 | Generator | 100.0 | No | Kohler Power Systems | 0.0 |

APPENDIX B: ENERGY STAR STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

ENERGY STAR® Statement of Energy Performance

LEARN MORE AT energystar.gov

N/A

Chatham Township Station No. 2

Primary Property Type: Fire Station
Gross Floor Area (ft²): 5,000
Built: 2010

For Year Ending: January 31, 2023
Date Generated: August 11, 2023

ENERGY STAR® Score¹

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

| Property & Contact Information | | | |
|--|--|--|--|
| Property Address Chatham Township Station No. 2 172 Southern Boulevard Chatham, New Jersey 07928 | Property Owner Chatham Township Volunteer Fire Department 495 River Road Chatham, NJ 07928 (862) 206-9418 | Primary Contact Matthew Chase 495 River Road Chatham, NJ 07928 (862) 206-9418 chief@ctfd.org | |
| Property ID: 26964171 | | | |

| Energy Consumption and Energy Use Intensity (EUI) | | | |
|---|-------------------------------------|--|-------|
| Site EUI 41.5 kBtu/ft² | Annual Energy by Fuel | National Median Comparison | |
| | Electric - Grid (kBtu) 77,511 (37%) | National Median Site EUI (kBtu/ft²) | 73.3 |
| | Natural Gas (kBtu) 129,786 (63%) | National Median Source EUI (kBtu/ft²) | 124.9 |
| | | % Diff from National Median Source EUI | -43% |
| Source EUI 70.7 kBtu/ft² | | Annual Emissions | |
| | | Total (Location-Based) GHG Emissions (Metric Tons CO2e/year) | 14 |

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: _____ Date: _____

Licensed Professional

New Jersey's Clean Energy Program - LGEA
 900 ROUTE 9 NORTH
 SUITE 404
 WOODBRIDGE, NJ 07095
 732-855-2864
 benchmarking@trcsolutions.com



Professional Engineer or Registered Architect Stamp

APPENDIX C: GLOSSARY

| TERM | DEFINITION |
|--------------------------|--|
| Blended Rate | Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour. |
| Btu | <i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit. |
| CHP | <i>Combined heat and power</i> . Also referred to as cogeneration. |
| COP | <i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input. |
| Demand Response | Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives. |
| DCV | <i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need. |
| US DOE | <i>United States Department of Energy</i> |
| EC Motor | <i>Electronically commutated motor</i> |
| ECM | <i>Energy conservation measure</i> |
| EER | <i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input. |
| EUI | <i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance. |
| Energy Efficiency | Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service. |
| ENERGY STAR | ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA. |
| EPA | <i>United States Environmental Protection Agency</i> |
| Generation | The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil). |
| GHG | <i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface. |
| gpf | <i>Gallons per flush</i> |

| | |
|------------------|---|
| gpm | <i>Gallon per minute</i> |
| HID | <i>High intensity discharge</i> : high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor. |
| hp | <i>Horsepower</i> |
| HPS | <i>High-pressure sodium</i> : a type of HID lamp. |
| HSPF | <i>Heating seasonal performance factor</i> : a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input. |
| HVAC | <i>Heating, ventilating, and air conditioning</i> |
| IHP 2014 | US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency. |
| IPLV | <i>Integrated part load value</i> : a measure of the part load efficiency usually applied to chillers. |
| kBtu | One thousand British thermal units |
| kW | <i>Kilowatt</i> : equal to 1,000 Watts. |
| kWh | <i>Kilowatt-hour</i> : 1,000 Watts of power expended over one hour. |
| LED | <i>Light emitting diode</i> : a high-efficiency source of light with a long lamp life. |
| LGEA | <i>Local Government Energy Audit</i> |
| Load | The total power a building or system is using at any given time. |
| Measure | A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption. |
| MH | <i>Metal halide</i> : a type of HID lamp. |
| MBh | <i>Thousand Btu per hour</i> |
| MBtu | <i>One thousand British thermal units</i> |
| MMBtu | <i>One million British thermal units</i> |
| MV | <i>Mercury Vapor</i> : a type of HID lamp. |
| NJBPU | <i>New Jersey Board of Public Utilities</i> |
| NJCEP | <i>New Jersey's Clean Energy Program</i> : NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment. |
| psig | Pounds per square inch gauge |
| Plug Load | Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug. |
| PV | <i>Photovoltaic</i> : refers to an electronic device capable of converting incident light directly into electricity (direct current). |

| | |
|-----------------------------|---|
| SEER | <i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input. |
| SEP | <i>Statement of energy performance</i> : a summary document from the ENERGY STAR Portfolio Manager. |
| Simple Payback | The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings. |
| SREC (II) | <i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array. |
| T5, T8, T12 | A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch. |
| Temperature Setpoint | The temperature at which a temperature regulating device (thermostat, for example) has been set. |
| therm | 100,000 Btu. Typically used as a measure of natural gas consumption. |
| tons | A unit of cooling capacity equal to 12,000 Btu/hr. |
| Turnkey | Provision of a complete product or service that is ready for immediate use. |
| VAV | <i>Variable air volume</i> |
| VFD | <i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor. |
| WaterSense® | The symbol for water efficiency. The WaterSense® program is managed by the EPA. |
| Watt (W) | Unit of power commonly used to measure electricity use. |