



# Local Government Energy Audit Report

Academic Wing G

July 10, 2024

*Prepared for:*

Ramapo College of New Jersey  
523 Route 202  
Mahwah, New Jersey 07430

*Prepared by:*

TRC  
317 George Street  
New Brunswick, New Jersey 08901

## Disclaimer

---

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based on previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2024 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

# Table of Contents

---


<b>1</b>	<b>Executive Summary.....</b>	<b>1</b>
<b>1.1</b>	<b>Planning Your Project .....</b>	<b>4</b>
	Pick Your Installation Approach .....	4
	Options from Your Utility Company.....	4
	<i>Prescriptive and Custom Rebates</i> .....	4
	<i>Direct Install</i> .....	4
	<i>Engineered Solutions</i> .....	4
	Options from New Jersey's Clean Energy Program .....	5
<b>2</b>	<b>Existing Conditions.....</b>	<b>6</b>
2.1	Site Overview.....	6
2.2	Building Occupancy .....	6
2.3	Building Envelope .....	6
2.4	Lighting Systems.....	8
2.5	Air Handling Systems.....	9
	Unitary Electric HVAC Equipment .....	9
	Air Handling Units (AHUs) .....	10
2.6	Heating Hot Water Systems .....	10
2.7	Chilled Water Systems.....	11
2.8	Building Automation System (BAS) .....	11
2.9	Domestic Hot Water .....	11
2.10	Plug Load and Vending Machines .....	12
2.11	Water-Using Systems .....	13
2.12	Process Equipment.....	13
<b>3</b>	<b>Energy Use and Costs .....</b>	<b>15</b>
3.1	Electricity .....	17
3.2	Natural Gas.....	18
3.3	Benchmarking.....	19
	Tracking Your Energy Performance .....	20
<b>4</b>	<b>Energy Conservation Measures .....</b>	<b>21</b>
4.1	Lighting .....	23
	ECM 1: Install LED Fixtures .....	23
	ECM 2: Retrofit Fixtures with LED Lamps .....	23
4.2	Lighting Controls.....	24
	ECM 3: Install Occupancy Sensor Lighting Controls .....	24
	ECM 4: Install High/Low Lighting Controls .....	24
4.3	Domestic Water Heating .....	25
	ECM 5: Install Low-Flow DHW Devices.....	25
4.4	Measures for Future Consideration .....	25
	Electric Sub Metering .....	26

<b>5</b>	<b>Energy Efficient Best Practices .....</b>	<b>27</b>
	Energy Tracking with ENERGY STAR Portfolio Manager .....	27
	Lighting Maintenance.....	27
	Lighting Controls .....	27
	Motor Maintenance .....	28
	AC System Evaporator/Condenser Coil Cleaning .....	28
	HVAC Filter Cleaning and Replacement .....	28
	Ductwork Maintenance.....	28
	Steam Trap Repair and Replacement.....	29
	Furnace Maintenance .....	29
	Label HVAC Equipment .....	29
	Optimize HVAC Equipment Schedules .....	29
	Water Heater Maintenance .....	30
	Refrigeration Equipment Maintenance.....	30
	Water Conservation .....	30
	Procurement Strategies .....	31
<b>6</b>	<b>On-site Generation .....</b>	<b>32</b>
6.1	Solar Photovoltaic .....	33
6.2	Combined Heat and Power .....	35
<b>7</b>	<b>Electric Vehicles (EV) .....</b>	<b>36</b>
7.1	Electric Vehicle Charging .....	36
<b>8</b>	<b>Project Funding and Incentives.....</b>	<b>38</b>
8.1	Utility Energy Efficiency Programs .....	39
	Prescriptive and Custom .....	39
	Direct Install .....	39
	Engineered Solutions .....	40
8.2	New Jersey's Clean Energy Programs.....	41
	Large Energy Users .....	41
	Combined Heat and Power .....	42
	Successor Solar Incentive Program (SuSI) .....	43
	Energy Savings Improvement Program .....	44
<b>9</b>	<b>Project Development .....</b>	<b>45</b>
<b>10</b>	<b>Energy Purchasing and Procurement Strategies .....</b>	<b>46</b>
10.1	Retail Electric Supply Options.....	46
10.2	Retail Natural Gas Supply Options .....	46
	<b>Appendix A: Equipment Inventory &amp; Recommendations .....</b>	<b>A-1</b>
	<b>Appendix B: ENERGY STAR Statement of Energy Performance.....</b>	<b>B-1</b>
	<b>Appendix C: Glossary .....</b>	<b>C-1</b>

# 1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPB) has sponsored this Local Government Energy Audit (LGEA) report for Academic Wing G. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

## BUILDING PERFORMANCE REPORT

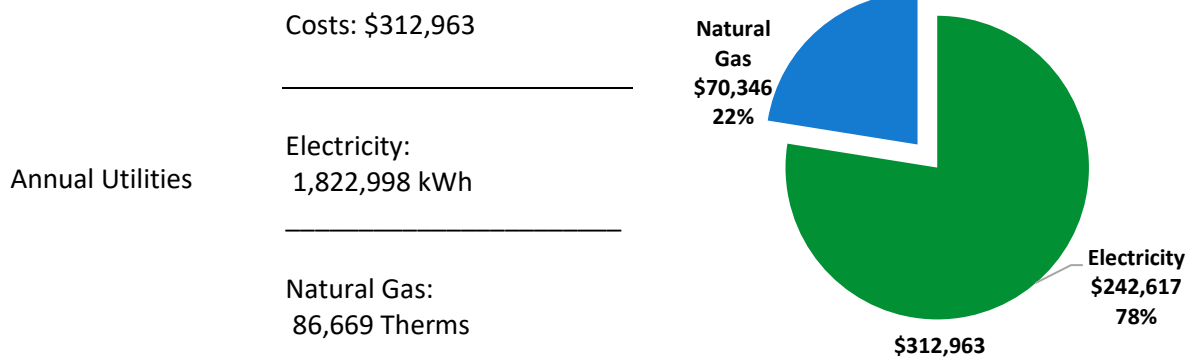

ENERGY STAR®  
Benchmarking Score

N/A  
(1-100 scale)

A standard energy use benchmark is not available for this facility type. This report contains suggestions about how to improve building performance and reduce energy costs.

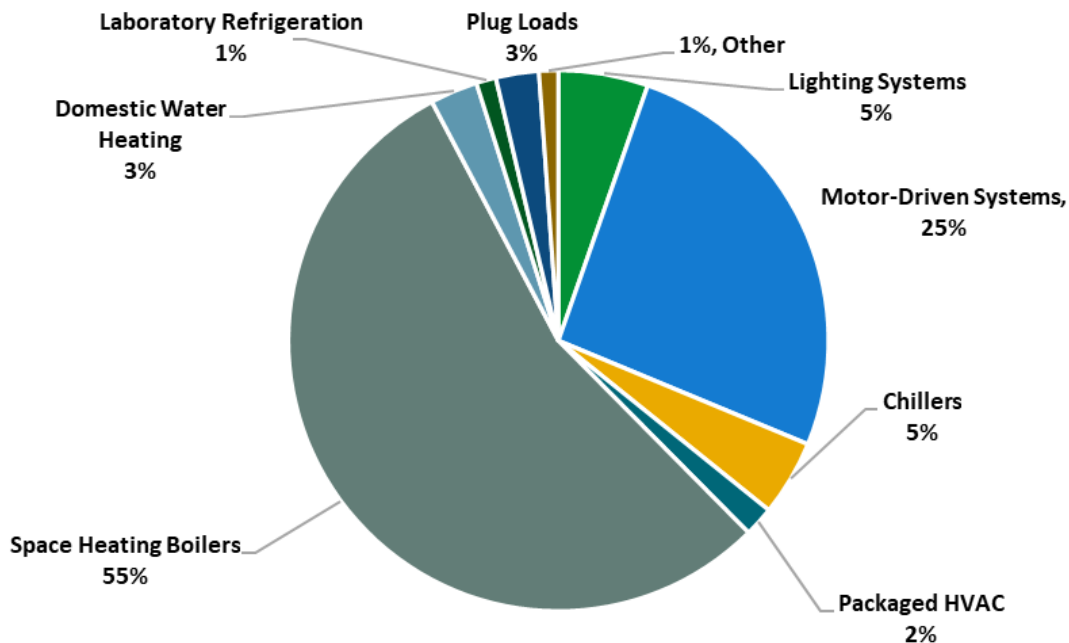


Figure 1 - Energy Use by System


## POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


### Scenario 1: Full Package (All Evaluated Measures)

Installation Cost	\$74,391
Potential Rebates & Incentives <sup>1</sup>	\$13,545
Annual Cost Savings	\$16,671
Annual Energy Savings	Electricity: 126,791 kWh Natural Gas: -250 Therms
Greenhouse Gas Emission Savings	62 Tons
Simple Payback	3.6 Years
Site Energy Savings (All Utilities)	3%

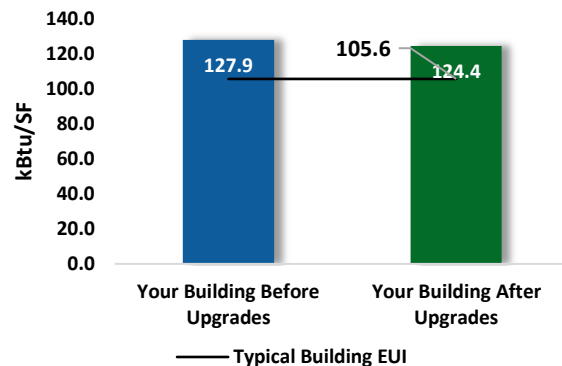

### Scenario 2: Cost Effective Package<sup>2</sup>

Installation Cost	\$74,391
Potential Rebates & Incentives	\$13,545
Annual Cost Savings	\$16,671
Annual Energy Savings	Electricity: 126,791 kWh Natural Gas: -250 Therms
Greenhouse Gas Emission Savings	62 Tons
Simple Payback	3.6 Years
Site Energy Savings (all utilities)	3%

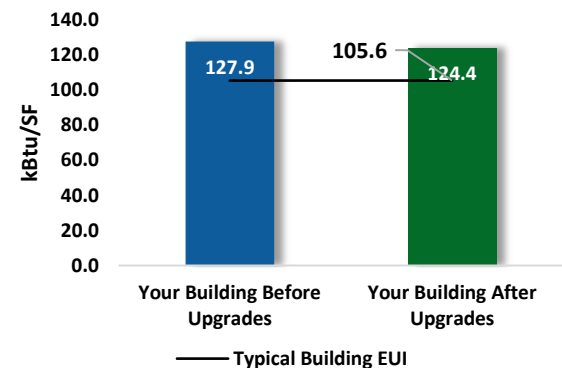

### On-site Generation Potential

Photovoltaic	None
Combined Heat and Power	None

<sup>1</sup> Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

<sup>2</sup> A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
Lighting Upgrades			116,520	24.8	-24	\$15,311	\$62,956	\$10,775	\$52,181	3.4	114,498
ECM 1	Install LED Fixtures	Yes	635	0.0	0	\$85	\$164	\$25	\$139	1.6	640
ECM 2	Retrofit Fixtures with LED Lamps	Yes	115,885	24.8	-24	\$15,226	\$62,792	\$10,750	\$52,042	3.4	113,858
Lighting Control Measures			10,271	1.7	-2	\$1,349	\$11,311	\$2,770	\$8,541	6.3	10,091
ECM 3	Install Occupancy Sensor Lighting Controls	Yes	8,796	1.5	-2	\$1,156	\$8,836	\$1,075	\$7,761	6.7	8,642
ECM 4	Install High/Low Lighting Controls	Yes	1,475	0.2	0	\$194	\$2,475	\$1,695	\$780	4.0	1,449
Domestic Water Heating Upgrade			0	0.0	1	\$11	\$124	\$0	\$124	11.3	158
ECM 5	Install Low-Flow DHW Devices	Yes	0	0.0	1	\$11	\$124	\$0	\$124	11.3	158
TOTALS (COST EFFECTIVE MEASURES)			126,791	26.5	-25	\$16,671	\$74,391	\$13,545	\$60,846	3.6	124,747
TOTALS (ALL MEASURES)			126,791	26.5	-25	\$16,671	\$74,391	\$13,545	\$60,846	3.6	124,747

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.



## 1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

### Pick Your Installation Approach

Utility-run energy efficiency programs and New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

### Options from Your Utility Company

#### *Prescriptive and Custom Rebates*

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the Prescriptive and Custom Rebates program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval may be required for some incentives. Contact your utility company for more details prior to project installation.

#### *Direct Install*

The Direct Install program provides turnkey installation of multiple measures through an authorized contractor. This program can provide incentives up to 70% or 80% of the cost of selected measures. A Direct Install contractor will assess and verify individual measure eligibility and perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

#### *Engineered Solutions*

The Engineered Solutions program provides tailored energy-efficiency assistance and turnkey engineering services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. The program provides all professional services from audit, design, construction administration, to commissioning and measurement and verification for custom whole-building energy-efficiency projects. Engineered Solutions allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs.

For more details on these programs please contact your utility provider.



## **Options from New Jersey's Clean Energy Program**

### *Financing and Planning Support with the Energy Savings Improvement Program (ESIP)*

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

### *Resiliency with Return on Investment through Combined Heat and Power (CHP)*

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

### *Successor Solar Incentive Program (SuSI)*

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

### *Ongoing Electric Savings with Demand Response*

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

### *Large Energy User Program (LEUP)*

LEUP is designed to promote self-investment in energy efficiency. It incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

For more details on these programs please visit [New Jersey's Clean Energy Program website](#) .



## 2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) report for Academic Wing G. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

### 2.1 Site Overview

On August 16, 2023, TRC performed an energy audit at Academic Wing G located in Mahwah, New Jersey. TRC met with facility staff to review the facility operations and help focus our investigation on specific energy-using systems.

Academic Wing G is a four-story, 116,377 square foot building built in 1973. Spaces include classrooms, offices, corridors, stairwells, and mechanical spaces.

### 2.2 Building Occupancy

The facility is occupied Monday through Friday during fall, spring, and summer semesters. Janitorial services are performed after hours.

Building Name	Weekday/Weekend	Operating Schedule
Academic Wing G	Weekday	8:00 AM - 5:00 PM
	Weekend	Closed

*Figure 3 - Building Occupancy Schedule*

### 2.3 Building Envelope

Building walls are concrete block over structural steel with a brick facade. The roof is flat and covered with white membrane, and it is in fair condition. Roof encloses semi conditioned space (e.g., a space that is not intentionally heated but escaping heat from HVAC equipment caused the space to be conditioned.).



*Building Exterior*



*Interior Structure*



*Roof*



Most of the windows are double glazed with low-e glass and have aluminum frames with a thermal break. The glass-to-frame seals are in fair condition. The operable window weather seals are in fair condition, showing little evidence of excessive wear. Exterior doors have aluminum frames and are in fair condition with undamaged door seals. Degraded window and door seals increase drafts and outside air infiltration.



*Exterior Doors*



*Windows*

## 2.4 Lighting Systems

The primary interior lighting system uses a mix of 32-Watt linear fluorescent T8 lamps and 28-watt T5 lamps. Fixture types include 1-lamp, 2-lamp, 3-lamp, or 4-lamp, 2-foot or 4-foot-long recessed troffer and surface mounted fixtures and 2-foot fixtures with U-bend tube lamps. Typically, T5 and T8 fluorescent lamps use electronic ballasts.

Additionally, there are some compact fluorescent lamps (CFL) and LED lamps. All exit signs are LED. Most fixtures are in fair condition. Interior lighting levels were generally sufficient.



*Linear Fluorescent Fixtures*

Most lighting fixtures are controlled by occupancy sensors and the remainder by wall switches.



*Wall Switch Sensors*

Exterior fixtures include HID wall packs and LED canopy lights. Exterior fixtures are photocell controlled.



*Wall Packs*

## 2.5 Air Handling Systems

### **Unitary Electric HVAC Equipment**

Sections of the building are cooled by ductless mini split air conditioning (AC) units. These vary in capacity between 1 ton and 2-tons. The units are in fair condition. They range in efficiency between 8 EER and 10 EER. They are not ENERGY STAR labeled.





*Ductless Mini Split System*

### **Air Handling Units (AHUs)**

The facility is mainly conditioned by six air handling units. Units are equipped with a VFD controlled supply fan, hot water coil, and chilled water coil. Supply fan motors range in size between 5 hp and 75 hp. AHU-4 is also equipped with a variable speed return fan. Units are connected to the heating and cooling systems described below. They are controlled by the BMS system.



*Air Handling Units*

## **2.6 Heating Hot Water Systems**

Steam is supplied by the central plant then converted to hot water with the help of a heat exchanger. Hot water is distributed to heating end uses. The hydronic distribution system is a four-pipe heating and cooling system.

Two, 5 hp and three, 15 hp pumps circulate hot water. They are controlled by VFDs.



*Heat Exchanger*



*Hot Water Pumps*

## 2.7 Chilled Water Systems

Chilled water is supplied from the central plant. Water is distributed by two, 40 hp VFD controlled pumps.



*Chilled Water Controls*



*Chilled Water Pumps*

## 2.8 Building Automation System (BAS)

A Johnson Controls BAS controls the HVAC equipment and air handlers. The BAS provides equipment scheduling control and monitors and controls space temperatures, supply air temperatures, humidity, heating water loop temperatures, and chilled water loop temperatures.

The site staff expressed an interest in expanding the level of control provided by the BAS, replacing the BAS, and receiving additional training on operating the BAS.

## 2.9 Domestic Hot Water

Hot water is produced by a heat exchanger using steam from the central plant heating boiler.



## 2.10 Plug Load and Vending Machines

The location is doing a great job managing the electrical plug loads. This report makes additional suggestions for ECMs in this area as well as energy efficient best practices.

There are 159 computer workstations throughout the facility. Plug loads include general cafe and office equipment. There are classroom typical loads such as smartboards, projectors, and fans. There are 46 refrigerators that vary in condition and efficiency.



*Lab Equipment*



*Computer Workstations*



*Lab Equipment*



*Lab Equipment*

## 2.11 Water-Using Systems

There are ten restrooms with toilets and sinks. Faucet flow rates are at 0.5 gallons per minute (gpm) or higher.



*Lavatory Sinks*

## 2.12 Process Equipment

The facility has a compressed air system used throughout the building. The air is used for labs. In addition, hoods in labs have ventilation that runs continuously. Motors are VFD controlled.



*Compressed Air System*




*Hood Ventilation System*

### 3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	1,822,998 kWh	\$242,617
Natural Gas	86,669 Therms	\$70,346
<b>Total</b>		<b>\$312,963</b>

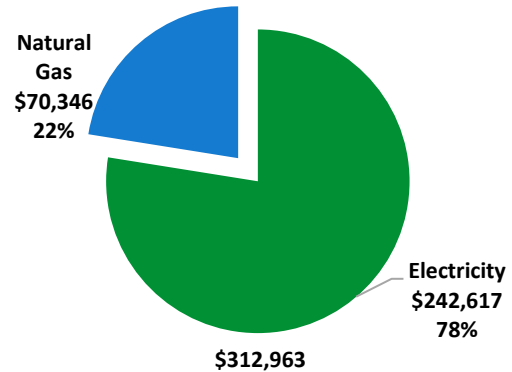

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


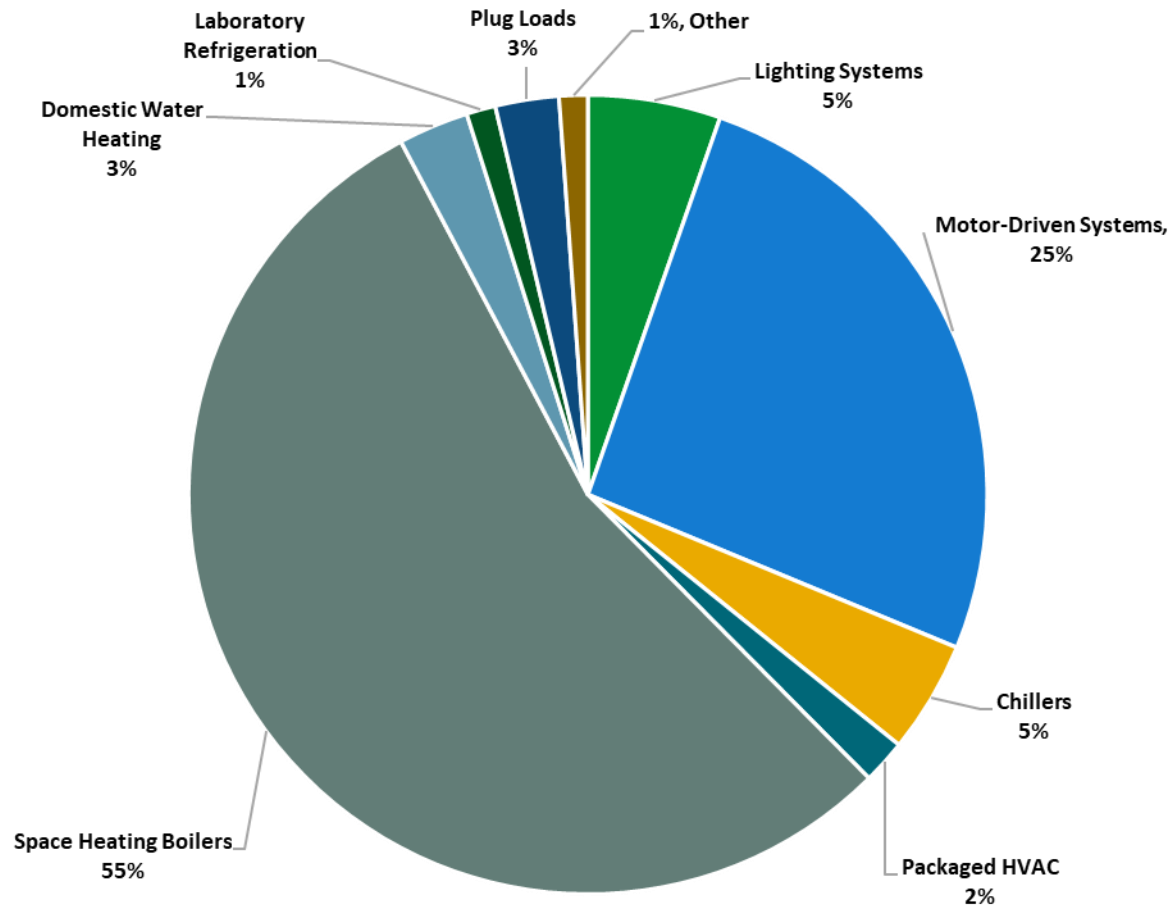


Figure 4 - Energy Balance

### 3.1 Electricity

Rockland Electric delivers electricity under rate class Electric Comm Prim (TOU-RE-DEL-PJM), with electric production provided by Direct Energy, a third-party supplier.

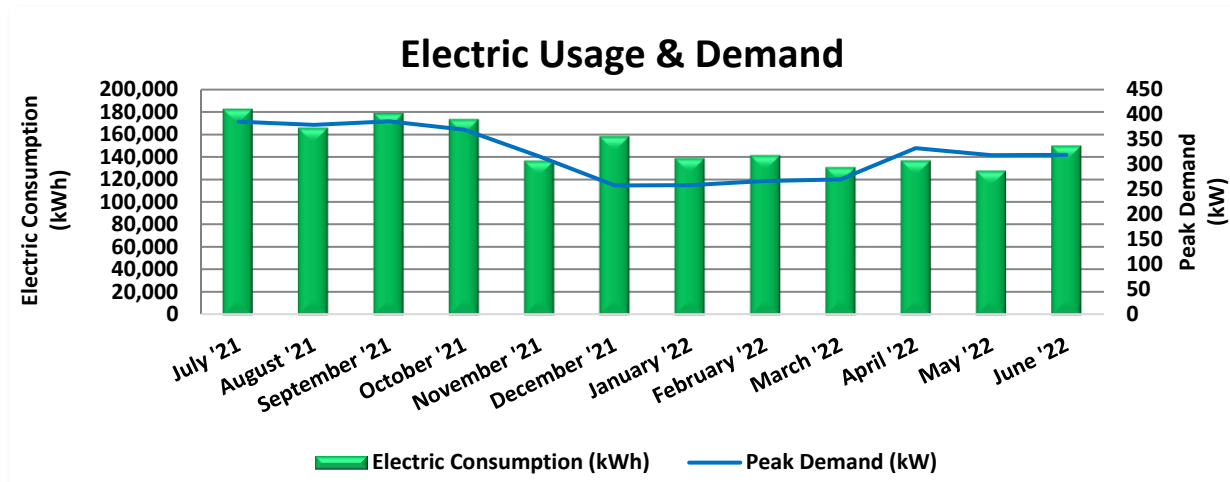

Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
7/26/21	32	182,063	386		\$21,367
8/24/21	29	165,351	379		\$19,669
9/23/21	30	178,452	386		\$21,126
10/25/21	32	173,094	370		\$20,464
11/23/21	29	136,399	316		\$16,277
12/27/21	34	157,962	258		\$18,309
1/26/22	30	138,722	258		\$20,710
2/24/22	29	141,242	267		\$21,188
3/25/22	29	130,754	270		\$19,727
4/25/22	31	136,616	333		\$20,872
5/23/22	28	127,584	319		\$19,446
6/23/22	31	149,764	319		\$22,797
<b>Totals</b>	<b>364</b>	<b>1,818,003</b>	<b>386</b>	<b>\$0</b>	<b>\$241,952</b>
<b>Annual</b>	<b>365</b>	<b>1,822,998</b>	<b>386</b>	<b>\$0</b>	<b>\$242,617</b>


Notes:

- The average electric cost over the past 12 months was \$0.133/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.
- This building is served from the main campus electric meter along with several others. Energy usage (kWh) and demand (kW) was apportioned among those buildings using a formula that accounts for building area (sf) and presumed energy intensity (EUI) by building type.



## 3.2 Natural Gas

PSE&G delivers natural gas under rate class General Service Gas, with natural gas supply provided by UGI, a third-party supplier.

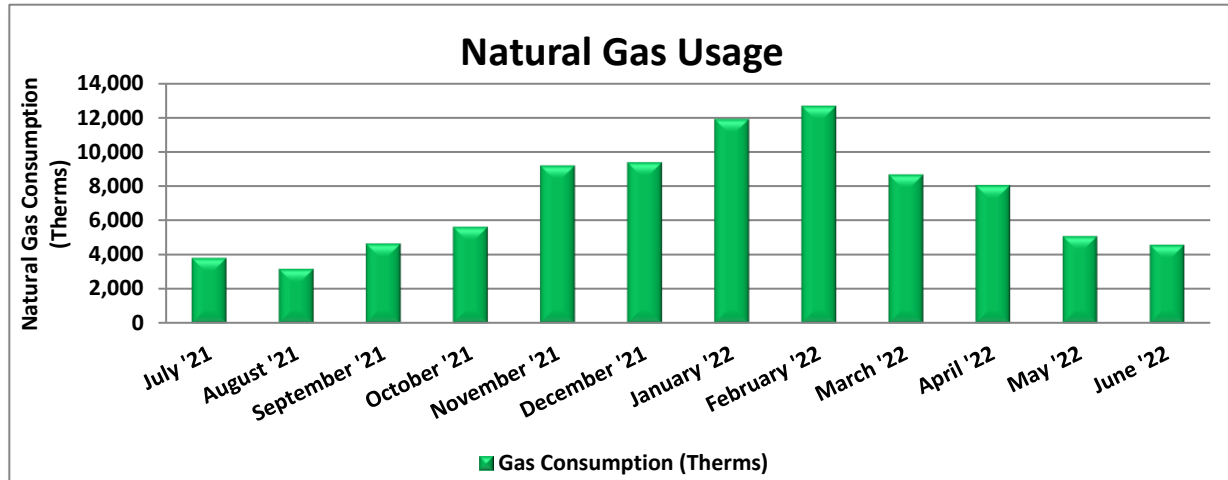

Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
8/2/21	33	3,811	\$2,074
8/27/21	25	3,172	\$1,723
9/28/21	32	4,649	\$2,523
10/28/21	30	5,614	\$3,225
11/30/21	33	9,183	\$6,924
12/29/21	29	9,359	\$7,185
1/28/22	30	11,881	\$11,433
3/3/22	34	12,656	\$12,228
3/31/22	28	8,660	\$8,873
5/2/22	32	8,043	\$6,549
5/31/22	29	5,070	\$4,044
6/30/22	30	4,571	\$3,565
<b>Totals</b>	<b>365</b>	<b>86,669</b>	<b>\$70,346</b>
<b>Annual</b>	<b>365</b>	<b>86,669</b>	<b>\$70,346</b>

### Notes:

- The average gas cost for the past 12 months is \$0.812/therm, which is the blended rate used throughout the analysis.
- Heating hot water for this building is converted from steam provided by the central plant. Central plant natural gas use has been apportioned among the buildings served with steam using a formula that accounts for building area (sf) and presumed energy intensity (EUI) by building type.



### 3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

#### Benchmarking Score

N/A

Due to its unique characteristics, this building type is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

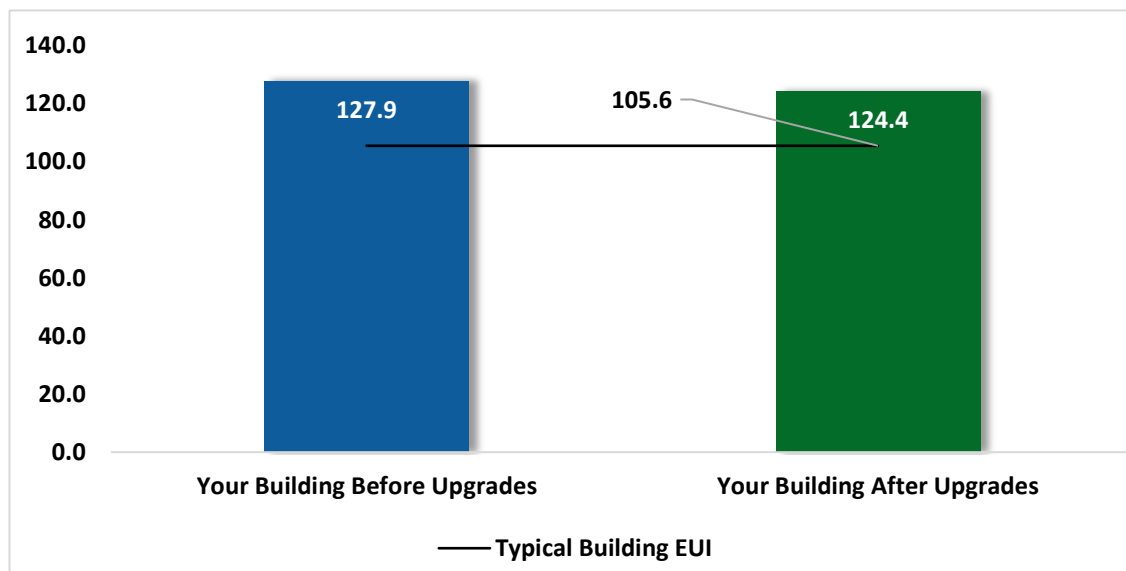


Figure 5 - Energy Use Intensity Comparison<sup>3</sup>

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

<sup>3</sup> Based on all evaluated ECMs



### **Tracking Your Energy Performance**

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance.

**We have created a Portfolio Manager account for your facility and have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.**

Free online training is available to help you use ENERGY STAR Portfolio Manager to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR and Portfolio Manager, visit their [website](#).

## 4 ENERGY CONSERVATION MEASURES

---

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives in this report are based on the previously run state rebate program SmartStart, which has been retired. Now, all investor-owned gas and electric utility companies are offering complementary energy efficiency programs directly to their customers. Some measures and proposed upgrades may be eligible for higher incentives than those shown below. The incentives in the summary tables should be used for high-level planning purposes. To verify incentives, reach out to your utility provider or visit the [NJCEP website](#) for more information.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>116,520</b>	<b>24.8</b>	<b>-24</b>	<b>\$15,311</b>	<b>\$62,956</b>	<b>\$10,775</b>	<b>\$52,181</b>	<b>3.4</b>	<b>114,498</b>
ECM 1	Install LED Fixtures	Yes	635	0.0	0	\$85	\$164	\$25	\$139	1.6	640
ECM 2	Retrofit Fixtures with LED Lamps	Yes	115,885	24.8	-24	\$15,226	\$62,792	\$10,750	\$52,042	3.4	113,858
<b>Lighting Control Measures</b>			<b>10,271</b>	<b>1.7</b>	<b>-2</b>	<b>\$1,349</b>	<b>\$11,311</b>	<b>\$2,770</b>	<b>\$8,541</b>	<b>6.3</b>	<b>10,091</b>
ECM 3	Install Occupancy Sensor Lighting Controls	Yes	8,796	1.5	-2	\$1,156	\$8,836	\$1,075	\$7,761	6.7	8,642
ECM 4	Install High/Low Lighting Controls	Yes	1,475	0.2	0	\$194	\$2,475	\$1,695	\$780	4.0	1,449
<b>Domestic Water Heating Upgrade</b>			<b>0</b>	<b>0.0</b>	<b>1</b>	<b>\$11</b>	<b>\$124</b>	<b>\$0</b>	<b>\$124</b>	<b>11.3</b>	<b>158</b>
ECM 5	Install Low-Flow DHW Devices	Yes	0	0.0	1	\$11	\$124	\$0	\$124	11.3	158
<b>TOTALS</b>			<b>126,791</b>	<b>26.5</b>	<b>-25</b>	<b>\$16,671</b>	<b>\$74,391</b>	<b>\$13,545</b>	<b>\$60,846</b>	<b>3.6</b>	<b>124,747</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 6 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>116,520</b>	<b>24.8</b>	<b>-24</b>	<b>\$15,311</b>	<b>\$62,956</b>	<b>\$10,775</b>	<b>\$52,181</b>	<b>3.4</b>	<b>114,498</b>
ECM 1	Install LED Fixtures	635	0.0	0	\$85	\$164	\$25	\$139	1.6	640
ECM 2	Retrofit Fixtures with LED Lamps	115,885	24.8	-24	\$15,226	\$62,792	\$10,750	\$52,042	3.4	113,858
<b>Lighting Control Measures</b>		<b>10,271</b>	<b>1.7</b>	<b>-2</b>	<b>\$1,349</b>	<b>\$11,311</b>	<b>\$2,770</b>	<b>\$8,541</b>	<b>6.3</b>	<b>10,091</b>
ECM 3	Install Occupancy Sensor Lighting Controls	8,796	1.5	-2	\$1,156	\$8,836	\$1,075	\$7,761	6.7	8,642
ECM 4	Install High/Low Lighting Controls	1,475	0.2	0	\$194	\$2,475	\$1,695	\$780	4.0	1,449
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>1</b>	<b>\$11</b>	<b>\$124</b>	<b>\$0</b>	<b>\$124</b>	<b>11.3</b>	<b>158</b>
ECM 5	Install Low-Flow DHW Devices	0	0.0	1	\$11	\$124	\$0	\$124	11.3	158
<b>TOTALS</b>		<b>126,791</b>	<b>26.5</b>	<b>-25</b>	<b>\$16,671</b>	<b>\$74,391</b>	<b>\$13,545</b>	<b>\$60,846</b>	<b>3.6</b>	<b>124,747</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – Cost Effective ECMs

## 4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>116,520</b>	<b>24.8</b>	<b>-24</b>	<b>\$15,311</b>	<b>\$62,956</b>	<b>\$10,775</b>	<b>\$52,181</b>	<b>3.4</b>	<b>114,498</b>
ECM 1	Install LED Fixtures	635	0.0	0	\$85	\$164	\$25	\$139	1.6	640
ECM 2	Retrofit Fixtures with LED Lamps	115,885	24.8	-24	\$15,226	\$62,792	\$10,750	\$52,042	3.4	113,858

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

### **ECM 1: Install LED Fixtures**

Replace existing fixtures containing HID lamps with new LED light fixtures. This measure saves energy by installing LEDs, which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixtures.

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

**Affected Building Areas:** exterior HID fixtures

### **ECM 2: Retrofit Fixtures with LED Lamps**

Replace lineal fluorescent or CFL lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

**Affected Building Areas:** all areas with fluorescent fixtures with T8 tubes, T5 tubes, or CFLs

## 4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Control Measures</b>		<b>10,271</b>	<b>1.7</b>	<b>-2</b>	<b>\$1,349</b>	<b>\$11,311</b>	<b>\$2,770</b>	<b>\$8,541</b>	<b>6.3</b>	<b>10,091</b>
ECM 3	Install Occupancy Sensor Lighting Controls	8,796	1.5	-2	\$1,156	\$8,836	\$1,075	\$7,761	6.7	8,642
ECM 4	Install High/Low Lighting Controls	1,475	0.2	0	\$194	\$2,475	\$1,695	\$780	4.0	1,449

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

### **ECM 3: Install Occupancy Sensor Lighting Controls**

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

**Affected Building Areas:** offices, classrooms, laboratories, and mechanical spaces

### **ECM 4: Install High/Low Lighting Controls**

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as occupants approach the area.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

**Affected Building Areas:** hallways and stairwells

### 4.3 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
	<b>Domestic Water Heating Upgrade</b>	<b>0</b>	<b>0.0</b>	<b>1</b>	<b>\$11</b>	<b>\$124</b>	<b>\$0</b>	<b>\$124</b>	<b>11.3</b>	<b>158</b>
ECM 5	Install Low-Flow DHW Devices	0	0.0	1	\$11	\$124	\$0	\$124	11.3	158

#### **ECM 5: Install Low-Flow DHW Devices**

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Additional cost savings may result from reduced water usage.

### 4.4 Measures for Future Consideration

There are additional opportunities for improvement that Ramapo College of New Jersey may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment, and/or include significant system reconfiguration. These measure(s) are therefore beyond the scope of this energy audit. These measure(s) are described here to support a whole building approach to energy efficiency and sustainability.

Ramapo College of New Jersey may wish to consider the Energy Savings Improvement Program (ESIP) or other whole building approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to:

- Evaluate these measures further.
- Develop firm costs.
- Determine measure savings.
- Prepare detailed implementation plans.



Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

### **Electric Sub Metering**

Electricity use varies in different facilities, and plant operators need to perform their own investigations and analyses to understand how their facilities consume energy. Facility staff expressed interest in sub metering key building, which are currently served by a master meter. Utility bills indicate how much energy a facility uses across the entire facility, but submetering provides more detailed data on the energy consumption of specific systems and even on individual pieces of equipment, depending on how extensively meters are installed. Electric submeters alone do not save energy, but they are a useful tool under the right circumstances. Electric sub-meters can provide facility staff with real-time energy use data for specific building information that enhances the potential for greater energy management activities. Revenue grade submeters are a tool that allow operators to better understand how and where electricity is used at the facility. Better resolution of system energy use can lead to operational changes or even equipment modifications or replacement, which often result in reduced energy use, which often result in reduced energy use.

## 5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5%–20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Energy Tracking with ENERGY STAR Portfolio Manager**



You've heard it before—you cannot manage what you do not measure. ENERGY STAR Portfolio Manager is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions<sup>4</sup>. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

### **Lighting Maintenance**



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.
- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

### **Lighting Controls**

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly. Adjust exterior lighting time clock controls seasonally as needed to match your lighting requirements.

---

<sup>4</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.

## **Motor Maintenance**

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

## **AC System Evaporator/Condenser Coil Cleaning**

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

## **HVAC Filter Cleaning and Replacement**

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

## **Ductwork Maintenance**

Duct maintenance has two primary goals: keep the ducts clean to avoid air quality problems and seal leaks to save energy. Check for cleanliness, obstructions that block airflow, water damage, and leaks. Ducts should be inspected at least every two years.

The biggest symptoms of clogged air ducts are differing temperatures throughout the building and areas with limited airflow from supply registers. If a particular air duct is clogged, then air flow will only be cut off to some rooms in the building—not all of them. The reduced airflow will make it more difficult for those areas to reach the temperature setpoint, which will cause the HVAC system to run longer to cool or heat that area properly. If you suspect clogged air ducts, ensure that all areas in front of supply registers are clear of items that may block or restrict air flow, and you should check for fire dampers or balancing dampers that have failed closed.

Duct leakage in commercial buildings can account for 5%–25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Check ductwork for leakage. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.

Distribution system losses are dependent on air system temperature, the size of the distribution system, and the level of insulation of the ductwork. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is missing or worn, the system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

### **Steam Trap Repair and Replacement**

Steam traps are a crucial part of delivering heat from the boiler to the space heating units. Steam traps are automatic valves that remove condensate from the system. If the traps fail closed, condensate can build up in the steam supply side of the trap, which reduces the flow in the steam lines and thermal capacity of the radiators. Or they may fail open, allowing steam into the condensate return lines resulting in wasted energy, water, and hammering. Losses can be significantly reduced by testing and replacing equipment as they start to fail. Repair or replace traps that are blocked or allowing steam to pass. Inspect steam traps as part of a regular steam system maintenance plan.

### **Furnace Maintenance**

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.

### **Label HVAC Equipment**

For improved coordination in maintenance practices, we recommend labeling or re-labeling the site HVAC equipment. Maintain continuity in labeling by following labeling conventions as indicated in the facility drawings or BAS building equipment list. Use weatherproof or heatproof labeling or stickers for permanence, but do not cover over original equipment nameplates, which should be kept clean and readable whenever possible. Besides equipment, label piping for service and direction of flow when possible. Ideally, maintain a log of HVAC equipment, including nameplate information, asset tag designation, areas served, installation year, service dates, and other pertinent information.

This investment in your equipment will enhance collaboration and communication between your staff and your contracted service providers and may help you with regulatory compliance.

### **Optimize HVAC Equipment Schedules**

Energy management systems (BAS) typically provide advanced controls for building HVAC systems, including chillers, boilers, air handling units, rooftop units and exhaust fans. The BAS monitors and reports operational status, schedules equipment start and stop times, locks out equipment operation based on outside air or space temperature, and often optimizes damper and valve operation based on complex algorithms. These BAS features, when in proper adjustment, can improve comfort for building occupants and save substantial energy.

Know your BAS scheduling capabilities. Regularly monitor HVAC equipment operating schedules and match them to building operating hours in order to eliminate unnecessary equipment operation and save energy. Monitoring should be performed often at sites with frequently changing usage patterns – daily in some cases. We recommend using the *optimal start* feature of the BAS (if available) to optimize the building warmup sequence. Most BAS scheduling programs provide for holiday schedules, which can be used during reduced use or shutdown periods. Finally, many systems are equipped with a one-time override function, which can be used to provide additional space conditioning due to a one-time, special event. When available this override feature should be used rather than changing the base operating schedule.

## **Water Heater Maintenance**

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

## **Refrigeration Equipment Maintenance**

Preventative maintenance keeps commercial refrigeration equipment running reliably and efficiently. Commercial refrigerators and freezers are mission-critical equipment that can cost a fortune when they go down. Even when they appear to be working properly, refrigeration units can be consuming too much energy. Have walk-in refrigeration and freezer and other commercial systems serviced at least annually. This practice will allow systems to perform to their highest capabilities and will help identify system issues if they exist.

Maintaining your commercial refrigeration equipment can save between five and ten percent on energy costs. When condenser coils are dirty, your commercial refrigerators and freezers work harder to maintain the temperature inside. Worn gaskets, hinges, door handles or faulty seals cause cold air to leak from the unit, forcing the unit to run longer and use more electricity.

Regular cleaning and maintenance also help your commercial refrigeration equipment to last longer.

## **Water Conservation**



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense® ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense website<sup>5</sup> or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"<sup>6</sup> to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

### **Procurement Strategies**

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR or WaterSense products where available.

---

<sup>5</sup> <https://www.epa.gov/watersense>.

<sup>6</sup> <https://www.epa.gov/watersense/watersense-work-0>.

## 6 ON-SITE GENERATION

---

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.



## 6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has no potential for installing a PV array.

This facility does not appear to meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as sufficient and sustained electric demand and sufficient flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

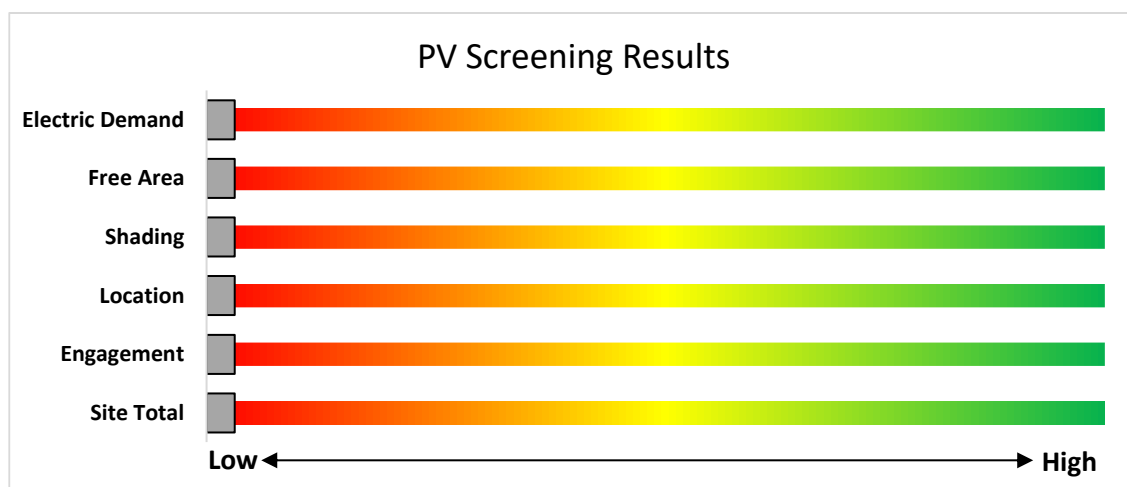


Figure 8 - Photovoltaic Screening

### **Successor Solar Incentive Program (SuSI)**

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners *must* register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

**Successor Solar Incentive Program (SuSI):** <https://www.njcleanenergy.com/renewable-energy/programs/susi-program>

- **Basic Info on Solar PV in NJ:** [www.njcleanenergy.com/whysolar](http://www.njcleanenergy.com/whysolar)
- **NJ Solar Market FAQs:** [www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs](http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs).
- **Approved Solar Installers in the NJ Market:** [www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/?id=60&start=1](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1)

## 6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

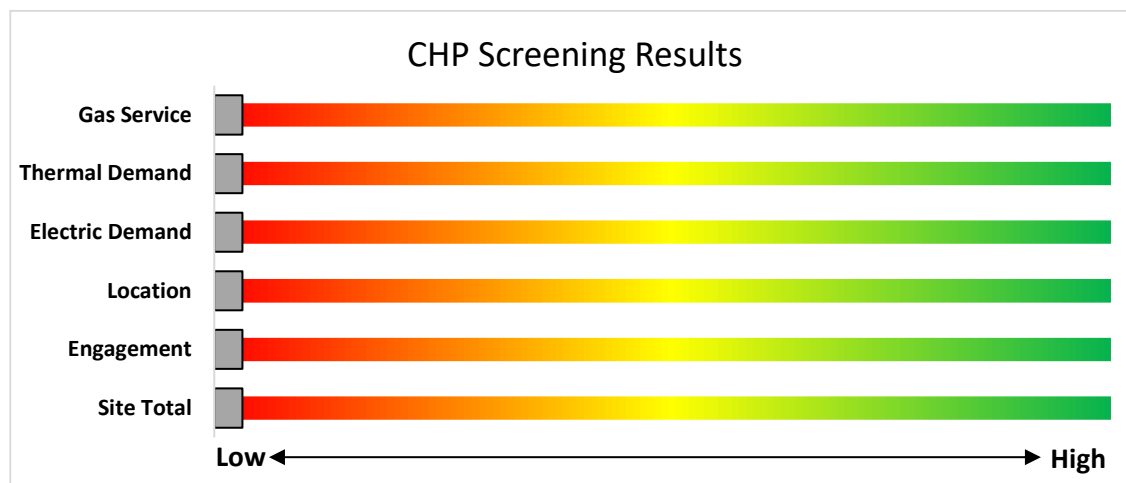


Figure 9 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation:  
[http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/)

## 7 ELECTRIC VEHICLES (EV)

All electric vehicles (EVs) have an electric motor instead of an internal combustion engine. EVs function by plugging into a charge point, taking electricity from the grid, and then storing it in rechargeable batteries. Although electricity production may contribute to air pollution, the U.S. EPA categorizes all-electric vehicles as zero-emission vehicles because they produce no direct exhaust or tailpipe emissions.

EVs are typically more expensive than similar conventional and hybrid vehicles, although some cost can be recovered through fuel savings, federal tax credit, or state incentives.

### 7.1 Electric Vehicle Charging

EV charging stations provide a means for electric vehicle operators to recharge their batteries at a facility. While many EV drivers charge at home, others do not have access to regular home charging, and the ability to charge at work or in public locations is critical to making EVs practical for more drivers. Charging can also be used for electric fleet vehicles, which can reduce fuel and maintenance costs for fleets that replace gas or diesel vehicles with EVs.

EV charging comes in three main types. For this assessment, the screening considers addition of Level 2 charging, which is most common at workplaces and other public locations. Depending on the site type and usage, other levels of charging power may be more appropriate.

The preliminary assessment of EV charging at the facility shows that there is no potential for adding EV chargers to the facility's parking, based on potential costs of installation and other site factors.

The primary costs associated with installing EV charging are the charger hardware and the cost to extend power from the facility to parking spaces. This may include upgrades to electric panels to serve increased loads.

The type and size of the parking area impact the costs and feasibility of adding EV charging. Parking structure installations can be less costly than surface lot installations as power may be readily available, and equipment and wiring can be surface mounted. Parking lot installations often require trenching through concrete or asphalt surface. Large parking areas provide greater flexibility in charger siting than smaller lots.

The location and capacity of facility electric panels also impact charger installation costs. A Level 2 charger generally requires a dedicated 208-240V, 40 Amp circuit. The electric panel nearest the planned installation may not have available capacity and may need to be upgraded to serve new EV charging loads. Alternatively, chargers could be powered from a more distant panel. The distance from the panel to the location of charging stations ties directly to costs, as conduits, cables, and potential trenching costs all increase on a per-foot basis. The more charging stations planned, the more likely it is that additional electrical capacity will be needed.

Other factors to consider when planning for EV charging at a facility include who the intended users are, how long they park vehicles at the site, and whether they will need to pay for the electricity they use.



The graphic below displays the results of the EV charging assessment conducted as part of this audit. The position of each slider indicates the impact each factor has on the feasibility of installing EV charging at the site.

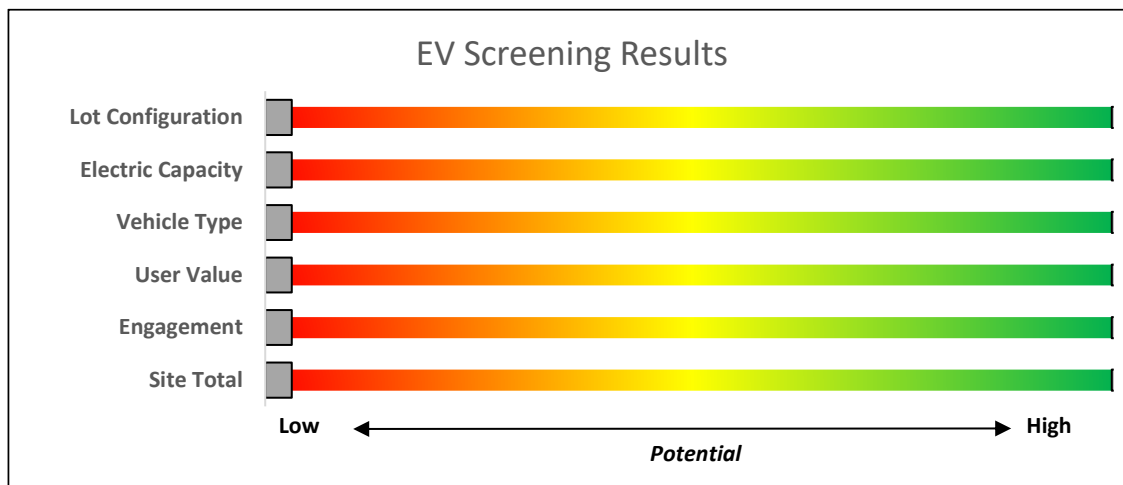


Figure 10 – EV Charger Screening

### Electric Vehicle Programs Available

New Jersey is leading the way on electric vehicle (EV) adoption on the East Coast. There are several programs designed to encourage EV adoption in New Jersey, which is crucial to reaching a 100% clean energy future.

NJCEP offers a variety of EV programs for vehicles, charging stations, and fleets. Certain EV charging stations that receive electric utility service from Atlantic City Electric Company (ACE) or Public Service Electric & Gas Company (PSE&G), may be eligible for additional electric vehicle charging incentives directly from the utility. Projects may be eligible for both the incentives offered by this BPU program and incentives offered by ACE or PSE&G, up to 90% of the combined charger purchase and installation costs. Please check ACE or PSE&G program eligibility requirements before purchasing EV charging equipment, as additional conditions on types of eligible chargers may apply for utility incentives.

Both Jersey Central Power & Light (JCP&L) and Rockland Electric (RECO) have filed proposals for EV charging programs. BPU staff is currently reviewing those proposals.

For more information and to keep up to date on all EV programs please visit <https://www.njcleanenergy.com/commercial-industrial/programs/electric-vehicle-programs>

## 8 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs and Utility Energy Efficiency Programs can help. Pick the program that works best for you. This section provides an overview of currently available incentive programs in.



---

**Program areas to be served by the Utilities:**

- Existing Buildings (residential, commercial, industrial, government)
- Efficient Products
  - HVAC
  - Appliance Rebates
  - Appliance Recycling

**Proposed New Programs & Features:**

- Dedicated multi-family program
- More financing options
- Quick home energy check-ups



---

**Program areas staying with NJCEP:**

- New Construction (residential, commercial, industrial, government)
- Large Energy Users
- Combined Heat & Power & Fuel Cells
- State Facilities
- Local Government Energy Audits
- Energy Savings Improvement Program
- Solar & Community Solar



## 8.1 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey's investor-owned gas and electric utilities to reduce their customers' use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

### **Prescriptive and Custom**

The Prescriptive and Custom rebate program through your utility provider offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

#### **Equipment Examples**

*Lighting*

*Lighting Controls*

*HVAC Equipment*

*Refrigeration*

*Gas Heating*

*Gas Cooling*

*Commercial Kitchen Equipment*

*Food Service Equipment*

*Variable Frequency Drives*

*Electronically Commutate Motors*

*Variable Frequency Drives*

*Plug Loads Controls*

*Washers and Dryers*

*Agricultural*

*Water Heating*

The Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type. The Custom program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives.

### **Direct Install**

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW or less over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls

#### **Incentives**

The program pays up to 70% of the total installed cost of eligible measures.

#### **How to Participate**

To participate in Direct Install, you will work with a participating contractor. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the Direct Install program, subject to program rules and eligibility, while the remaining percent of the cost is paid to the contractor by the customer.

## **Engineered Solutions**

The Engineered Solutions Program provides tailored energy-efficiency assistance and services to municipalities, universities, schools, hospitals and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. Customers receive expert guided services, including investment-grade energy auditing, engineering design, installation assistance, construction administration, commissioning, and measurement and verification (M&V) services to support the implementation of cost-effective and comprehensive efficiency projects. Engineered Solutions is generally a good option for medium to large sized facilities with a peak demand over 200 kW looking to implement as many measures as possible under a single project to achieve deep energy savings. Engineered Solutions has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Incentives for this program are based on project scope and energy savings achieved.

---

For more information on any of these programs, contact your local utility provider or visit <https://www.njcleanenergy.com/transition>.

## 8.2 New Jersey's Clean Energy Programs

Save money while saving the planet! New Jersey's Clean Energy Program is a statewide program that offers incentives, programs, and services that benefit New Jersey residents, businesses, educational, non-profit, and government entities to help them save energy, money, and the environment.

### **Large Energy Users**

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers that annually contribute at least \$200,000 to the NJCEP aggregate of all buildings/sites. This equates to roughly \$5 million in energy costs in the prior fiscal year.

#### **Incentives**

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually

#### **How to Participate**

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEEP). Once the FEEP is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at [www.njcleanenergy.com/LEUP](http://www.njcleanenergy.com/LEUP).

## Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

### Incentives

Eligible Technologies	Size (Installed Rated Capacity) <sup>1</sup>	Incentive (\$/kW)	% of Total Cost Cap per Project <sup>3</sup>	\$ Cap per Project <sup>3</sup>		
Powered by non-renewable or renewable fuel source <sup>4</sup>	≤500 kW	\$2,000	30-40% <sup>2</sup>	\$2 million		
Gas Internal Combustion Engine	>500 kW - 1 MW	\$1,000				
Gas Combustion Turbine	> 1 MW - 3 MW	\$550	30%	\$3 million		
Microturbine	>3 MW	\$350				
Fuel Cells with Heat Recovery						
Waste Heat to Power*	<1 MW	\$1,000	30%	\$2 million		
	> 1MW	\$500		\$3 million		

\*Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

### How to Participate

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at [www.njcleanenergy.com/CHP](http://www.njcleanenergy.com/CHP).

## Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two sub-programs. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

### **Administratively Determined Incentive (ADI) Program**

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

Market Segments	Size MW dc	Incentive Value (\$/SREC II)	Public Entities Incentive Value - \$20 Adder (\$/SRECII)
Net Metered Residential	All types and sizes	\$90	N/A
Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects smaller than 1 MW	\$100	\$120
Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects 1 MW to 5 MW	\$90	\$110
Small Net Metered Non-Residential Ground Mount	Projects smaller than 1 MW	\$85	\$105
Large Net Metered Non-Residential Ground Mount	Projects 1 MW to 5 MW	\$80	\$100
LMI Community Solar	Up to 5 MW	\$90	N/A
Non-LMI Community Solar	Up to 5 MW	\$70	N/A
Interim Subsection (t)	All types and sizes	\$100	N/A

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations.

### **Competitive Solar Incentive Program**

The Competitive Solar Incentive (CSI) Program will provide competitively set incentives for grid supply projects and net metered non-residential projects greater than 5MW (dc). The program is currently under development. For updates, please continue to check the [Solar Proceedings](#) page on the New Jersey's Clean Energy Program website.

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state's Energy Master Plan.

If you are considering installing solar photovoltaics on your building, visit the following link for more information: <https://njcleanenergy.com/renewable-energy/programs/susi-program>.

## **Energy Savings Improvement Program**

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter into contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

### **How to Participate**

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.


The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at [www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

*ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.*



## 9 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

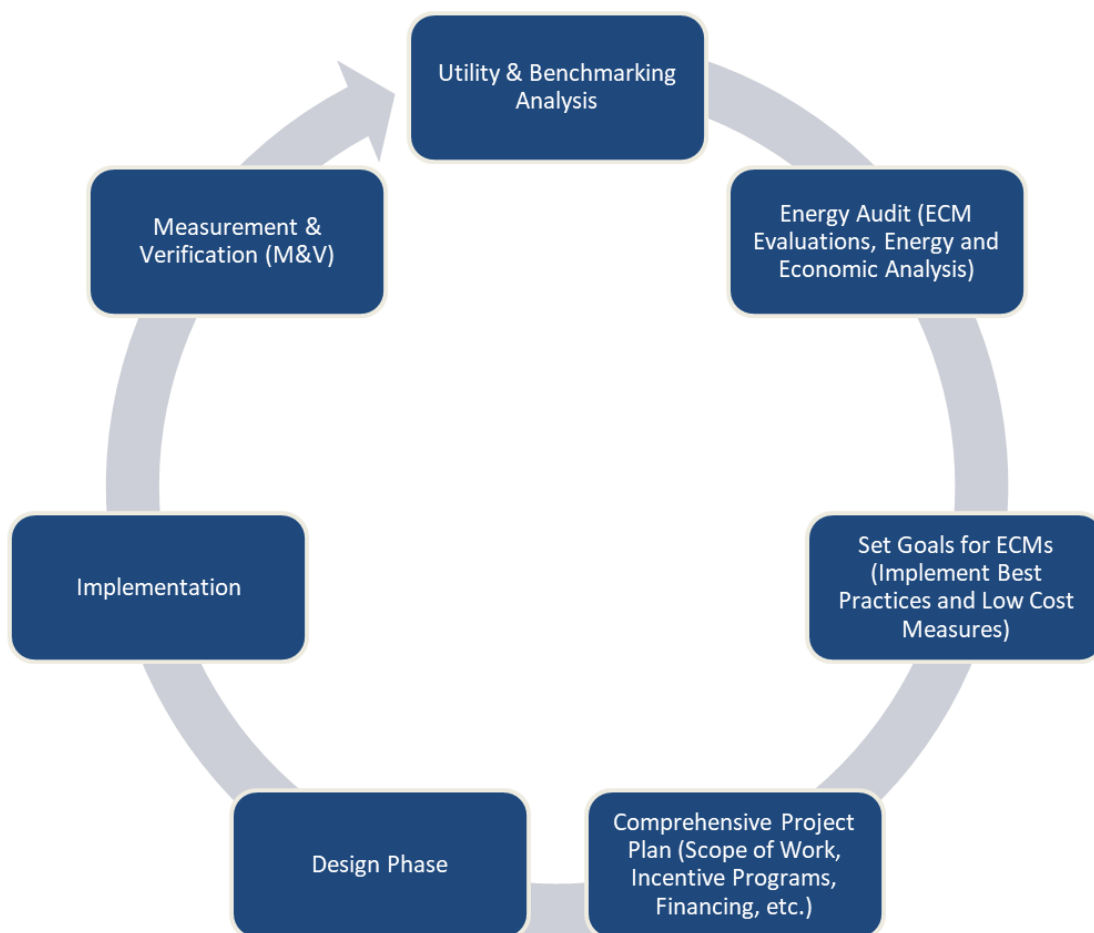

*Figure 11 – Project Development Cycle*

## 10 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 10.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website<sup>7</sup>.

### 10.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website<sup>8</sup>.

---

<sup>7</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

<sup>8</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).



APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Classroom G123	15	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	15	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,353	0	\$178	\$856	\$150	4.0
Academic Wing G - Classroom G123	7	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	7	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	631	0	\$83	\$399	\$70	4.0
Academic Wing G - Classroom G124	20	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	20	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.1	421	0	\$55	\$250	\$20	4.2
Academic Wing G - Classroom G124	10	LED - Fixtures: Flood Fixture	Occupancy Sensor	S	30	2,732		None	No	10	LED - Fixtures: Flood Fixture	Occupancy Sensor	30	2,732	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Classroom G124	12	LED - Fixtures: Flood Fixture	Wall Switch	S	30	3,960	3	None	Yes	12	LED - Fixtures: Flood Fixture	Occupancy Sensor	30	2,732	0.1	486	0	\$64	\$270	\$35	3.7
Academic Wing G - Classroom G126	6	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	6	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.0	126	0	\$17	\$75	\$6	4.2
Academic Wing G - Classroom G126	4	Linear Fluorescent - T5: 3' T5 (21W) - 3L	Occupancy Sensor	S	75	2,732	2	Relamp	No	4	LED - Linear Tubes: (3) 3' T5 (12W) Lamp	Occupancy Sensor	36	2,732	0.1	469	0	\$62	\$219	\$0	3.6
Academic Wing G - Classroom G126	8	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	8	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	721	0	\$95	\$457	\$80	4.0
Academic Wing G - Classroom G127	12	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	12	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.1	252	0	\$33	\$150	\$12	4.2
Academic Wing G - Classroom G127	5	LED - Fixtures: Flood Fixture	Occupancy Sensor	S	30	2,732		None	No	5	LED - Fixtures: Flood Fixture	Occupancy Sensor	30	2,732	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Classroom G127	12	LED - Fixtures: Flood Fixture	Wall Switch	S	30	3,960	3	None	Yes	12	LED - Fixtures: Flood Fixture	Occupancy Sensor	30	2,732	0.1	486	0	\$64	\$270	\$35	3.7
Academic Wing G - Classroom G130	3	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	3	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.0	63	0	\$8	\$38	\$3	4.2
Academic Wing G - Classroom G130	7	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	7	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	316	0	\$41	\$230	\$35	4.7
Academic Wing G - Classroom G130	16	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	16	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,443	0	\$190	\$913	\$160	4.0
Academic Wing G - Classroom G132	10	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	10	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	451	0	\$59	\$328	\$50	4.7
Academic Wing G - Classroom G132	15	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	15	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,353	0	\$178	\$856	\$150	4.0
Academic Wing G - Classroom G132	6	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	6	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	541	0	\$71	\$342	\$60	4.0
Academic Wing G - Classroom G133	20	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	20	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.1	421	0	\$55	\$250	\$20	4.2
Academic Wing G - Classroom G133	10	LED - Fixtures: Flood Fixture	Occupancy Sensor	S	30	2,732		None	No	10	LED - Fixtures: Flood Fixture	Occupancy Sensor	30	2,732	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Classroom G133	12	LED - Fixtures: Flood Fixture	Wall Switch	S	30	3,960	3	None	Yes	12	LED - Fixtures: Flood Fixture	Occupancy Sensor	30	2,732	0.1	486	0	\$64	\$270	\$35	3.7
Academic Wing G - Classroom G134	6	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	6	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.0	126	0	\$17	\$75	\$6	4.2
Academic Wing G - Classroom G134	4	Linear Fluorescent - T5: 3' T5 (21W) - 3L	Occupancy Sensor	S	75	2,732	2	Relamp	No	4	LED - Linear Tubes: (3) 3' T5 (12W) Lamp	Occupancy Sensor	36	2,732	0.1	469	0	\$62	\$219	\$0	3.6
Academic Wing G - Classroom G134	8	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	8	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	721	0	\$95	\$457	\$80	4.0
Academic Wing G - Classroom G135	10	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	10	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	451	0	\$59	\$328	\$50	4.7
Academic Wing G - Classroom G135	15	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	15	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,353	0	\$178	\$856	\$150	4.0

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Classroom G135	6	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	6	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	541	0	\$71	\$342	\$60	4.0
Academic Wing G - Corridor 4	5	Compact Fluorescent: (1) 13W Biaxial Plug-In Lamp	Occupancy Sensor	S	13	4,380	2	Relamp	No	5	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	10	4,380	0.0	72	0	\$9	\$63	\$5	6.1
Academic Wing G - Corridor 4	4	Compact Fluorescent: (1) 13W Biaxial Plug-In Lamp	Wall Switch	S	13	4,380	2, 4	Relamp	Yes	4	LED Lamps: GX23 (Plug-In) Lamps	High/Low Control	10	3,022	0.0	118	0	\$15	\$275	\$144	8.5
Academic Wing G - Corridor 4	8	Compact Fluorescent: (1) 18W Biaxial Plug-In Lamp	Occupancy Sensor	S	18	4,380	2	Relamp	No	8	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	13	4,380	0.0	193	0	\$25	\$100	\$8	3.6
Academic Wing G - Corridor 4	1	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Occupancy Sensor	S	32	4,380	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	4,380	0.0	43	0	\$6	\$13	\$1	2.0
Academic Wing G - Corridor 4	8	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	8	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Corridor 4	4	LED - Fixtures: Linear Strip	None	S	5	4,380	4	None	Yes	4	LED - Fixtures: Linear Strip	High/Low Control	5	3,022	0.0	30	0	\$4	\$225	\$140	21.7
Academic Wing G - Corridor 4	4	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	4,380	2	Relamp	No	4	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	4,380	0.0	289	0	\$38	\$131	\$20	2.9
Academic Wing G - Electrical Room G122	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Electrical Room G204	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Elevator G111A	1	Linear Fluorescent - T5HO: 4' T5HO (54W) - 2L	Wall Switch	S	117	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5HO (25W) Lamps	Wall Switch	51	3,960	0.0	287	0	\$38	\$57	\$10	1.2
Academic Wing G - Exterior 4	1	LED Lamps: (1) 12W PAR30 Screw-In Lamp	Photocell		12	4,380		None	No	1	LED Lamps: (1) 12W PAR30 Screw-In Lamp	Photocell	12	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Exterior 4	1	Metal Halide: (1) 150W Lamp	Photocell		190	4,380	1	Fixture Replacement	No	1	LED - Fixtures: Landscape/Accent Flood and Spot Luminaires	Photocell	45	4,380	0.0	635	0	\$85	\$164	\$25	1.6
Academic Wing G - Janitorial G104	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Janitorial G119	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Laboratory G112	12	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	12	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,082	0	\$142	\$685	\$120	4.0
Academic Wing G - Laboratory G125	14	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	14	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.1	295	0	\$39	\$175	\$14	4.2
Academic Wing G - Laboratory G125	19	LED - Fixtures: Flood Fixture	Occupancy Sensor	S	30	2,732		None	No	19	LED - Fixtures: Flood Fixture	Occupancy Sensor	30	2,732	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Mechanical 109	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Mechanical 109	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.1	549	0	\$72	\$380	\$65	4.4
Academic Wing G - Mechanical 109	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.1	366	0	\$48	\$189	\$40	3.1
Academic Wing G - Mechanical G107	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Mechanical G107	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.1	732	0	\$96	\$416	\$75	3.5
Academic Wing G - Mechanical G107	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	None	S	62	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.1	366	0	\$48	\$343	\$55	6.0
Academic Wing G - Mechanical G108	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	342	0	\$45	\$230	\$40	4.2

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Office - Enclosed G113	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G114	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G115	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G116	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G117	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G128A	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Enclosed G128B	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Enclosed G128C	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Enclosed G128D	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G128E	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Enclosed G128F	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Enclosed G128G	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G128H	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Enclosed G128I	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Enclosed G128J	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Enclosed G129	4	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	4	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	361	0	\$47	\$228	\$40	4.0
Academic Wing G - Office - Enclosed G131	7	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	7	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	316	0	\$41	\$230	\$35	4.7
Academic Wing G - Office - Enclosed G131	14	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	14	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,262	0	\$166	\$799	\$140	4.0
Academic Wing G - Office - Enclosed G131A	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Open Plan G128	4	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	4	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.0	84	0	\$11	\$50	\$4	4.2
Academic Wing G - Office - Open Plan G128	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Office - Open Plan G128	4	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	4	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	204	0	\$27	\$213	\$24	7.0
Academic Wing G - Restroom - Female 4	2	Compact Fluorescent: (1) 42W Biaxial Plug-In Lamp	Occupancy Sensor	S	42	2,732	2	Relamp	No	2	LED Lamps: PL-L (Biax) Lamps	Occupancy Sensor	30	2,732	0.0	72	0	\$9	\$27	\$2	2.6
Academic Wing G - Restroom - Female 4	1	Linear Fluorescent - T5: 3' T5 (21W) - 1L	Occupancy Sensor	S	27	2,732	2	Relamp	No	1	LED - Linear Tubes: (1) 3' T5 (12W) Lamp	Occupancy Sensor	12	2,732	0.0	45	0	\$6	\$33	\$0	5.5
Academic Wing G - Restroom - Female 4	5	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	5	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	225	0	\$30	\$164	\$25	4.7



	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Restroom - Female 5	2	Compact Fluorescent: (1) 42W Biaxial Plug-In Lamp	Occupancy Sensor	S	42	2,732	2	Relamp	No	2	LED Lamps: PL-L (Biax) Lamps	Occupancy Sensor	30	2,732	0.0	72	0	\$9	\$27	\$2	2.6
Academic Wing G - Restroom - Female 5	1	Linear Fluorescent - T5: 3' T5 (21W) - 1L	Occupancy Sensor	S	27	2,732	2	Relamp	No	1	LED - Linear Tubes: (1) 3' T5 (12W) Lamp	Occupancy Sensor	12	2,732	0.0	45	0	\$6	\$33	\$0	5.5
Academic Wing G - Restroom - Female 5	5	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	5	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	225	0	\$30	\$164	\$25	4.7
Academic Wing G - Restroom - Male 4	2	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	2	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.0	42	0	\$6	\$25	\$2	4.2
Academic Wing G - Restroom - Male 4	7	Linear Fluorescent - T5: 3' T5 (21W) - 1L	Occupancy Sensor	S	27	2,732	2	Relamp	No	7	LED - Linear Tubes: (1) 3' T5 (12W) Lamp	Occupancy Sensor	12	2,732	0.1	316	0	\$41	\$230	\$0	5.5
Academic Wing G - Server Room G122A	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Storage G111B	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Storage G126	3	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	514	0	\$67	\$441	\$30	6.1
Academic Wing G - Workshop G110	14	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	14	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.1	295	0	\$39	\$175	\$14	4.2
Academic Wing G - Classroom G221	16	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	16	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,443	0	\$190	\$913	\$160	4.0
Academic Wing G - Classroom G221	5	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	5	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	451	0	\$59	\$285	\$50	4.0
Academic Wing G - Classroom G238	4	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Occupancy Sensor	S	32	2,732	2	Relamp	No	4	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	2,732	0.0	108	0	\$14	\$50	\$4	3.2
Academic Wing G - Classroom G238	5	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	5	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	225	0	\$30	\$164	\$25	4.7
Academic Wing G - Classroom G238	9	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	9	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	812	0	\$107	\$514	\$90	4.0
Academic Wing G - Classroom G253	15	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Occupancy Sensor	S	32	2,732	2	Relamp	No	15	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	2,732	0.1	406	0	\$53	\$188	\$15	3.2
Academic Wing G - Classroom G253	16	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	16	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,443	0	\$190	\$913	\$160	4.0
Academic Wing G - Classroom G268	3	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	3	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.0	135	0	\$18	\$98	\$15	4.7
Academic Wing G - Classroom G268	12	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	12	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,082	0	\$142	\$685	\$120	4.0
Academic Wing G - Classroom G268	12	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	12	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,082	0	\$142	\$685	\$120	4.0
Academic Wing G - Corridor 3	9	Compact Fluorescent: (1) 13W Biaxial Plug-In Lamp	Wall Switch	S	13	4,380	2, 4	Relamp	Yes	9	LED Lamps: GX23 (Plug-In) Lamps	High/Low Control	10	3,022	0.0	265	0	\$35	\$563	\$324	6.9
Academic Wing G - Corridor 3	8	Compact Fluorescent: (1) 13W Biaxial Plug-In Lamp	Occupancy Sensor	S	13	4,380	2	Relamp	No	8	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	10	4,380	0.0	116	0	\$15	\$100	\$8	6.1
Academic Wing G - Corridor 3	8	Compact Fluorescent: (1) 18W Biaxial Plug-In Lamp	Occupancy Sensor	S	18	4,380	2	Relamp	No	8	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	13	4,380	0.0	193	0	\$25	\$100	\$8	3.6
Academic Wing G - Corridor 3	2	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Occupancy Sensor	S	32	4,380	2	Relamp	No	2	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	4,380	0.0	87	0	\$11	\$25	\$2	2.0
Academic Wing G - Corridor 3	14	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	14	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Corridor 3	4	LED - Fixtures: Linear Strip	None	S	5	4,380	4	None	Yes	4	LED - Fixtures: Linear Strip	High/Low Control	5	3,022	0.0	30	0	\$4	\$225	\$140	21.7



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Corridor 3	7	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	4,380	2	Relamp	No	7	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	4,380	0.1	506	0	\$66	\$230	\$35	2.9
Academic Wing G - Electrical Room G234	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Janitorial G230	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	342	0	\$45	\$230	\$40	4.2
Academic Wing G - Office - Enclosed G201	3	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	3	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	153	0	\$20	\$160	\$18	7.0
Academic Wing G - Office - Enclosed G201A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G201B	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G202	3	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	3	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	153	0	\$20	\$160	\$18	7.0
Academic Wing G - Office - Enclosed G202A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G202B	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G203	3	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	3	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	153	0	\$20	\$160	\$18	7.0
Academic Wing G - Office - Enclosed G203A	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G203B	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G205	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G206	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G207	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G208	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G209	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G210	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G211	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G212	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G213	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G214	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G215	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G216	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G217	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Office - Enclosed G218	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G219	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G220	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.1	595	0	\$78	\$219	\$60	2.0
Academic Wing G - Office - Enclosed G222	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G222A	8	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	8	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	1,370	0	\$180	\$727	\$115	3.4
Academic Wing G - Office - Enclosed G222B	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G222C	3	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2, 3	Relamp	Yes	3	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.0	257	0	\$34	\$98	\$15	2.5
Academic Wing G - Office - Enclosed G222C	6	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	6	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	1,027	0	\$135	\$612	\$95	3.8
Academic Wing G - Office - Enclosed G223	3	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	514	0	\$67	\$441	\$65	5.6
Academic Wing G - Office - Enclosed G224	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	342	0	\$45	\$230	\$40	4.2
Academic Wing G - Office - Enclosed G225	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G226	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G227	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G228	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G235	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Office - Enclosed G236	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Office - Enclosed G239	3	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Occupancy Sensor	S	32	2,732	2	Relamp	No	3	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	2,732	0.0	81	0	\$11	\$38	\$3	3.2
Academic Wing G - Office - Enclosed G239	9	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	9	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	812	0	\$107	\$514	\$90	4.0
Academic Wing G - Office - Enclosed G239A	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	102	0	\$13	\$107	\$12	7.0
Academic Wing G - Office - Enclosed G239B	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	102	0	\$13	\$107	\$12	7.0
Academic Wing G - Office - Enclosed G240	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G241	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G242	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G243	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G245	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Office - Enclosed G246	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G247	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G248	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G250A	8	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Wall Switch	S	32	3,960	2, 3	Relamp	Yes	8	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	2,732	0.1	562	0	\$74	\$370	\$43	4.4
Academic Wing G - Office - Enclosed G250B	8	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Wall Switch	S	32	3,960	2, 3	Relamp	Yes	8	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	2,732	0.1	562	0	\$74	\$370	\$43	4.4
Academic Wing G - Office - Enclosed G250C	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	342	0	\$45	\$230	\$40	4.2
Academic Wing G - Office - Enclosed G251	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G252	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Enclosed G253A	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G253B	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G253C	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G253D	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G253E	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G253H	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G253I	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G253J	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G253K	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G253L	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	3,960	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Wall Switch	15	3,960	0.0	65	0	\$9	\$33	\$5	3.2
Academic Wing G - Office - Enclosed G254	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G255	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Office - Enclosed G256	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G257	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G259	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G260	4	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	4	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	361	0	\$47	\$228	\$40	4.0
Academic Wing G - Office - Enclosed G261	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Office - Enclosed G262	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G264	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G265	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G266C	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	102	0	\$13	\$107	\$12	7.0
Academic Wing G - Office - Enclosed G266D	4	LED Lamps: (1) 12W PAR30 Screw-In Lamp	Wall Switch	S	12	3,960	3	None	Yes	4	LED Lamps: (1) 12W PAR30 Screw-In Lamp	Occupancy Sensor	12	2,732	0.0	65	0	\$9	\$116	\$20	11.3
Academic Wing G - Office - Enclosed G266E	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	102	0	\$13	\$107	\$12	7.0
Academic Wing G - Office - Enclosed G266P	4	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	4	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	361	0	\$47	\$228	\$40	4.0
Academic Wing G - Office - Enclosed G267	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G269	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G270	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G271	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G271	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G272	8	Linear Fluorescent - T5: 1' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732		None	No	8	Linear Fluorescent - T5: 1' T5 (14W) - 2L	Occupancy Sensor	34	2,732	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Office - Enclosed G272B	2	Linear Fluorescent - T5: 1' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732		None	No	2	Linear Fluorescent - T5: 1' T5 (14W) - 2L	Occupancy Sensor	34	2,732	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Office - Enclosed G272C	2	Linear Fluorescent - T5: 1' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732		None	No	2	Linear Fluorescent - T5: 1' T5 (14W) - 2L	Occupancy Sensor	34	2,732	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Office - Enclosed G273	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G274	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G275	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Office - Open Plan G250	6	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	6	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	1,027	0	\$135	\$612	\$95	3.8
Academic Wing G - Office - Open Plan G266	3	Compact Fluorescent: (1) 32W Bi axial Plug-In Lamp	Occupancy Sensor	S	32	2,732	2	Relamp	No	3	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	2,732	0.0	81	0	\$11	\$38	\$3	3.2
Academic Wing G - Office - Open Plan G266	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Office - Open Plan G266	8	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	8	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.1	409	0	\$54	\$426	\$48	7.0
Academic Wing G - Restroom - Female 3	2	Compact Fluorescent: (1) 42W Bi axial Plug-In Lamp	Occupancy Sensor	S	42	2,732	2	Relamp	No	2	LED Lamps: PL-L (Bi ax) Lamps	Occupancy Sensor	30	2,732	0.0	72	0	\$9	\$27	\$2	2.6
Academic Wing G - Restroom - Female 3	1	Linear Fluorescent - T5: 3' T5 (21W) - 1L	Occupancy Sensor	S	27	2,732	2	Relamp	No	1	LED - Linear Tubes: (1) 3' T5 (12W) Lamp	Occupancy Sensor	12	2,732	0.0	45	0	\$6	\$33	\$0	5.5
Academic Wing G - Restroom - Female 3	5	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	5	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	225	0	\$30	\$164	\$25	4.7



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Restroom - Male 3	2	Compact Fluorescent: (1) 26W Biacial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	2	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.0	42	0	\$6	\$25	\$2	4.2
Academic Wing G - Restroom - Male 3	7	Linear Fluorescent - T5: 3' T5 (21W) - 1L	Occupancy Sensor	S	27	2,732	2	Relamp	No	7	LED - Linear Tubes: (1) 3' T5 (12W) Lamp	Occupancy Sensor	12	2,732	0.1	316	0	\$41	\$230	\$0	5.5
Academic Wing G - Server Room G234A	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Storage G222D	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Storage G231	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.1	298	0	\$39	\$110	\$30	2.0
Academic Wing G - Storage G253F	1	Compact Fluorescent: (1) 32W Biacial Plug-In Lamp	Wall Switch	S	32	3,960	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Wall Switch	23	3,960	0.0	39	0	\$5	\$13	\$1	2.2
Academic Wing G - Storage G253G	1	Compact Fluorescent: (1) 32W Biacial Plug-In Lamp	Wall Switch	S	32	3,960	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Wall Switch	23	3,960	0.0	39	0	\$5	\$13	\$1	2.2
Academic Wing G - Storage G258	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	198	0	\$26	\$73	\$20	2.0
Academic Wing G - Storage G268A	1	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	51	0	\$7	\$53	\$6	7.0
Academic Wing G - Computer Lab G301	4	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	4	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.0	180	0	\$24	\$131	\$20	4.7
Academic Wing G - Computer Lab G301	15	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	15	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,353	0	\$178	\$856	\$150	4.0
Academic Wing G - Corridor 2	4	Compact Fluorescent: (1) 13W Biacial Plug-In Lamp	Occupancy Sensor	S	13	4,380	2	Relamp	No	4	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	10	4,380	0.0	58	0	\$8	\$50	\$4	6.1
Academic Wing G - Corridor 2	3	Compact Fluorescent: (1) 18W Biacial Plug-In Lamp	Occupancy Sensor	S	18	4,380	2	Relamp	No	3	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	13	4,380	0.0	72	0	\$9	\$38	\$3	3.6
Academic Wing G - Corridor 2	1	Compact Fluorescent: (1) 32W Biacial Plug-In Lamp	Occupancy Sensor	S	32	4,380	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	4,380	0.0	43	0	\$6	\$13	\$1	2.0
Academic Wing G - Corridor 2	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Corridor 2	4	LED - Fixtures: Linear Strip	None	S	5	4,380	4	None	Yes	4	LED - Fixtures: Linear Strip	High/Low Control	5	3,022	0.0	30	0	\$4	\$0	\$0	0.0
Academic Wing G - Corridor 2	4	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	4,380	2	Relamp	No	4	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	4,380	0.0	289	0	\$38	\$131	\$20	2.9
Academic Wing G - Electrical Room G105	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Electrical Room G105	9	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	9	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,541	0	\$202	\$784	\$125	3.3
Academic Wing G - Electrical Room G106	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,960	0.0	144	0	\$19	\$37	\$10	1.4
Academic Wing G - Electrical Room G321	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Janitorial G318	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Laboratory 324	1	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	1	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.0	45	0	\$6	\$33	\$5	4.7
Academic Wing G - Laboratory 324	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Laboratory 324	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,960	0.0	70	0	\$9	\$33	\$6	2.9

Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Laboratory G303	6	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	6	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	271	0	\$36	\$197	\$30	4.7
Academic Wing G - Laboratory G303	12	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	12	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,082	0	\$142	\$685	\$120	4.0
Academic Wing G - Laboratory G303	4	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	685	0	\$90	\$498	\$75	4.7
Academic Wing G - Laboratory G311	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,960	0.0	70	0	\$9	\$33	\$6	2.9
Academic Wing G - Laboratory G311	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,960	0.0	70	0	\$9	\$33	\$6	2.9
Academic Wing G - Laboratory G311	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,960	0.0	70	0	\$9	\$33	\$6	2.9
Academic Wing G - Laboratory G311	17	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	17	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.4	1,686	0	\$222	\$621	\$170	2.0
Academic Wing G - Laboratory G322	15	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	15	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.2	676	0	\$89	\$492	\$75	4.7
Academic Wing G - Laboratory G322	15	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	15	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,353	0	\$178	\$856	\$150	4.0
Academic Wing G - Laboratory G322	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,732	0.0	185	0	\$24	\$181	\$32	6.1
Academic Wing G - Laboratory G323	10	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	10	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	451	0	\$59	\$328	\$50	4.7
Academic Wing G - Laboratory G323	15	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	15	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,353	0	\$178	\$856	\$150	4.0
Academic Wing G - Laboratory G323	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,960	0.0	70	0	\$9	\$33	\$6	2.9
Academic Wing G - Laboratory G329	6	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	6	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	271	0	\$36	\$197	\$30	4.7
Academic Wing G - Laboratory G329	18	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	18	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.4	1,623	0	\$213	\$1,027	\$180	4.0
Academic Wing G - Laboratory G329	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,732	0.0	185	0	\$24	\$181	\$32	6.1
Academic Wing G - Laboratory G329	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,960	0.0	144	0	\$19	\$37	\$10	1.4
Academic Wing G - Laboratory G332	1	Compact Fluorescent: (1) 42W Bi axial Plug-In Lamp	Occupancy Sensor	S	42	2,732	2	Relamp	No	1	LED Lamps: PL-L (Bi ax) Lamps	Occupancy Sensor	30	2,732	0.0	36	0	\$5	\$14	\$1	2.6
Academic Wing G - Laboratory G332	7	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	7	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	316	0	\$41	\$230	\$35	4.7
Academic Wing G - Laboratory G332	15	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	15	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,353	0	\$178	\$856	\$150	4.0
Academic Wing G - Laboratory G332	7	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2, 3	Relamp	Yes	7	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,732	0.1	649	0	\$85	\$498	\$77	4.9
Academic Wing G - Laboratory G333	1	Compact Fluorescent: (1) 42W Bi axial Plug-In Lamp	Occupancy Sensor	S	42	2,732	2	Relamp	No	1	LED Lamps: PL-L (Bi ax) Lamps	Occupancy Sensor	30	2,732	0.0	36	0	\$5	\$14	\$1	2.6
Academic Wing G - Laboratory G333	13	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	13	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	586	0	\$77	\$427	\$65	4.7
Academic Wing G - Laboratory G333	15	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	15	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,353	0	\$178	\$856	\$150	4.0
Academic Wing G - Laboratory G333	9	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2, 3	Relamp	Yes	9	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,732	0.1	834	0	\$110	\$563	\$89	4.3



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Laboratory G334	10	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	10	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	451	0	\$59	\$328	\$50	4.7
Academic Wing G - Laboratory G334	15	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	15	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,353	0	\$178	\$856	\$150	4.0
Academic Wing G - Office - Enclosed G304	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G305	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G306	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G307	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G308	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G309	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G310	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G312	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G313	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G314	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G315	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G316	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G325	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G326	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G327	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G335	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Restroom - Female 2	2	Compact Fluorescent: (1) 42W Bi axial Plug-In Lamp	Occupancy Sensor	S	42	2,732	2	Relamp	No	2	LED Lamps: PL-L (Bi ax) Lamps	Occupancy Sensor	30	2,732	0.0	72	0	\$9	\$27	\$2	2.6
Academic Wing G - Restroom - Female 2	1	Linear Fluorescent - T5: 3' T5 (21W) - 1L	Occupancy Sensor	S	27	2,732	2	Relamp	No	1	LED - Linear Tubes: (1) 3' T5 (12W) Lamp	Occupancy Sensor	12	2,732	0.0	45	0	\$6	\$33	\$0	5.5
Academic Wing G - Restroom - Female 2	5	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	5	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	225	0	\$30	\$164	\$25	4.7
Academic Wing G - Restroom - Male 2	2	Compact Fluorescent: (1) 26W Bi axial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	2	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.0	42	0	\$6	\$25	\$2	4.2
Academic Wing G - Restroom - Male 2	7	Linear Fluorescent - T5: 3' T5 (21W) - 1L	Occupancy Sensor	S	27	2,732	2	Relamp	No	7	LED - Linear Tubes: (1) 3' T5 (12W) Lamp	Occupancy Sensor	12	2,732	0.1	316	0	\$41	\$230	\$0	5.5
Academic Wing G - Server Room G321A	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Storage G311A	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,960	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	3,960	0.0	244	0	\$32	\$73	\$20	1.7

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Storage G328	6	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	6	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	541	0	\$71	\$342	\$60	4.0
Academic Wing G - Storage G328	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,960	0.0	70	0	\$9	\$33	\$6	2.9
Academic Wing G - Storage G330	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Storage G331	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	3,960	2, 3	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,732	0.1	823	0	\$108	\$434	\$45	3.6
Academic Wing G - Classroom G401	12	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	12	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	541	0	\$71	\$394	\$60	4.7
Academic Wing G - Classroom G401	8	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	8	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	721	0	\$95	\$457	\$80	4.0
Academic Wing G - Classroom G401	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,732	0.0	185	0	\$24	\$181	\$32	6.1
Academic Wing G - Classroom G430	15	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	15	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.2	676	0	\$89	\$492	\$75	4.7
Academic Wing G - Classroom G430	20	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	20	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.4	1,803	0	\$237	\$1,141	\$200	4.0
Academic Wing G - Conference G429	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Corridor 1	5	Compact Fluorescent: (1) 13W Biaxial Plug-In Lamp	Occupancy Sensor	S	13	4,380	2	Relamp	No	5	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	10	4,380	0.0	72	0	\$9	\$63	\$5	6.1
Academic Wing G - Corridor 1	30	Compact Fluorescent: (1) 18W Biaxial Plug-In Lamp	Occupancy Sensor	S	18	4,380	2	Relamp	No	30	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	13	4,380	0.1	723	0	\$95	\$375	\$30	3.6
Academic Wing G - Corridor 1	1	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Occupancy Sensor	S	32	4,380	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	4,380	0.0	43	0	\$6	\$13	\$1	2.0
Academic Wing G - Corridor 1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Corridor 1	4	LED - Fixtures: Linear Strip	None	S	5	4,380	4	None	Yes	4	LED - Fixtures: Linear Strip	High/Low Control	5	3,022	0.0	30	0	\$4	\$225	\$140	21.7
Academic Wing G - Corridor 1	46	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	4,380	2	Relamp	No	46	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	4,380	0.5	3,324	-1	\$437	\$1,509	\$230	2.9
Academic Wing G - Electrical Room G402	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Electrical Room G424	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Janitorial G420	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Laboratory 422	3	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	3	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.0	135	0	\$18	\$98	\$15	4.7
Academic Wing G - Laboratory 422	10	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	10	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	902	0	\$118	\$571	\$100	4.0
Academic Wing G - Laboratory 422	10	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	10	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	902	0	\$118	\$571	\$100	4.0
Academic Wing G - Laboratory 422	6	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2, 3	Relamp	Yes	6	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,732	0.1	556	0	\$73	\$465	\$71	5.4
Academic Wing G - Laboratory 425	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	2,732	2	Relamp	No	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,732	0.2	673	0	\$88	\$292	\$80	2.4
Academic Wing G - Laboratory 425B	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	2,732	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,732	0.0	168	0	\$22	\$73	\$20	2.4

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Laboratory 425C	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Timeclock	S	114	2,464	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Timeclock	58	2,464	0.0	152	0	\$20	\$73	\$20	2.7
Academic Wing G - Laboratory 425D	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Timeclock	S	114	2,464	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Timeclock	58	2,464	0.0	152	0	\$20	\$73	\$20	2.7
Academic Wing G - Laboratory 425E	2	Linear Fluorescent - T5: 2' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 2' T5 (8W) Lamps	Occupancy Sensor	17	2,732	0.0	102	0	\$13	\$107	\$12	7.0
Academic Wing G - Laboratory G403	12	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	12	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	1,082	0	\$142	\$685	\$120	4.0
Academic Wing G - Laboratory G403	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,960	0.0	144	0	\$19	\$37	\$10	1.4
Academic Wing G - Laboratory G411	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	2,732	0.1	243	0	\$32	\$217	\$30	5.9
Academic Wing G - Laboratory G425A	6	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	6	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.0	126	0	\$17	\$75	\$6	4.2
Academic Wing G - Laboratory G426	4	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	4	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.0	180	0	\$24	\$131	\$20	4.7
Academic Wing G - Laboratory G426	21	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	21	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.5	1,894	0	\$249	\$1,198	\$210	4.0
Academic Wing G - Laboratory G426	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,960	0.0	70	0	\$9	\$33	\$6	2.9
Academic Wing G - Laboratory G429C	3	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	3	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	271	0	\$36	\$171	\$30	4.0
Academic Wing G - Laboratory G429C	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,960	0.0	70	0	\$9	\$33	\$6	2.9
Academic Wing G - Laboratory G431A	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	2,732	2	Relamp	No	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,732	0.1	337	0	\$44	\$146	\$40	2.4
Academic Wing G - Laboratory G431B	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	2,732	2	Relamp	No	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,732	0.1	337	0	\$44	\$146	\$40	2.4
Academic Wing G - Laboratory G431C	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	2,732	2	Relamp	No	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,732	0.1	337	0	\$44	\$146	\$40	2.4
Academic Wing G - Laboratory G431D	12	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	12	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.3	2,054	0	\$270	\$955	\$155	3.0
Academic Wing G - Laboratory G432	10	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	10	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.2	902	0	\$118	\$571	\$100	4.0
Academic Wing G - Laboratory G432	6	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2, 3	Relamp	Yes	6	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,732	0.1	556	0	\$73	\$465	\$71	5.4
Academic Wing G - Laboratory G432	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,960	0.0	144	0	\$19	\$37	\$10	1.4
Academic Wing G - Laboratory G433	5	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	5	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	451	0	\$59	\$285	\$50	4.0
Academic Wing G - Laboratory G433	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,732	0.0	185	0	\$24	\$181	\$32	6.1
Academic Wing G - Laboratory G434	5	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	5	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	451	0	\$59	\$285	\$50	4.0
Academic Wing G - Laboratory G434	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,960	0.0	70	0	\$9	\$33	\$6	2.9
Academic Wing G - Laboratory G434	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,960	0.0	144	0	\$19	\$37	\$10	1.4
Academic Wing G - Office - Enclosed G403A	10	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Occupancy Sensor	S	32	2,732	2	Relamp	No	10	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	2,732	0.1	271	0	\$36	\$125	\$10	3.2

	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Office - Enclosed G403B	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G403C	4	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	4	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	361	0	\$47	\$228	\$40	4.0
Academic Wing G - Office - Enclosed G404	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G405	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G406	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G407	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G408	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G409	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G410	3	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	3	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	271	0	\$36	\$171	\$30	4.0
Academic Wing G - Office - Enclosed G412	6	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Wall Switch	S	32	3,960	2, 3	Relamp	Yes	6	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	23	2,732	0.1	422	0	\$55	\$345	\$41	5.5
Academic Wing G - Office - Enclosed G415	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G415	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G416	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G418	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G418	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	180	0	\$24	\$114	\$20	4.0
Academic Wing G - Office - Enclosed G427	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G428	18	Compact Fluorescent: (1) 18W Biaxial Plug-In Lamp	Occupancy Sensor	S	18	2,732	2	Relamp	No	18	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	13	2,732	0.1	271	0	\$36	\$225	\$18	5.8
Academic Wing G - Office - Enclosed G429A	6	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	6	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	541	0	\$71	\$342	\$60	4.0
Academic Wing G - Office - Enclosed G429B	6	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	6	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	541	0	\$71	\$342	\$60	4.0
Academic Wing G - Office - Enclosed G429D	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Occupancy Sensor	S	60	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.0	90	0	\$12	\$57	\$10	4.0
Academic Wing G - Office - Enclosed G429D	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,732	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.0	99	0	\$13	\$37	\$10	2.0
Academic Wing G - Office - Enclosed G432	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Occupancy Sensor	S	33	2,732	2	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,732	0.0	96	0	\$13	\$65	\$12	4.2
Academic Wing G - Restroom - Female 1	2	Compact Fluorescent: (1) 42W Biaxial Plug-In Lamp	Occupancy Sensor	S	42	2,732	2	Relamp	No	2	LED Lamps: PL-L (Biax) Lamps	Occupancy Sensor	30	2,732	0.0	72	0	\$9	\$27	\$2	2.6
Academic Wing G - Restroom - Female 1	1	Linear Fluorescent - T5: 3' T5 (21W) - 1L	Occupancy Sensor	S	27	2,732	2	Relamp	No	1	LED - Linear Tubes: (1) 3' T5 (12W) Lamp	Occupancy Sensor	12	2,732	0.0	45	0	\$6	\$33	\$0	5.5
Academic Wing G - Restroom - Female 1	5	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Occupancy Sensor	S	30	2,732	2	Relamp	No	5	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	2,732	0.1	225	0	\$30	\$164	\$25	4.7



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G - Restroom - Male 1	2	Compact Fluorescent: (1) 26W Biacial Plug-In Lamp	Occupancy Sensor	S	26	2,732	2	Relamp	No	2	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,732	0.0	42	0	\$6	\$25	\$2	4.2
Academic Wing G - Restroom - Male 1	7	Linear Fluorescent - T5: 3' T5 (21W) - 1L	Occupancy Sensor	S	27	2,732	2	Relamp	No	7	LED - Linear Tubes: (1) 3' T5 (12W) Lamp	Occupancy Sensor	12	2,732	0.1	316	0	\$41	\$230	\$0	5.5
Academic Wing G - Server Room G424A	1	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2	Relamp	No	1	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Wall Switch	30	3,960	0.0	131	0	\$17	\$57	\$10	2.7
Academic Wing G - Storage G427A	1	Linear Fluorescent - T5: 1' T5 (14W) - 2L	Occupancy Sensor	S	34	2,732		None	No	1	Linear Fluorescent - T5: 1' T5 (14W) - 2L	Occupancy Sensor	34	2,732	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Storage G431F	2	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	3,960	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	2,732	0.1	342	0	\$45	\$230	\$20	4.7
Academic Wing G - Storage ASB020	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2, 3	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.4	2,195	0	\$288	\$708	\$120	2.0
Academic Wing G - Mechanical 1	7	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	7	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Mechanical 1	48	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2, 3	Relamp	Yes	48	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	1.5	8,780	-2	\$1,154	\$2,833	\$620	1.9
Academic Wing G - Mechanical 1	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,960	2, 3	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,732	0.2	1,280	0	\$168	\$526	\$105	2.5
Academic Wing G - Restroom - Unisex 1	1	Linear Fluorescent - T5: 2' T5 (14W) - 3L	Occupancy Sensor	S	42	2,732	2	Relamp	No	1	LED - Linear Tubes: (3) 2' T5 (8W) Lamps	Occupancy Sensor	24	2,732	0.0	54	0	\$7	\$81	\$0	11.4
Academic Wing G - Stairs A	1	Compact Fluorescent: (2) 13W Biacial Plug-In Lamps	None		26	3,960	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	None	19	3,960	0.0	30	0	\$4	\$25	\$2	5.7
Academic Wing G - Stairs A	3	Compact Fluorescent: (1) 42W Biacial Plug-In Lamp	None		42	3,960	2, 4	Relamp	Yes	3	LED Lamps: PL-L (Bi-ax) Lamps	High/Low Control	30	2,732	0.0	278	0	\$37	\$266	\$108	4.3
Academic Wing G - Stairs A	3	Linear Fluorescent - T5: 4' T5 (28W) - 1L	None		30	3,960	2, 4	Relamp	Yes	3	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	High/Low Control	15	2,732	0.0	257	0	\$34	\$323	\$120	6.0
Academic Wing G - Stairs B	1	Compact Fluorescent: (2) 13W Biacial Plug-In Lamps	None		26	3,960	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	None	19	3,960	0.0	30	0	\$4	\$25	\$2	5.7
Academic Wing G - Stairs B	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Stairs B	6	Linear Fluorescent - T5: 4' T5 (28W) - 3L	None		90	3,960	2, 4	Relamp	Yes	6	LED - Linear Tubes: (3) 4' T5 (14.5W) Lamps	High/Low Control	45	2,732	0.3	1,541	0	\$202	\$713	\$300	2.0
Academic Wing G - Stairs C	3	Compact Fluorescent: (1) 13W Biacial Plug-In Lamp	Occupancy Sensor		13	2,732	2	Relamp	No	3	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	10	2,732	0.0	27	0	\$4	\$38	\$3	9.7
Academic Wing G - Stairs C	5	Compact Fluorescent: (2) 13W Biacial Plug-In Lamps	None		26	3,960	2, 4	Relamp	Yes	5	LED Lamps: GX23 (Plug-In) Lamps	High/Low Control	19	2,732	0.0	281	0	\$37	\$350	\$185	4.5
Academic Wing G - Stairs C	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G - Stairs C	8	Linear Fluorescent - T5: 4' T5 (28W) - 3L	None		90	3,960	2, 4	Relamp	Yes	8	LED - Linear Tubes: (3) 4' T5 (14.5W) Lamps	High/Low Control	45	2,732	0.3	2,054	0	\$270	\$876	\$345	2.0
Academic Wing G - Stairs C	2	Linear Fluorescent - T5: 4' T5 (28W) - 4L	Occupancy Sensor		120	2,732	2	Relamp	No	2	LED - Linear Tubes: (4) 4' T5 (14.5W) Lamps	Occupancy Sensor	60	2,732	0.1	361	0	\$47	\$211	\$40	3.6



Motor Inventory & Recommendations

		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	Academic Wing G	1	Return Fan	20.0	93.6%	Yes	Unknown	Unknown	W	5,000		No	93.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Supply Fan	40.0	94.5%	Yes	Baldor	EHM2539T	W	5,000		No	94.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Supply Fan	5.0	89.5%	Yes	Baldor	EHM3218T	W	5,000		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Supply Fan	5.0	89.5%	Yes	Baldor	EHM3218T	W	5,000		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Supply Fan	75.0	95.0%	Yes	Baldor	EHM2551T	W	5,000		No	95.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Supply Fan	50.0	94.5%	Yes	Baldor	EHM2543T	W	5,000		No	94.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Supply Fan	50.0	94.5%	Yes	Baldor	EHM254T	W	5,000		No	94.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Return Fan	25.0	93.6%	Yes	Unknown	Unknown	W	5,000		No	93.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Chilled Water Pump	40.0	94.1%	Yes	Baldor	EM2539T	W	2,034		No	94.1%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Condensate Pump	0.3	72.0%	No	Baldor	KM3457	W	2,745		No	72.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Condensate Pump	5.0	87.5%	No	Baldor	JMM3613T	W	2,745		No	87.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Condensate Pump	3.0	85.5%	No	Baldor	JMM3559T	W	2,745		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Condensate Pump	0.8	74.0%	No	Baldor	VM3541	W	2,745		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Exhaust Fan	0.2	65.0%	No	Unknown	Unknown	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Exhaust Fan	0.5	70.0%	No	Unknown	Unknown	W	2,745		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	3	Exhaust Fan	20.0	93.0%	Yes	Unknown	Unknown	W	3,391		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	3	Exhaust Fan	20.0	93.0%	Yes	Unknown	Unknown	W	3,391		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Exhaust Fan	3.0	89.5%	No	Baldor	Unknown	W	2,745		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Exhaust Fan	0.3	65.0%	No	Greenheck	CK48HB02K01	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Exhaust Fan	1.0	70.0%	No	Unknown	Unknown	W	2,745		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0



		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	Academic Wing G	2	Heating Hot Water Pump	5.0	89.5%	Yes	Baldor	EM3218T	W	2,745		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	3	Heating Hot Water Pump	15.0	93.0%	Yes	Baldor	EM2515T	W	3,391		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Other	60.0	70.0%	No	AC Motors	326EAJ0C010/6333BC32	W	200		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Other	10.0	89.5%	No	Baldor	EM3312T	W	2,190		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Other	0.3	65.0%	No	Marathon	5KH32FN5586MX	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Other	15.0	91.7%	No	Baldor	EM254T	W	1,696		No	91.7%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Other	0.3	65.0%	No	Marathon	5KH32FN5586MX	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	6	Supply Fan	0.3	65.0%	No	Unknown	Unknown	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	2	Water Supply Pump	1.5	71.0%	No	Baldor	84Z04007	W	1,373		No	71.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	8	Supply Fan	0.3	65.0%	No	Unknown	Unknown	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

#### Packaged HVAC Inventory & Recommendations

		Existing Conditions									Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	Academic Wing G	2	Split-System	10.00		8.00		Trane	TTA120F40SAA	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	4	Split-System	1.00		8.00		Liebert	PFH014A-PL7	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	5	Ductless Mini-Split AC	1.00		9.90		Mitsubishi	PKA-A12HA4	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	3	Split-System	2.00		8.00		Liebert	Unknown	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	Academic Wing G	1	Ductless Mini-Split AC	2.00		8.00		Mitsubishi	Unknown	W		No							0.0	0	0	\$0	\$0	\$0	0.0

#### Electric Chiller Inventory & Recommendations

		Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	Academic Wing G	1	Water-Cooled Centrifugal Chiller	233.00	Varied	Varied	W		No							0.0	0	0	\$0	\$0	\$0	0.0

### Space Heating Boiler Inventory & Recommendations

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis							
Location	Area(s)/System(s) Served	System Quantity	System Type	Output Capacity per Unit (MBh)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	Academic Wing G	1	Forced Draft Steam Boiler	8,065	Cleaver Brooks	Varried	W		No						0.0	0	0	\$0	\$0	\$0	0.0

### DHW Inventory & Recommendations

		Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Manufacturer	Model	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	Academic Wing G	1	Boiler	Cleaver Brooks	Varried	W		No						0.0	0	0	\$0	\$0	\$0	0.0

### Low-Flow Device Recommendations

		Recommendation Inputs				Energy Impact & Financial Analysis						
Location	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	5	1	Pre-Rinse Spray Valve	2.50	1.28	0.0	0	1	\$11	\$124	\$0	11.3

### Walk-In Cooler/Freezer Inventory & Recommendations

		Existing Conditions			Proposed Conditions				Energy Impact & Financial Analysis						
Location	Cooler/Freezer Quantity	Case Type/Temperature	Manufacturer	Model	ECM #	Install EC Evaporator Fan Motors?	Install Electric Defrost Control?	Install Evaporator Fan Control?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	1	Cooler (35F to 55F)	Heatcraft	BHT010X6C		No	No	No	0.0	0	0	\$0	\$0	\$0	0.0

### Commercial Refrigerator/Freezer Inventory & Recommendations

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Refrigerator/ Freezer Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	3	Freezer Chest	So-Low	C85-9	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	2	Stand-Up Freezer, Solid Door (16 - 30 cu. ft.)	So-Low	DHW20-20MDP	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	1	Stand-Up Refrigerator, Solid Door (31 - 50 cu. ft.)	Continental	S3R	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	1	Stand-Up Refrigerator, Solid Door (16 - 30 cu. ft.)	Continental	S2R-SS	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	1	Stand-Up Refrigerator, Solid Door (≤15 cu. ft.)	Norlake	NSLR211WAW/0	No		No	0.0	0	0	\$0	\$0	\$0	0.0

### Commercial Ice Maker Inventory & Recommendations

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Ice Maker Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Academic Wing G	1	Self-Contained Unit (≥175 lbs/day), Continuous	Hoshizaki	F-330BAH	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Academic Wing G	2	Self-Contained Unit (<175 lbs/day), Continuous	Manitowoc	RF0385A	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0

### Dishwasher Inventory & Recommendations

Dishwasher Inventory & Recommendations																
Existing Conditions								Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Dishwasher Type	Manufacturer	Model	Water Heater Fuel Type	Booster Heater Fuel Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Payback w/ Incentives in Years
Academic Wing G - Laboratory 425	1	Multi-Tank Conveyor (High Temp)	SMC-ROE	CBW 1026KD	Natural Gas	N/A	No		No	0.0	0	0	\$0	\$0	\$0	0.0



Plug Load Inventory


Existing Conditions						
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?	Manufacturer	Model
Academic Wing G	18	Coffee Machine	1,500	No	Varied	Varied
Academic Wing G	6	Dehumidifier	1,000	No	Varied	Varied
Academic Wing G	152	Desktop	150	No	Varied	Varied
Academic Wing G	6	Electric Space Heater	1,500	No	Varied	Varied
Academic Wing G	10	Fan	200	No	Varied	Varied
Academic Wing G	7	Laptop	75	No	Unknown	Unknown
Academic Wing G	23	Microwave	1,000	No	Varied	Varied
Academic Wing G	10	Hand Dryer	1,500	No	Varied	Varied
Academic Wing G	107	Printer	150	Yes	Varied	Varied
Academic Wing G	31	Projector	150	No	Varied	Varied
Academic Wing G	24	Mini Refrigerator	126	No	Varied	Varied
Academic Wing G	22	Refrigerator	300	No	Varied	Varied
Academic Wing G	22	Television	150	Yes	Unknown	Unknown
Academic Wing G	2	Autoclave	20,000	No	Varied	Varied
Academic Wing G	5	Water Purification	500	No	Unknown	Unknown
Academic Wing G	4	Shaker	1,500	No	Unknown	Unknown
Academic Wing G	14	Hood	500		Varied	Varied
Academic Wing G	1	Lab Equipment	2,000	No	Unknown	Unknown
Academic Wing G	2	Compactor	14,900	No	Unknown	Unknown
Academic Wing G	9	Lab Oven	4,500	No	Varied	Varied
Academic Wing G	1	Misc Lab Equipment	2,000	No	Varied	Varied
Academic Wing G	1	CNC	240	No	Nomad 883	PRO
Academic Wing G	1	Misc Tools	1,500	No	Varied	Varied
Academic Wing G	1	3-D Printer	250	No	Varied	Varied
Academic Wing G	19	Incubator	200	No	Varied	Varied
Academic Wing G	16	Centrifuge	320	No	Varied	Varied
Academic Wing G	7	Hot Plate	698	No	Varied	Varied
Academic Wing G	1	Washer	30,000	No	Reimers	RH-30
Academic Wing G	1	Water Bath	500	No	Brinkmann	RM 20
Academic Wing G	7	Misc Scientific Equipment	1,500	No	Varied	Varied

Miscellaneous Fuel Inventory


Existing Conditions						
Location	Quantity	Equipment Description	Input Capacity per Unit (MBh)	ENERGY STAR Qualified ?	Manufacturer	Model
Academic Wing G	1	Generator	1,706.0	No	Stamford	M13J43675

## APPENDIX B: ENERGY STAR STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.



# ENERGY STAR® Statement of Energy Performance



**ENERGY STAR®  
Score<sup>1</sup>**

**Ramapo College of New Jersey (Campus)**

Primary Property Type: College/University  
Gross Floor Area (ft²): 1,894,712  
Built: 1973

For Year Ending: May 31, 2022  
Date Generated: February 07, 2024

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
<b>Property Address</b>	<b>Property Owner</b>	<b>Primary Contact</b>	
Ramapo College of New Jersey (Campus) 505 Ramapo Valley Road & 523 Route 202 Mahwah, New Jersey 07430	Ramapo College of New Jersey 505 Ramapo Valley Road Mahwah, NJ 07430 (201) 684-7666	Mike Cunningham 505 Ramapo Valley Road Mahwah, NJ 07430 (201) 684-7666 mcunning@ramapo.edu	
<b>Property ID:</b> 26333864			

Energy Consumption and Energy Use Intensity (EUI)			
<b>Site EUI</b>	<b>Annual Energy by Fuel</b>	<b>National Median Comparison</b>	
102.1 kBtu/ft²	Electric - Grid (kBtu) 73,580,913 (38%)	National Median Site EUI (kBtu/ft²)	105.6
	Electric - Solar (kBtu) 17,652,538 (9%)	National Median Source EUI (kBtu/ft²)	180.6
	Natural Gas (kBtu) 102,253,203 (53%)	% Diff from National Median Source EUI	-3%
<b>Source EUI</b>		<b>Annual Emissions</b>	
174.7 kBtu/ft²		Total (Location-Based) GHG Emissions	7,720
		(Metric Tons CO2e/year)	

**Signature & Stamp of Verifying Professional**

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: \_\_\_\_\_ Date: \_\_\_\_\_

Licensed Professional

\_\_\_\_\_

\_\_\_\_\_

Professional Engineer or Registered Architect Stamp (if applicable)

## APPENDIX C: GLOSSARY

TERM	DEFINITION
<b>Blended Rate</b>	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
<b>Btu</b>	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
<b>CHP</b>	<i>Combined heat and power</i> . Also referred to as cogeneration.
<b>COP</b>	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
<b>Demand Response</b>	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
<b>DCV</b>	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
<b>US DOE</b>	<i>United States Department of Energy</i>
<b>EC Motor</b>	<i>Electronically commutated motor</i>
<b>ECM</b>	<i>Energy conservation measure</i>
<b>EER</b>	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
<b>EUI</b>	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
<b>Energy Efficiency</b>	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
<b>ENERGY STAR</b>	ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA.
<b>EPA</b>	<i>United States Environmental Protection Agency</i>
<b>Generation</b>	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
<b>GHG</b>	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
<b>gpf</b>	<i>Gallons per flush</i>



<b>gpm</b>	<i>Gallon per minute</i>
<b>HID</b>	<i>High intensity discharge</i> : high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
<b>hp</b>	<i>Horsepower</i>
<b>HPS</b>	<i>High-pressure sodium</i> : a type of HID lamp.
<b>HSPF</b>	<i>Heating seasonal performance factor</i> : a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
<b>HVAC</b>	<i>Heating, ventilating, and air conditioning</i>
<b>IHP 2014</b>	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
<b>IPLV</b>	<i>Integrated part load value</i> : a measure of the part load efficiency usually applied to chillers.
<b>kBtu</b>	One thousand British thermal units
<b>kW</b>	<i>Kilowatt</i> : equal to 1,000 Watts.
<b>kWh</b>	<i>Kilowatt-hour</i> : 1,000 Watts of power expended over one hour.
<b>LED</b>	<i>Light emitting diode</i> : a high-efficiency source of light with a long lamp life.
<b>LGEA</b>	<i>Local Government Energy Audit</i>
<b>Load</b>	The total power a building or system is using at any given time.
<b>Measure</b>	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
<b>MH</b>	<i>Metal halide</i> : a type of HID lamp.
<b>MBh</b>	<i>Thousand Btu per hour</i>
<b>MBtu</b>	<i>One thousand British thermal units</i>
<b>MMBtu</b>	<i>One million British thermal units</i>
<b>MV</b>	<i>Mercury Vapor</i> : a type of HID lamp.
<b>NJBPU</b>	<i>New Jersey Board of Public Utilities</i>
<b>NJCEP</b>	<i>New Jersey's Clean Energy Program</i> : NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment.
<b>psig</b>	Pounds per square inch gauge
<b>Plug Load</b>	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
<b>PV</b>	<i>Photovoltaic</i> : refers to an electronic device capable of converting incident light directly into electricity (direct current).

<b>SEER</b>	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
<b>SEP</b>	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR Portfolio Manager.
<b>Simple Payback</b>	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
<b>SREC (II)</b>	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
<b>T5, T8, T12</b>	A reference to a linear lamp diameter. The number represents increments of 1/8 <sup>th</sup> of an inch.
<b>Temperature Setpoint</b>	The temperature at which a temperature regulating device (thermostat, for example) has been set.
<b>therm</b>	100,000 Btu. Typically used as a measure of natural gas consumption.
<b>tons</b>	A unit of cooling capacity equal to 12,000 Btu/hr.
<b>Turnkey</b>	Provision of a complete product or service that is ready for immediate use.
<b>VAV</b>	<i>Variable air volume</i>
<b>VFD</b>	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
<b>WaterSense®</b>	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
<b>Watt (W)</b>	Unit of power commonly used to measure electricity use.