





Local Government Energy Audit Report

Berrie Center July 10, 2024

Prepared for:

Ramapo College of New Jersey

525 Route 22

Mahwah, New Jersey 07430

Prepared by:

TRC

317 George Street

New Brunswick, New Jersey 08901





Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based on previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2024 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.





Table of Contents

1	Execu	itive Summary	1
	1.1	Planning Your Project	4
	Picl	ς Your Installation Approach	4
		tions from Your Utility Company	
	Pre	scriptive and Custom Rebates	4
	Dire	ect Install	4
	_	rineered Solutions	
	Opt	tions from New Jersey's Clean Energy Program	5
2	Existi	ng Conditions	6
	2.1	Site Overview	6
	2.2	Building Occupancy	6
	2.3	Building Envelope	6
	2.4	Lighting Systems	8
	2.5	Air Handling Systems	9
	Uni	tary Electric HVAC Equipment	9
		tary Heating Equipment	
	Pac	kaged Units	10
	2.6	Building Automation System (BAS)	
	2.7	Domestic Hot Water	
	2.8	Plug Load and Vending Machines	
	2.9	Water-Using Systems	
3	Energ	y Use and Costs	13
	3.1	Electricity	15
	3.2	Natural Gas	
	3.3	Benchmarking	
	Tra	cking Your Energy Performance	18
4	Energ	y Conservation Measures	19
	4.1	Lighting	22
	FCN		
		И 1: Install LED Fixtures	
		A 3: Retrofit Fixtures with LED Lamps	
		·	
	4.2	Lighting Controls	
		A 4: Install Occupancy Sensor Lighting Controls	
	ECN	И 5: Install High/Low Lighting Controls	23
	4.3	Variable Frequency Drives (VFD)	24
	ECN	И 6: Install VFDs on Constant Volume (CV) Fans	24
	4.4	Unitary HVAC	25
	ECN	л 7: Install High Efficiency Air Conditioning Units	25
		4 8: Install High Efficiency Heat Pumps	






	4.5	Domestic Water Heating	26
	ECN	Л 9: Install High Efficiency Gas-Fired Water Heater	26
		/I 10: Install Low-Flow DHW Devices	
	4.6	Custom Measures	26
	ECN	Л 11: Replace Gas Fired Water Heater with Heat Pump Water Heater	26
	4.7	Measures for Future Consideration	
		tric Sub Metering	
5		y Efficient Best Practices	
3			
		rgy Tracking with ENERGY STAR Portfolio Managerting Maintenance	
	_	tor Maintenance	
		nomizer Maintenance	
		System Evaporator/Condenser Coil Cleaning	
		AC Filter Cleaning and Replacement	
		twork Maintenance	
		nace Maintenance	
	Wat	ter Heater Maintenance	32
	Con	npressed Air System Maintenance	32
		ter Conservation	
	Pro	curement Strategies	33
6	On-sit	te Generation	34
	6.1	Solar Photovoltaic	35
	6.2	Combined Heat and Power	
_	_		
7	Electr	ic Vehicles (EV)	38
	7.1	Electric Vehicle Charging	38
8	Proje	ct Funding and Incentives	40
	8.1	Utility Energy Efficiency Programs	41
	Pre	scriptive and Custom	41
		ect Install	
		ineered Solutions	
	8.2	New Jersey's Clean Energy Programs	43
	lard	ge Energy Users	ИЗ
	_	nbined Heat and Power	
		cessor Solar Incentive Program (SuSI)	
		rgy Savings Improvement Program	
9		ct Development	
		y Purchasing and Procurement Strategies	
	10.1	Retail Electric Supply Options	
	10.2	Retail Natural Gas Supply Options	
۸			
-	-	A: Equipment Inventory & Recommendations	
-	-	C: Glossary	
\neg	~~IUIA	C. CIOSSUI V	





1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) report for Berrie Center. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

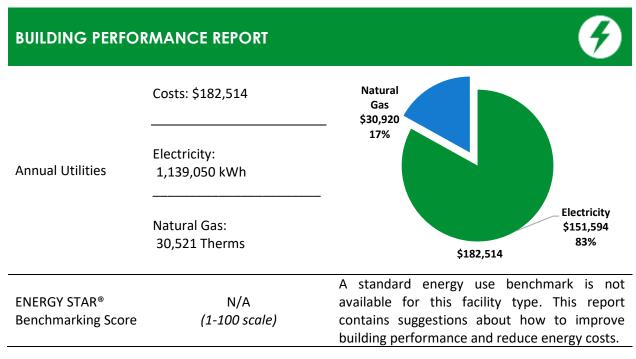

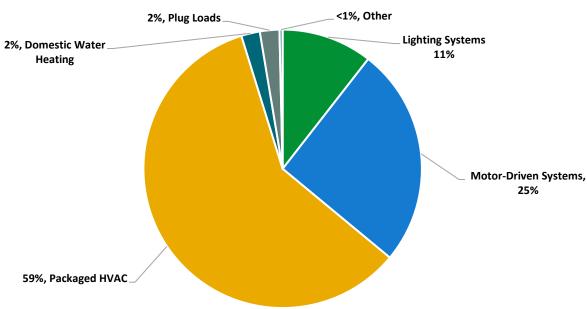


Figure 1 - Energy Use by System






POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (All Evaluated Measures)

Installation Cost	\$310,189			
Potential Rebates & Incen	\$31,083			
Annual Cost Savings	\$45,933			
Annual Energy Savings	331,504 kWh 1,791 Therms			
Greenhouse Gas Emission	177 Tons			
Simple Payback	6.1 Years			
Site Energy Savings (All Ut	19%			



Scenario 2: Cost Effective Package²

Installation Cost		\$168,705			
Potential Rebates & Incention	ves	\$22,769			
Annual Cost Savings		\$40,550			
Annual Energy Savings	Electricity: 305,713 kWh Natural Gas: -135 Therms				
Greenhouse Gas Emission S	avings	153 Tons			
Simple Payback		3.6 Years			
Site Energy Savings (all utilit	ties)	15%			

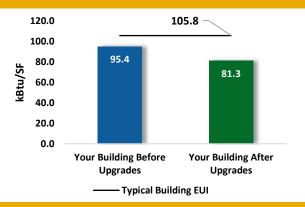

On-site Generation Potential

Photovoltaic	None
Combined Heat and Power	None

¹ Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.





#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting	Upgrades		88,882	21.8	-18	\$11,644	\$35,495	\$6,267	\$29,228	2.5	87,366
ECM 1	Install LED Fixtures	Yes	1,288	0.0	0	\$171	\$788	\$150	\$638	3.7	1,297
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	4,387	2.0	-1	\$575	\$2,732	\$400	\$2,332	4.1	4,310
ECM 3	Retrofit Fixtures with LED Lamps	Yes	83,208	19.8	-17	\$10,898	\$31,976	\$5,717	\$26,259	2.4	81,759
Lighting Control Measures			21,108	5.1	-4	\$2,765	\$35,226	\$5,920	\$29,306	10.6	20,739
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	18,264	4.8	-4	\$2,392	\$32,526	\$4,135	\$28,391	11.9	17,945
ECM 5	Install High/Low Lighting Controls	Yes	2,844	0.4	-1	\$372	\$2,700	\$1,785	\$915	2.5	2,794
Variable	Variable Frequency Drive (VFD) Measures		190,930	32.6	0	\$25,411	\$89,850	\$10,500	\$79,350	3.1	192,265
ECM 6	Install VFDs on Constant Volume (CV) Fans	Yes	190,930	32.6	0	\$25,411	\$89,850	\$10,500	\$79,350	3.1	192,265
Unitary	HVAC Measures		45,026	23.9	17	\$6,165	\$138,445	\$7,684	\$130,761	21.2	47,335
ECM 7	Install High Efficiency Air Conditioning Units	No	40,233	21.2	17	\$5,527	\$130,491	\$7,684	\$122,807	22.2	42,509
ECM 8	Install High Efficiency Heat Pumps	Yes	4,793	2.7	0	\$638	\$7,954	\$0	\$7,954	12.5	4,826
Domest	c Water Heating Upgrade		0	0.0	31	\$311	\$7,822	\$712	\$7,110	22.9	3,596
ECM 9	Install High Efficiency Gas-Fired Water Heater	No	0	0.0	22	\$218	\$7,643	\$630	\$7,013	32.2	2,521
ECM 10	Install Low-Flow DHW Devices	Yes	0	0.0	9	\$93	\$179	\$82	\$98	1.0	1,075
Custom	Custom Measures		-14,443	0.0	154	-\$362	\$3,350	\$0	\$3,350	-9.3	3,487
ECM 11	ECM 11 Replace Gas Fired Water Heater with Heat Pump Water Heater No			0.0	154	-\$362	\$3,350	\$0	\$3,350	-9.3	3,487
	TOTALS (COST EFFECTIVE MEASURES)		305,713	62.2	-13	\$40,550	\$168,705	\$22,769	\$145,936	3.6	306,272
	TOTALS (ALL MEASURES)				179	\$45,933	\$310,189	\$31,083	\$279,106	6.1	354,788

^{* -} All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures.**

^{** -} Simple Payback Period is based on net measure costs (i.e. after incentives).





1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ♦ How will the project be funded and/or financed?
- Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

Utility-run energy efficiency programs and New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives <u>before</u> purchasing materials or starting installation.

Options from Your Utility Company

Prescriptive and Custom Rebates

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the Prescriptive and Custom Rebates program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval may be required for some incentives. Contact your utility company for more details prior to project installation.

Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized contractor. This program can provide incentives up to 70% or 80% of the cost of selected measures. A Direct Install contractor will assess and verify individual measure eligibility and perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Engineered Solutions

The Engineered Solutions program provides tailored energy-efficiency assistance and turnkey engineering services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. The program provides all professional services from audit, design, construction administration, to commissioning and measurement and verification for custom whole-building energy-efficiency projects. Engineered Solutions allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs.

For more details on these programs please contact your utility provider.





Options from New Jersey's Clean Energy Program

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat and Power (CHP)

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Successor Solar Incentive Program (SuSI)

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

Large Energy User Program (LEUP)

LEUP is designed to promote self-investment in energy efficiency. It incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

For more details on these programs please visit New Jersey's Clean Energy Program website.







2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) report for Berrie Center. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On July 28, 2023, TRC performed an energy audit at Berrie Center located in Mahwah, New Jersey. TRC met with facility staff to review the facility operations and help focus our investigation on specific energy-using systems.

Berrie Center is a three-story, 72,715 square foot building built in 1973. Spaces include classrooms, offices, corridors, stairwells, dining room, storage rooms, and mechanical space.

2.2 Building Occupancy

The school is fully occupied during the fall, spring, and summer semesters. Weekend activities vary by semester. The facility is occupied intermittently, as needed for maintenance and operations.

Building Name	Weekday/Weekend	Operating Schedule		
Parria Cantar	Weekday	7:00 AM - 10:00 PM		
Berrie Center	Weekend	7:00 AM - 10:00 PM		

Figure 3 - Building Occupancy Schedule

2.3 Building Envelope

Building walls are concrete block over structural steel with a mix of brick facades. The roof is flat and covered with black membrane and in fair condition.





Building Exterior









Interior Structure





Roof

Most of the windows are double glazed and have aluminum frames with a thermal break. The glass-to-frame seals are in fair condition. The operable window weather seals are in fair condition, showing little evidence of excessive wear. Exterior doors have aluminum frames and are in fair condition with undamaged door seals. Degraded window and door seals increase drafts and outside air infiltration.



Exterior Doors

Windows









Exterior Doors

Windows

2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. There are also several 34-Watt T12 fixtures. Fixture types include 1-lamp, 2-lamp, 3-lamp, or 4-lamp, 4-foot or 8-foot-long recessed troffer surface mounted fixtures and 2-foot fixtures with U-bend tube lamps. Typically, T8 fluorescent lamps use electronic ballasts and T12 fluorescent lamps use magnetic ballasts.

Additionally, there are some compact fluorescent lamps (CFL), incandescent, and LED lamps. Auditorium fixtures have high bay LED lamps and are manually controlled. There are a few HID lights in the set shop. All exit signs are LED. Most fixtures are in fair condition. Interior lighting levels were generally sufficient.






Linear Fluorescent Fixtures

Light fixtures are controlled by wall switches or circuit breakers.

Exterior fixtures include wall packs and canopy lights with CFLs. The pole mounted flood fixtures incorporate high intensity discharge (HID) lamps. Exterior fixtures are timer controlled.





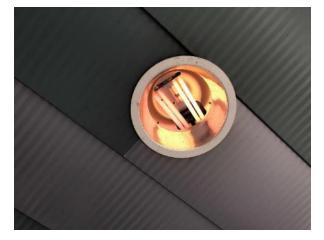



CFL Recessed Can

HID Pole Tops

2.5 Air Handling Systems

Unitary Electric HVAC Equipment

Storage area use ductless mini split heat pumps (AC) units. It is rated at 4 tons of cooling with an EER of 13 and MBh of 54.6. The unit are in poor condition and are ready for replacement.





Ductless Min Split Heat Pump

Unitary Heating Equipment

Several areas are heated by electric resistance heaters. These vary in capacity between 0.35 kW and 2.9 kW. The units are in fair condition.









Electric Resistance Heater

Packaged Units

The electrical control room is served with a packaged terminal heat pump (PTHP) unit controlled by a room thermostat. The 10.8 EER unit with a heating capacity of 10 MBh and 1-ton cooling capacity.

Most of the building is served by packaged roof top units (RTUs). There are 14 gas-fired burner units. Most range in size from 3 to 25-tons of cooling with inputs ratings between 112 and 400 MBh. One unit, AC11, is rated at 80 tons of cooling with a heating input capacity of 800 MBh. The units are equipped with economizers that are generally in poor condition.

Refer to Appendix A for detailed information about each unit.





PTHP









RTUs

2.6 Building Automation System (BAS)

A Johnson Controls BAS controls the HVAC equipment and package units. The BAS provides equipment scheduling control and monitors and controls space temperatures, supply air temperatures, humidity, heating water loop temperatures, and chilled water loop temperatures.

The site staff expressed an interest in expanding the level of control provided by the BAS, replacing the BAS, and receiving additional training on operating the BAS.

2.7 Domestic Hot Water

Hot water is produced by an 81 gallon, 180 MBh gas-fired storage water heater with an efficiency rating of 80 percent. A fractional hp circulation pump distributes water to end uses. The circulation pump operates continuously.







DHW Circulation Pump





2.8 Plug Load and Vending Machines

The location is doing a great job managing the electrical plug loads. This report makes additional suggestions for ECMs in this area as well as energy efficient best practices.

There are 77 computer workstations throughout the facility. Plug loads include general cafe and office equipment. There are classroom typical loads such as smartboards, projectors, and fans.

There are several refrigerators throughout the building. These vary in condition and efficiency.

There is one refrigerated beverage vending machine and one non-refrigerated vending machine. Vending machines are equipped with occupancy-based controls.





Computer Workstation

Copier

2.9 Water-Using Systems

There are eight restrooms with toilets and sinks. Faucet flow rates are at 1.5 gallons per minute (gpm) or higher.





Lavatory Sink






3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary								
Fuel	Usage	Cost						
Electricity	1,139,050 kWh	\$151,594						
Natural Gas	30,521 Therms	\$30,920						
Total	\$182,514							



An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.





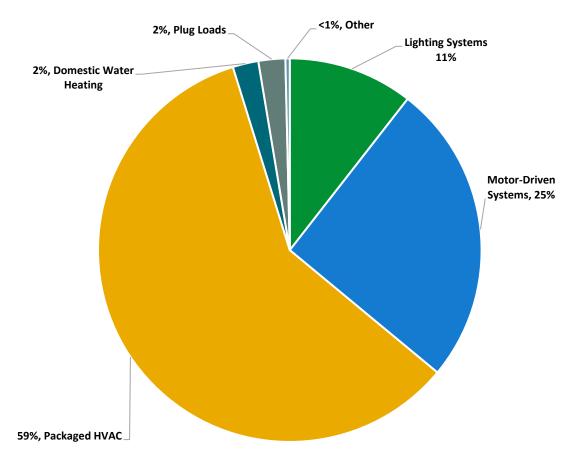



Figure 4 - Energy Balance





3.1 Electricity

Rockland Electric delivers electricity under rate class Electric Comm Prim (TOU-RE-DEL-PJM), with electric production provided by Direct Energy, a third-party supplier.

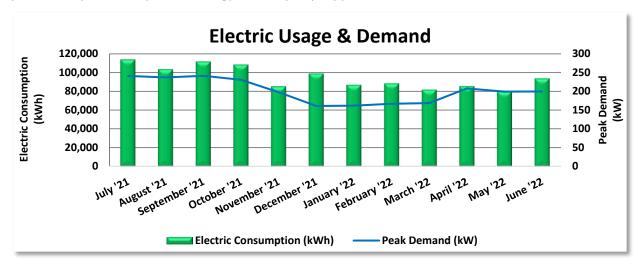

Electric Billing Data										
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost					
7/26/21	32	113,757	241		\$13,351					
8/24/21	29	103,315	237		\$12,290					
9/23/21	30	111,501	241		\$13,200					
10/25/21	32	108,153	231		\$12,787					
11/23/21	29	85,225	198		\$10,170					
12/27/21	34	98,698	161		\$11,440					
1/26/22	30	86,677	162		\$12,940					
2/24/22	29	88,251	167		\$13,239					
3/25/22	29	81,698	169		\$12,326					
4/25/22	31	85,361	208		\$13,042					
5/23/22	28	79,717	199		\$12,150					
6/23/22	31	93,576	200		\$14,244					
Totals	364	1,135,929	241	\$0	\$151,179					
Annual	365	1,139,050	241	\$0	\$151,594					

Notes:


- The average electric cost over the past 12 months was \$0.133/kWh, which is the blended rate
 that includes energy supply, distribution, demand, and other charges. This report uses this
 blended rate to estimate energy cost savings.
- This building is served from the main campus electric meter along with several others. Energy usage (kWh) and demand (kW) was apportioned among those buildings using a formula that accounts for building area (sf) and presumed energy intensity (EUI) by building type.





3.2 Natural Gas

PSE&G delivers natural gas under rate class Large Volume Gas, with natural gas supply provided by Direct Energy, a third-party supplier.

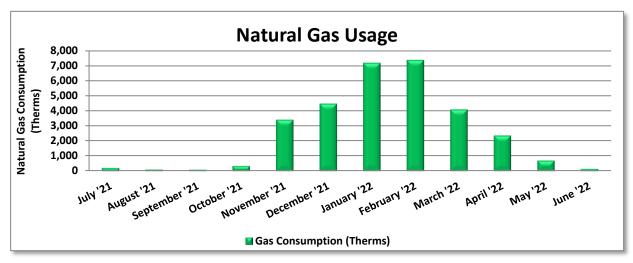

Gas Billing Data									
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost						
8/2/21	33	215	\$272						
8/27/21	25	112	\$217						
9/28/21	32	92	\$206						
10/28/21	30	346	\$358						
11/30/21	33	3,409	\$3,244						
12/29/21	29	4,476	\$3,982						
1/28/22	30	7,188	\$7,242						
3/3/22	34	7,377	\$7,507						
3/31/22	28	4,092	\$4,703						
5/2/22	32	2,368	\$2,165						
5/31/22	29	701	\$744						
6/30/22	30	145	\$280						
Totals	365	30,521	\$30,920						
Annual	365	30,521	\$30,920						

Notes:

- The average gas cost for the past 12 months is \$1.013/therm, which is the blended rate used throughout the analysis.
- This building is served by a dedicated gas meter.





3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager®* software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

Benchmarking Score

N/A

Due to its unique characteristics, this building type is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

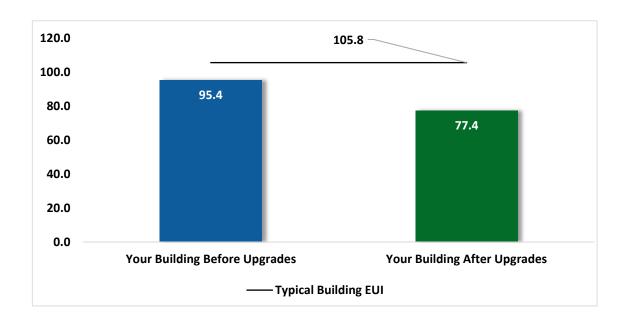


Figure 5 - Energy Use Intensity Comparison³

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

³ Based on all evaluated ECMs





Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager account for your facility and have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR Portfolio Manager to track your building's performance at: https://www.energystar.gov/buildings/training.

For more information on ENERGY STAR and Portfolio Manager, visit their website.





4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives in this report are based on the previously run state rebate program SmartStart, which has been retired. Now, all investor-owned gas and electric utility companies are offering complementary energy efficiency programs directly to their customers. Some measures and proposed upgrades may be eligible for higher incentives than those shown below. The incentives in the summary tables should be used for high-level planning purposes. To verify incentives, reach out to your utility provider or visit the NJCEP website for more information.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.





#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO₂e Emissions Reduction (lbs)
Lighting	Upgrades		88,882	21.8	-18	\$11,644	\$35,495	\$6,267	\$29,228	2.5	87,366
ECM 1	Install LED Fixtures	Yes	1,288	0.0	0	\$171	\$788	\$150	\$638	3.7	1,297
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	4,387	2.0	-1	\$575	\$2,732	\$400	\$2,332	4.1	4,310
ECM 3	Retrofit Fixtures with LED Lamps	Yes	83,208	19.8	-17	\$10,898	\$31,976	\$5,717	\$26,259	2.4	81,759
Lighting Control Measures			21,108	5.1	-4	\$2,765	\$35,226	\$5,920	\$29,306	10.6	20,739
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	18,264	4.8	-4	\$2,392	\$32,526	\$4,135	\$28,391	11.9	17,945
ECM 5	Install High/Low Lighting Controls	Yes	2,844	0.4	-1	\$372	\$2,700	\$1,785	\$915	2.5	2,794
Variable	Frequency Drive (VFD) Measures		190,930	32.6	0	\$25,411	\$89,850	\$10,500	\$79,350	3.1	192,265
ECM 6	Install VFDs on Constant Volume (CV) Fans	Yes	190,930	32.6	0	\$25,411	\$89,850	\$10,500	\$79,350	3.1	192,265
Unitary	HVAC Measures		45,026	23.9	17	\$6,165	\$138,445	\$7,684	\$130,761	21.2	47,335
ECM 7	Install High Efficiency Air Conditioning Units	No	40,233	21.2	17	\$5,527	\$130,491	\$7,684	\$122,807	22.2	42,509
ECM 8	Install High Efficiency Heat Pumps	Yes	4,793	2.7	0	\$638	\$7,954	\$0	\$7,954	12.5	4,826
Domest	ic Water Heating Upgrade		0	0.0	31	\$311	\$7,822	\$712	\$7,110	22.9	3,596
ECM 9	Install High Efficiency Gas-Fired Water Heater	No	0	0.0	22	\$218	\$7,643	\$630	\$7,013	32.2	2,521
ECM 10	Install Low-Flow DHW Devices	Yes	0	0.0	9	\$93	\$179	\$82	\$98	1.0	1,075
Custom Measures		-14,443	0.0	154	-\$362	\$3,350	\$0	\$3,350	-9.3	3,487	
ECM 11	Replace Gas Fired Water Heater with Heat Pump Water Heater	No	-14,443	0.0	154	-\$362	\$3,350	\$0	\$3,350	-9.3	3,487
	TOTALS	331,504	83.4	179	\$45,933	\$310,189	\$31,083	\$279,106	6.1	354,788	

^{* -} All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

Figure 6 – All Evaluated ECMs

^{** -} Simple Payback Period is based on net measure costs (i.e. after incentives).





#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)		Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)		CO ₂ e Emissions Reduction (lbs)
Lighting	Upgrades	88,882	21.8	-18	\$11,644	\$35,495	\$6,267	\$29,228	2.5	87,366
ECM 1	Install LED Fixtures	1,288	0.0	0	\$171	\$788	\$150	\$638	3.7	1,297
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	4,387	2.0	-1	\$575	\$2,732	\$400	\$2,332	4.1	4,310
ECM 3	Retrofit Fixtures with LED Lamps	83,208	19.8	-17	\$10,898	\$31,976	\$5,717	\$26,259	2.4	81,759
Lighting Control Measures		21,108	5.1	-4	\$2,765	\$35,226	\$5,920	\$29,306	10.6	20,739
ECM 4	Install Occupancy Sensor Lighting Controls	18,264	4.8	-4	\$2,392	\$32,526	\$4,135	\$28,391	11.9	17,945
ECM 5	Install High/Low Lighting Controls	2,844	0.4	-1	\$372	\$2,700	\$1,785	\$915	2.5	2,794
Variable	e Frequency Drive (VFD) Measures	190,930	32.6	0	\$25,411	\$89,850	\$10,500	\$79,350	3.1	192,265
ECM 6	Install VFDs on Constant Volume (CV) Fans	190,930	32.6	0	\$25,411	\$89,850	\$10,500	\$79,350	3.1	192,265
Unitary	HVAC Measures	4,793	2.7	0	\$638	\$7,954	\$0	\$7,954	12.5	4,826
ECM 8	Install High Efficiency Heat Pumps	4,793	2.7	0	\$638	\$7,954	\$0	\$7,954	12.5	4,826
Domestic Water Heating Upgrade		0	0.0	9	\$93	\$179	\$82	\$98	1.0	1,075
ECM 10	Install Low-Flow DHW Devices	0	0.0	9	\$93	\$179	\$82	\$98	1.0	1,075
	TOTALS	305,713	62.2	-13	\$40,550	\$168,705	\$22,769	\$145,936	3.6	306,272

^{* -} All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

Figure 7 – Cost Effective ECMs

^{** -} Simple Payback Period is based on net measure costs (i.e. after incentives).





4.1 Lighting

#	Energy Conservation Measure		Peak Demand Savings (kW)		Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)		CO ₂ e Emissions Reduction (Ibs)
Lighting	g Upgrades	88,882	21.8	-18	\$11,644	\$35,495	\$6,267	\$29,228	2.5	87,366
ECM 1	Install LED Fixtures	1,288	0.0	0	\$171	\$788	\$150	\$638	3.7	1,297
ECM 2	Retrofit Fluores cent Fixtures with LED Lamps and Drivers	4,387	2.0	-1	\$575	\$2,732	\$400	\$2,332	4.1	4,310
ECM 3	Retrofit Fixtures with LED Lamps	83,208	19.8	-17	\$10,898	\$31,976	\$5,717	\$26,259	2.4	81,759

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

ECM 1: Install LED Fixtures

Replace existing fixtures containing HID lamps with new LED light fixtures. This measure saves energy by installing LEDs, which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixtures.

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

Affected Building Areas: exterior HID fixtures

ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers

Retrofit fluorescent fixtures by removing the fluorescent tubes and ballasts and replacing them with LED tubes and LED drivers (if necessary), which are designed to be used in retrofitted fluorescent fixtures.

The measure uses the existing fixture housing but replaces the electric components with more efficient lighting technology, which use less power than other lighting technologies but provides equivalent lighting output. Maintenance savings may also be achieved since LED tubes last longer than fluorescent tubes and, therefore, do not need to be replaced as often.

Affected Building Areas: all areas with fluorescent fixtures with T12 tubes





ECM 3: Retrofit Fixtures with LED Lamps

Replace fluorescent, HID, CFL, or incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected Building Areas: all areas with fluorescent fixtures with T8 tubes, HID, CFL, or incandescent lamps

4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)		CO ₂ e Emissions Reduction (Ibs)
Lighting	Lighting Control Measures		5.1	-4	\$2,765	\$35,226	\$5,920	\$29,306	10.6	20,739
ECM 4	Install Occupancy Sensor Lighting Controls	18,264	4.8	-4	\$2,392	\$32,526	\$4,135	\$28,391	11.9	17,945
LECIVI 5	Install High/Low Lighting Controls	2,844	0.4	-1	\$372	\$2,700	\$1,785	\$915	2.5	2,794

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 4: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected Building Areas: offices, classrooms, and restrooms

ECM 5: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.





Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as occupants approach the area.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Affected Building Areas: hallways and stairwells

4.3 Variable Frequency Drives (VFD)

#	Energy Conservation Measure		Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)		CO ₂ e Emissions Reduction (lbs)
Variabl	e Frequency Drive (VFD) Measures	190,930	32.6	0	\$25,411	\$89,850	\$10,500	\$79,350	3.1	192,265
ECM 6	Install VFDs on Constant Volume (CV) Fans	190,930	32.6	0	\$25,411	\$89,850	\$10,500	\$79,350	3.1	192,265

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

ECM 6: Install VFDs on Constant Volume (CV) Fans

Install VFDs to control constant volume fan motor speeds. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature.

VAV system controls should not raise the supply air temperature at the expense of the fan power. A common mistake is to reset the supply air temperature to achieve chiller energy savings, which can lead to additional air flow requirements. Supply air temperature should be kept low (e.g., 55°F) until the minimum fan speed (typically about 50%) is met. At this point, it is efficient to raise the supply air temperature as the load decreases, but not such that additional air flow and thus fan energy is required.

For air handlers with direct expansion (DX) cooling systems, the minimum air flow across the cooling coil required to prevent the coil from freezing must be determined during the final project design. The control





system programming should maintain the minimum air flow whenever the compressor is operating. Prior to implementation, verify minimum fan speed in cooling mode with the manufacturer. Note that savings will vary depending on the operating characteristics of each AHU.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

Affected Air Handlers: packaged RTUs as indicated in Appendix A

4.4 Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Net M&L		CO ₂ e Emissions Reduction (Ibs)
Unitary	Unitary HVAC Measures		23.9	17	\$6,165	\$138,445	\$7,684	\$130,761	21.2	47,335
ECM 7	Install High Efficiency Air Conditioning Units	40,233	21.2	17	\$5,527	\$130,491	\$7,684	\$122,807	22.2	42,509
ECM 8	Install High Efficiency Heat Pumps	4,793	2.7	0	\$638	\$7,954	\$0	\$7,954	12.5	4,826

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the Packaged RTUs are eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

ECM 7: Install High Efficiency Air Conditioning Units

We evaluated replacing standard efficiency packaged air conditioning units with high efficiency packaged air conditioning units. All the replacement units will incorporate efficient gas furnaces. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling and heating load, and the estimated annual operating hours.

Affected Units: packaged RTUs as indicated in Appendix A

ECM 8: Install High Efficiency Heat Pumps

Replace standard efficiency heat pumps with high efficiency heat pumps. A higher EER or SEER rating indicates a more efficient cooling system, and a higher HSPF rating indicates more efficient heating mode. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average heating and cooling loads, and the estimated annual operating hours.

Affected Units: ductless mini split system





4.5 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Net M&L	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Domes	Domestic Water Heating Upgrade		0.0	31	\$311	\$7,822	\$712	\$7,110	22.9	3,596
ECM 9	Install High Efficiency Gas-Fired Water Heater	0	0.0	22	\$218	\$7,643	\$630	\$7,013	32.2	2,521
ECM 10	Install Low-Flow DHW Devices	0	0.0	9	\$93	\$179	\$82	\$98	1.0	1,075

ECM 9: Install High Efficiency Gas-Fired Water Heater

We evaluated replacing the existing tank water heater with a high efficiency condensing tank water heater. Energy savings result from the increased efficiency of the unit, which uses less gas to heat water, and fewer operating hours to maintain the tank water temperature. Refer to ECM 11 for a second option for this unit.

ECM 10: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Additional cost savings may result from reduced water usage.

4.6 Custom Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)		Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)		CO₂e Emissions Reduction (lbs)
Custom	Custom Measures		0.0	154	-\$362	\$3,350	\$0	\$3,350	-9.3	3,487
	Replace Gas Fired Water Heater with Heat Pump Water Heater	-14,443	0.0	154	-\$362	\$3,350	\$0	\$3,350	-9.3	3,487

ECM 11: Replace Gas Fired Water Heater with Heat Pump Water Heater

A gas fired water heater uses a burner to heat water. Air source heat pump water heaters (HPWH) use a refrigeration cycle to transfer heat from the surrounding air to the domestic water. Water heater efficiency is rated by the uniform energy factor (UEF). For a relative comparison of water heater UEFs,





the criteria for certifying a water heater in the ENERGY STAR program are provided below. These values indicate that HPWH heaters are significantly more efficient than gas fired water heaters.

There are two types of HPWH: those integrated with the heat pump and storage tank in the same unit, and those that are split into two sections (with the storage tank separate from the heat pump). The measure considers an integrated HPWH.

ENERGY STAR Uniform Energy Factor (UEF) Criteria for Certified Water Heaters *

Water Heater Type	Minimum UEF	Other
Integrated HPWH	3.3	
Integrated HPWH	2.2	120 Volt, 15 Amp circuit
Split System HPWH	2.2	
Gas Fired Storage	0.64	≤ 55-gal, Medium Draw Pattern
Gas Fired Storage	0.68	≤ 55-gal, High Draw Pattern
Gas Fired Storage	0.78	> 55-gal, Medium Draw Pattern
Gas Fired Storage	0.80	> 55-gal, High Draw Pattern
Gas Fired Storage	0.80	Residential Duty
Gas Fired Instantaneous	0.87	

^{*} Note: Uniform Energy Factor (UEF): The newest measure of water heater overall efficiency. The higher the UEF value is, the more efficient the water heater. UEF is determined by the Department of Energy's test method outlined in 10 CFR Part 430, Subpart B, Appendix E.4

HPWH reject cold air. As such, they need to be installed in an unconditioned space of about 750 cubic feet with good ventilation⁵. Ideal locations are garages, large enclosed, unconditioned storage areas, or areas with excess heat such as a furnace or boiler room. The HPWH will also produce condensate so accommodations for draining the condensate need to be provided.

Most HPWH operate effectively down to an air temperature of 40 °F. Below that temperature, an electric resistance booster heater is typically required to achieve full heating capacity. It is critical that the HPWH controls are set up so that the electric resistance heat only engages when the air temperature is too cold for the HPWH to extract heat from it. HPWHs have a slow recovery. During periods of high demand, the electric resistance heating element, if enabled, may be energized to maintain set point, thus reducing the overall efficiency of the unit. It is recommended that a careful analysis of the hot water demand be conducted to determine if the application makes economic sense, and the HPWH heating capacity and storage are properly sized.

_

⁴ https://www.energy.gov/sites/prod/files/2014/06/f17/rwh_tp_final_rule.pdf

⁵ https://basc.pnnl.gov/code-compliance/heat-pump-water-heaters-code-compliance-brief#:~:text=HPWH%20must%20have%20urrestricted%20airflow,depending%20on%20size%20of%20system





HPWH operate most effectively when the temperature difference between the incoming and outgoing water is high. Generally, this means that cold make-up water should be piped to the bottom of the tank and return water should be piped to the top of the tank in order to maintain stratification within the storage tank. Water should be drawn from the bottom of the tank to be heated. If there is a DHW recirculation pump, it should only be operated during high hot water demand periods.

Switching from a gas fired water heater to a HPWH has the potential to reduce the sites overall greenhouse gas emissions. If the electricity for the HPWH is provided by an on-site photovoltaic (PV) system then there are essentially no greenhouse gas (GHG) emissions. A 2016 study conducted at Cornell 6 calculated the kg of methane (CH $_4$) and carbon dioxide (CO $_2$) produced per GJ of water heated. The study compared HPWH to gas and electric fired, storage and tankless water heaters. The study also considered electricity produced from natural gas and coal fired electric plants. In all cases the study found that HPWHs produced less methane than all of the other water heaters. The study also found that HPWH produced less carbon dioxide than electric resistance water heaters but more carbon dioxide than tankless gas water heaters and about the same amount of carbon dioxide as storage gas water heaters. The summary tables provide the reduction in CO2 equivalent emissions based on the typical New Jersey electric utility.

This measure has a negative simple payback due to the relative cost of electricity to natural gas. At this site the cost per Btu for natural gas is significantly lower than for electricity. Therefore, even though this measure will result in a net energy savings in terms of Btu at this site it will increase the overall cost for providing domestic hot water.

4.7 Measures for Future Consideration

There are additional opportunities for improvement that Ramapo College of New Jersey may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment, and/or include significant system reconfiguration. These measure(s) are therefore beyond the scope of this energy audit. These measure(s) are described here to support a whole building approach to energy efficiency and sustainability.

Ramapo College of New Jersey may wish to consider the Energy Savings Improvement Program (ESIP) or other whole building approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to:

- Evaluate these measures further.
- Develop firm costs.
- Determine measure savings.
- Prepare detailed implementation plans.

Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

_

⁶ <u>Greenhouse gas emissions from domestic hot water: Heat pumps compared to most commonly used systems. Bongghi Hong, Robert W. Howarth. Department of Ecology and Evolutionary Biology, Cornell University. Energy Science and Engineering 2016.</u>





Electric Sub Metering

Electricity use varies in different facilities, and plant operators need to perform their own investigations and analyses to understand how their facilities consume energy. Facility staff expressed interest in sub metering key buildings, which are currently served by a master meter. Utility bills indicate how much energy a facility uses across the entire facility, but submetering provides more detailed data on the energy consumption of specific systems and even on individual pieces of equipment, depending on how extensively meters are installed. Electric submeters alone do not save energy, but they are a useful tool under the right circumstances. Electric sub-meters can provide facility staff with real-time energy use data for specific buildings, information that enhances the potential for greater energy management activities. Revenue grade submeters are a tool that allow operators to better understand how and where electricity is used at the facility. Better resolution of system energy use can lead to operational changes or even equipment modifications or replacement, which often result in reduced energy use, which often result in reduced energy use.





5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5% –20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR Portfolio Manager



You've heard it before—you cannot manage what you do not measure. ENERGY STAR Portfolio Manager is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions⁷. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Lighting Maintenance



Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.

In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-

lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

⁷ https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager.





Economizer Maintenance

Economizers can significantly reduce cooling system load. A malfunctioning economizer can increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air. Common economizer malfunctions include broken outdoor thermostat or enthalpy control or dampers that are stuck or improperly adjusted.

Periodic inspection and maintenance will keep economizers working in sync with the heating and cooling system. This maintenance should be part of annual system maintenance, and it should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position.

AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Ductwork Maintenance

Duct maintenance has two primary goals: keep the ducts clean to avoid air quality problems and seal leaks to save energy. Check for cleanliness, obstructions that block airflow, water damage, and leaks. Ducts should be inspected at least every two years.

The biggest symptoms of clogged air ducts are differing temperatures throughout the building and areas with limited airflow from supply registers. If a particular air duct is clogged, then air flow will only be cut off to some rooms in the building—not all of them. The reduced airflow will make it more difficult for those areas to reach the temperature setpoint, which will cause the HVAC system to run longer to cool or heat that area properly. If you suspect clogged air ducts, ensure that all areas in front of supply registers are clear of items that may block or restrict air flow, and you should check for fire dampers or balancing dampers that have failed closed.

Duct leakage in commercial buildings can account for 5%–25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Check ductwork for leakage. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.

Distribution system losses are dependent on-air system temperature, the size of the distribution system, and the level of insulation of the ductwork. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is missing or worn, the system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.





Furnace Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.

Water Heater Maintenance

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues, and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Compressed Air System Maintenance

Compressed air systems require periodic maintenance to operate at peak efficiency. A maintenance plan for compressed air systems should include:

- Inspection, cleaning, and replacement of inlet filter cartridges.
- Cleaning of drain traps.
- Daily inspection of lubricant levels to reduce unwanted friction.
- Inspection of belt condition and tension.
- Check for leaks and adjust loose connections.
- Overall system cleaning.
- Reduce pressure setting to minimum needed for air operated equipment.
- Turn off compressor if not routinely needed.
- Use low pressure blower air rather than high pressure compressed air.

Contact a qualified technician for help with setting up periodic maintenance schedule.





Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense® ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense website⁸ or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities" to get ideas for creating a water

management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR or WaterSense products where available.

⁸ https://www.epa.gov/watersense.

⁹ https://www.epa.gov/watersense/watersense-work-0.





You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.





6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has no potential for installing a PV array.

This facility does not appear to meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as sufficient and sustained electric demand and sufficient flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

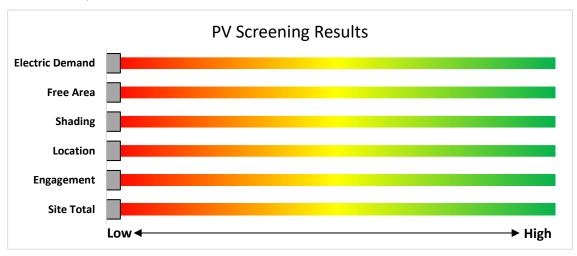


Figure 8 - Photovoltaic Screening





Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners *must* register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

Successor Solar Incentive Program (SuSI): https://www.njcleanenergy.com/renewable-energy/programs/susi-program

- Basic Info on Solar PV in NJ: www.njcleanenergy.com/whysolar
- **NJ Solar Market FAQs**: <u>www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs</u>.
- Approved Solar Installers in the NJ Market: www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1





6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

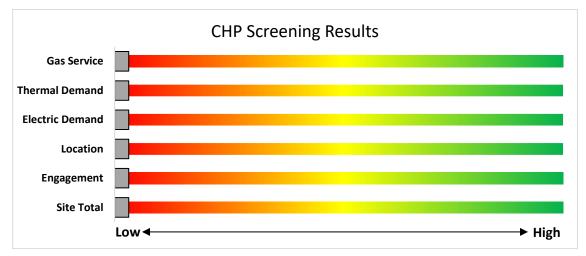


Figure 9 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved vendorsearch/





7 ELECTRIC VEHICLES (EV)

All electric vehicles (EVs) have an electric motor instead of an internal combustion engine. EVs function by plugging into a charge point, taking electricity from the grid, and then storing it in rechargeable batteries. Although electricity production may contribute to air pollution, the U.S. EPA categorizes all-electric vehicles as zero-emission vehicles because they produce no direct exhaust or tailpipe emissions.

EVs are typically more expensive than similar conventional and hybrid vehicles, although some cost can be recovered through fuel savings, federal tax credit, or state incentives.

7.1 Electric Vehicle Charging

EV charging stations provide a means for electric vehicle operators to recharge their batteries at a facility. While many EV drivers charge at home, others do not have access to regular home charging, and the ability to charge at work or in public locations is critical to making EVs practical for more drivers. Charging can also be used for electric fleet vehicles, which can reduce fuel and maintenance costs for fleets that replace gas or diesel vehicles with EVs.

EV charging comes in three main types. For this assessment, the screening considers addition of Level 2 charging, which is most common at workplaces and other public locations. Depending on the site type

and usage, other levels of charging power may be more appropriate.

The preliminary assessment of EV charging at the facility shows that there is no potential for adding EV chargers to the facility's parking, based on potential costs of installation and other site factors.

The primary costs associated with installing EV charging are the charger hardware and the cost to extend power from the facility to parking spaces. This may include upgrades to electric panels to serve increased loads.

The type and size of the parking area impact the costs and feasibility of adding EV charging. Parking structure installations can be less costly than surface lot installations as power may be

readily available, and equipment and wiring can be surface mounted. Parking lot installations often require trenching through concrete or asphalt surface. Large parking areas provide greater flexibility in charger siting than smaller lots.

The location and capacity of facility electric panels also impact charger installation costs. A Level 2 charger generally requires a dedicated 208-240V, 40 Amp circuit. The electric panel nearest the planned installation may not have available capacity and may need to be upgraded to serve new EV charging loads. Alternatively, chargers could be powered from a more distant panel. The distance from the panel to the location of charging stations ties directly to costs, as conduits, cables, and potential trenching costs all increase on a per-foot basis. The more charging stations planned, the more likely it is that additional electrical capacity will be needed.

Other factors to consider when planning for EV charging at a facility include who the intended users are, how long they park vehicles at the site, and whether they will need to pay for the electricity they use.







The graphic below displays the results of the EV charging assessment conducted as part of this audit. The position of each slider indicates the impact each factor has on the feasibility of installing EV charging at the site.

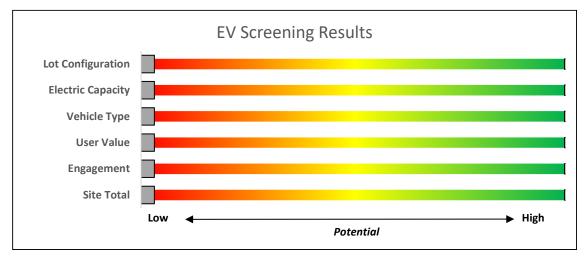


Figure 10 – EV Charger Screening

Electric Vehicle Programs Available

New Jersey is leading the way on electric vehicle (EV) adoption on the East Coast. There are several programs designed to encourage EV adoption in New Jersey, which is crucial to reaching a 100% clean energy future.

NJCEP offers a variety of EV programs for vehicles, charging stations, and fleets. Certain EV charging stations that receive electric utility service from Atlantic City Electric Company (ACE) or Public Service Electric & Gas Company (PSE&G), may be eligible for additional electric vehicle charging incentives directly from the utility. Projects may be eligible for both the incentives offered by this BPU program and incentives offered by ACE or PSE&G, up to 90% of the combined charger purchase and installation costs. Please check ACE or PSE&G program eligibility requirements before purchasing EV charging equipment, as additional conditions on types of eligible chargers may apply for utility incentives.

Both Jersey Central Power & Light (JCP&L) and Rockland Electric (RECO) have filed proposals for EV charging programs. BPU staff is currently reviewing those proposals.

For more information and to keep up to date on all EV programs please visit https://www.njcleanenergy.com/commercial-industrial/programs/electric-vehicle-programs





8 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs and Utility Energy Efficiency Programs can help. Pick the program that works best for you. This section provides an overview of currently available incentive programs in.





Program areas staying with NJCEP:

- New Construction (residential, commercial, industrial, government)
- · Large Energy Users
- · Combined Heat & Power & Fuel Cells
- · State Facilities
- Local Government Energy Audits
- · Energy Savings Improvement Program
- Solar & Community Solar





8.1 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey's investor-owned gas and electric utilities to reduce their customers' use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

Prescriptive and Custom

The Prescriptive and Custom rebate program through your utility provider offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

Equipment Examples

Lighting
Lighting Controls
HVAC Equipment
Refrigeration
Gas Heating
Gas Cooling
Commercial Kitchen Equipment
Food Service Equipment

Variable Frequency Drives
Electronically Commutate Motors
Variable Frequency Drives
Plug Loads Controls
Washers and Dryers
Agricultural
Water Heating

The Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type. The Custom program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives.

Direct Install

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW or less over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls

Incentives

The program pays up to 70% of the total installed cost of eligible measures.

How to Participate

To participate in Direct Install, you will work with a participating contractor. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the Direct Install program, subject to program rules and eligibility, while the remaining percent of the cost is paid to the contractor by the customer.





Engineered Solutions

The Engineered Solutions Program provides tailored energy-efficiency assistance and services to municipalities, universities, schools, hospitals and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. Customers receive expert guided services, including investment-grade energy auditing, engineering design, installation assistance, construction administration, commissioning, and measurement and verification (M&V) services to support the implementation of cost-effective and comprehensive efficiency projects. Engineered Solutions is generally a good option for medium to large sized facilities with a peak demand over 200 kW looking to implement as many measures as possible under a single project to achieve deep energy savings. Engineered Solutions has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Incentives for this program are based on project scope and energy savings achieved.

For more information on any of these programs, contact your local utility provider or visit https://www.njcleanenergy.com/transition.





8.2 New Jersey's Clean Energy Programs

Save money while saving the planet! New Jersey's Clean Energy Program is a statewide program that offers incentives, programs, and services that benefit New Jersey residents, businesses, educational, non-profit, and government entities to help them save energy, money, and the environment.

Large Energy Users

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers that annually contribute at least \$200,000 to the NJCEP aggregate of all buildings/sites. This equates to roughly \$5 million in energy costs in the prior fiscal year.

Incentives

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually

How to Participate

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEEP). Once the FEEP is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at www.njcleanenergy.com/LEUP.





Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

Incentives

Eligible Technologies	Size (Installed Rated Capacity) ¹	Incentive (\$/kW)	% of Total Cost Cap per Project ³	\$ Cap per Project ³
Powered by non- renewable or renewable fuel source ⁴	≤500 kW	\$2,000	30-40% ²	\$2 million
Gas Internal Combustion Engine	>500 kW - 1 MW	\$1,000		
Gas Combustion Turbine	> 1 MW - 3 MW	\$550		
Microturbine Fuel Cells with Heat Recovery	>3 MW	\$350	30%	\$3 million
Waste Heat to	<1 MW	\$1,000	30%	\$2 million
Power*	> 1MW	\$500	50 /6	\$3 million

^{*}Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

How to Participate

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at www.njcleanenergy.com/CHP.





<u>Successor Solar Incentive Program (SuSI)</u>

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two subprograms. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

Administratively Determined Incentive (ADI) Program

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

Market Segments	Size MW dc	Incentive Value (\$/SREC II)	Public Entities Incentive Value - \$20 Adder (\$/SRECII)
Net Metered Residential	All types and sizes	\$90	N/A
Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects smaller than 1 MW	\$100	\$120
Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects 1 MW to 5 MW	\$90	\$110
Small Net Metered Non-Residential Ground Mount	Projects smaller than 1 MW	\$85	\$105
Large Net Metered Non-Residential Ground Mount	Projects 1 MW to 5 MW	\$80	\$100
LMI Community Solar	Up to 5 MW	\$90	N/A
Non-LMI Community Solar	Up to 5 MW	\$70	N/A
Interim Subsection (t)	All types and sizes	\$100	N/A

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations.

Competitive Solar Incentive Program

The Competitive Solar Incentive (CSI) Program will provide competitively set incentives for grid supply projects and net metered non-residential projects greater than 5MW (dc). The program is currently under development. For updates, please continue to check the <u>Solar Proceedings</u> page on the New Jersey's Clean Energy Program website.

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state's Energy Master

If you are considering installing solar photovoltaics on your building, visit the following link for more information: https://njcleanenergy.com/renewable-energy/programs/susi-program.





Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter into contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.





9 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

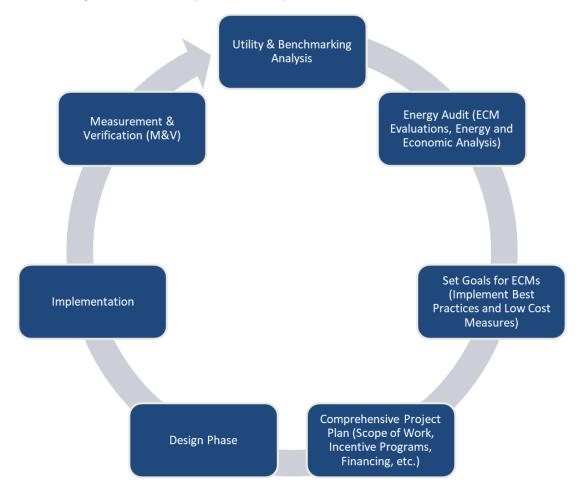


Figure 11 - Project Development Cycle





10 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

10.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website¹⁰.

10.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website¹¹.

¹⁰ www.state.nj.us/bpu/commercial/shopping.html.

¹¹ www.state.nj.us/bpu/commercial/shopping.html.





APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

		ecommendations g Conditions					Prop	osed Conditio	ns						Energy_li	mpact & F	inancial A	nalvsis _			
Location	Fixture Quantit y	Fixture Description	Control System	Light Level	Watts per Fixtur e	Annual Operatin g Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantit Y	Fixture Description	Control System	Watts per Fixtur e	Annual Operatin g Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Art & Engineering Lab 153	5	Incandescent: (1) 90W PAR30 Screw-In Lamp	Wall Switch	S	90	2,575	3, 4	Relamp	Yes	5	LED Lamps: PAR30 Lamps	Occupanc y Sensor	14	1,777	0.3	1,138	0	\$149	\$386	\$50	2.3
Art & Engineering Lab 153	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.2	667	0	\$87	\$705	\$95	7.0
Classroom 137	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,575	3, 4	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupanc y Sensor	44	1,777	0.4	1,427	0	\$187	\$708	\$155	3.0
Classroom 141	6	Incandescent: (1) 90W PAR30 Screw-In Lamp	Wall Switch	S	90	2,575	3, 4	Relamp	Yes	6	LED Lamps: PAR30 Lamps	Occupanc y Sensor	14	1,777	0.3	1,365	0	\$179	\$409	\$53	2.0
Classroom 141	4	LED Lamps: (1) 10W BR40 Screw- In Lamp	Wall Switch	S	10	2,575	4	None	Yes	4	LED Lamps: (1) 10W BR40 Screw- In Lamp	Occupanc y Sensor	10	1,777	0.0	35	0	\$5	\$0	\$0	0.0
Classroom 141	6	LED Lamps: (1) 12W PAR30 Screw- In Lamp	- Wall Switch	S	12	2,575	4	None	Yes	6	LED Lamps: (1) 12W PAR30 Screw- In Lamp	Occupanc y Sensor	12	1,777	0.0	63	0	\$8	\$0	\$0	0.0
Classroom 141	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,575	3, 4	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupanc y Sensor	44	1,777	0.4	1,427	0	\$187	\$708	\$155	3.0
Classroom BC140A	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.3	1,189	0	\$156	\$635	\$135	3.2
Classroom BC142A	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.2	951	0	\$125	\$562	\$115	3.6
Computer Lab 138	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	None	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	None	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Computer Lab 142	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Computer Lab 142	10	LED - Fixtures: Ambient 2x4 Fixture	Wall Switch	S	30	2,575	4	None	Yes	10	LED - Fixtures: Ambient 2x4 Fixture	Occupanc y Sensor	30	1,777	0.1	263	0	\$35	\$270	\$35	6.8
Corridor Setshop	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor Setshop	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,380	3, 5	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,022	0.1	607	0	\$79	\$335	\$135	2.5
Corridor Setshop	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,380	3, 5	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,022	0.3	2,023	0	\$265	\$815	\$450	1.4
Corridor Setshop	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	None	S	62	4,380	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	None	29	4,380	0.0	159	0	\$21	\$37	\$10	1.3
Corridor Setshop	1	Linear Fluores cent - T8: 4' T8 (32W) - 4L	None	S	114	4,380	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	None	58	4,380	0.0	270	0	\$35	\$73	\$20	1.5
Electrical Control Room 145	2	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	345	0.1	46	0	\$6	\$189	\$40	24.6
Electrical Room 116A	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	18	0	\$2	\$37	\$10	11.2
Electrical Room 118	2	Linear Fluorescent - EST12: 4' T12 (34W) - 2L	Wall Switch	S	72	500	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	345	0.1	57	0	\$7	\$254	\$40	28.5
Elevator 114	1	Linear Fluorescent - T12: 3' T12 (30W) - 4L	Wall Switch	S	158	500	2	Relamp & Reballast	No	1	LED - Linear Tubes: (4) 3' Lamps	Wall Switch	42	500	0.1	64	0	\$8	\$118	\$20	11.8
Exterior 3	1	Biaxial Plug-In Lamps	Timeclock		52	4,380	3	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Timeclock	37	4,380	0.0	66	0	\$9	\$25	\$2	2.6
Exterior 3	4	Compact Fluorescent: (1) 42W Biaxial Plug-In Lamp	Photocell		42	4,380	3	Relamp	No	4	LED Lamps: PL-L (Biax) Lamps	Photocell	30	4,380	0.0	210	0	\$28	\$54	\$4	1.8
Exterior 3	3	. ,	Photocell		128	4,380	1	Fixture Replacement	No	3	LED - Fixtures: Outdoor Wall- Mounted Area Fixture	Photocell	30	4,380	0.0	1,288	0	\$171	\$788	\$150	3.7
Green Rm	3	U-Bend Fluores cent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	333	0	\$44	\$487	\$65	9.7





	Existin	g Conditions					Prop	osed Conditio	ns						Energy li	mpact & F	inancial <i>i</i>	Analysis			
Location	Fixture Quantit y	Fixture Description	Control System	Light Level	Watts per Fixtur e	Annual Operatin g Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantit y	Fixture Description	Control System	Watts per Fixtur e	Annual Operatin g Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Green Rm	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	None	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	None	33	2,575	0.0	82	0	\$11	\$72	\$10	5.8
Janitorial 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	None	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	None	29	500	0.0	18	0	\$2	\$37	\$10	11.2
Janitorial 2	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	18	0	\$2	\$37	\$10	11.2
Lobby 1	1	Compact Fluorescent: (2) 18W Biaxial Plug-In Lamps	None	S	36	4,380	3	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	None	26	4,380	0.0	48	0	\$6	\$25	\$2	3.6
Lobby BC142A	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,380	3, 5	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,022	0.1	405	0	\$53	\$298	\$90	3.9
Main Lobby	12	Compact Fluorescent: (2) 18W Biaxial Plug-In Lamps	Wall Switch	S	36	4,380	3, 5	Relamp	Yes	12	LED Lamps: GX23 (Plug-In) Lamps	High/Low Control	26	3,022	0.2	1,044	0	\$137	\$750	\$444	2.2
Main Lobby	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Main Lobby	1	Linear Fluorescent - T8: 2' T8 (17W) - 1L	None	S	22	4,380	3	Relamp	No	1	LED - Linear Tubes: (1) 2' Lamp	None	9	4,380	0.0	65	0	\$9	\$16	\$3	1.6
Main Lobby	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Photocell	S	33	4,380	3	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Photocell	17	4,380	0.0	77	0	\$10	\$33	\$6	2.6
Main Lobby	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	None	S	32	4,380	3	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	None	15	4,380	0.0	84	0	\$11	\$18	\$5	1.2
Main Lobby	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Photocell	S	62	4,380	3	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Photocell	29	4,380	0.1	636	0	\$83	\$146	\$40	1.3
Main Lobby	8	Linear Fluorescent - T8: 8' T8 (59W) - 1L	None	S	58	4,380	3, 5	Relamp	Yes	8	LED - Linear Tubes: (1) 8' Lamp	High/Low Control	36	3,022	0.2	1,278	0	\$167	\$804	\$360	2.7
Main Lobby	9	Linear Fluorescent - T8: 8' T8 (59W) - 2L	Photocell	S	110	4,380	3	Relamp	No	9	LED - Linear Tubes: (2) 8' Lamps	Photocell	72	4,380	0.2	1,648	0	\$216	\$797	\$180	2.9
Main Lobby	2	Linear Fluorescent - T8: 8' T8 (59W) - 2L	None	S	110	4,380	3, 5	Relamp	Yes	2	LED - Linear Tubes: (2) 8' Lamps	High/Low Control	72	3,022	0.1	581	0	\$76	\$402	\$110	3.8
Mechanical 101	6	Linear Fluores cent - EST12: 4' T12 (34W) - 2L	Wall Switch	S	72	500	2, 4	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	345	0.2	172	0	\$22	\$683	\$95	26.2
Mechanical 108	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	345	0.1	46	0	\$6	\$189	\$40	24.6
Men's Dressing Rm	23	LED Lamps: (1) 8.5W A19 Screw- In Lamp	Wall Switch	S	9	2,575	4	None	Yes	23	LED Lamps: (1) 8.5W A19 Screw-In Lamp	Occupanc y Sensor	9	1,777	0.0	172	0	\$22	\$540	\$70	20.9
Men's Dressing Rm	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	333	0	\$44	\$487	\$65	9.7
Men's Dressing Rm	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	None	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	None	33	2,575	0.0	82	0	\$11	\$72	\$10	5.8
Office - BC113	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Office - Enclosed 140B	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 147	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 148	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 149	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 150	2	U-Bend Fluores cent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6





	Existin	g Conditions					Prop	osed Condition	ons						Energy In	mpact & F	inancial A	Analysis			
Location	Fixture Quantit Y	Fixture Description	Control System	Light Level	Watts per Fixtur e	Annual Operatin g Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantit y	Fixture Description	Control System	Watts per Fixtur e	Annual Operatin g Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - Enclosed 151	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 152	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 154	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 155	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 155	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 156	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed BC140	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Setshop	2	Compact Fluores cent: (2) 26W Biaxial Plug-In Lamps	Wall Switch	S	52	2,575	3, 4	Relamp	Yes	2	LED Lamps: GX23 (Plug-In) Lamps	Occupanc y Sensor	37	1,777	0.0	150	0	\$20	\$166	\$24	7.2
Office Corridor	5	Compact Fluorescent: (2) 18W Biaxial Plug-In Lamps	None	S	36	2,575	3, 4	Relamp	Yes	5	LED Lamps: GX23 (Plug-In) Lamps	Occupanc y Sensor	26	1,777	0.1	256	0	\$33	\$395	\$45	10.4
Office Corridor	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Office Corridor	9	Linear Fluores cent - T8: 4' T8 (32W) - 1L	None	S	32	2,575	3, 4	Relamp	Yes	9	LED - Linear Tubes: (1) 4' Lamp	Occupanc y Sensor	15	1,777	0.1	561	0	\$73	\$434	\$80	4.8
Restroom - Female 1	4	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	476	0	\$62	\$416	\$75	5.5
Restroom - Female 1	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	333	0	\$44	\$487	\$65	9.7
Restroom - Female 1	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	2,575	0.0	82	0	\$11	\$72	\$10	5.8
Restroom - Female Dressing Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Restroom - Male 1	4	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	476	0	\$62	\$416	\$75	5.5
Restroom - Male 1	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	333	0	\$44	\$487	\$65	9.7
Restroom - Male 1	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	2,575	0.0	82	0	\$11	\$72	\$10	5.8
Restroom - Mens Dressing	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Setshop	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Setshop	9	Metal Halide: (1) 250W Lamp	Wall Switch	S	295	2,575	3, 4	Relamp	Yes	9	LED Lamps - E39: ≤125 W Lamp	Occupanc y Sensor	75	1,777	1.6	6,201	-1	\$812	\$2,412	\$485	2.4
Storage - 139	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	None	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	None	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Storage 116B	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Storage 136A	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Storage 140C	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$20	8.3





	Existin	g Conditions					Prop	osed Conditio	ns						Energy li	mpact & F	inancial <i>A</i>	Analysis			
Location	Fixture Quantit Y	Fixture Description	Control System	Light Level	Watts per Fixtur e	Annual Operatin g Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantit y	Fixture Description	Control System	Watts per Fixtur e	Annual Operatin g Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Storage 15	1	Linear Fluorescent - EST12: 4' T12 (34W) - 2L	None	S	72	2,575	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	None	29	2,575	0.0	122	0	\$16	\$69	\$10	3.7
Storage 331	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	None	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	None	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Storage Pump Rm 145	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Storage Pump Rm 145	7	Linear Fluores cent - T12: 4' T12 (60W) - 2L	Wall Switch	S	120	2,575	2, 4	Relamp & Reballast	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.5	1,983	0	\$260	\$751	\$70	2.6
Storage Pump Rm 145	2	Linear Fluores cent - T12: 4' T12 (60W) - 2L	Wall Switch	S	120	2,575	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	566	0	\$74	\$254	\$20	3.1
Theater Stage	5	Compact Fluorescent: (1) 32W Biaxial Plug-In Lamp	Wall Switch	S	32	2,575	3, 4	Relamp	Yes	5	LED Lamps: GX23 (Plug-In) Lamps	Occupanc y Sensor	23	1,777	0.1	228	0	\$30	\$333	\$40	9.8
Theater Stage	8	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	8	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Theater Stage	177	Incandes cent: (1) 750W Screw-in Lamps	Wall Switch	S	750	500		None	No	177	Incandescent: (1) 750W Screw-in Lamps	Wall Switch	750	500	0.0	0	0	\$0	\$0	\$0	0.0
Theater Stage	43	Incandes cent: (1) 25W A19 Screw-In Lamp	Wall Switch	S	25	2,575	3, 4	Relamp	Yes	43	LED Lamps: A19 Lamps	Occupanc y Sensor	4	1,777	0.7	2,709	-1	\$355	\$1,551	\$148	4.0
Theater Stage	192	Incandes cent: (1) 25W A19 Screw-In Lamp	Wall Switch	S	25	2,575	3, 4	Relamp	Yes	192	LED Lamps: A19 Lamps	Occupanc y Sensor	4	1,777	3.1	12,095	-3	\$1,584	\$6,817	\$647	3.9
Theater Stage	28	Incandes cent: (1) 43W A19 Screw-In Lamp	Wall Switch	S	43	2,575	3, 4	Relamp	Yes	28	LED Lamps: A19 Lamps	Occupanc y Sensor	7	1,777	0.8	3,027	-1	\$396	\$1,022	\$98	2.3
Theater Stage	9	Incandescent: (1) 75W BR40 Screw-In Lamp	Wall Switch	S	75	2,575	3, 4	Relamp	Yes	9	LED Lamps: BR40 Lamps	Occupanc y Sensor	12	1,777	0.4	1,701	0	\$223	\$502	\$62	2.0
Theater Stage	23	LED Lamps: (1) 90W LED Screw-In Lamp	Wall Switch	S	90	2,575	4	None	Yes	23	LED Lamps: (1) 90W LED Screw-In Lamp	Occupanc y Sensor	90	1,777	0.5	1,818	0	\$238	\$540	\$70	2.0
Theater Stage	48	LED Lamps: (1) 12W BR30 Screw- In Lamp	Wall Switch	S	12	2,575	4	None	Yes	48	LED Lamps: (1) 12W BR30 Screw- In Lamp	Occupanc y Sensor	12	1,777	0.1	506	0	\$66	\$1,080	\$140	14.2
Theater Stage	2	LED Lamps: (1) 12W BR40 Screw- In Lamp	Wall Switch	S	12	2,575	4	None	Yes	2	LED Lamps: (1) 12W BR40 Screw- In Lamp	Occupanc y Sensor	12	1,777	0.0	21	0	\$3	\$116	\$20	34.8
Theater Stage	11	LED Lamps: (1) 18W Corn Bulb Screw-In Lamp	Wall Switch	S	18	2,575	4	None	Yes	11	LED Lamps: (1) 18W Corn Bulb Screw-In Lamp	Occupanc y Sensor	18	1,777	0.0	174	0	\$23	\$270	\$35	10.3
Theater Stage	12	LED Lamps: (1) 27W Corn Bulb Screw-In Lamp	Wall Switch	S	27	2,575	4	None	Yes	12	LED Lamps: (1) 27W Corn Bulb Screw-In Lamp	Occupanc y Sensor	27	1,777	0.1	284	0	\$37	\$270	\$35	6.3
Theater Stage	24	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	24	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.7	2,854	-1	\$374	\$1,416	\$310	3.0
Women's Dressing Rm	23	LED Lamps: (1) 8.5W A19 Screw- In Lamp	Wall Switch	S	9	2,575	4	None	Yes	23	LED Lamps: (1) 8.5W A19 Screw-In Lamp	Occupanc y Sensor	9	1,777	0.0	172	0	\$22	\$540	\$70	20.9
Women's Dressing Rm	63	LED Lamps: (1) 8.5W A19 Screw- In Lamp	Wall Switch	S	9	2,575	4	None	Yes	63	LED Lamps: (1) 8.5W A19 Screw-In Lamp	Occupanc y Sensor	9	1,777	0.1	470	0	\$62	\$1,350	\$175	19.1
Women's Dressing Rm	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.2	667	0	\$87	\$705	\$95	7.0
Women's Dressing Rm	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	None	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	None	33	2,575	0.0	82	0	\$11	\$72	\$10	5.8
Workshop 135 Film Processing	12	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.4	1,427	0	\$187	\$708	\$155	3.0
216 Rehearsal Rm	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
216 Rehearsal Rm	84	LED Lamps: (1) 9W BR30 Screw- In Lamp	Wall Switch	S	9	2,575	4	None	Yes	84	LED Lamps: (1) 9W BR30 Screw-In Lamp	Occupanc y Sensor	9	1,777	0.2	664	0	\$87	\$1,620	\$210	16.2





	Existin	g Conditions					Prop	osed Conditio	ns						Energy I	mpact & F	inancial <i>A</i>	nalysis			
Location	Fixture Quantit Y	Fixture Description	Control System	Light Level	Watts per Fixtur e	Annual Operatin g Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantit y	Fixture Description	Control System	Watts per Fixtur e	Annual Operatin g Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
216 Rehearsal Rm	13	Metal Halide: (1) 250W Lamp	Wall Switch	S	295	2,575	3, 4	Relamp	Yes	13	LED Lamps - E39: ≤125 W Lamp	Occupanc y Sensor	75	1,777	2.3	8,957	-2	\$1,173	\$3,364	\$685	2.3
218 Art Gallery	18	Compact Fluorescent: (1) 42W Biaxial Plug-In Lamp	Wall Switch	S	42	2,575	3, 4	Relamp	Yes	18	LED Lamps: PL-L (Biax) Lamps	Occupanc y Sensor	30	1,777	0.3	1,086	0	\$142	\$783	\$88	4.9
218 Art Gallery	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
218 Art Gallery	19	LED Lamps: (1) 18.5W PAR38 Screw-In Lamp	Wall Switch	S	19	2,575	4	None	Yes	19	LED Lamps: (1) 18.5W PAR38 Screw-In Lamp	Occupanc y Sensor	19	1,777	0.1	309	0	\$40	\$540	\$70	11.6
220 Art Gallery	16	Compact Fluorescent: (2) 26W Biaxial Plug-In Lamps	Wall Switch	S	52	2,575	3, 4	Relamp	Yes	16	LED Lamps: GX23 (Plug-In) Lamps	Occupanc y Sensor	37	1,777	0.3	1,200	0	\$157	\$940	\$102	5.3
220 Art Gallery	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
220 Art Gallery	20	Incandes cent: (1) 50W R16 Screw-In Lamp	Wall Switch	S	50	2,575	3, 4	Relamp	Yes	20	LED Lamps: R16 Lamps	Occupanc y Sensor	8	1,777	0.6	2,520	-1	\$330	\$940	\$110	2.5
Classroom 224	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 224	13	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,575	3, 4	Relamp	Yes	13	LED - Linear Tubes: (3) 4' Lamps	Occupanc y Sensor	44	1,777	0.6	2,319	0	\$304	\$982	\$230	2.5
Conference 239	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	444	0	\$58	\$560	\$75	8.3
Dressing Rm	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Electrical Room 226	6	Linear Fluorescent - T12: 4' T12 (60W) - 2L	Wall Switch	S	120	500	2, 4	Relamp & Reballast	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	345	0.4	330	0	\$43	\$683	\$95	13.6
Mechanical 227	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 227	3	Linear Fluorescent - T12: 4' T12 (60W) - 2L	Wall Switch	S	120	500	2, 4	Relamp & Reballast	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	345	0.2	165	0	\$22	\$476	\$65	19.0
Mechanical 227	2	Linear Fluorescent - T12: 4' T12 (60W) - 2L	Wall Switch	S	120	500	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	345	0.1	110	0	\$14	\$254	\$40	14.8
Office - Enclosed 230	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	444	0	\$58	\$560	\$75	8.3
Office - Enclosed 231	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	444	0	\$58	\$560	\$75	8.3
Office - Enclosed 232	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	444	0	\$58	\$560	\$75	8.3
Office - Enclosed 233	4	U-Bend Fluores cent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	444	0	\$58	\$560	\$75	8.3
Office - Enclosed 234	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	444	0	\$58	\$560	\$75	8.3
Office - Enclosed 236	2	U-Bend Fluores cent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 236	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 237	4	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	444	0	\$58	\$560	\$75	8.3
Office - Enclosed 238	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office Corridor 3	9	Compact Fluorescent: (2) 18W Biaxial Plug-In Lamps	None	S	36	2,575	3, 4	Relamp	Yes	9	LED Lamps: GX23 (Plug-In) Lamps	Occupanc y Sensor	26	1,777	0.1	460	0	\$60	\$495	\$53	7.3





	Existin	g Conditions					Prop	osed Conditio	ns						Energy I	mpact & F	inancial <i>i</i>	Analysis			
Location	Fixture Quantit Y	Fixture Description	Control System	Light Level	Watts per Fixtur e	Annual Operatin g Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantit y	Fixture Description	Control System	Watts per Fixtur e	Annual Operatin g Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office Corridor 3	7	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	7	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Office Corridor 3	5	Linear Fluores cent - T8: 1' T8 (10W) - 1L	None	S	10	2,575		None	No	5	Linear Fluorescent - T8: 1' T8 (10W) - 1L	None	10	2,575	0.0	0	0	\$0	\$0	\$0	0.0
Office Corridor 3	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	None	S	32	2,575	3	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	None	15	2,575	0.0	50	0	\$6	\$18	\$5	2.0
Office Corridor 3	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	None	S	32	2,575	3	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	None	15	2,575	0.0	50	0	\$6	\$18	\$5	2.0
Office Corridor 3	8	Linear Fluorescent - T8: 8' T8 (59W) - 1L	None	S	58	2,575	3, 4	Relamp	Yes	8	LED - Linear Tubes: (1) 8' Lamp	Occupanc y Sensor	36	1,777	0.2	751	0	\$98	\$624	\$115	5.2
Restroom - Female 3	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Restroom - Female 3	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	238	0	\$31	\$189	\$40	4.8
Restroom - Female 3	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$415	\$55	12.4
Restroom - Male 3	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Restroom - Male 3	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$415	\$55	12.4
Restroom - Male 3	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	None	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	None	33	2,575	0.0	82	0	\$11	\$72	\$10	5.8
Storage 17	2	Linear Fluorescent - EST12: 4' T12 (34W) - 2L	Wall Switch	S	72	2,575	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	295	0	\$39	\$254	\$20	6.1
Storage 203	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	357	0	\$47	\$380	\$30	7.5
Storage 208A	1	Linear Fluores cent - EST12: 4' T12 (34W) - 2L	Wall Switch	S	72	2,575	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	122	0	\$16	\$69	\$10	3.7
Storage 225	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,575	3	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,575	0.0	140	0	\$18	\$55	\$15	2.2
Storage Gallery	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,575	3, 4	Relamp	Yes	8	LED - Linear Tubes: (3) 4' Lamps	Occupanc y Sensor	44	1,777	0.4	1,427	0	\$187	\$708	\$120	3.1
Theater 206	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Theater 206	20	Incandes cent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	2,575	3, 4	Relamp	Yes	20	LED Lamps: A19 Lamps	Occupanc y Sensor	9	1,777	0.8	3,047	-1	\$399	\$885	\$90	2.0
Theater 206	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.5	2,141	0	\$280	\$1,197	\$250	3.4
Wardrobe 203	9	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,575	3, 4	Relamp	Yes	9	LED - Linear Tubes: (3) 4' Lamps	Occupanc y Sensor	44	1,777	0.4	1,606	0	\$210	\$763	\$170	2.8
Wardrobe 203	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	2,575	0.0	82	0	\$11	\$72	\$10	5.8
Classroom 301	1	Compact Fluorescent: (2) 26W Biaxial Plug-In Lamps	Wall Switch	S	52	2,575	3, 4	Relamp	Yes	1	LED Lamps: GX23 (Plug-In) Lamps	Occupanc y Sensor	37	1,777	0.0	75	0	\$10	\$295	\$37	26.3
Classroom 301	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 301	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.0	119	0	\$16	\$37	\$10	1.7
Classroom 301	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.0	119	0	\$16	\$37	\$10	1.7





	Existin	g Conditions					Prop	osed Conditio	ns						Energy I	mpact & F	inancial A	nalysis			
Location	Fixture Quantit Y	Fixture Description	Control System	Light Level	Watts per Fixtur e	Annual Operatin g Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantit y	Fixture Description	Control System	Watts per Fixtur e	Annual Operatin g Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 308	1	Compact Fluorescent: (2) 18W Biaxial Plug-In Lamps	Wall Switch	S	36	2,575	3, 4	Relamp	Yes	1	LED Lamps: GX23 (Plug-In) Lamps	Occupanc y Sensor	26	1,777	0.0	51	0	\$7	\$25	\$2	3.4
Classroom 308	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.0	119	0	\$16	\$37	\$10	1.7
Classroom 308	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.0	119	0	\$16	\$307	\$45	16.8
Classroom 315	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 315	7	LED Lamps: (1) 17W PAR30 Screw- In Lamp	Wall Switch	S	17	2,575	4	None	Yes	7	LED Lamps: (1) 17W PAR30 Screw- In Lamp	y Sensor	17	1,777	0.0	104	0	\$14	\$270	\$35	17.2
Classroom 315	20	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	20	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.6	2,379	0	\$312	\$1,270	\$270	3.2
Classroom 315	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Classroom 317	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 317	1	LED Lamps: (1) 17W PAR30 Screw- In Lamp	Wall Switch	S	17	2,575	4	None	Yes	1	LED Lamps: (1) 17W PAR30 Screw- In Lamp	y Sensor	17	1,777	0.0	15	0	\$2	\$0	\$0	0.0
Classroom 317	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.0	119	0	\$16	\$37	\$10	1.7
Classroom 317	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	238	0	\$31	\$343	\$55	9.2
Corridor 1	1	Compact Fluorescent: (2) 18W Biaxial Plug-In Lamps	Wall Switch	S	36	4,380	3	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Wall Switch	26	4,380	0.0	48	0	\$6	\$25	\$2	3.6
Corridor 1	2	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Photocell	S	26	4,380	3	Relamp	No	2	LED Lamps: GX23 (Plug-In) Lamps	Photocell	19	4,380	0.0	67	0	\$9	\$25	\$2	2.6
Corridor 1	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	4,380	3	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	4,380	0.0	84	0	\$11	\$18	\$5	1.2
Corridor 1	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,380	3, 5	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,022	0.1	607	0	\$79	\$335	\$135	2.5
305 Control Rm	4	Compact Fluorescent: (2) 18W Biaxial Plug-In Lamps	Wall Switch	S	36	500	3, 4	Relamp	Yes	4	LED Lamps: GX23 (Plug-In) Lamps	Occupanc y Sensor	26	345	0.1	40	0	\$5	\$370	\$43	62.8
Electrical Room 320	2	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	345	0.1	46	0	\$6	\$189	\$40	24.6
Office - Enclosed 321	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 322	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 323	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 324	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 325	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 326	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6
Office - Enclosed 327	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupanc y Sensor	33	1,777	0.1	222	0	\$29	\$261	\$40	7.6





7 111																					program™
	Existin	g Conditions					Prop	osed Condition	ons						Energy In	mpact & F	inancial <i>i</i>	Analysis			
Location	Fixture Quantit Y	Fixture Description	Control System	Light Level	Watts per Fixtur e	Annual Operatin g Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantit Y	Fixture Description	Control System	Watts per Fixtur e	Annual Operatin g Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - Enclosed 329	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	357	0	\$47	\$380	\$65	6.7
Office - Enclosed 329	1	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Restroom - Unisex 1	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	2,575	0.0	82	0	\$11	\$72	\$10	5.8
Restroom - Unisex 2	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	2,575	0.0	82	0	\$11	\$72	\$10	5.8
Storage 307	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	2,575	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	167	0	\$22	\$69	\$10	2.7
Storage 309	4	Linear Fluorescent - EST12: 4' T12 (34W) - 2L	Wall Switch	S	72	2,575	2, 4	Relamp & Reballast	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	589	0	\$77	\$545	\$40	6.5
Storage 310	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	238	0	\$31	\$189	\$20	5.4
Storage 311	2	Linear Fluores cent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	238	0	\$31	\$189	\$20	5.4
Storage 312	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupanc y Sensor	29	1,777	0.1	238	0	\$31	\$189	\$20	5.4
Storage 314	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Storage 317	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Storage 328	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,575	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	93	0	\$12	\$37	\$10	2.2
Storage 6	1	Linear Fluorescent - EST12: 4' T12 (34W) - 2L	Wall Switch	S	72	2,575	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,575	0.0	122	0	\$16	\$69	\$10	3.7
Stairs 1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs 1	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	None		62	8,760	3, 5	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,044	0.2	2,428	-1	\$318	\$444	\$270	0.5
Stairs 2	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	None		62	8,760	3, 5	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,044	0.2	2,023	0	\$265	\$408	\$225	0.7





Motor Inventory & Recommendations

iviotor inventory			g Conditions								Prop	osed Co	ndition	S		Energy Im	pact & Fir	nancial An	alysis			
Location	Area(s)/System(s) Served	Motor Quantit y	Motor Application	HP Per Motor	Etticienc	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficienc y Motors?	Full Load Efficiency	Install VFDs?		Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical 101	Berie Center	1	Air Compressor	7.5	85.5%	No	Baldor	M3311T-CH	w	500		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior A	Berie Center	1	Exhaust Fan	0.3	65.0%	No	ACME	PV100E4	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior A	Berie Center	1	Exhaust Fan	2.0	86.5%	No	ACME	PNN245	W	5,500		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior B	Berie Center	1	Exhaust Fan	2.0	86.5%	No	ACME	PNN246	W	5,500		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior B	Berie Center	1	Exhaust Fan	0.5	78.0%	No	ACME	PV165	w	5,500		No	78.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior B	Berie Center	1	Exhaust Fan	0.5	78.0%	No	ACME	PNN135	w	5,500		No	78.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior B	Berie Center	1	Exhaust Fan	5.0	89.5%	No	Unkown	Unkown	w	5,500		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior B	Berie Center	1	Exhaust Fan	25.0	93.6%	No	Unkown	Unkown	W	5,500		No	93.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 101	Berie Center	1	DHW Circulation Pump	0.3	70.0%	No	Bell & Gosset	EQF 56A17D57F P	W	8,760		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Elevator 114	Berie Center	1	Other	30.0	74.0%	No	US Motors	B07-H12686-M	W	200		No	74.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Setshop	Berie Center	1	Other	0.5	78.0%	No	Unknown	Unkown	W	180		No	78.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Storage Pump Rm 145	Berie Center	2	Process Pump	7.5	91.0%	No	Boulay Fabrication, Inc.	Unkown	W	360		No	91.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Corridor Setshop	Berie Center	1	Supply Fan	0.8	81.0%	No	Dynaforce	ESH-96	W	5,500		No	81.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior 3	Berie Center	1	Supply Fan	30.0	93.6%	No	Super-E	EM2535T	В	5,500	6	No	94.1%	Yes	1	8.6	49,787	0	\$6,626	\$14,881	\$1,500	2.0
Exterior 3	Berie Center	1	Return Fan	15.0	92.4%	No	Super-E	EM2513T	В	5,500	6	No	93.0%	Yes	1	4.5	25,268	0	\$3,363	\$9,177	\$1,200	2.4
Exterior A	Berie Center	1	Supply Fan	15.0	92.4%	No	York	ZF300N40R5C1A AA1A2	W	5,500	6	No	93.0%	Yes	1	4.3	25,268	0	\$3,363	\$9,177	\$1,200	2.4
Exterior A	Berie Center	1	Exhaust Fan	0.8	86.5%	No	York	ZF300N40R5C1A AA1A2	w	5,500	6	No	86.5%	Yes	1	0.2	1,334	0	\$178	\$3,308	\$50	18.4
Exterior A	Berie Center	1	Supply Fan	5.0	87.5%	No	United Technologies Carrier	50HJ-017 660QA	В	5,500	6	No	89.5%	Yes	1	1.5	9,146	0	\$1,217	\$5,028	\$900	3.4
Exterior A	Berie Center	1	Supply Fan	3.7	86.0%	No	Carrier	48TJF016	В	5,500	6	No	89.5%	Yes	1	1.1	7,086	0	\$943	\$4,720	\$200	4.8
Exterior B	Berie Center	1	Supply Fan	10.0	91.7%	No	Carrier	48TJF028	W	5,500	6	No	91.7%	Yes	1	2.9	16,779	0	\$2,233	\$6,697	\$1,100	2.5





		Existin	g Conditions								Prop	osed C	ondition	S		Energy In	npact & Fi	nancial Ar	nalysis			
Location	Area(s)/System(s) Served	Motor Quantit Y	Motor Application	HP Per Motor	Full Load Efficienc Y	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficience y Motors?				Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings		Total Incentives	Simple Payback w/ Incentives in Years
Exterior B	Berie Center	1	Supply Fan	7.5	91.0%	No	York	ZF240N40R4C1A AA1A1	W	5,500	6	No	91.0%	Yes	1	2.1	12,681	0	\$1,688	\$5,945	\$1,000	2.9
Exterior B	Berie Center	1	Supply Fan	0.8	81.0%	No	York	ZF240N40R4C1A AA1A1	W	5,500		No	81.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior B	Berie Center	1	Supply Fan	7.5	91.0%	No	Carrier	48TJF024	W	5,500	6	No	91.0%	Yes	1	2.1	12,681	0	\$1,688	\$5,945	\$1,000	2.9
Exterior B	Berie Center	1	Supply Fan	7.5	91.0%	No	Carrier	48TJF024	W	5,500	6	No	91.0%	Yes	1	2.1	12,681	0	\$1,688	\$5,945	\$1,000	2.9
Eletrical Room 320	Berie Center	1	Supply Fan	0.1	65.0%	No	Goodman MFG	PTH123B35AMB P	W	5,500		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Supply Fan	5.0	89.0%	No	York	ZXG06E4C1AA1A 111A1	W	5,500	6	No	89.5%	Yes	1	1.4	8,731	0	\$1,162	\$5,028	\$900	3.6
Berrie Center	Berrie Center	1	Exhaust Fan	0.5	78.0%	No	York	ZXG06E4C1AA1A 111A1	W	5,500	6	No	78.2%	Yes	1	0.1	899	0	\$120	\$3,136	\$50	25.8
Berrie Center	Berrie Center	2	Supply Fan	1.5	86.0%	No	York	ZQG04E4C1AA1 A111A2	W	5,500		No	86.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	2	Exhaust Fan	0.3	69.0%	No	York	ZQG04E4C1AA1 A111A2	W	5,500		No	69.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Supply Fan	4.4	89.0%	No	York	ZXG12E4C3AA1A 111A2	W	5,500	6	No	89.5%	Yes	1	1.3	7,683	0	\$1,023	\$4,886	\$300	4.5
Berrie Center	Berrie Center	2	Exhaust Fan	0.3	69.0%	No	York	ZXG12E4C3AA1A 111A2	W	5,500	6	No	69.5%	Yes	2	0.2	908	0	\$121	\$5,977	\$100	48.6
Berrie Center	Berrie Center	1	Supply Fan	1.0	85.0%	No	Carrier	48TJE005 601AA	В	5,500		No	85.0%	No		0.0	0	0	\$0	\$0	\$0	0.0





Packaged HVAC Inventory & Recommendations

- autraged 1117	ic inventory &	Existing Conditions									Prop	osed Co	nditio	าร					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantit y	System Type	Cooling Capacit y per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/ EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficienc y System?	System Quantit y	System Type	Cooling Capacit y per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/ EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings		Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Berrie Center	Berrie Center	2	Electric Resistance Heat		1.20		1 COP	Dayton	30G56D	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Electric Resistance Heat		10.20		1 COP	Marley	C2544WC	w		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	2	Electric Resistance Heat		2.50		1 COP	Marley	Unknown	w		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Ductless Mini-Split HP	4.00	54.60	13.00	1.9929660 0234467 COP	Samsung	ULM40CAV	В	8	Yes	1	Ductless Mini-Split HP	4.00	54.60	18.00	3.8 COP	2.7	4,793	0	\$638	\$7,954	\$0	12.5
Berrie Center	Berrie Center	2	Packaged Terminal HP	1.00	10.80	10.80	3 COP	Goodman	PTH123B35AMB P	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Package Unit	5.00	89.60	12.10	0.8 AFUE	York	ZXG06E4C1AA1A 111A1	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Package Unit	3.00	89.60	12.20	0.8 AFUE	York	ZQG04E4C1AA1 A111A2	w		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Package Unit	25.00	320.00	10.00	0.8 Et	York	ZF300N40R4C1A AA1A2	w		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Package Unit	15.00	187.66	8.50	1 COP	Carrier	50HJ-017 660QA	В		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Package Unit	15.00	243.00	8.50	0.81 Et	Carrier	48TJF016	В	7	Yes	1	Package Unit	15.00	243.00	14.00	0.82 Et	4.2	7,903	3	\$1,080	\$21,087	\$1,335	18.3
Berrie Center	Berrie Center	1	Package Unit	3.00	89.60	12.20	0.8 AFUE	York	ZQG04E4C1AA1 A111A2	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Package Unit	25.00	291.00	8.50	0.81 Et	Carrier	48TJF028	В	7	Yes	1	Package Unit	25.00	291.00	12.50	0.82 Et	5.6	10,729	3	\$1,462	\$36,054	\$2,125	23.2
Berrie Center	Berrie Center	1	Package Unit	10.00	176.00	10.30	0.8 AFUE	York	ZXG12E4C3AA1A 111A2	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	1	Package Unit	20.00	320.00	12.20	0.8 Et	York	ZF240N40R4C1A AA1A1	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Berrie Center	Berrie Center	2	Package Unit	20.00	291.00	8.50	0.81 Et	Carrier	48TJF024	В	7	Yes	2	Package Unit	20.00	291.00	12.50	0.82 Et	9.0	17,167	7	\$2,352	\$52,601	\$3,400	20.9
Berrie Center	Berrie Center	2	Package Unit	4.00	92.00	9.00	0.8 AFUE	Carrier	48TJE005 601AA	В	7	Yes	2	Package Unit	4.00	92.00	16.00	0.82 AFUE	2.3	4,433	4	\$633	\$20,749	\$824	31.5
Berrie Center	Berrie Center	1	Package Unit	80.00	640.00	8.00	0.8 Et	Governair	TL10-7026-E	В		No							0.0	0	0	\$0	\$0	\$0	0.0

DHW Inventory & Recommendations

Direct inventory	<u> </u>																			
		Existing Conditions P					Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantit y	System Type	Manufacturer	Model	Remaining Useful Life		Replace?	System Quantit y	System Type	Fuel Type			Total Peak kW Savings	Total Annual kWh Savings		Total Annual Energy Cost Savings		Total Incentives	Simple Payback wy Incentives in Years
Berrie Cener	Berrie Center	1	Storage Tank Water Heater (> 50 Gal)	AO Smith	BTR 180 118 118	В	9	Yes	1	Storage Tank Water Heater (> 50 Gal)	Natural Gas	93.00%	UEF	0.0	0	22	\$218	\$7,643	\$630	32.2





Low-Flow Device Recommendations

	Reco	mmeda	ation Inputs			Energy Impact & Financial Analysis									
Location	ECM #	Device Quantit Y	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	kWh	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years			
Berrie Center	10	3	Faucet Aerator (Kitchen)	2.00	1.50	0.0	0	0	\$4	\$22	\$6	3.7			
Berrie Center	10	2	Faucet Aerator (Kitchen)	2.20	1.50	0.0	0	0	\$4	\$14	\$4	2.6			
Berrie Center	10	20	Faucet Aerator (Lavatory)	2.00	0.50	0.0	0	8	\$85	\$143	\$72	0.8			

Plug Load Inventory

	Existin	g Conditions				
Location	Quantit y	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?	Manufacturer	Model
Berrie Center	3	Air Filtration System	1,000	No	Jet	Unknown
Berrie Center	1	Clothes Washer	1,176	No	Alliance	SWNMN28P112 TW01
Berrie Center	2	Coffee Machine	1,200	No	Unknown	Unknown
Berrie Center	77	Desktop	150	No	Unknown	Unknown
Berrie Center	5	Electric Space Heater	1,500	No	Varied	Varied
Berrie Center	8	Fan	200	No	Varied	Varied
Berrie Center	4	Microwave	1,000	No	Varied	Varied
Berrie Center	7	Hand Dryer	1,000	No	Varied	Varied
Berrie Center	2	Misc. Tools	1,000	No	Varied	Varied
Berrie Center	1	3D Printer	450	No	Unknown	Unknown
Berrie Center	1	Misc. Computer Equipment	1,500	No	Varied	Varied
Berrie Center	1	Misc. Tools	1,500	No	Varied	Varied
Berrie Center	1	Misc. Computer Equipment	1,500	No	Varied	Varied
Berrie Center	37	Printer	150	Yes	Varied	Varied
Berrie Center	3	Copier	1,500	Yes	Unknown	Unknown
Berrie Center	8	Projector	100	No	Varied	Varied
Berrie Center	7	Mini Refrigerator	126	No	Varied	Varied
Berrie Center	6	Television	100	No	Varied	Varied
Berrie Center	2	Water Cooler	125	No	Unknown	Unknown
Berrie Center	2	Water Fountain	200	No	Elkay	Unknown





Vending Machine Inventory & Recommendations

=	Existin	g Conditions	Proposed	Conditions	Energy Impact & Financial Analysis									
Location	Quantit y	Vending Machine Type	ECM#	Install Controls?	Total Peak kW Savings	kWh		Total Annual Energy Cost Savings		Total Incentives	Simple Payback w/ Incentives in Years			
Main Lobby	1	Glass Fronted Refrigerated	N/A	No	0.0	0	0	\$0	\$0	\$0	0.0			
Main Lobby	1	Non-Refrigerated	N/A	No	0.0	0	0	\$0	\$0	\$0	0.0			

Miscellaneous Fuel Inventory


		g Conditions				
Location	Quantit y	Equipment Description	Input Capacity per Unit (MBh)	ENERGY STAR Qualified ?	Manufacturer	Model
mechanical 227	1	Generator	259.0	No	Kohler	200RZD
Berrie Center	1	Clothes Dryer	2.0	No	Kenmore	Unknown





APPENDIX B: ENERGY STAR STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

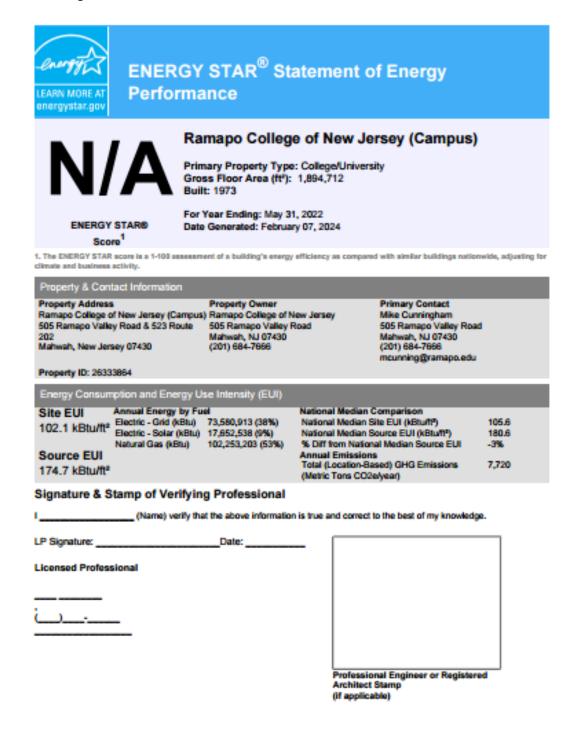

APPENDIX C: GLOSSARY

TERM	DEFINITION								
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.								
Btu	British thermal unit: a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.								
СНР	Combined heat and power. Also referred to as cogeneration.								
СОР	Coefficient of performance: a measure of efficiency in terms of useful energy delivered divided by total energy input.								
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.								
DCV	Demand control ventilation: a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.								
US DOE	United States Department of Energy								
EC Motor	Electronically commutated motor								
ЕСМ	Energy conservation measure								
EER	Energy efficiency ratio: a measure of efficiency in terms of cooling energy provided divided by electric input.								
EUI	Energy Use Intensity: measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.								
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.								
ENERGY STAR	ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA.								
EPA	United States Environmental Protection Agency								
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).								
GHG	Greenhouse gas gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.								
gpf	Gallons per flush								

gpm	Gallon per minute
HID	High intensity discharge: high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
hp	Horsepower
HPS	High-pressure sodium: a type of HID lamp.
HSPF	Heating seasonal performance factor: a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
HVAC	Heating, ventilating, and air conditioning
IHP 2014	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
IPLV	Integrated part load value: a measure of the part load efficiency usually applied to chillers.
kBtu	One thousand British thermal units
kW	Kilowatt: equal to 1,000 Watts.
kWh	Kilowatt-hour: 1,000 Watts of power expended over one hour.
LED	Light emitting diode: a high-efficiency source of light with a long lamp life.
LGEA	Local Government Energy Audit
Load	The total power a building or system is using at any given time.
Measure	A single activity, or installation of a single type of equipment, which is implemented in a building system to reduce total energy consumption.
МН	Metal halide: a type of HID lamp.
MBh	Thousand Btu per hour
MBtu	One thousand British thermal units
MMBtu	One million British thermal units
MV	Mercury Vapor: a type of HID lamp.
NJBPU	New Jersey Board of Public Utilities
NJCEP	New Jersey's Clean Energy Program: NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment.
psig	Pounds per square inch gauge
Plug Load	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
PV	Photovoltaic: refers to an electronic device capable of converting incident light directly into electricity (direct current).

SEER	Seasonal energy efficiency ratio: a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
SEP	Statement of energy performance: a summary document from the ENERGY STAR Portfolio Manager.
Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
SREC (II)	Solar renewable energy credit: a credit you can earn from the state for energy produced from a photovoltaic array.
T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of $1/8^{\text{th}}$ of an inch.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
therm	100,000 Btu. Typically used as a measure of natural gas consumption.
tons	A unit of cooling capacity equal to 12,000 Btu/hr.
Turnkey	Provision of a complete product or service that is ready for immediate use.
VAV	Variable air volume
VFD	Variable frequency drive: a controller used to vary the speed of an electric motor.
WaterSense®	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
Watt (W)	Unit of power commonly used to measure electricity use.