



Local Government Energy Audit Report

Ancora Psych Hospital (Main)

March 31, 2025

Prepared for:

State of NJ Department of Human Services
301 Spring Garden Road
Hammonton, New Jersey 08037

Prepared by:

TRC
317 George Street
New Brunswick, New Jersey 08901



Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based on previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2025 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product, or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks, or copyrights.

Table of Contents

1	Executive Summary	1
1.1	Planning Your Project.....	4
	Pick Your Installation Approach	4
	Options from Your Utility Company.....	4
	Options from New Jersey's Clean Energy Program	5
2	Existing Conditions	6
2.1	Site Overview	6
2.2	Building Occupancy	6
2.3	Building Envelope.....	7
2.4	Lighting Systems.....	8
2.5	Air Handling Systems	11
	Unit Ventilators.....	11
	Unitary Electric HVAC Equipment	12
	Unitary Heating Equipment	12
	Packaged Units.....	13
	Air Handling Units (AHUs)	14
2.6	Steam to Hot Water	15
2.7	Chilled Water Systems	16
2.8	Building Automation System (BAS).....	17
2.9	Domestic Hot Water	18
2.10	Refrigeration	19
2.11	Plug Load and Vending Machines	20
2.12	Water-Using Systems	21
2.13	Process Equipment.....	21
3	Energy and Water Use and Costs	23
3.1	Electricity.....	25
3.2	Natural Gas	26
3.3	Water (Campus)	27
3.4	Benchmarking	29
	Tracking your Energy Performance.....	30
3.5	Understanding Your Utility Bills	31
4	Energy Conservation Measures	32



4.1	Lighting.....	35
	ECM 1: Install LED Fixtures.....	35
	ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers	35
	ECM 3: Retrofit Fixtures with LED Lamps.....	36
4.2	Lighting Controls	36
	ECM 4: Install Occupancy Sensor Lighting Controls.....	36
	ECM 5: Install High/Low Lighting Controls.....	37
4.3	Variable Frequency Drives (VFD)	37
	ECM 6: Install VFDs on Constant Volume (CV) Fans	37
	ECM 7: Install VFDs on Heating Water Pumps.....	39
4.4	Unitary HVAC	39
	ECM 8: Install High Efficiency Air Conditioning Units	39
	ECM 9: Install High Efficiency Heat Pumps	40
4.5	HVAC Improvements.....	40
	ECM 10: Install Pipe Insulation	40
4.6	Domestic Water Heating.....	41
	ECM 11: Install Low-Flow DHW Devices	41
4.7	Food Service and Refrigeration Measures	41
	ECM 12: Vending Machine Control.....	41
4.8	Custom Measures	42
	ECM 13: Installation of an Energy Management System.....	42
4.9	Measures for Future Consideration.....	43
	Electric Sub Metering.....	43
	Upgrade to a Heat Pump System	43
5	Energy Efficient Best Practices.....	45
	Energy Tracking with ENERGY STAR Portfolio Manager	45
	Weatherization	45
	Doors and Windows.....	45
	Window Treatments/Coverings	45
	Lighting Maintenance	46
	Motor Controls.....	46
	Motor Maintenance	46
	Thermostat Schedules and Temperature Resets.....	46
	Economizer Maintenance	46

AC System Evaporator/Condenser Coil Cleaning	46
HVAC Filter Cleaning and Replacement	47
Steam Trap Repair and Replacement	47
Label HVAC Equipment	47
Optimize HVAC Equipment Schedules	47
Water Heater Maintenance	48
Compressed Air System Maintenance	48
Procurement Strategies	48
6 Water Best Practices	49
Getting Started	49
Water Metering and Submetering	49
Leak Detection and Repair	50
Toilets and Urinals	50
Faucets and Showerheads	50
Ice Machines	51
7 On-Site Generation	53
7.1 Solar Photovoltaic	54
7.2 Combined Heat and Power	55
8 Electric Vehicles	56
8.1 EV Charging	56
9 Project Funding and Incentives	58
9.1 New Jersey's Clean Energy Program	59
9.2 Utility Energy Efficiency Programs	66
10 Project Development	68
11 Energy Purchasing and Procurement Strategies	69
11.1 Retail Electric Supply Options	69
11.2 Retail Natural Gas Supply Options	69
Appendix A: Equipment Inventory & Recommendations	A-1
Appendix B: ENERGY STAR Statement of Energy Performance	B-1
Appendix C: Glossary	C-1

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) report for Ancora Psych Hospital (Main). This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT

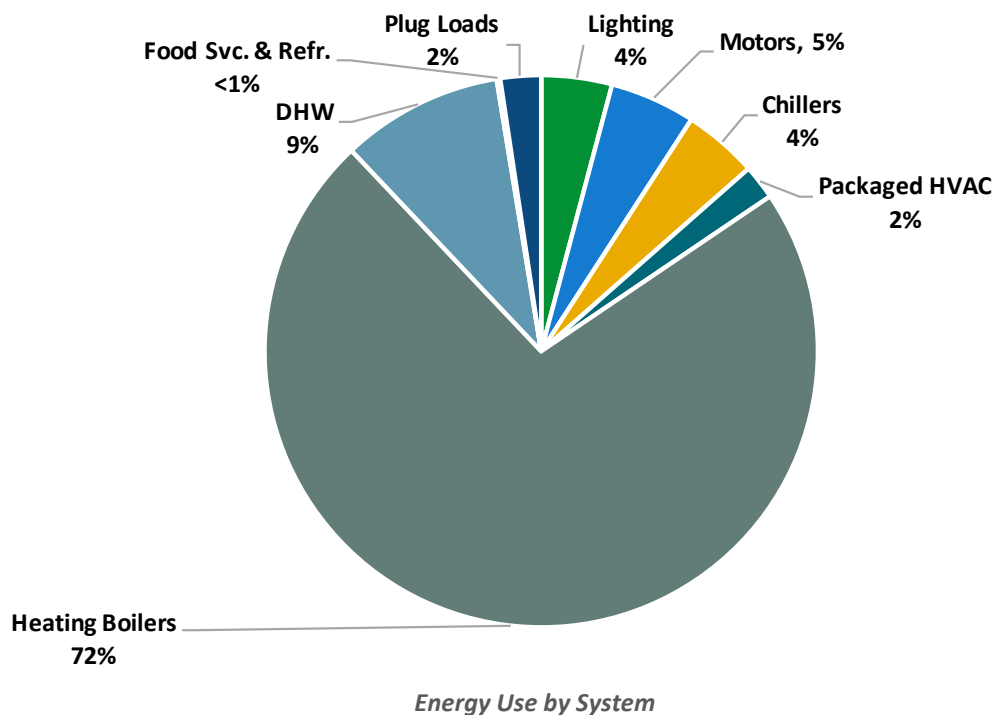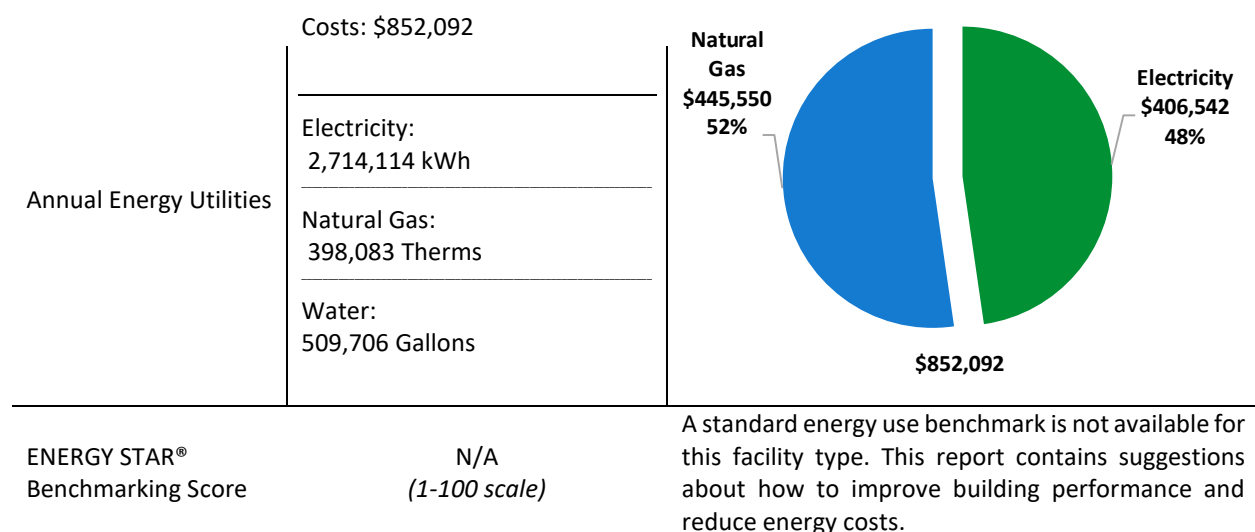


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (All Evaluated Measures)

Installation Cost	\$1,133,670
Potential Rebates & Incentives ¹	\$49,580
Annual Cost Savings	\$158,123
Annual Energy Savings	Electricity: 787,733 kWh Natural Gas: 35,854 Therms
Greenhouse Gas Emission Savings	607 Tons
Simple Payback	6.9 Years
Site Energy Savings (All Utilities)	13%

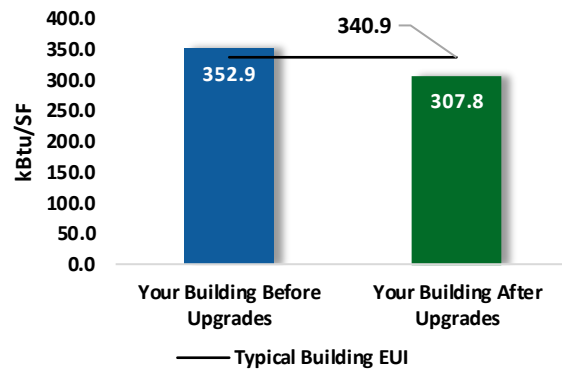

Scenario 2: Cost Effective Package²

Installation Cost	\$1,075,270
Potential Rebates & Incentives	\$46,280
Annual Cost Savings	\$155,877
Annual Energy Savings	Electricity: 772,738 kWh Natural Gas: 35,854 Therms
Greenhouse Gas Emission Savings	599 Tons
Simple Payback	6.6 Years
Site Energy Savings (all utilities)	13%

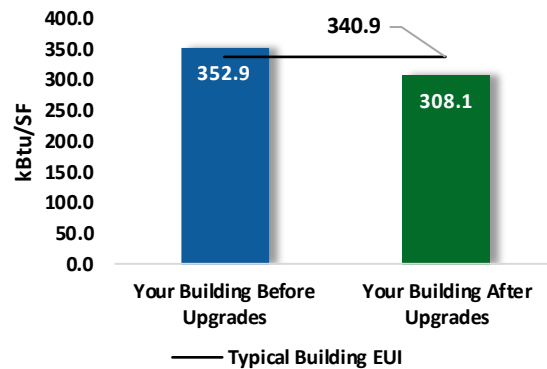

On-site Generation Potential

Photovoltaic	None
Combined Heat and Power	None

¹ Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			276,142	35.4	-57	\$40,728	\$61,810	\$11,370	\$50,440	1.2	271,436
ECM 1	Install LED Fixtures	Yes	11,745	0.2	0	\$1,755	\$10,800	\$1,000	\$9,800	5.6	11,781
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	2,227	0.3	0	\$328	\$360	\$40	\$320	1.0	2,187
ECM 3	Retrofit Fixtures with LED Lamps	Yes	262,171	34.9	-56	\$38,645	\$50,650	\$10,330	\$40,320	1.0	257,469
Lighting Control Measures			92,702	11.8	-20	\$13,665	\$72,050	\$20,120	\$51,930	3.8	91,038
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	64,822	8.6	-14	\$9,555	\$52,080	\$6,560	\$45,520	4.8	63,659
ECM 5	Install High/Low Lighting Controls	Yes	27,879	3.2	-6	\$4,110	\$19,970	\$13,560	\$6,410	1.6	27,379
Variable Frequency Drive (VFD) Measures			139,448	33.1	0	\$20,888	\$112,700	\$14,300	\$98,400	4.7	140,423
ECM 6	Install VFDs on Constant Volume (CV) Fans	Yes	122,337	31.4	0	\$18,325	\$92,100	\$12,300	\$79,800	4.4	123,193
ECM 7	Install VFDs on Heating Water Pumps	Yes	17,110	1.7	0	\$2,563	\$20,600	\$2,000	\$18,600	7.3	17,230
Unitary HVAC Measures			32,024	7.5	0	\$4,797	\$77,600	\$3,300	\$74,300	15.5	32,248
ECM 8	Install High Efficiency Air Conditioning Units	No	14,996	4.6	0	\$2,246	\$58,400	\$3,300	\$55,100	24.5	15,100
ECM 9	Install High Efficiency Heat Pumps	Yes	17,028	2.9	0	\$2,551	\$19,200	\$0	\$19,200	7.5	17,147
HVAC System Improvements			0	0.0	18	\$200	\$450	\$50	\$400	2.0	2,092
ECM 10	Install Pipe Insulation	Yes	0	0.0	18	\$200	\$450	\$50	\$400	2.0	2,092
Domestic Water Heating Upgrade			0	0.0	91	\$1,020	\$820	\$390	\$430	0.4	10,666
ECM 11	Install Low-Flow DHW Devices	Yes	0	0.0	91	\$1,020	\$820	\$390	\$430	0.4	10,666
Food Service & Refrigeration Measures			1,954	0.2	0	\$293	\$540	\$50	\$490	1.7	1,968
ECM 12	Vending Machine Control	Yes	1,954	0.2	0	\$293	\$540	\$50	\$490	1.7	1,968
Custom Measures			245,464	0.0	3,553	\$76,533	\$807,700	\$0	\$807,700	10.6	663,178
ECM 13	Installation of an Energy Management System	Yes	245,464	0.0	3,553	\$76,533	\$807,700	\$0	\$807,700	10.6	663,178
TOTALS (COST EFFECTIVE MEASURES)			772,738	83.4	3,585	\$155,877	\$1,075,270	\$46,280	\$1,028,990	6.6	1,197,949
TOTALS (ALL MEASURES)			787,733	87.9	3,585	\$158,123	\$1,133,670	\$49,580	\$1,084,090	6.9	1,213,050

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

All Evaluated Energy Improvements³

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

³ TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations.

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decision to make, such as:

- ◆ How will the project be funded/and or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

Utility-run energy efficiency programs and New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives *before* purchasing materials or starting installation.

Options from Your Utility Company

Prescriptive and Custom Rebates

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the Prescriptive and Custom Rebates program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval may be required for some incentives. Contact your utility company for more details prior to project installation.

Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized contractor. This program can provide incentives up to 70% or 80% of the cost of selected measures. A Direct Install contractor will assess and verify individual measure eligibility and perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Engineered Solutions

The Engineered Solutions program provides tailored energy-efficiency assistance and turnkey engineering services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. The program provides all professional services from audit, design, construction administration, to commissioning and measurement and verification for custom whole-building energy-efficiency projects. Engineered Solutions allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs.

For more details on these programs please contact your utility provider.

Options from New Jersey's Clean Energy Program

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is *required to participate in ESIP*.

Resiliency with Return on Investment through Combined Heat and Power (CHP)

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Successor Solar Incentive Program (SuSI)

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

Large Energy User Program (LEUP)

LEUP is designed to promote self-investment in energy efficiency for the largest energy consumers in the state. Customers in this category spend about \$5 million a year on energy bills. This program incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

For more details on these programs please visit [New Jersey's Clean Energy Program website](http://www.njcleanenergy.com).



2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) report for Ancora Psych Hospital (Main). This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On January 11, 2024, TRC performed an energy audit at Ancora Psych Hospital (Main) located in Hammonton, New Jersey. TRC met with Kyle Irizarry to review the facility operations and help focus our investigation on specific energy-using systems. Ancora Psychiatric Hospital is a 600-bed adult inpatient facility that offers a multidisciplinary team approach to development and implementation of care. Opened in 1955, the Ancora campus consists of multiple buildings across 650 acres.

The Ancora Psych Hospital (Main) is a five-story, 138,778 square foot building built in 1953. Spaces include classrooms, offices, cafeteria, corridors, stairwells, dining room, commercial kitchen, storage rooms, residential rooms, electrical and mechanical spaces. The oxygen storage building is a one-story, 281 square foot building built in 1953 and is adjacent to the hospital. Spaces include the oxygen storage room.

The facility primarily uses linear fluorescent T8 fixtures for lighting. The building is cooled by package units, chillers, window AC units, and split air conditioners in various areas. Heating is provided mainly by steam from the central boiler plant, converted to hot water using heat exchangers. Supplemental heating is provided by electric resistance heaters and heat pumps.

An emergency diesel-fired backup generator supplies power to the main building during emergencies. The facility staff's main concerns include maintaining comfortable temperatures for clients, addressing humidity issues that have previously caused microbial growth, and updating outdated kitchen equipment. Currently, the BAS system only supports the chiller. Facility staff have expressed interest in expanding the BAS control capabilities.

2.2 Building Occupancy

The facility is fully occupied 24 hours a day, every day of the week.

Building Name	Weekday/Weekend	Operating Schedule
Ancora Psych Hospital (Main)	Weekday	12:00 AM - 12:00 AM
	Weekend	12:00 AM - 12:00 AM
Ancora Psych Hospital (Dmhh)- Oxygen Storage	Weekday	Limited
	Weekend	Limited

Building Occupancy Schedule

2.3 Building Envelope

The walls consist of concrete masonry units (CMUs) over structural steel, with a brick veneer and painted CMU interior finish. The flat roof is supported by steel trusses and formed of a reinforced concrete deck with ethylene propylene diene terpolymer (EPDM) covering. Overall, the building roof is in good condition, with some sections installed approximately eight years ago. The roof encloses a plenum area with conditioned space below a drop ceiling.

Most of the windows are single paned with aluminum frames. The glass-to-frame seals are in fair condition. The weather seals on the operable windows are also in fair condition, showing little evidence of excessive wear. Exterior doors are made from fiberglass reinforced polymer (FRP) composite material with aluminum frames. They are in fair condition, but according to the facility personnel the door seals are damaged and the weatherstripping is poor. Degraded window and door seals increase drafts and outside air infiltration.



Typical Building Envelope



Building Roof



Building Roof



Typical Building Envelope



Building Window



Building Door



Oxygen Storage Building



Oxygen Storage Building

2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. There are also a few T12 fixtures in the mechanical elevator rooms and some T5 fixtures in conference room 421. Fixture types include 1-lamp, 2-lamp, 3-lamp, and 4-lamp fixtures, 4-foot-long recessed and surface-mounted fixtures with U-bend and linear tube lamps. Typically, T8 fluorescent lamps use electronic ballasts, while T12 fluorescent lamps use magnetic ballasts.

Some of the linear fixtures have been converted to operate LED tube lamps. Additionally, there are some compact fluorescent lamps (CFL), incandescent, and LED general-purpose lamps, mainly in restrooms, storage areas, offices, and janitorial closets. Several LED wall packs and ceiling-mounted fixtures illuminate various offices, stairways, corridors, and restrooms.

All exit signs are LED. Most fixtures are in fair condition. Interior lighting levels were generally sufficient. Lighting fixtures in a few of the restrooms are controlled by occupancy sensors. Most lighting fixtures are controlled manually by wall switches.




Oxygen Storage – LED Lamps



Linear Fluorescent T8 Lamps



LED Wall Pack Fixtures

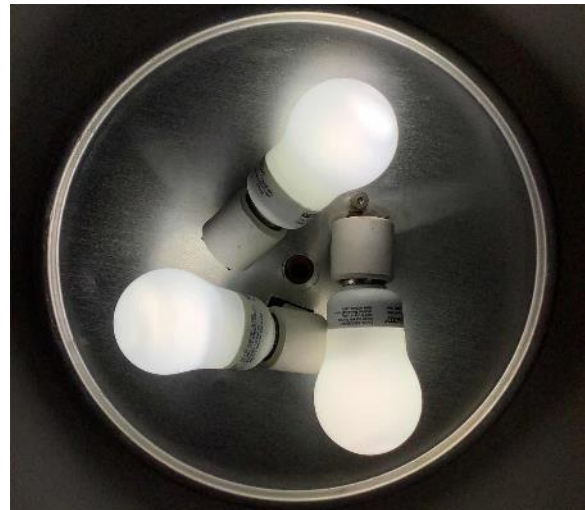

Typical LED Lamps



Typical LED Linear Tube



LED "Corn" Bulb



Typical CFL Lamp



Typical Incandescent Lamps

Exterior fixtures include a mix of wall packs, floodlights, and canopy lights with high-intensity discharge (HID), CFLs, and LED lamps. Exterior light fixtures are mainly controlled by a photocell, however, the fixture at the gym patio is controlled by a wall switch and was observed to be operating during daylight hours.



Exterior HID Wall Pack Fixture



Exterior LED Wall Pack Fixture



Exterior HID Fixture



Exterior HID Fixture



Exterior Oxygen Storage- CFL Wall Pack



Exterior LED Fixture

2.5 Air Handling Systems

Unit Ventilators

Unit ventilators provide heating, cooling, and ventilation to offices and various locations. They are equipped with supply fan motors and pneumatically controlled outside air dampers and are connected to the hot water and chilled water distribution systems. Overall, the system is in fair operating condition.



Typical Unit Ventilator



Typical Unit Ventilator

Unitary Electric HVAC Equipment

Several offices, conference rooms, and lounge areas are cooled by window air conditioning (AC) units with capacities between 10,000 Btu and 15,000 Btu. Most units are still operating within their useful lifespan, in fair condition, and of standard efficiency. Newer systems are operated using remote control units located within the space while older window air conditioners have on-board manual controls with rotary knobs to control temperature and fan speed.

Split air conditioning systems cool various offices and areas on the basement and first floor. Three Fujitsu and Daikin ductless mini-split heat pump units, ranging from 2.5 tons to 3 tons, are of standard efficiency but are operating beyond their useful life and have been evaluated for replacement. Other split AC units range from 0.75 tons to 7.5 tons. These units are in fair condition, and of standard efficiency. Three of the units are operating beyond their useful life and have been evaluated for replacement.



Typical Window AC



Split Heat Pump-Outdoor



Wall Mounted Indoor Unit



Outdoor Condensing Unit

Unitary Heating Equipment

Office 3201, office 3018, and the 4th-floor corridor are heated by electric resistance heaters, which vary in capacity. The units are in fair condition and are controlled by manual dial thermostats. Some of the stairs and the lounge area are heated by radiant heaters connected to a hot water distribution system.



Electric Resistance Unit Heater



Electric Resistance Unit Heater



Lounge-B Radiant Heater



Stairs Radiant Heater

Packaged Units

Several areas of the main hospital are served by four packaged units with DX cooling coils. These units are controlled by local thermostats. The cooling capacity of these units varies from 4 tons to 26 tons. They are of standard efficiency. Two of these units are operating beyond their useful life and have been evaluated for replacement. The equipment is in fair condition.

Both 26-ton Aeon units have a 7.5 hp supply fan each, with MUA 1 having a 7.5 hp return fan and MUA 3 having a 5 hp return fan. Fans operate at constant volume and are not equipped with VFDs. Motors are of standard efficiency. These units are equipped with economizers that are in fair condition.

The building area is served by multiple packaged rooftop units, including:

Location	System Designation	System Qty	System Type	Cooling Capacity per Unit (Tons)	Manufacturer	Model
Roof	Package Unit - MUA1	1	Package Unit	26.00	Aeon	RN-026-8-0-EA09-EHJ
Roof	Package Unit -MUA3	1	Package Unit	26.00	Aeon	RN-026-8-0-EA09-EHJ
Electrical Room F80	Air Handling Unit	1	Package Unit	4.00		RCMDD2248S008
Mechanical M43	Air Handling Unit	1	Package Unit	7.50	York	NL090C00B2BAA2

Refer to Appendix A for detailed information about each unit.



Package Unit MUA-1



Package Unit MUA-3

Air Handling Units (AHUs)

A significant portion of the building areas are conditioned by one of several air handling units (AHUs). Each unit is equipped with a supply fan motor, hot water heating coil, and chilled water-cooling coil. The motors are of standard efficiency and operate at a constant speed. Some of the supply fan motors were not visible during inspection and have been estimated. Motor sizes range from 1.5 hp to 20 hp.

Air handling units are provided with hot water from the heat exchanger (Section 2.6) and chilled water (Section 2.7).

These AHUs serve different sections of the building, each with varying air change requirements based on design constraints for critical spaces. VFDs have been evaluated for AHU fan motors that exceed 2.0 hp. Air change requirements can impact how VFDs could be used, therefore, we recommend working with your mechanical design team to determine the application of VFDs for these fan motors.

The main building is served by multiple air handling units, including:

Location	Area(s)/System(s) Served	Motor Qty	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?
Mechanical - Penthouse	Air Handling Unit	1	Supply Fan	15.00	90.0%	No
Mechanical - Penthouse	Air Handling Unit - E1	1	Supply Fan	20.00	91.0%	No
Mechanical - M16	AHU-4 & AHU-7	2	Supply Fan	5.00	87.0%	No
Mechanical F6	AHU-1, 2, 3	3	Supply Fan	5.00	87.0%	No
Mechanical M43	AHU-2	1	Supply Fan	1.50	84.0%	No
Mechanical M43	AHU-6	1	Supply Fan	3.00	89.5%	No
Roof	HRU	1	Supply Fan	15.00	91.0%	No
Roof	HRU	1	Return Fan	15.00	91.0%	No



Air Handling Unit -E1



Heat Recovery Unit

2.6 Steam to Hot Water

This building is supplied with steam produced by the boilers located at the boiler house. The steam is converted to hot water in this building using a heat exchanger, and the hot water is distributed to heating end uses. The hydronic distribution system serves both heating, using hot water; and cooling, which is provided by the chilled water system as described in Section 2.7.

The building is served by a primary-only distribution system with four constant-speed heating hot water pumps operating in a lead/lag fashion. Two, 5 hp pumps are in the mechanical penthouse and two, 2 hp pumps are in mechanical room M16. Hot water is used by unit heaters, unit ventilators, and air handling units.

Most of the supply and return piping is well insulated, but there are several areas where piping is either uninsulated or the insulation is in poor condition. We have evaluated pipe insulation for those areas.



Heating Hot Water Tank- Heat Exchanger



Heating Hot Water Tank- Heat Exchanger



Heating Hot Water Pump

Chiller controls and set point temperature are managed through a BAS, however, there are limited options for making changes.




Carrier Chiller Nameplate


2.8 Building Automation System (BAS)

The BAS currently controls only the chilled water system. It schedules equipment, monitors, and controls space temperatures, supply air temperatures, and chilled water loop temperatures. It also monitors and controls the chilled water pumps and their associated VFDs.

The site staff has shown interest in expanding BAS control capabilities which may require replacing the existing BAS and receiving additional training on its operation. We have evaluated installing a new BAS for the building's HVAC system. This would enable centralized, remote control and monitoring of the HVAC equipment.

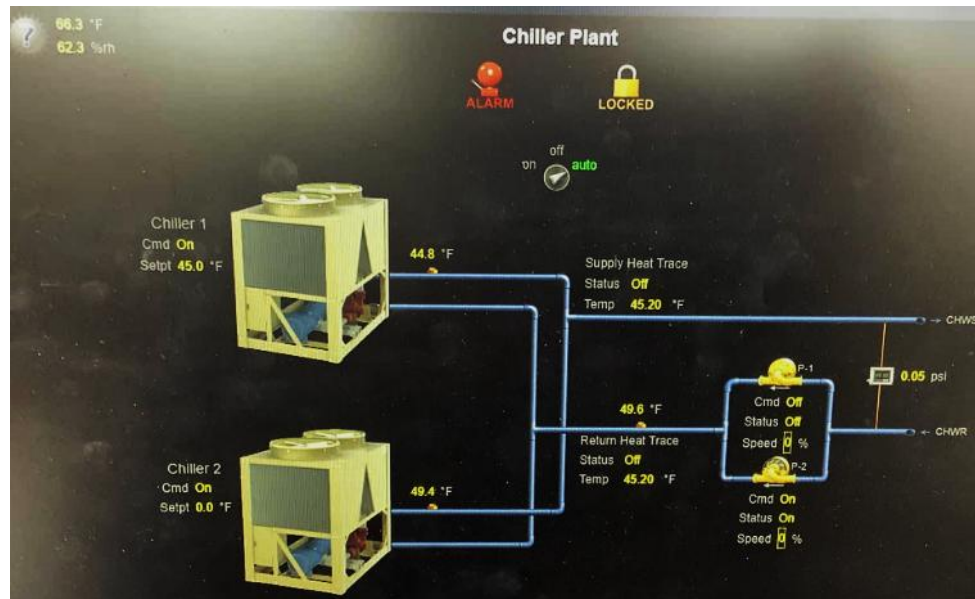


BAS System- Chiller

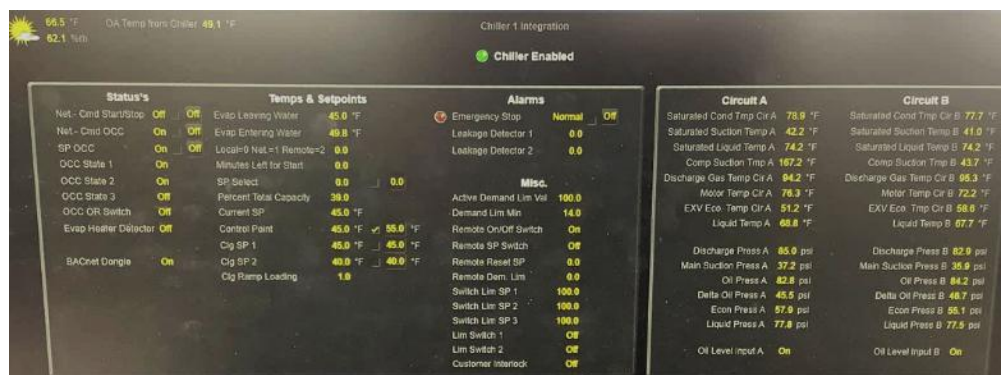

The screenshot displays the BAS interface for Chiller 1, showing a detailed status and temperature data table. The table is organized into columns for Status's, Temps & Setpoints, Alarms, and Circuit A/B. The status of various components like Net - Cmd Start/Stop, Net - Cmd OCC, and SP OCC is shown. The temperature data includes Evap Leaving Water, Evap Entering Water, and various liquid and gas temperatures. The alarm section shows Emergency Stop, Leakage Detector 1, and Leakage Detector 2. The circuit section provides detailed data for Circuit A and Circuit B, including saturated and liquid temperatures, discharge gas temperatures, motor temperatures, and various pressures.

Status's	Temps & Setpoints	Alarms	Circuit A	Circuit B
Net - Cmd Start/Stop: Off	Evap Leaving Water: 45.0 °F	Emergency Stop: Normal	Saturated Cond Temp Cir A: 73.9 °F	Saturated Cond Temp Cir B: 77.7 °F
Net - Cmd OCC: On	Evap Entering Water: 49.8 °F	Leakage Detector 1: 0.0	Saturated Suction Temp A: 42.2 °F	Saturated Suction Temp B: 41.0 °F
SP OCC: On	Local-9 Net-1 Remote-2: 0.0	Leakage Detector 2: 0.0	Saturated Liquid Temp A: 74.2 °F	Saturated Liquid Temp B: 74.2 °F
OCC State 1: On	Minutes Left for Start: 0.0		Comp Suction Temp A: 167.2 °F	Comp Suction Temp B: 43.7 °F
OCC State 2: On	SP Select: 0.0		Discharge Gas Temp Cir A: 94.2 °F	Discharge Gas Temp Cir B: 95.3 °F
OCC State 3: Off	Percent Total Capacity: 38.0	Misc: Active Demand Lin Val: 100.0	Motor Temp Cir A: 76.3 °F	Motor Temp Cir B: 72.2 °F
OCC OR Switch: Off	Current SP: 45.0 °F	Misc: Demand Lin Min: 14.0	EXV Eco Temp Cir A: 51.2 °F	EXV Eco Temp Cir B: 58.6 °F
Evap Heater Deflector: Off	Control Plant: 45.0 °F	Remote On/Off Switch: On	Liquid Temp A: 68.8 °F	Liquid Temp B: 67.7 °F
BACnet Dongle: On	Cig SP 1: 45.0 °F	Remote SP Switch: Off	Discharge Press A: 85.0 psi	Discharge Press B: 82.0 psi
	Cig SP 2: 40.0 °F	Remote Reset BP: 0.0	Main Suction Press A: 37.2 psi	Main Suction Press B: 35.0 psi
	Cig Ramp Loading: 1.0	Remote Dem. Lin: 0.0	Oil Press A: 82.8 psi	Oil Press B: 84.2 psi
		Switch Lin SP 1: 100.0	Delta Oil Press A: 45.5 psi	Delta Oil Press B: 48.7 psi
		Switch Lin SP 2: 100.0	Econ Press A: 57.9 psi	Econ Press B: 56.1 psi
		Switch Lin SP 3: 100.0	Liquid Press A: 77.8 psi	Liquid Press B: 77.5 psi
		Lim Switch 1: Off	Oil Level Input A: On	Oil Level Input B: On
		Lim Switch 2: Off		
		Customer Interlock: Off		

BAS System- Chiller

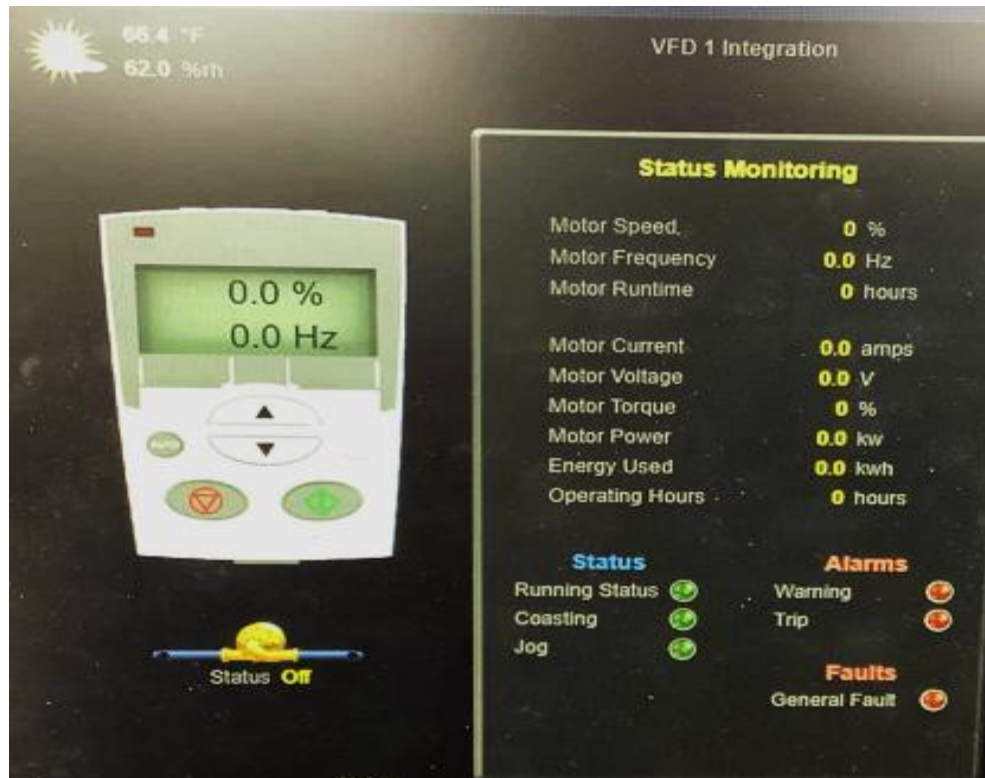

BAS System- VFD

2.9 Domestic Hot Water

This building receives steam from the boilers at the boiler house. Steam is turned into potable hot water using a dedicated heat exchanger located in the main hospital building. Hot water is stored in a tank and then distributed to end uses.

Three small circulation pumps continuously distribute the hot water. The domestic hot water pipes are insulated, and the insulation is in fair condition.



DHW Storage Water Tank



DHW Recirculation Pump

2.10 Refrigeration

The kitchen has three stand-up refrigerators with solid doors and one stand-up solid door freezer. Some of the equipment is ENERGY STAR-rated and is in fair condition. This report makes additional suggestions for ECMs and energy-efficient best practices in this area.

The kitchen and lounge also have three self-contained ice makers which are standard efficiency and in fair condition.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.



Stand-Up Solid Door Refrigerator



Self-Contained Ice Maker



Stand-Up Solid Door Refrigerator



Self-Contained Ice Maker

2.11 Plug Load and Vending Machines

The location is doing a great job managing the electrical plug loads. This report makes additional suggestions for ECMs in this area as well as energy efficient best practices.

There are 247 computer workstations throughout the facility. Plug loads include general café and office equipment. Typical office and kitchen loads include a coffee machine, microwave, printer/copier, smartboard, and television. There is a server equipped with a UPS.

There are also a few residential-style refrigerators throughout the building that store food. These vary in condition and efficiency. There are three clothes dryers and four clothes washers, as well as several miscellaneous hospital-related plug loads. There is a refrigerated beverage vending machine and a non-refrigerated vending machine. The vending machines are not equipped with occupancy-based controls.

Additional process loads are described in Section 2.13.



Residential Style Refrigerator



Clothes Washer



Typical Printer/ Copier



Non-Refrigerated Vending Machine

2.12 Water-Using Systems

Water is provided by New Jersey American Water. There is one active onsite well that serves as a secondary water source for emergencies, firefighting, and other uses. Well water is directed to the water tower located on campus. The primary use of water is for drinking, cleaning, cooking, and sanitary fixtures. No water leaks were observed.

The EPA WaterSense® has set maximum flow rates for sanitary fixtures: 1.28 gallons per flush (gpf) for toilets, 0.5 gpf for urinals, 1.5 gallons per minute (gpm) for lavatory faucets, and 2.0 gpm for showerheads. There are a few restrooms with toilets, urinals, and sinks. Faucet flow rates are 0.5 gpm and 2.2 gpm or higher.



Typical Restroom Faucet



Typical Restroom Faucet

2.13 Process Equipment

Process medical equipment includes x-ray machines and other hospital equipment. There are two air compressors that support various medical process equipment and tools. The AirStar air compressor located in the mechanical dental room has a 1.5 hp motor while the Quincy air compressor located in mechanical F9 room has a 2 hp motor.




X-Ray Machine



Air Compressor- Mechanical-2010 Dental




Air Compressor- Mechanical-F6

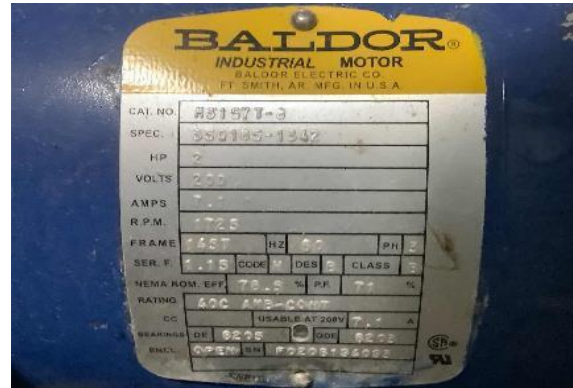

Air Compressor Motor Nameplate


3 ENERGY AND WATER USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

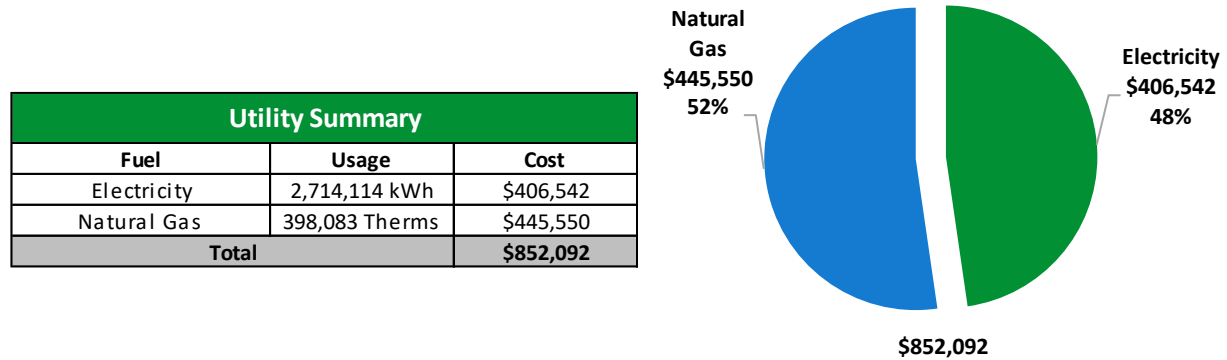

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.


The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.

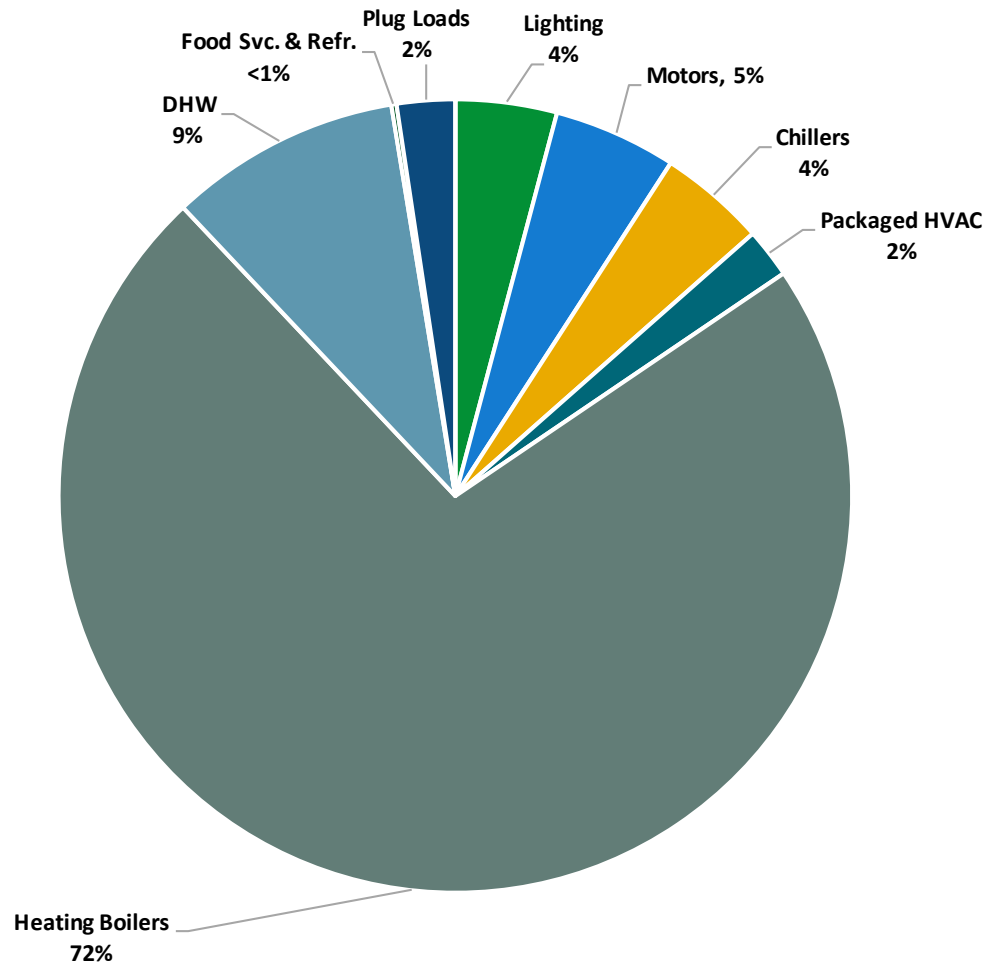

Energy Balance by System

3.1 Electricity

Atlantic City Electric delivers electricity under rate class Annual General Service Primary (GSP), with electric production provided by Constellation, a third-party supplier.

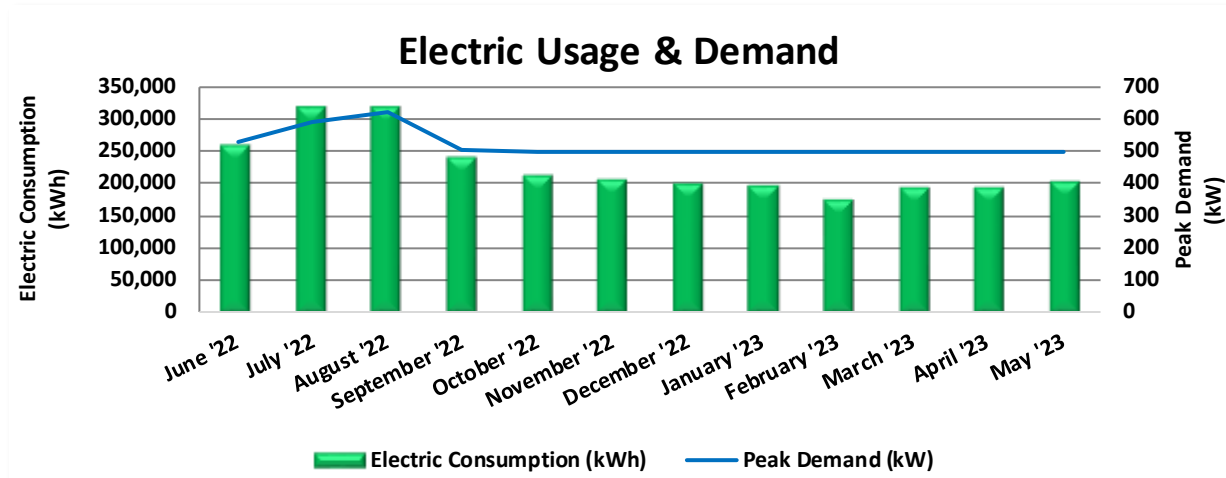


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
6/30/22	30	258,812	533	\$5,332	\$37,241
7/31/22	31	317,136	591	\$6,112	\$45,240
8/31/22	31	318,052	624	\$6,445	\$45,656
9/30/22	30	238,948	506	\$5,053	\$34,739
10/31/22	31	213,708	499	\$5,172	\$31,621
11/30/22	30	206,699	499	\$5,005	\$30,565
12/31/22	31	199,866	499	\$5,172	\$31,182
1/31/23	31	197,311	499	\$5,172	\$30,802
2/28/23	28	174,860	499	\$4,672	\$27,533
3/31/23	31	193,548	499	\$5,172	\$30,340
4/30/23	30	192,549	499	\$5,005	\$30,020
5/31/23	31	202,625	499	\$5,172	\$31,603
Totals	365	2,714,114	624	\$63,484	\$406,542
Annual	365	2,714,114	624	\$63,484	\$406,542

Notes:

- An estimated peak demand of 624 kW occurred in August '22.
- The estimated average demand over the past 12 months was 521 kW.
- This building is served from the main campus electric meter along with several others. Energy usage (kWh) and demand (kW) was apportioned among those buildings using a formula that accounts for building area (sf), usage, and the energy intensity of the equipment.
- The average electric cost over the past 12 months was \$0.150/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

3.2 Natural Gas

South Jersey Gas delivers natural gas under rate class Comprehensive Transportation Services (SJ-CTS), with natural gas supply provided by UGI, a third-party supplier.

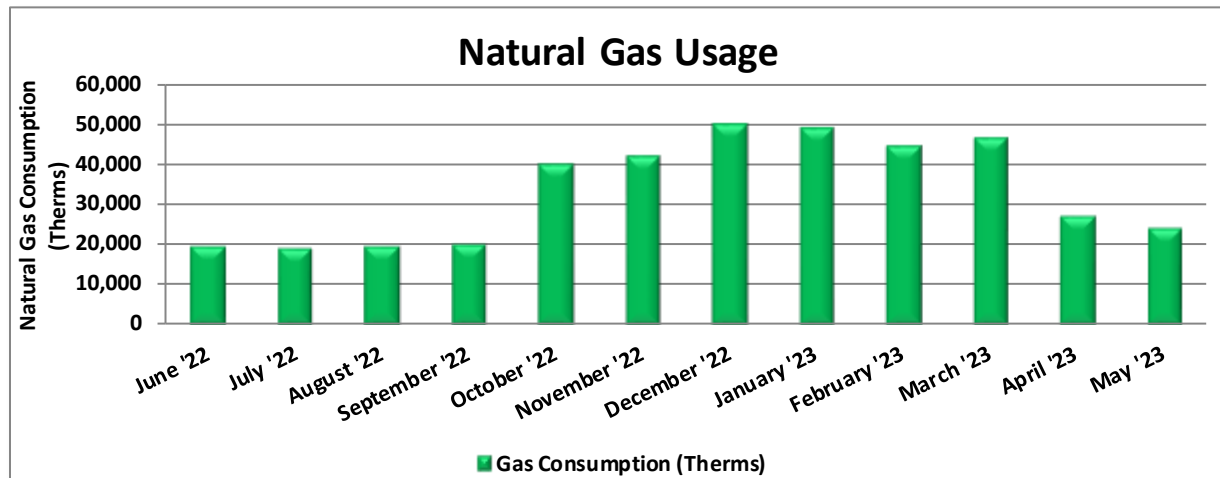


Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
6/30/22	30	19,164	\$23,584
7/31/22	31	18,669	\$23,476
8/31/22	31	19,470	\$23,653
9/30/22	30	19,964	\$24,015
10/31/22	31	39,677	\$38,897
11/30/22	30	41,773	\$40,956
12/31/22	31	49,892	\$34,490
1/31/23	31	49,071	\$57,735
2/28/23	28	44,095	\$54,794
3/31/23	31	46,092	\$55,093
4/30/23	30	26,589	\$35,952
5/31/23	31	23,627	\$32,905
Totals	365	398,083	\$445,550
Annual	365	398,083	\$445,550

Notes:

- The average gas cost for the past 12 months is \$1.119/therm, which is the blended rate used throughout the analysis.
- Heating hot water and domestic hot water for this building is converted from steam provided by the central plant. Central plant natural gas use has been apportioned among the buildings served with steam using a formula that accounts for building area (sf), usage, and the energy intensity of the equipment.

3.3 Water (Campus)


New Jersey American Water delivers water to the campus site.

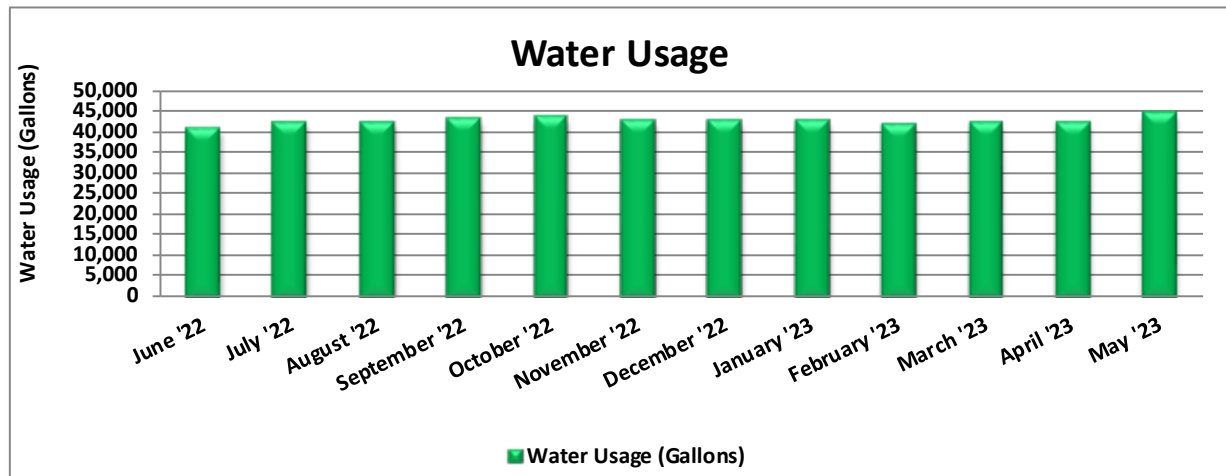

Water Billing Data			
Period Ending	Days in Period	Water Usage (gallons)	Water Cost
6/30/22	30	40,844	\$112,124
7/31/22	31	41,896	\$41,896
8/31/22	31	41,999	\$41,999
9/30/22	30	43,303	\$114,583
10/31/22	31	43,331	\$43,331
11/30/22	30	42,702	\$42,702
12/31/22	31	42,486	\$113,765
1/31/23	31	42,709	\$42,709
2/28/23	28	41,635	\$41,634
3/31/23	31	42,182	\$113,462
4/30/23	30	42,268	\$42,268
5/31/23	31	44,352	\$44,352
Totals	365	509,706	\$794,826
Annual	365	509,706	\$794,826

Notes:

- The average cost of metered water for the past 12 months is \$1.5594/gal.
- This building, along with several others, is connected to the main campus water meter. The water bills were not divided among these buildings, so this bill includes the metered water consumption for multiple buildings on the campus.
- Unmetered well water is also shared between buildings.

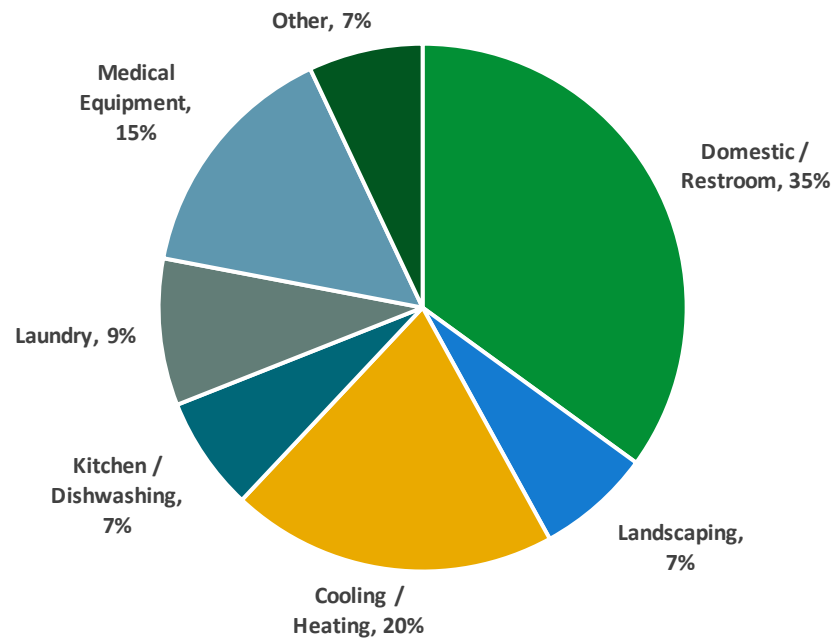

Typical Hospital Water End Use⁴

⁴ Chart is of typical water end use and not specific to the facility.

3.4 Benchmarking


Your building was benchmarked using the United States Environmental Protection Agency's (EPA) Portfolio Manager® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

Benchmarking Score

N/A

Due to its unique characteristics, this building type is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

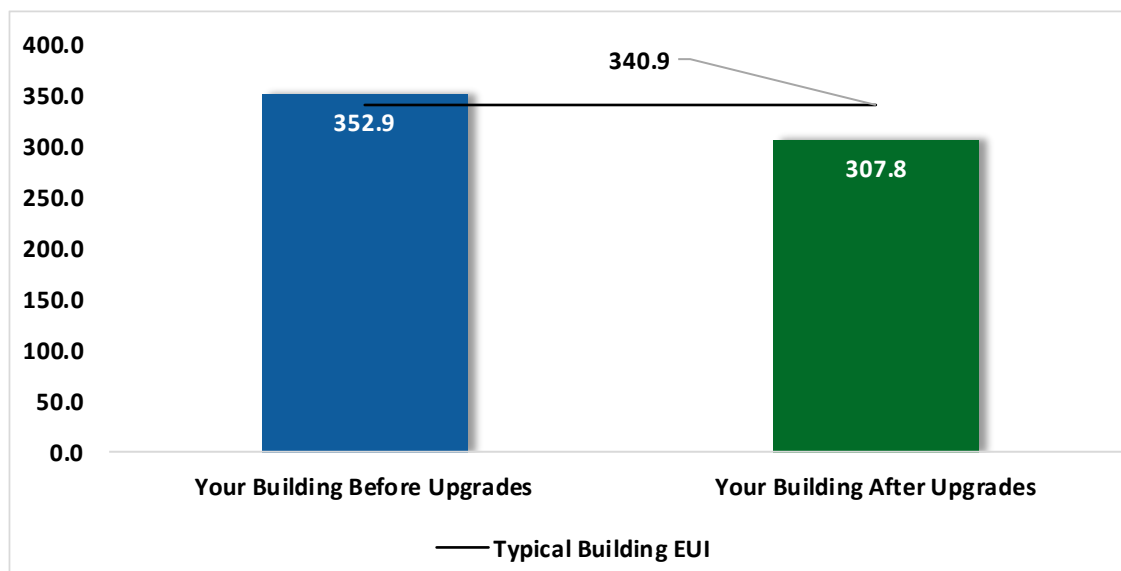


Energy Use Intensity Comparison⁵

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

Note that the typical building EUI used in this report refers to the national median energy use intensity for a "specialty hospital" and does not correlate with the energy use intensity of a particular building. Specifically, buildings with lower occupancy periods or less equipment typically use less energy.

⁵ Based on all evaluated ECMs

Campus Water Benchmarking

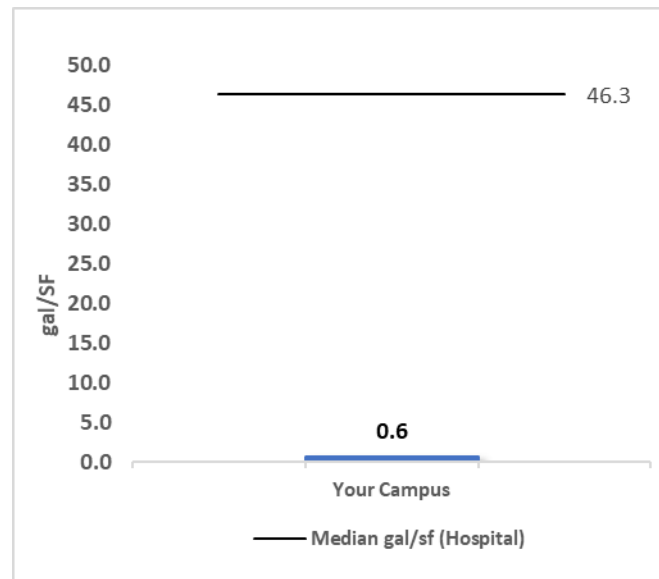

A benchmark is provided for your campus's water use based on the annual water use in gallons per square foot of building area (gal/sf-yr). Your building is compared to other similar buildings based on average water usage as available from the 2012 Commercial Buildings Energy Consumption Survey (CBECS) and from the EPA ENERGY STAR DataTrends Water Use Tracking database.

The water bills were not divided among these buildings, so this bill includes the metered water consumption for multiple buildings on the campus. Additional use of unmetered well water may contribute slightly to overall water consumption. Water use varies considerably depending mainly on the extent of outdoor water use and whether process water is used, such as for laboratory sterilizers. Steam boilers are also significant water users. Kitchens and sanitary fixtures may use varying amounts of water.

Tracking your Energy Performance

Keeping track of your energy and water use on a monthly basis is one of the best ways to keep utility costs in check and keep your facility operating efficiently. Update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager account for your facility and have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR Portfolio Manager to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR and Portfolio Manager, visit their [website](#).

3.5 Understanding Your Utility Bills

The State of New Jersey Department of the Public Advocate provides detailed information on how to read natural gas and electric bills. Your bills contain important information including account numbers, meter numbers, rate schedules, meter readings, and the supply and delivery charges. Gas and electric bills both provide comparisons of current energy consumption with prior usage.

Sample bills, with annotation, may be viewed at:

https://www.nj.gov/rpa/docs/Understanding_Electric_Bill.pdf

https://www.nj.gov/rpa/docs/Understanding_Gas_Bill.pdf

Why Utility Bills Vary

Utility bills vary from one month to another for many reasons. For this reason, assessing the effects of your energy savings efforts can be difficult.

Billing periods vary, typically ranging between 28 and 33 days. Electric bills provide the kilowatt-hours (kWh) used per month while gas bills provide therms (or hundreds of cubic feet - CCF) per month consumption information. Monthly consumption information can be helpful as a tool to assess your efforts to reduce energy, particularly when compared to monthly usage from a similar calendar period in a prior year.

Bills typically vary seasonally, often with more gas consumed in the winter for heating, and more electricity used in the summer when air conditioning is used. Facilities with electric heating may experience higher electricity use in the winter. Seasonal variance will be impacted by the type of heating and cooling systems used. Normal seasonal fluctuations are further impacted by the weather. Extremely cold or hot weathers causes HVAC equipment to run longer, increasing usage. Other monthly fluctuations in usage can be caused by changes in building occupancy. Utility bills provide a comparison of usage between the current period and comparable billing month period of the prior year. Year-to-year monthly use comparisons can point to trends with energy savings for measures/projects that were implemented within the timeframe, but these comparisons do not account for changing weather or occupancy patterns.

The price of fuel and purchased power used to produce and delivery electricity and gas fluctuates. Any increase or decrease in these costs will be reflected in your monthly bill. Additionally, billing rates occasionally change after justification and approval of the NJBPU. For this reason, it is more useful to review energy use rather than cost when assessing energy use trends or the impact of energy conservation measures implemented.

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives in this report are based on the previously run state rebate program SmartStart, which has been retired. Now, all investor-owned gas and electric utility companies are offering complementary energy efficiency programs directly to their customers. Some measures and proposed upgrades may be eligible for higher incentives than those shown below. The incentives in the summary tables should be used for high-level planning purposes. To verify incentives, reach out to your utility provider or visit the [NJCEP website](#) for more information.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			276,142	35.4	-57	\$40,728	\$61,810	\$11,370	\$50,440	1.2	271,436
ECM 1	Install LED Fixtures	Yes	11,745	0.2	0	\$1,755	\$10,800	\$1,000	\$9,800	5.6	11,781
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	2,227	0.3	0	\$328	\$360	\$40	\$320	1.0	2,187
ECM 3	Retrofit Fixtures with LED Lamps	Yes	262,171	34.9	-56	\$38,645	\$50,650	\$10,330	\$40,320	1.0	257,469
Lighting Control Measures			92,702	11.8	-20	\$13,665	\$72,050	\$20,120	\$51,930	3.8	91,038
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	64,822	8.6	-14	\$9,555	\$52,080	\$6,560	\$45,520	4.8	63,659
ECM 5	Install High/Low Lighting Controls	Yes	27,879	3.2	-6	\$4,110	\$19,970	\$13,560	\$6,410	1.6	27,379
Variable Frequency Drive (VFD) Measures			139,448	33.1	0	\$20,888	\$112,700	\$14,300	\$98,400	4.7	140,423
ECM 6	Install VFDs on Constant Volume (CV) Fans	Yes	122,337	31.4	0	\$18,325	\$92,100	\$12,300	\$79,800	4.4	123,193
ECM 7	Install VFDs on Heating Water Pumps	Yes	17,110	1.7	0	\$2,563	\$20,600	\$2,000	\$18,600	7.3	17,230
Unitary HVAC Measures			32,024	7.5	0	\$4,797	\$77,600	\$3,300	\$74,300	15.5	32,248
ECM 8	Install High Efficiency Air Conditioning Units	No	14,996	4.6	0	\$2,246	\$58,400	\$3,300	\$55,100	24.5	15,100
ECM 9	Install High Efficiency Heat Pumps	Yes	17,028	2.9	0	\$2,551	\$19,200	\$0	\$19,200	7.5	17,147
HVAC System Improvements			0	0.0	18	\$200	\$450	\$50	\$400	2.0	2,092
ECM 10	Install Pipe Insulation	Yes	0	0.0	18	\$200	\$450	\$50	\$400	2.0	2,092
Domestic Water Heating Upgrade			0	0.0	91	\$1,020	\$820	\$390	\$430	0.4	10,666
ECM 11	Install Low-Flow DHW Devices	Yes	0	0.0	91	\$1,020	\$820	\$390	\$430	0.4	10,666
Food Service & Refrigeration Measures			1,954	0.2	0	\$293	\$540	\$50	\$490	1.7	1,968
ECM 12	Vending Machine Control	Yes	1,954	0.2	0	\$293	\$540	\$50	\$490	1.7	1,968
Custom Measures			245,464	0.0	3,553	\$76,533	\$807,700	\$0	\$807,700	10.6	663,178
ECM 13	Installation of an Energy Management System	Yes	245,464	0.0	3,553	\$76,533	\$807,700	\$0	\$807,700	10.6	663,178
TOTALS			787,733	87.9	3,585	\$158,123	\$1,133,670	\$49,580	\$1,084,090	6.9	1,213,050

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		276,142	35.4	-57	\$40,728	\$61,810	\$11,370	\$50,440	1.2	271,436
ECM 1	Install LED Fixtures	11,745	0.2	0	\$1,755	\$10,800	\$1,000	\$9,800	5.6	11,781
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	2,227	0.3	0	\$328	\$360	\$40	\$320	1.0	2,187
ECM 3	Retrofit Fixtures with LED Lamps	262,171	34.9	-56	\$38,645	\$50,650	\$10,330	\$40,320	1.0	257,469
Lighting Control Measures		92,702	11.8	-20	\$13,665	\$72,050	\$20,120	\$51,930	3.8	91,038
ECM 4	Install Occupancy Sensor Lighting Controls	64,822	8.6	-14	\$9,555	\$52,080	\$6,560	\$45,520	4.8	63,659
ECM 5	Install High/Low Lighting Controls	27,879	3.2	-6	\$4,110	\$19,970	\$13,560	\$6,410	1.6	27,379
Variable Frequency Drive (VFD) Measures		139,448	33.1	0	\$20,888	\$112,700	\$14,300	\$98,400	4.7	140,423
ECM 6	Install VFDs on Constant Volume (CV) Fans	122,337	31.4	0	\$18,325	\$92,100	\$12,300	\$79,800	4.4	123,193
ECM 7	Install VFDs on Heating Water Pumps	17,110	1.7	0	\$2,563	\$20,600	\$2,000	\$18,600	7.3	17,230
Unitary HVAC Measures		17,028	2.9	0	\$2,551	\$19,200	\$0	\$19,200	7.5	17,147
ECM 9	Install High Efficiency Heat Pumps	17,028	2.9	0	\$2,551	\$19,200	\$0	\$19,200	7.5	17,147
HVAC System Improvements		0	0.0	18	\$200	\$450	\$50	\$400	2.0	2,092
ECM 10	Install Pipe Insulation	0	0.0	18	\$200	\$450	\$50	\$400	2.0	2,092
Domestic Water Heating Upgrade		0	0.0	91	\$1,020	\$820	\$390	\$430	0.4	10,666
ECM 11	Install Low-Flow DHW Devices	0	0.0	91	\$1,020	\$820	\$390	\$430	0.4	10,666
Food Service & Refrigeration Measures		1,954	0.2	0	\$293	\$540	\$50	\$490	1.7	1,968
ECM 12	Vending Machine Control	1,954	0.2	0	\$293	\$540	\$50	\$490	1.7	1,968
Custom Measures		245,464	0.0	3,553	\$76,533	\$807,700	\$0	\$807,700	10.6	663,178
ECM 13	Installation of an Energy Management System	245,464	0.0	3,553	\$76,533	\$807,700	\$0	\$807,700	10.6	663,178
TOTALS		772,738	83.4	3,585	\$155,877	\$1,075,270	\$46,280	\$1,028,990	6.6	1,197,949

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		276,142	35.4	-57	\$40,728	\$61,810	\$11,370	\$50,440	1.2	271,436
ECM 1	Install LED Fixtures	11,745	0.2	0	\$1,755	\$10,800	\$1,000	\$9,800	5.6	11,781
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	2,227	0.3	0	\$328	\$360	\$40	\$320	1.0	2,187
ECM 3	Retrofit Fixtures with LED Lamps	262,171	34.9	-56	\$38,645	\$50,650	\$10,330	\$40,320	1.0	257,469

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

ECM 1: Install LED Fixtures

Replace existing fixtures containing HID, or incandescent lamps with new LED light fixtures. This measure saves energy by installing LEDs, which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixtures.

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

Affected Building Areas: HID fixtures in basement corridor, Verizon server room, and building exterior

ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers

Retrofit fluorescent fixtures by removing the fluorescent tubes and ballasts and replacing them with LED tubes and LED drivers (if necessary), which are designed to be used in retrofitted fluorescent fixtures.

The measure uses the existing fixture housing but replaces the electric components with more efficient lighting technology, which use less power than other lighting technologies but provides equivalent lighting output. Maintenance savings may also be achieved since LED tubes last longer than fluorescent tubes and, therefore, do not need to be replaced as often.

Affected Building Areas: all areas with fluorescent fixtures with T12 tubes: mechanical elevator 1 and mechanical elevator 3

ECM 3: Retrofit Fixtures with LED Lamps

Replace fluorescent, or incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected Building Areas: all areas with fluorescent fixtures with T8 tubes; T5 tubes: conference room 421; CFLs: oxygen building, janitorial M131, office 2006, janitorial 328, storage M334, and exterior; incandescent lamps: janitorial F131, janitorial F133, restroom-M241, restroom-M242, storage 2003

4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		92,702	11.8	-20	\$13,665	\$72,050	\$20,120	\$51,930	3.8	91,038
ECM 4	Install Occupancy Sensor Lighting Controls	64,822	8.6	-14	\$9,555	\$52,080	\$6,560	\$45,520	4.8	63,659
ECM 5	Install High/Low Lighting Controls	27,879	3.2	-6	\$4,110	\$19,970	\$13,560	\$6,410	1.6	27,379

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 4: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected Building Areas: offices, conference rooms, classrooms, dining rooms, dorm rooms, garage, kitchen, lounge, mechanical room, office, residential room, storage rooms, restrooms, and server room

ECM 5: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as occupants approach the area.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Affected Building Areas: hallways and stairwells

4.3 Variable Frequency Drives (VFD)

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures		139,448	33.1	0	\$20,888	\$112,700	\$14,300	\$98,400	4.7	140,423
ECM 6	Install VFDs on Constant Volume (CV) Fans	122,337	31.4	0	\$18,325	\$92,100	\$12,300	\$79,800	4.4	123,193
ECM 7	Install VFDs on Heating Water Pumps	17,110	1.7	0	\$2,563	\$20,600	\$2,000	\$18,600	7.3	17,230

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

ECM 6: Install VFDs on Constant Volume (CV) Fans

Install VFDs to control constant volume fan motor speeds. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature.

VAV system controls should not raise the supply air temperature at the expense of the fan power. A common mistake is to reset the supply air temperature to achieve chiller energy savings, which can lead to additional air flow requirements. Supply air temperature should be kept low (e.g., 55°F) until the minimum fan speed (typically about 50%) is met. At this point, it is efficient to raise the supply air temperature as the load decreases, but not such that additional air flow and thus fan energy is required.

For air handlers with direct expansion (DX) cooling systems, the minimum air flow across the cooling coil required to prevent the coil from freezing must be determined during the final project design. The control system programming should maintain the minimum air flow whenever the compressor is operating. Prior to implementation, verify minimum fan speed in cooling mode with the manufacturer. Note that savings will vary depending on the operating characteristics of each AHU.

These AHUs, MAUs, and HRUs serve different sections of the building, each with varying air change requirements based on design constraints for critical spaces. Air change requirements can impact how VFDs could be used, therefore, we recommend working with your mechanical design team to determine the application of VFDs for these fan motors.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

Affected Air Handlers:

Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Manufacturer	Model
Mechanical - Penthouse	Air Handling Unit - E1	1	Supply Fan	20.00	Strobic Air	TD36M25A1ZY
Mechanical - M16	AHU-4 & AHU-7	2	Supply Fan	5.00	-	-
Mechanical F6	AHU-1, 2, 3	3	Supply Fan	5.00	-	-
Mechanical M43	AHU-6	1	Supply Fan	3.00	Dayton	2MXU4B
Roof	HRU	1	Supply Fan	15.00	ACS- Hoval	PC1140
Roof	HRU	1	Return Fan	15.00	ACS- Hoval	PC1141
Roof	Package Unit - MUA-1	1	Supply Fan	7.50	-	-
Roof	Package Unit - MUA-1	1	Exhaust Fan	7.50	-	-
Roof	Package Unit - MUA-3	1	Supply Fan	7.50	-	-
Roof	Package Unit - MUA-3	1	Exhaust Fan	5.00	-	-

ECM 7: Install VFDs on Heating Water Pumps

Install variable frequency drives (VFD) to control heating water pumps. Two-way valves must serve the hot water coils, and the hot water loop must have a differential pressure sensor installed. If three-way valves or a bypass leg are used in the hot water distribution, they will need to be modified when this measure is implemented. As the hot water valves close, the differential pressure increases and the VFD modulates the pump speed to maintain a differential pressure setpoint.

Energy savings result from reducing pump motor speed (and power) as hot water valves close. The magnitude of energy savings is based on the estimated amount of time that the system will operate at reduced load.

Affected Pumps:

Location	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency
Mechanical - Penthouse	1	Heating Hot Water Pump	5.00	85.5%
Mechanical - Penthouse	1	Heating Hot Water Pump	5.00	81.0%
Mechanical - M16	1	Heating Hot Water Pump	2.00	81.5%
Mechanical - M16	1	Heating Hot Water Pump	2.00	86.5%

4.4 Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Unitary HVAC Measures		32,024	7.5	0	\$4,797	\$77,600	\$3,300	\$74,300	15.5	32,248
ECM 8	Install High Efficiency Air Conditioning Units	14,996	4.6	0	\$2,246	\$58,400	\$3,300	\$55,100	24.5	15,100
ECM 9	Install High Efficiency Heat Pumps	17,028	2.9	0	\$2,551	\$19,200	\$0	\$19,200	7.5	17,147

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the air conditioners are eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

ECM 8: Install High Efficiency Air Conditioning Units

We evaluated replacing standard efficiency packaged, split, and window air conditioning units with high efficiency air conditioning units. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling and heating load, and the estimated annual operating hours.

Affected Units:

Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Manufacturer	Model
Exterior	Condensing Unit-Basement	1	Split-System	4.00	Ducane	2AC13B48T-1A
Exterior	First Floor	1	Ductless Mini-Split AC	0.75	Friedrich	MR09Y3J
Exterior	Basement- Cooling	1	Split-System	3.00	Mitsubishi Electric	PUY-A36NHA
Locker Room M30	Locker Room M30 - Cooling	1	Window AC	1.00	Whirlpool	
Office - M73A	Office - M73A - Cooling	1	Window AC	1.00	Frigidaire	FFRE1233S10
Roof	Package Unit - MUA3	1	Package Unit	26.00	Aaon	RN-026-8-0-EA09-EHJ
Electrical Room F80	Air Handling Unit	1	Package Unit	4.00		RCMDD2248S008

ECM 9: Install High Efficiency Heat Pumps

Replace standard efficiency heat pumps with high efficiency heat pumps. A higher EER or SEER rating indicates a more efficient cooling system, and a higher HSPF rating indicates more efficient heating mode. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average heating and cooling loads, and the estimated annual operating hours.

Affected Units: basement cooling—Fujitsu and Daikin ductless mini split heat pumps

4.5 HVAC Improvements

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
HVAC System Improvements		0	0.0	18	\$200	\$450	\$50	\$400	2.0	2,092
ECM 10	Install Pipe Insulation	0	0.0	18	\$200	\$450	\$50	\$400	2.0	2,092

ECM 10: Install Pipe Insulation

Install insulation on steam and heating water system piping. Distribution system thermal losses are dependent on system fluid temperature, the size of the distribution system, and the extent and condition of piping insulation. When the insulation has been damaged due to exposure to water, when the insulation has been removed from some areas of the pipe, or when valves have not been properly insulated, system thermal efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

Affected Systems: heating hot water piping and steam system piping

4.6 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade		0	0.0	91	\$1,020	\$820	\$390	\$430	0.4	10,666
ECM 11	Install Low-Flow DHW Devices	0	0.0	91	\$1,020	\$820	\$390	\$430	0.4	10,666

ECM 11: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing.

4.7 Food Service and Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Food Service & Refrigeration Measures		1,954	0.2	0	\$293	\$540	\$50	\$490	1.7	1,968
ECM 12	Vending Machine Control	1,954	0.2	0	\$293	\$540	\$50	\$490	1.7	1,968

ECM 12: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

Affected Systems: refrigerated and non-refrigerated vending machine

4.8 Custom Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Custom Measures		245,464	0.0	3,553	\$76,533	\$807,700	\$0	\$807,700	10.6	663,178
ECM 13	Installation of an Energy Management System	245,464	0.0	3,553	\$76,533	\$807,700	\$0	\$807,700	10.6	663,178

ECM 13: Installation of an Energy Management System

Most larger facilities have some type of building automation system (BAS), which provides for centralized, remote control and monitoring of HVAC equipment, and sometimes lighting or other building systems. A BAS utilizes a system of temperature and pressure sensors that obtain feedback about field conditions and provide signals to control systems that adjust HVAC system operation for optimal functioning. Thirty years ago, most control systems were pneumatic systems driven by compressed air, with pneumatic thermostats and air driven actuators for valves and dampers. Pneumatic controls have largely been replaced by direct digital control (DDC) systems, but many pneumatic systems remain. Contemporary DDC systems afford tighter controls and enhanced monitoring and trending capabilities as compared to the older systems.

Often smaller (or older) facilities are not equipped with central controls. For many small sites, it has been less costly to install distributed local controls, such as programmable thermostats and timeclocks, rather than centralized DDC. Local controls do a reasonably good job of scheduling equipment and maintaining operating conditions by relying on controls integral to HVAC units, such as logic for compressor staging, to manage the equipment operating algorithms.

Inefficiencies arise when temperature sensors and thermostat schedules are not maintained, when there are separate systems for heating and cooling, and especially when equipment is added, or the facility is reconfigured or repurposed.

We noted that the chilled water system is equipped with some level of BAS control, but other systems are not. Based on our survey, it appears that the installation of a BAS at your site could increase the efficiency of your building HVAC system operation.

A controls upgrade would enable automated equipment to start and stop times, temperature setpoints, lockouts and deadbands to be programmed remotely using a graphic interface. Controls can be configured to optimize ventilation and outside air intake by adjusting economizer position, damper function, and fan speed. Existing chilled and hot water distribution system controls are typically tied in, including associated pumps and valves. Coordinated control of HVAC systems is dependent on a network of sensors and status points. A comprehensive building control system provides monitoring and control for all HVAC systems, so operators can adjust system programming for optimal comfort and energy savings.

It is recommended that an HVAC engineer or contractor who specializes in BAS be contacted for a detailed evaluation and implementation costs. For the purposes of this report, the potential energy savings and measure costs were estimated based on industry standards and previous project experience. Further analysis should be conducted for the feasibility of this measure. This is not an investment grade analysis nor should be used as a basis for design and construction.

A high-level evaluation of potential savings and costs is provided for demonstration purposes only. It is a screening evaluation for the potential in installing a BAS. Based on industry standards and previous project experience, the potential energy savings may be up to 20% of existing HVAC energy use. We estimate the cost for installing a BAS is approximately \$5.00 per square foot. Actual savings and costs will need to be outlined by the specific contractor engaged to implement the system. For the purposes of this report, we have conservatively estimated savings to be 10.7% of the HVAC energy consumption baseline.

4.9 Measures for Future Consideration

There are additional opportunities for improvement that State of NJ Department of Human Services may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment, and/or include significant system reconfiguration. These measures are therefore beyond the scope of this energy audit. These measures are described here to support a whole building approach to energy efficiency and sustainability.

State of NJ Department of Human Services may wish to consider the Energy Savings Improvement Program (ESIP) or other whole building approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to:

- Evaluate these measures further.
- Develop firm costs.
- Determine measure savings.
- Prepare detailed implementation plans.

Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

Electric Sub Metering

Electricity use varies in different facilities, and plant operators need to perform their own investigations and analyses to understand how their facilities consume energy. Utility bills indicate how much energy a facility uses across the entire facility, but submetering provides more detailed data on the energy consumption of specific systems and even on individual pieces of equipment, depending on how extensively meters are installed. Electric submeters alone do not save energy, but they are a useful tool under the right circumstances. Electric sub-meters can provide facility staff with real-time energy use data for specific buildings and equipment, information that enhances the potential for greater energy management activities. Revenue grade submeters are a tool that allow operators to better understand how and where electricity is used at the facility. Better resolution of system energy use can lead to operational changes or even equipment modifications or replacement, which often result in reduced energy use, which often result in reduced energy use.

Upgrade to a Heat Pump System

Electric resistance heating units work by passing an electric current through wires to heat them. The system is 100% efficient since for every unit of electricity consumed, one unit of heat is produced.

But there is a way to convert electricity to create heat at better than a 1:1 ratio. Heat pumps operate on a more efficient principle, the refrigeration cycle. Instead of directly converting electricity to heat, electricity does the work, via a compressor, of moving refrigerant through a system that transfers heat from a cooler place to a warmer place. That system can move three to five as much energy as is available

using electric resistance heating methods. Heat pumps work in a similar manner to an air conditioner, except they reverse the cooling process to circulate warm air instead of cold air. Also, heat pumps are generally capable of dispensing refrigerated air as they can typically be operated in air conditioning mode.

Electric resistance heat, including electric furnaces and baseboard heaters, can be inexpensive to install but often expensive to run. Facilities with these systems can save substantial energy at a moderate cost by installing a heat pump when they replace a central air conditioner.

Even in buildings without central air-conditioning, there are opportunities to save energy when an existing electric furnace needs to be replaced, as well as opportunities to install ductless electric heat pumps in buildings with baseboard electric heaters and electric fan coils. Unit ventilators with built-in electric resistance heaters can be replaced with unit ventilators with integrated heat pumps.

Electric heat pumps have high coefficient of performance (COP) ratings and are substantially more efficient than traditional electric heating systems. Further investigation is required to determine whether installing a heat pump system is a cost-effective solution when replacing existing electrical heating systems.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5%–20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR Portfolio Manager



You've heard it before—you cannot manage what you do not measure. ENERGY STAR Portfolio Manager is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions⁶. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Weatherization

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. Materials used may include caulk, polyurethane foam, and other weather-stripping materials. There is an energy savings opportunity by reducing the uncontrolled air exchange between the outside and inside of the building. Blower door assisted comprehensive building air sealing will reduce the amount of air exchange, which will in turn reduce the load on the buildings heating and cooling equipment, providing energy savings and increased occupant comfort.

Doors and Windows

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Window Treatments/Coverings

Use high-reflectivity films or cover windows with shades or shutters to reduce solar heat gain and reduce the load on cooling and heating systems. Older, single-pane windows and east- or west-facing windows are especially prone to solar heat gain. In addition, use shades or shutters at night during cold weather to reduce heat loss.

⁶ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>

Lighting Maintenance



Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.

In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

Motor Controls

Electric motors often run unnecessarily, and this is an overlooked opportunity to save energy. These motors should be identified and turned off when appropriate. For example, exhaust fans often run unnecessarily when ventilation requirements are already met. Whenever possible, use automatic devices such as twist timers or occupancy sensors to turn off motors when they are not needed.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Thermostat Schedules and Temperature Resets



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5°F-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

Economizer Maintenance

Economizers can significantly reduce cooling system load. A malfunctioning economizer can increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air. Common economizer malfunctions include broken outdoor thermostat or enthalpy control or dampers that are stuck or improperly adjusted.

Periodic inspection and maintenance will keep economizers working in sync with the heating and cooling system. This maintenance should be part of annual system maintenance, and it should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position.

AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Steam Trap Repair and Replacement

Steam traps are a crucial part of delivering heat from the boiler to the space heating units. Steam traps are automatic valves that remove condensate from the system. If the traps fail closed, condensate can build up in the steam supply side of the trap, which reduces the flow in the steam lines and thermal capacity of the radiators. Or they may fail open, allowing steam into the condensate return lines resulting in wasted energy, water, and hammering. Losses can be significantly reduced by testing and replacing equipment as they start to fail. Repair or replace traps that are blocked or allowing steam to pass. Inspect steam traps as part of a regular steam system maintenance plan.

Label HVAC Equipment

For improved coordination in maintenance practices, we recommend labeling or re-labeling the site HVAC equipment. Maintain continuity in labeling by following labeling conventions as indicated in the facility drawings or BAS building equipment list. Use weatherproof or heatproof labeling or stickers for permanence, but do not cover over original equipment nameplates, which should be kept clean and readable whenever possible. Besides equipment, label piping for service and direction of flow when possible. Ideally, maintain a log of HVAC equipment, including nameplate information, asset tag designation, areas served, installation year, service dates, and other pertinent information.

This investment in your equipment will enhance collaboration and communication between your staff and your contracted service providers and may help you with regulatory compliance.

Optimize HVAC Equipment Schedules

Energy management systems (BAS) typically provide advanced controls for building HVAC systems, including chillers, boilers, air handling units, rooftop units and exhaust fans. The BAS monitors and reports operational status, schedules equipment start and stop times, locks out equipment operation based on outside air or space temperature, and often optimizes damper and valve operation based on complex algorithms. These BAS features, when in proper adjustment, can improve comfort for building occupants and save substantial energy.

Know your BAS scheduling capabilities. Regularly monitor HVAC equipment operating schedules and match them to building operating hours to eliminate unnecessary equipment operation and save energy. Monitoring should be performed often at sites with frequently changing usage patterns – daily in some cases. We recommend using the optimal start feature of the BAS (if available) to optimize the building warmup sequence. Most BAS scheduling programs provide for holiday schedules, which can be used during reduced use or shutdown periods. Finally, many systems are equipped with a one-time override function, which can be used to provide additional space conditioning due to a one-time, special event. When available this override feature should be used rather than changing the base operating schedule.

Water Heater Maintenance

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues, and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Compressed Air System Maintenance

Compressed air systems require periodic maintenance to operate at peak efficiency. A maintenance plan for compressed air systems should include:

- Inspection, cleaning, and replacement of inlet filter cartridges.
- Cleaning of drain traps.
- Daily inspection of lubricant levels to reduce unwanted friction.
- Inspection of belt condition and tension.
- Check for leaks and adjust loose connections.
- Overall system cleaning.
- Reduce pressure setting to minimum needed for air operated equipment.
- Turn off compressor if not routinely needed.
- Use low pressure blower air rather than high pressure compressed air.

Contact a qualified technician for help with setting up periodic maintenance schedule.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR products where available.

6 WATER BEST PRACTICES

Getting Started



The commercial and institutional sector is the second largest consumer of publicly supplied water in the United States, accounting for 17% of the withdrawals from public water supplies⁷. In New Jersey, excluding water used for power generation, approximately 80% of total water use was attributed to potable supply during the period of 2009 to 2018. Water withdrawals for potable supply have not changed noticeably during the period from 1990 to 2018⁸.

Water management planning serves as the foundation for any successful water reduction effort. It is the first step a commercial or institutional facility owner or manager should take to achieve and sustain long-term water savings. Understanding how water is used within a facility is critical for the water management planning process. A water assessment provides a comprehensive account of all known water uses at the facility. It allows the water management team to establish a baseline from which progress and program success can be measured. It also enables the water management team to set achievable goals and identify and prioritize specific projects based on the relative savings opportunities and project cost-effectiveness.

Water conservation devices may significantly reduce your water and sewer usage costs. Any reduction in water use reduces grid-level electricity use since a significant amount of electricity is used to treat and deliver water from reservoirs to end users.

For more information regarding water conservation or additional details regarding the practices shown below go to the EPA's WaterSense website⁹ or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"¹⁰ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water Metering and Submetering

Tracking a facility's total water use, as well as specific end uses, is a key component of a facility's water-efficiency efforts. Accurately measuring water use can help facility managers identify areas for targeted reductions and track progress from water-efficiency upgrades. If possible, install meters to measure all water conveyed to the facility, regardless of the source. Each source should be metered separately. Consider developing a metering plan and installing separate submeters to measure specific end uses. There are many types and sizes of meters intended for different uses. Installing the correct type and size of meter are critical to accurate water measurement. Sub-metering applications may include:

- Individual tenant spaces
- Cooling tower make-up and blowdown water supply
- Water lines serving other HVAC systems including water circulating loops
- Make up water supply for steam boiler plants with a capacity of 500,000 Btu/hr. or greater
- Systems or equipment that use single pass cooling water
- Irrigation systems

⁷ Estimated from analyzing data in: [Solley, Wayne B., et al, "Estimated Use of Water in the United States in 1995", U.S Geological Survey Circular 1200, \(1998\)](#)

⁸ <https://dep.nj.gov/wp-content/uploads/dsr/trends-water-supply.pdf>

⁹ <https://www.epa.gov/watersense>

¹⁰ <https://www.epa.gov/watersense/watersense-work-0>

- Roof spray systems (for irrigating vegetated roofs or thermal conditioning)
- Ornamental water features
- Indoor and outdoor pools and spas
- Industrial water using processes

Leak Detection and Repair

Identifying and repairing leaks and other water use anomalies within a facility's water distribution system or from processes or equipment can keep a facility from wasting significant quantities of water. Examples of common leaks include leaking toilets and faucets, drip irrigation malfunctions, stuck float valves, and broken distribution lines. Reading meters, installing failure abatement technologies, and conducting visual and auditory inspections are important best practices to detect leaks. Train building occupants, employees, and visitors to report any leaks that they detect. To reduce unnecessary water loss, detected leaks should be repaired quickly. Repairing leaks in water distribution that is pressurized by on-site pumps or in heated or chilled water piping will also reduce energy use.

Toilets and Urinals

Toilets and urinals are considered sanitary fixtures and are found in most facilities. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously flushing, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment and the frequency of use, it may be cost effective to replace older inefficient fixtures with current generation WaterSense labeled equipment.

Commercial facilities typically use tank toilets or wall-mount flushometers. Educate and inform users with restroom signage and other means to avoid flushing inappropriate objects. For tank toilets, periodically check to ensure fill valves are working properly and that water level is set correctly. Annually test toilets to ensure the flappers are not worn or allowing water to seep from the tank into the bowl and down the sewer. Control stops and piston valves on flushometer toilets should be checked at least annually.

Most urinals use water to flush liquid. These standard single-user fixtures are present in most facilities. Non-water urinals use a specially designed trap that allows liquid waste to drain out of the fixture through a trap seal, and into the drainage system. Flushing urinals should be inspected at least annually for proper valve and sensor operation. For non-water urinals, follow maintenance practices as directed by the manufacturer to ensure products perform as expected. Non-water urinals can be considered during urinal replacement, however, review the condition and design of the existing plumbing system and the expected usage patterns to ensure that these products will provide the anticipated performance.

Faucets and Showerheads

Faucets and showerheads are sanitary fixtures that generally dispense heated water. Reducing water use by these fixtures translates into a reduction of site fuel or electric use depending on how water is heated. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously dripping, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment and the frequency of use, it may be cost effective to replace older fixtures with current generation WaterSense labeled equipment.

Faucets are used for a variety of purposes, and standard flow rates are dictated by the intended use. Public use lavatory faucets and kitchen faucets are subject to maximum flow rates while service sinks are not. Periodically inspect faucet aerators for scale buildup to ensure flow is not being restricted. Clean or replace the aerator or other spout end device as needed. Check and adjust automatic sensors (where

installed) to ensure they are operating properly to avoid faucets running longer than necessary. Post materials in restrooms and kitchens to ensure user awareness of the facility's water-efficiency goals. Remind users to turn off the tap when they are done and to consider turning the tap off during sanitation activities when it is not being used. Consider installing lavatory and kitchen faucet fixtures with reduced flow. Federal standards limit kitchen and restroom faucet flows to 2.2 gpm. To qualify for a WaterSense label a faucet cannot exceed 1.5 gpm.

Effective in 1992, the maximum allowable flow rate for all showerheads sold in the United States is 2.5 gpm. Since this standard was enacted, many showerheads have been designed to use even less water. WaterSense labeled equipment is designed to use 2.0 gpm, or less. For optimum showerhead efficiency, the system pressure should be tested to make sure that it is between 20 and 80 pounds per square inch (psi). Verify that plumbing lines are routed through a shower valve to prevent water pressure fluctuations. Periodically inspect showerheads for scale buildup to ensure flow is not being restricted. In general, replace showerheads with 2.5 gpm flow rates or higher with WaterSense labeled models. Note: Use of poor performing replacement reduced flow showerheads may result in increased use if the duration of use is increased to compensate for reduced performance. WaterSense labeled showerheads are independently certified to meet or exceed minimum performance requirements for spray coverage and force.

Ice Machines

Commercial ice machines use refrigeration units to freeze water into ice. Ice machines typically use water for two purposes: cooling the refrigeration unit and making ice. Because the ice-making process generates a significant amount of heat, either water or air is used to remove this waste heat from the ice machine's refrigeration unit.

Water-cooled ice machines generally pass water through the machine once to cool it and then dispose of the single-pass water down the drain. Water-cooled systems can use less water by recirculating the cooling water through a chiller or a cooling tower to lower the temperature, returning the water to the machine for reuse. To eliminate using water to cool the refrigeration unit altogether, air can be used to cool the unit. Air-cooled ice machines use motor-driven fans or centrifugal blowers to move air through the refrigeration unit to remove heat. In general, water-cooled units are more energy efficient than air-cooled units but use more water. Commercial ice machines that are ENERGY STAR qualified are, on average, 15% more energy-efficient and 10% more water-efficient than standard air-cooled models.

For optimal ice machine efficiency, consider the following:

- Clean the ice machine to remove lime and scale buildup; sanitize it to kill bacteria and fungi. Run the self-cleaning sequence if available. For machines without a self-cleaning mode, shut down the machine, empty the bin of ice, add cleaning or sanitizing solution to the machine, switch it to cleaning mode, and then switch it to ice production mode. For health and safety purposes, create and discard several batches of ice to remove residual cleaning solution.
- Keep the ice machine's coils clean to ensure the heat exchange process is running efficiently.
- Keep the lid closed to preserve cool air and maintain the appropriate temperature.
- Install a timer to shift ice production to off-peak hours to decrease peak energy demand.
- Work with the manufacturer to ensure that the ice machine's rinse cycle is set to the lowest possible frequency that still provides sufficient ice quality and meets local water quality and site requirements.
- Follow the manufacturer's use and care instructions for the specific ice machine model.
- Train users to report leaking or otherwise improperly operating ice machines to the appropriate personnel.

If the machine is cooled using single-pass water, modify the machine to operate on a closed loop that recirculates the cooling water through a cooling tower or heat exchanger, if possible.

When replacing an ice machine or installing a new one, ensure that the new model is sized appropriately to fit the facility's need. Choose an ice machine that is appropriate for the quality of ice needed. Producing ice of higher quality than required will use water unnecessarily. Look for ENERGY STAR qualified models, all of which are air-cooled. Also consider air- or water-cooled ice machines that meet the efficiency specifications outlined by the Consortium for Energy Efficiency. If feasible, consider selecting air-cooled flake or nugget ice machines, which use less water and energy than cubed ice machines.

7 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

7.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A campus wide screening based on the facility's demand, combined available spaces, and shading elements has been included in the report for Boiler House.

Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners must register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- ◆ **Successor Solar Incentive Program (SuSI):** <https://www.njcleanenergy.com/renewable-energy/programs/susi-program>
- ◆ **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- ◆ **NJ Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs
- ◆ **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

7.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection has been included in the report for the Boiler House.

Find a qualified firm that specializes in commercial CHP cost assessment and installation:
http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/

8 ELECTRIC VEHICLES

All electric vehicles (EVs) have an electric motor instead of an internal combustion engine. EVs function by plugging into a charge point, taking electricity from the grid, and then storing it in rechargeable batteries. Although electricity production may contribute to air pollution, the U.S. EPA categorizes all-electric vehicles as zero-emission vehicles because they produce no direct exhaust or tailpipe emissions.

EVs are typically more expensive than similar conventional and hybrid vehicles, although some cost can be recovered through fuel savings, federal tax credit, or state incentives.

8.1 EV Charging

EV charging stations provide a means for electric vehicle operators to recharge their batteries at a facility. While many EV drivers charge at home, others do not have access to regular home charging, and the ability to charge at work or in public locations is critical to making EVs practical for more drivers. Charging can also be used for electric fleet vehicles, which can reduce fuel and maintenance costs for fleets that replace gas or diesel vehicles with EVs.

EV charging comes in three main types. For this assessment, the screening considers addition of Level 2 charging, which is most common at workplaces and other public locations. Depending on the site type and usage, other levels of charging power may be more appropriate.

The preliminary assessment of EV charging at the facility shows that there is medium potential for adding EV chargers to the facility's parking, based on potential costs of installation and other site factors.

The primary costs associated with installing EV charging are the charger hardware and the cost to extend power from the facility to parking spaces. This may include upgrades to electric panels to serve increased loads.


The type and size of the parking area impact the costs and feasibility of adding EV charging. Parking structure installations can be less costly than surface lot installations as power may be readily available, and equipment and wiring can be surface mounted. Parking lot installations often require trenching through concrete or asphalt surface. Large parking areas provide greater flexibility in charger siting than smaller lots.

The location and capacity of facility electric panels also impact charger installation costs. A Level 2 charger generally requires a dedicated 208V-240V, 40 Amp circuit. The electric panel nearest the planned installation may not have available capacity and may need to be upgraded to serve new EV charging loads. Alternatively, chargers could be powered from a more distant panel. The distance from the panel to the location of charging stations ties directly to costs, as conduits, cables, and potential trenching costs all increase on a per-foot basis. The more charging stations planned, the more likely it is that additional electrical capacity will be needed.

Other factors to consider when planning for EV charging at a facility include who the intended users are, how long they park vehicles at the site, and whether they will need to pay for the electricity they use.



The graphic below displays the results of the EV charging assessment conducted as part of this audit. The position of each slider indicates the impact each factor has on the feasibility of installing EV charging at the site.

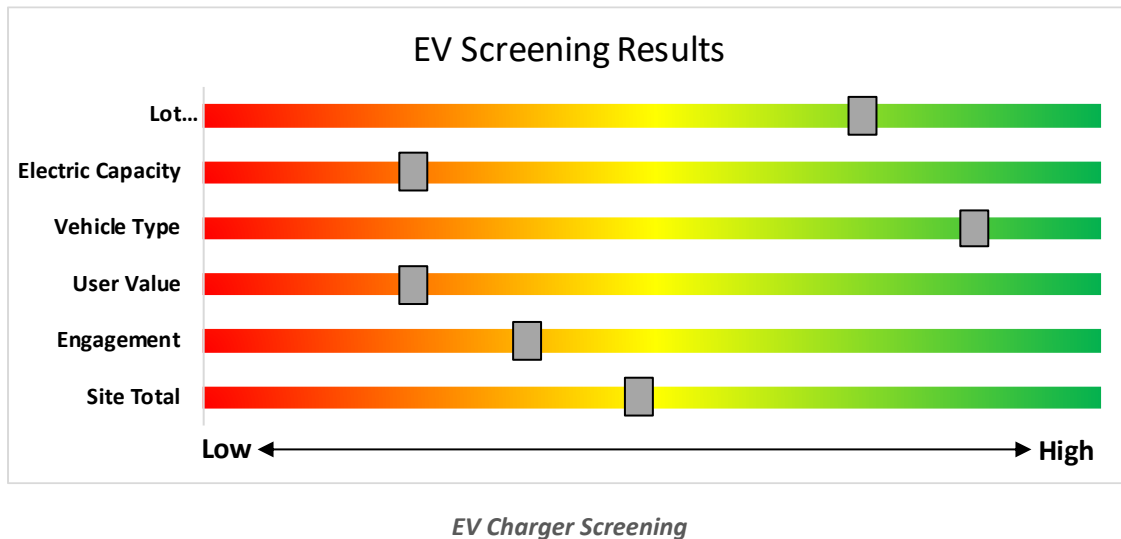

Electric Vehicle Programs Available

New Jersey is leading the way on electric vehicle (EV) adoption on the East Coast. There are several programs designed to encourage EV adoption in New Jersey, which is crucial to reaching a 100% clean energy future.

NJCEP offers a variety of EV programs for vehicles, charging stations, and fleets. Certain EV charging stations that receive electric utility service from Atlantic City Electric Company (ACE), Public Service Electric and Gas Company (PSE&G) or Jersey Central Power and Light (JCP&L), may be eligible for additional electric vehicle charging incentives directly from the utility. Projects may be eligible for both the incentives offered by this BPU program and incentives offered by ACE, PSE&G or JCP&L, up to 90% of the combined charger purchase and installation costs. Please check ACE, PSE&G or JCP&L program eligibility requirements before purchasing EV charging equipment, as additional conditions on types of eligible chargers may apply for utility incentives.

EV Charging incentive information is available from Atlantic City Electric, PSE&G and JCP&L. For more information and to keep up to date on all EV programs please visit <https://www.njcleanenergy.com/commercial-industrial/programs/electric-vehicle-programs>

9 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs and Utility Energy Efficiency Programs can help. Pick the program that works best for you. This section provides an overview of currently available incentive programs in New Jersey.

NJBPU and NJCEP Administered Programs



- New Construction (residential, commercial, industrial, government)
- Large Energy Users
- Energy Savings Improvement Program (financing)
- State Facilities Initiative*
- Local Government Energy Audits
- Combined Heat & Power & Fuel Cells

*State facilities are also eligible for utility programs

Utility Administered Programs



- Existing buildings (residential, commercial, industrial, government)
- Efficient Products
 - Lighting & Marketplace
 - HVAC
 - Appliance Rebates
 - Appliance Recycling

9.1 New Jersey's Clean Energy Program

Save money while saving the planet! New Jersey's Clean Energy Program is a statewide program that offers incentives, programs, and services that benefit New Jersey residents, businesses, educational, non-profit, and government entities to help them save energy, money, and the environment.

Large Energy Users

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers. To qualify entities must have incurred at least \$5 million in total energy costs in the prior fiscal year.

Incentives

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually

How to Participate

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEED). Once the FEED is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at <http://www.njcleanenergy.com/LEUP>.

Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation. ≤

Incentives¹¹

Eligible Technology	Size (Installed Rated Capacity)	Incentive (\$/Watt) ⁵	% of Total Cost Cap per Project	\$ Cap per Project
CHPs powered by non-renewable or renewable fuel source, or a combination: ⁴ - Gas Internal Combustion Engine - Gas Combustion Turbine - Microturbine Fuel Cells ≥60%	≤500 kW ¹	\$2.00	30-40% ²	\$2 million
	>500 kW - 1 MW ¹	\$1.00		
	> 1 MW - 3 MW ¹	\$0.55	30%	\$3 million
	>3 MW ¹	\$0.35		
Fuel Cells ≥40%	Same as above ¹	Applicable amount above	30%	\$1 million
Waste Heat to Power (WHP) ³ Powered by non-renewable fuel source. Heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine)	≤1MW ¹	\$1.00	30%	\$2 million
	> 1MW ¹	\$.50	30%	\$3 million

¹¹

¹ Incentives are tiered, which means the incentive levels vary based upon the installed rated capacity, as listed in the chart above. For example, a 4 MW CHP system would receive \$2.00/watt for the first 500 kW, \$1.00/watt for the second 500 kW, \$0.55/watt for the next 2 MW and \$0.35/watt for the last 1 MW (up to the caps listed).

² The maximum incentive will be limited to 30% of total project. For CHP projects up to 1 MW, this cap will be increased to 40% where a cooling application is used or included with the CHP system (e.g. absorption chiller).

³ Projects will be eligible for incentives shown above, not to exceed the lesser of % of total project cost per project cap or maximum \$ per project cap. Projects installing CHP or FC with WHP will be eligible for incentive shown above, not to exceed the lesser caps of the CHP or FC incentive. Minimum efficiency will be calculated based on annual total electricity generated, utilized waste heat at the host site (i.e. not lost/rejected), and energy input.

⁴ Systems fueled by a Class 1 Renewable Fuel Source, as defined by N.J.A.C. 14:8-2.5, are eligible for a 30% incentive bonus. If the fuel is mixed, the bonus will be prorated accordingly. For example, if the mix is 60/40 (60% being a Class 1 renewable), the bonus will be 18%. This bonus will be included in the final performance incentive payment, based on system performance and fuel mix consumption data. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.

⁵ CHP-FC systems located at Critical Facility and incorporating blackstart and islanding technology are eligible for a 25% incentive bonus. This bonus incentive will be paid with the second/Installation incentive payment. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.



How to Participate

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at <http://www.njcleanenergy.com/CHP>.

Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects must register their projects prior to the start of construction to establish the project's eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two sub-programs. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

Administratively Determined Incentive (ADI) Program

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

Market Segments	Size MW dc	Incentive Value (\$/SREC II)	Public Entities Incentive Value - \$20 Adder (\$/SRECII)
Net Metered Residential	All types and sizes	\$90	N/A
Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects smaller than 1 MW	\$100	\$120
Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects 1 MW to 5 MW	\$90	\$110
Small Net Metered Non-Residential Ground Mount	Projects smaller than 1 MW	\$85	\$105
Large Net Metered Non-Residential Ground Mount	Projects 1 MW to 5 MW	\$80	\$100
LMI Community Solar	Up to 5 MW	\$90	N/A
Non-LMI Community Solar	Up to 5 MW	\$70	N/A
Interim Subsection (t)	All types and sizes	\$100	N/A

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations.

Competitive Solar Incentive (CSI) Program

The CSI Program opened on April 15, 2023, and will serve as the permanent program within the SuSI Program providing incentives to larger solar facilities. The CSI Program is open to qualifying grid supply solar facilities, non-residential net metered solar installations with a capacity greater than five (5) megawatts ("MW"), and to eligible grid supply solar facilities installed in combination with energy storage.

CSI eligible facilities will only be allowed to register in the CSI program upon award of a bid pursuant to N.J.A.C. 14:8-11.10.

The CSI program structure has separate categories, or tranches, to ensure that a range of solar project types, including those on preferred sites, are able to participate despite potentially different project cost profiles. The Board has approved four tranches for grid supply and large net metered solar and an additional fifth tranche for storage in combination with grid supply solar. The following table lists procurement targets for the first solicitation:

Tranche	Project Type	MW (dc) Targets
Tranche 1.	Basic Grid Supply	140
Tranche 2.	Grid Supply on the Built Environment	80
Tranche 3.	Grid Supply on Contaminated Sites and Landfills	40
Tranche 4.	Net Metered Non- Residential	40
Tranche 5.	*Storage Paired with Grid	160 MWh

*The storage tranche of 160 MWh corresponds to a 4-hour storage pairing of 40 MW of solar

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state's Energy Master Plan.

If you are considering installing solar on your building, visit the following link for more information: <https://njcleanenergy.com/renewable-energy/programs/susi-program>

Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

Demand Response (DR) Energy Aggregator

Demand Response Energy Aggregator is a program designed to reduce the electric load when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Grid operators call upon curtailment service providers and commercial facilities to reduce electric usage during times of peak demand, making the grid more reliable and reducing transmission costs for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary, and participants receive payments whether or not their facility is called upon to curtail its electric usage.

Typically, an electric customer must be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with greater capability to quickly curtail their demand during peak hours receive higher payments. Customers with back-up generators on site may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in DR programs often find it to be a valuable source of revenue for their facility, because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature setpoints on thermostats (so that air conditioning units run less frequently) or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a DR activity in most situations.

The first step toward participation in a DR program is to contact a curtailment service provider. A list of these providers is available on the website of the independent system operator, PJM, and it includes contact information for each company, as well as the states where they have active business¹². PJM also posts training materials for program members interested in specific rules and requirements regarding DR activity along with a variety of other DR program information¹³.

Curtailment service providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities, and they may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

¹² <http://www.pjm.com/markets-and-operations/demand-response.aspx>.

¹³ <http://www.pjm.com/training/training-events.aspx>.

9.2 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey's investor-owned gas and electric utilities to reduce their customers' use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

Prescriptive and Custom

The Prescriptive and Custom rebate program through your utility provider offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

Equipment Examples

Lighting

Lighting Controls

HVAC Equipment

Refrigeration

Gas Heating

Gas Cooling

Commercial Kitchen Equipment

Food Service Equipment

Variable Frequency Drives

Electronically Commutate Motors

Variable Frequency Drives

Plug Loads Controls

Washers and Dryers

Agricultural

Water Heating

The Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type. The Custom program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives.

Direct Install

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW or less over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures.

How to Participate

To participate in Direct Install, you will work with a participating contractor. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the Direct Install program, subject to program rules and eligibility, while the remaining percent of the cost is paid to the contractor by the customer.


Engineered Solutions

The Engineered Solutions Program provides tailored energy-efficiency assistance and services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. Customers receive expert guided services, including investment-grade energy auditing, engineering design, installation assistance, construction administration, commissioning, and measurement and verification (M&V) services to support the implementation of cost-effective and comprehensive efficiency projects. Engineered Solutions is generally a good option for medium to large sized facilities with a peak demand over 200 kW looking to implement as many measures as possible under a single project to achieve deep energy savings. Engineered Solutions has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Incentives for this program are based on project scope and energy savings achieved.

For more information on any of these programs, contact your local utility provider or visit <https://www.njcleanenergy.com/transition>.

10 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

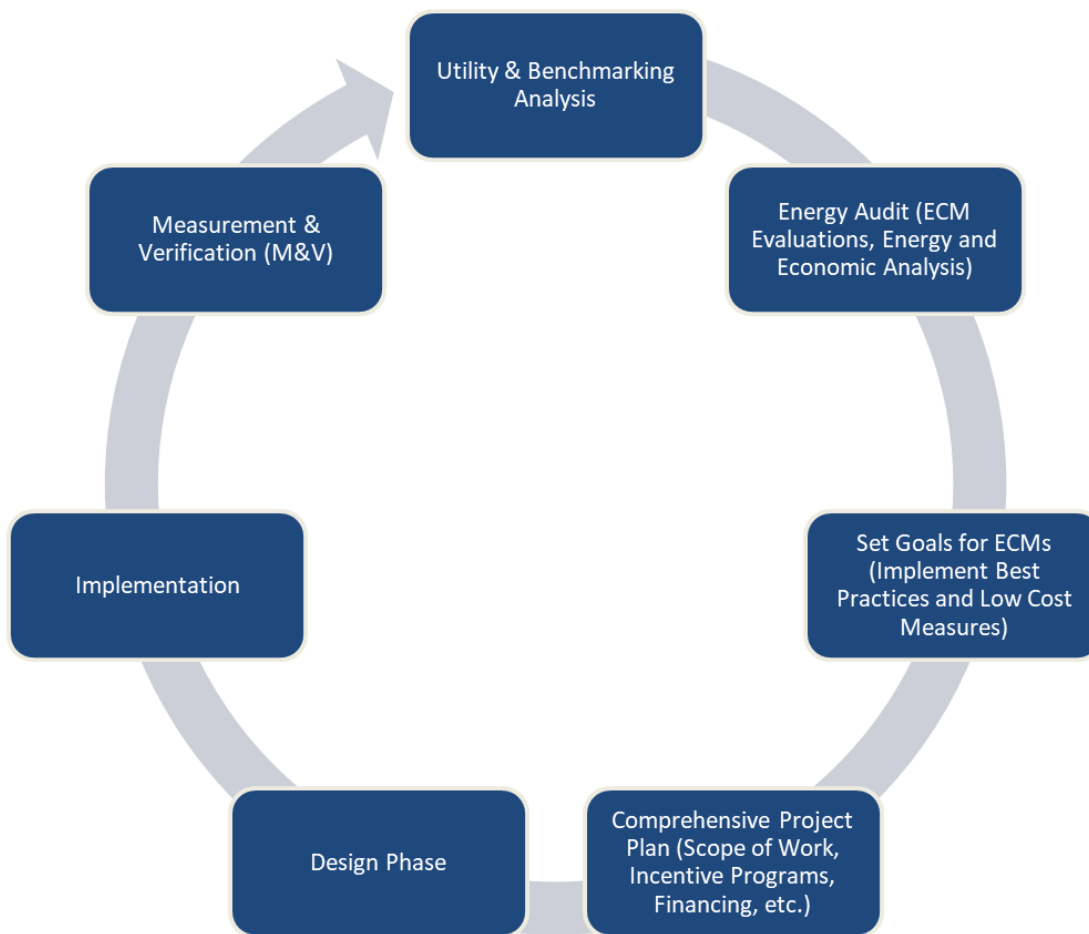

Project Development Cycle

11 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

11.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website¹⁴.

11.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website¹⁵.

¹⁴ www.state.nj.us/bpu/commercial/shopping.html

¹⁵ www.state.nj.us/bpu/commercial/shopping.html



APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Oxygen Building	1	Compact Fluorescent: (1) 42W Plug-In Lamp	Photocell		42	4,380	3	Relamp	No	1	LED Lamps: PL-L (Biax) Lamps	Photocell	30	4,380	0.0	53	0	\$8	\$10	\$0	1.3
Oxygen Building	1	LED Lamps: (1) 12W Plug-In Lamp	Wall Switch	S	12	8,736		None	No	1	LED Lamps: (1) 12W Plug-In Lamp	Wall Switch	12	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Classroom - F113	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.2	990	0	\$146	\$530	\$80	3.1
Classroom - F114	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	743	0	\$109	\$480	\$70	3.7
Classroom F144	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.3	1,486	0	\$219	\$630	\$100	2.4
Computer Lab F110	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	311	0	\$46	\$50	\$10	0.9
Conference 1002	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.5	2,476	-1	\$365	\$840	\$140	1.9
Conference 1006	10	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	5,460	3, 4	Relamp	Yes	10	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,767	0.7	3,714	-1	\$547	\$960	\$190	1.4
Conference 1059	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.5	2,476	-1	\$365	\$840	\$140	1.9
Corridor - 1st Floor F-Side	14	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	14	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor - 1st Floor F-Side	10	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,736	5	None	Yes	10	LED - Fixtures: Ceiling Mount	High/Low Control	20	6,028	0.1	585	0	\$86	\$560	\$350	2.4
Corridor - 1st Floor F-Side	8	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,736	5	None	Yes	8	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	6,028	0.1	1,018	0	\$150	\$560	\$280	1.9
Corridor - 1st Floor F-Side	16	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	S	26	8,736	5	None	Yes	16	LED - Linear Tubes: (3) 2' Lamps	High/Low Control	26	6,028	0.1	1,193	0	\$176	\$850	\$560	1.6
Corridor - 1st Floor M-Side	14	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	14	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor - 1st Floor M-Side	10	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,736	5	None	Yes	10	LED - Fixtures: Ceiling Mount	High/Low Control	20	6,028	0.1	585	0	\$86	\$560	\$350	2.4
Corridor - 1st Floor M-Side	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,736	5	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	6,028	0.1	509	0	\$75	\$280	\$140	1.9
Corridor - 1st Floor M-Side	17	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	S	26	8,736	5	None	Yes	17	LED - Linear Tubes: (3) 2' Lamps	High/Low Control	26	6,028	0.1	1,268	0	\$187	\$850	\$600	1.3
Electrical Room 1038	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,736	0.1	528	0	\$78	\$90	\$20	0.9
Exterior - Gym Patio	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch		20	8,736		None	No	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Wall Switch	20	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Gymnasium M143	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,736	3, 4	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.4	3,566	-1	\$526	\$710	\$130	1.1
Janitorial 1055	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial F131	1	Incandescent: (1) 75W A19 Screw-In Lamp	Wall Switch	S	75	2,912	3	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	12	2,912	0.1	198	0	\$29	\$30	\$0	1.0
Janitorial F133	1	Incandescent: (1) 75W A19 Screw-In Lamp	Wall Switch	S	75	2,912	3	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	12	2,912	0.1	198	0	\$29	\$30	\$0	1.0
Janitorial M131	1	Compact Fluorescent: (1) 42W Triple Biaxial Plug-In Lamp	Wall Switch	S	42	2,912	3	Relamp	No	1	LED Lamps: PL-L (Biax) Lamps	Wall Switch	30	2,912	0.0	38	0	\$6	\$10	\$0	1.8
Kitchen - M154	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.2	2,094	0	\$309	\$600	\$100	1.6



Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Lobby M129	2	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,736		None	No	2	LED - Fixtures: Ceiling Mount	Wall Switch	20	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Lounge F154	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.2	1,396	0	\$206	\$330	\$60	1.3
Main Lobby	9	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	S	26	8,736	5	None	Yes	9	LED - Linear Tubes: (3) 2' Lamps	High/Low Control	26	6,028	0.1	671	0	\$99	\$560	\$320	2.4
Main Vestibule	6	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,736	4	None	Yes	6	LED - Fixtures: Ceiling Mount	Occupancy Sensor	20	6,028	0.0	351	0	\$52	\$330	\$40	5.6
Office - 1004	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.3	2,676	-1	\$394	\$680	\$120	1.4
Office - 1010	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 1014	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.4	3,417	-1	\$504	\$710	\$130	1.2
Office - 1015	7	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	7	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.5	3,986	-1	\$588	\$770	\$150	1.1
Office - 1020	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.3	2,278	0	\$336	\$580	\$100	1.4
Office - 1022	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.3	2,278	0	\$336	\$580	\$100	1.4
Office - 1024	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.3	2,278	0	\$336	\$580	\$100	1.4
Office - 1026	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.3	2,278	0	\$336	\$580	\$100	1.4
Office - 1026A	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 1030	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.3	2,278	0	\$336	\$580	\$100	1.4
Office - 1032	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 1033	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 1035	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 1042	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.3	2,278	0	\$336	\$580	\$100	1.4
Office - 1043	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 1044	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,372	0.1	448	0	\$66	\$60	\$20	0.6
Office - 1050	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 1052	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 1054	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.3	2,278	0	\$336	\$580	\$100	1.4
Office - 1056	2	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	S	26	8,372	4	None	Yes	2	LED - Linear Tubes: (3) 2' Lamps	Occupancy Sensor	26	5,777	0.0	143	0	\$21	\$150	\$20	6.2
Office - 121	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - 125	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 128	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 129	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - F102	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,898	0	\$280	\$580	\$90	1.8
Office - F107	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F111	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F112	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F115	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F116	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F117	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F134	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - F138	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F139	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F142	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F143	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F147	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F149	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F151	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F155	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	1,139	0	\$168	\$480	\$70	2.4
Office - M101	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M102	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - M107	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	1,139	0	\$168	\$480	\$70	2.4
Office - M110	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M111	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,372		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	8,372	0.0	0	0	\$0	\$0	\$0	0.0
Office - M111	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9

Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - M113	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.3	2,278	0	\$336	\$580	\$100	1.4
Office - M114	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M124	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M125	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M128	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M134	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M137	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M138	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M140	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M142	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M145	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M147	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M148	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M149	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Restroom - 1004	1	LED - Fixtures: Wall Pack	Wall Switch	S	20	5,460		None	No	1	LED - Fixtures: Wall Pack	Wall Switch	20	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 1011	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	5,460		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 1012	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	5,460		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 1013	2	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	5,460	4	None	Yes	2	LED - Fixtures: Ceiling Mount	Occupancy Sensor	20	3,767	0.0	73	0	\$11	\$150	\$20	12.1
Restroom - 123	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 124	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - F103	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	5,460		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - F124	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	5,460		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - F136	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - Female F120	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - M102B	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	5,460		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	5,460	0.0	0	0	\$0	\$0	\$0	0.0



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Restroom - M103	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	5,460		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - M120	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - M123	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	5,460		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Stairs - Dorm Exit #1	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	8,736	3, 5	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.3	2,377	-1	\$350	\$580	\$270	0.9
Stairs - Dorm Exit #2	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	8,736	3, 5	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.3	2,377	-1	\$350	\$580	\$270	0.9
Stairs - Dorm Exit #3	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	8,736	3, 5	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.3	2,377	-1	\$350	\$580	\$270	0.9
Stairs - Dorm Exit #4	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	8,736	3, 5	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.3	2,377	-1	\$350	\$580	\$270	0.9
Stairs - Dorm Exit #5	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	8,736	3, 5	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.3	2,377	-1	\$350	\$580	\$270	0.9
Stairs #1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs #1	1	LED - Fixtures: Ceiling Mount	Wall Switch		20	8,736	5	None	Yes	1	LED - Fixtures: Ceiling Mount	High/Low Control	20	6,028	0.0	58	0	\$9	\$0	\$0	0.0
Stairs #1	16	LED - Fixtures: Wall Pack	Wall Switch		20	8,736	5	None	Yes	16	LED - Fixtures: Wall Pack	High/Low Control	20	6,028	0.1	936	0	\$138	\$560	\$560	0.0
Stairs #2	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs #2	1	LED - Fixtures: Ceiling Mount	Wall Switch		20	8,736	5	None	Yes	1	LED - Fixtures: Ceiling Mount	High/Low Control	20	6,028	0.0	58	0	\$9	\$0	\$0	0.0
Stairs #2	22	LED - Fixtures: Wall Pack	Wall Switch		20	8,736	5	None	Yes	22	LED - Fixtures: Wall Pack	High/Low Control	20	6,028	0.1	1,287	0	\$190	\$1,130	\$770	1.9
Stairs #3	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs #3	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch		12	8,736	5	None	Yes	1	LED Lamps: (1) 12W A19 Screw-In Lamp	High/Low Control	12	6,028	0.0	35	0	\$5	\$0	\$0	0.0
Stairs #3	1	LED - Fixtures: Ceiling Mount	Wall Switch		20	8,736	5	None	Yes	1	LED - Fixtures: Ceiling Mount	High/Low Control	20	6,028	0.0	58	0	\$9	\$0	\$0	0.0
Stairs #3	18	LED - Fixtures: Wall Pack	Wall Switch		20	8,736	5	None	Yes	18	LED - Fixtures: Wall Pack	High/Low Control	20	6,028	0.1	1,053	0	\$155	\$850	\$630	1.4
Storage 1017	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage F119	2	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	2,912	4	None	Yes	2	LED - Fixtures: Ceiling Mount	Occupancy Sensor	20	2,009	0.0	39	0	\$6	\$150	\$20	22.6
Storage F130	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage F130	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4
Storage M112	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4
Storage M115	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4
Storage M116	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Storage M119	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage M130	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage M130	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4
Storage M133	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	2,912		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage M136	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	2,912		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage M155	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,912	3, 4	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,009	0.2	698	0	\$103	\$600	\$100	4.9
Vestibule - 1st Floor Center Hall	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	792	0	\$117	\$250	\$40	1.8
Computer Lab - 2017	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.3	2,377	-1	\$350	\$630	\$100	1.5
Corridor 2nd	20	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	20	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 2nd	22	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,736	5	None	Yes	22	LED - Fixtures: Ceiling Mount	High/Low Control	20	6,028	0.1	1,287	0	\$190	\$1,130	\$770	1.9
Corridor 2nd	61	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	S	26	8,736	5	None	Yes	61	LED - Linear Tubes: (3) 2' Lamps	High/Low Control	26	6,028	0.5	4,550	-1	\$671	\$3,100	\$2,140	1.4
Corridor 2nd	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 5	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.1	792	0	\$117	\$380	\$90	2.5
Corridor 2nd	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,736	3, 5	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	6,028	0.1	1,189	0	\$175	\$410	\$100	1.8
Corridor 2nd	0	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 5	Relamp	Yes	0	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,028	0.0	0	0	\$0	\$0	\$0	0.0
Dining Area - F220	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,736	4	None	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.0	382	0	\$56	\$330	\$40	5.2
Dining Area M220	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,736	3, 4	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.2	1,783	0	\$263	\$520	\$90	1.6
Electrical - 2028	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,736	0.1	528	0	\$78	\$90	\$20	0.9
Janitorial - M226	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial 2005	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial F212	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	2,912		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial M212	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	2,912		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial M220A	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen - F220A	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,736	4	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.1	509	0	\$75	\$330	\$40	3.9
Kitchen M221	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,736	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.3	2,377	-1	\$350	\$580	\$100	1.4
Lobby - 2024	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 5	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.2	1,585	0	\$234	\$480	\$180	1.3



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Lounge - F219	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,736	4	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.1	509	0	\$75	\$330	\$40	3.9
Lounge - F227	4	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,736	4	None	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.1	509	0	\$75	\$330	\$40	3.9
Lounge - F228	3	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,736	4	None	Yes	3	LED - Fixtures: Ceiling Mount	Occupancy Sensor	20	6,028	0.0	175	0	\$26	\$330	\$40	11.2
Lounge - F228	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,736	4	None	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.0	254	0	\$38	\$330	\$40	7.7
Lounge - M219	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.3	2,792	-1	\$412	\$680	\$120	1.4
Lounge - M227	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,736	3, 4	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.2	1,783	0	\$263	\$520	\$90	1.6
Lounge - M228	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,736	3, 4	Relamp	Yes	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.3	2,377	-1	\$350	\$580	\$100	1.4
Mechanical - 2010 Dental	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,736		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Office - 2001	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - 2001A	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - 2006	1	Compact Fluorescent: (1) 23W Spiral Plug-In Lamp	Wall Switch	S	23	8,372	3	Relamp	No	1	LED Lamps: LED Lamp	Wall Switch	17	8,372	0.0	54	0	\$8	\$30	\$0	3.8
Office - 2006	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	2,007	0	\$296	\$420	\$80	1.1
Office - 2009	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	8,372		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	8,372	0.0	0	0	\$0	\$0	\$0	0.0
Office - 2009	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Office - 2014	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - 2015	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - 2016	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - 2023	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - 2027	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,898	0	\$280	\$400	\$70	1.2
Office - F201	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F202	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - F213	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F214	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F215	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F216	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9



Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - F217	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F218	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F231	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F240	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F243	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F244	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M201	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M202	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M203	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M204	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M205	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M206	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M209	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	1,139	0	\$168	\$480	\$70	2.4
Office - M213	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M214	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M215	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M216	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M217	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M218	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M231	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M240	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M244	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M245	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M246	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M247	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Porch - F229	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	1,189	0	\$175	\$480	\$70	2.3
Porch - M229	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	1,189	0	\$175	\$480	\$70	2.3
Residential - F203	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,044	0.1	795	0	\$117	\$250	\$40	1.8
Residential - F204	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,044	0.1	795	0	\$117	\$250	\$40	1.8
Residential - F205	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,044	0.1	795	0	\$117	\$250	\$40	1.8
Residential - F206	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,760	0.0	312	0	\$46	\$50	\$10	0.9
Residential - F209	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,044	0.1	1,192	0	\$176	\$300	\$50	1.4
Residential - F245	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,760	0.0	312	0	\$46	\$50	\$10	0.9
Residential - F246	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,760	0.0	312	0	\$46	\$50	\$10	0.9
Residential - F247	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,760	3	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	8,760	0.1	468	0	\$69	\$60	\$20	0.6
Residential F235A	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential F235B	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential F235C	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential F235D	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential F235E	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential F235F	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential F235G	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential F235H	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential M235A	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential M235B	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential M235C	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential M235D	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	1,113	0	\$164	\$600	\$70	3.2
Residential M235E	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential M235F	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential M235G	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7

Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Residential M235H	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Residential M235I	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,760	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	6,044	0.1	742	0	\$109	\$330	\$40	2.7
Restroom - 2019	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 2020	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 2021	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - F207	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	5,460	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	5,460	0.1	330	0	\$49	\$90	\$20	1.4
Restroom - F211	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - F223	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - F224	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - F230	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	5,460	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	5,460	0.1	330	0	\$49	\$90	\$20	1.4
Restroom - M207	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	495	0	\$73	\$250	\$40	2.9
Restroom - M211	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - M223	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - M224	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - M230	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	495	0	\$73	\$250	\$40	2.9
Restroom - M241	1	Incandescent: (1) 100W A19 Screw-In Lamp	Wall Switch	S	100	5,460	3	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	15	5,460	0.1	501	0	\$74	\$30	\$0	0.4
Restroom - M242	1	Incandescent: (1) 100W A19 Screw-In Lamp	Wall Switch	S	100	5,460	3	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	15	5,460	0.1	501	0	\$74	\$30	\$0	0.4
Shower Room - F236	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	8,736	4	None	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.0	254	0	\$38	\$330	\$40	7.7
Shower Room - M236	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,736	4	None	Yes	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Occupancy Sensor	12	6,028	0.0	105	0	\$16	\$330	\$40	18.7
Shower Room - M236	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	792	0	\$117	\$250	\$40	1.8
Storage - 2007	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,009	0.2	465	0	\$69	\$330	\$60	3.9
Storage - F220A	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - F220C	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - F225	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - F226	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Storage - F232	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - F237	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	104	0	\$15	\$50	\$10	2.6
Storage - F239	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912	4	None	Yes	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Occupancy Sensor	12	2,009	0.0	35	0	\$5	\$150	\$20	25.1
Storage - M220B	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - M225	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - M232	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - M239	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - M243	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage 2003	1	Incandescent: (1) 100W A19 Screw-In Lamp	Wall Switch	S	100	2,912	3	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	15	2,912	0.1	267	0	\$39	\$30	\$0	0.8
Storage M238	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	104	0	\$15	\$50	\$10	2.6
Conference - 3028	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.2	1,238	0	\$182	\$580	\$90	2.7
Conference - F331	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	5,460	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	5,460	0.1	330	0	\$49	\$90	\$20	1.4
Conference - M331	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	5,460	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	5,460	0.1	330	0	\$49	\$90	\$20	1.4
Corridor 3rd	21	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	21	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 3rd	19	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,736	5	None	Yes	19	LED - Fixtures: Ceiling Mount	High/Low Control	20	6,028	0.1	1,111	0	\$164	\$850	\$670	1.1
Corridor 3rd	42	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	S	26	8,736	5	None	Yes	42	LED - Linear Tubes: (3) 2' Lamps	High/Low Control	26	6,028	0.4	3,132	-1	\$462	\$1,970	\$1,470	1.1
Corridor 3rd	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 5	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.1	792	0	\$117	\$380	\$90	2.5
Corridor 3rd	5	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 5	Relamp	Yes	5	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	6,028	0.2	1,851	0	\$273	\$720	\$230	1.8
Corridor 3rd - Center	6	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,736	5	None	Yes	6	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	6,028	0.1	763	0	\$113	\$280	\$210	0.6
Dorm - M319	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.2	990	0	\$146	\$530	\$80	3.1
Dorm - M320	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	495	0	\$73	\$250	\$40	2.9
Dorm - M321	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	495	0	\$73	\$250	\$40	2.9
Dorm - M322	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	495	0	\$73	\$250	\$40	2.9
Dorm - M323	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	495	0	\$73	\$250	\$40	2.9
Dorm - M324	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	743	0	\$109	\$480	\$70	3.7



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Dorm - M325	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	495	0	\$73	\$250	\$40	2.9
Electrical Room 3027	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,736	0.1	528	0	\$78	\$90	\$20	0.9
Janitorial - 3012	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial - M328	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial 328	1	Compact Fluorescent: (1) 42W Triple Biaxial Plug-In Lamp	Wall Switch	S	42	2,912	3	Relamp	No	1	LED Lamps: PL-L (Bi-ax) Lamps	Wall Switch	30	2,912	0.0	38	0	\$6	\$10	\$0	1.8
Kitchen - 3016	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	792	0	\$117	\$250	\$40	1.8
Kitchen - 356	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,736	0.1	528	0	\$78	\$90	\$20	0.9
Kitchen - F360	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.2	1,396	0	\$206	\$330	\$60	1.3
Kitchen - M305	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	311	0	\$46	\$50	\$10	0.9
Kitchen - M360	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.2	1,396	0	\$206	\$330	\$60	1.3
Laboratory - X Ray 3009	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	8,736		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Laboratory - X Ray 3009	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.1	623	0	\$92	\$100	\$20	0.9
Lounge M361	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.2	1,396	0	\$206	\$330	\$60	1.3
Office - 3000	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.3	2,676	-1	\$394	\$680	\$120	1.4
Office - 3005	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - 3009	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	1,139	0	\$168	\$480	\$70	2.4
Office - 301	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office- 3014	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - 3018	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - 302	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Office - 3021	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - 3024	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.4	3,037	-1	\$448	\$730	\$120	1.4
Office- 3026	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	1,139	0	\$168	\$480	\$70	2.4
Office - 303	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 305	2	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,372		None	No	2	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	8,372	0.0	0	0	\$0	\$0	\$0	0.0



Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - 305	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - 319	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - 320	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - 321	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - 322	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - 323	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - 324	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - 324	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Office - 325	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - 338	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 339	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 340	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 341	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 342	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 343	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 344	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 345	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 346	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 348	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 349	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 351	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 352	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 353	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 354	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 355	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9



Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - 362	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M302	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M303	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M304	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Office - M337	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M338	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M339	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M340	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M341	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M342	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M343	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M344	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M345	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M347	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M348	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M349	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M351	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M352	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M353	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M354	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M355	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M356	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - Nurse Station F-3	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,372	4	None	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.0	366	0	\$54	\$330	\$40	5.4
Office - Nurse Station M-3	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,372	4	None	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.0	366	0	\$54	\$330	\$40	5.4
Restroom - 3009	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0

Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Restroom - 3013A	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 301A	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	5,460		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 301B	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	5,460		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 3025	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 3025A	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 309	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 310	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 333	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 347	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - Female 337	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - M306	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - M307	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	5,460		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - M309	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	5,460		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - M310	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - M332	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	5,460	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	5,460	0.1	330	0	\$49	\$90	\$20	1.4
Restroom - M333	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Occupancy Sensor	S	24	5,460		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Occupancy Sensor	24	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - M346	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - Male 332	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Shower Room - F314	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	792	0	\$117	\$250	\$40	1.8
Shower Room - M314	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	792	0	\$117	\$250	\$40	1.8
Storage - 3013	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	104	0	\$15	\$50	\$10	2.6
Storage - 3019	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4
Storage - 3022	2	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	2	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - 326	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	2,912		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - M326	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	2,912		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	2,912	0.0	0	0	\$0	\$0	\$0	0.0



Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Storage - M334	1	Compact Fluorescent: (1) 42W Triple Biaxial Plug-In Lamp	Wall Switch	S	42	2,912	3	Relamp	No	1	LED Lamps: PL-L (Biax) Lamps	Wall Switch	30	2,912	0.0	38	0	\$6	\$10	\$0	1.8
Storage - M335	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	104	0	\$15	\$50	\$10	2.6
Storage 3017	2	LED Lamps: (3) 9W A19 Screw-In Lamps	Wall Switch	S	27	2,912		None	No	2	LED Lamps: (3) 9W A19 Screw-In Lamps	Wall Switch	27	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage 304	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,912	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,912	0.1	176	0	\$26	\$90	\$20	2.7
Storage 310	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,912	3, 4	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,009	0.2	594	0	\$88	\$520	\$90	4.9
Storage 327	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	2,912	0.0	91	0	\$13	\$90	\$10	6.0
Storage 329	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4
Storage 334	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage 335	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,912	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,912	0.1	176	0	\$26	\$90	\$20	2.7
Storage 361	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	2,009	0.1	370	0	\$55	\$600	\$70	9.7
Storage F330	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.3	792	0	\$117	\$630	\$100	4.5
Storage F358	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	396	0	\$58	\$480	\$70	7.0
Storage F359	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	104	0	\$15	\$50	\$10	2.6
Storage M310	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,912	3, 4	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,009	0.2	594	0	\$88	\$520	\$90	4.9
Storage M327	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	2,912	0.0	91	0	\$13	\$90	\$10	6.0
Storage M329	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4
Storage M330	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.3	924	0	\$136	\$680	\$110	4.2
Storage M358	2	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	2	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage M358	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	104	0	\$15	\$50	\$10	2.6
Storage M359	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	104	0	\$15	\$50	\$10	2.6
Conference - 406	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	5,460	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	5,460	0.1	330	0	\$49	\$90	\$20	1.4
Conference - 428	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,767	0.1	495	0	\$73	\$250	\$40	2.9
Conference - 434	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	5,460	3, 4	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,767	0.3	1,745	0	\$257	\$680	\$120	2.2
Conference - 441	2	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	3,767	0.0	259	0	\$38	\$200	\$30	4.4
Conference - 441	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	5,460	3, 4	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,767	0.2	1,114	0	\$164	\$520	\$90	2.6



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Conference 421	5	Linear Fluorescent - T5: 4' T5 (28W) - 1L	Wall Switch	S	30	5,460	3, 4	Relamp	Yes	5	LED - Linear Tubes: (1) 4' T5 (14.5W) Lamp	Occupancy Sensor	15	3,767	0.1	579	0	\$85	\$520	\$70	5.3
Conference 421	5	Linear Fluorescent - T5: 4' T5 (28W) - 2L	Wall Switch	S	60	5,460	3, 4	Relamp	Yes	5	LED - Linear Tubes: (2) 4' T5 (14.5W) Lamps	Occupancy Sensor	30	3,767	0.2	1,159	0	\$171	\$710	\$90	3.6
Copy Room - 404	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	311	0	\$46	\$50	\$10	0.9
Corridor 4th	6	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	6	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 4th	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	S	44	8,736	5	None	Yes	3	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	6,028	0.0	382	0	\$56	\$280	\$110	3.0
Corridor 4th	8	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	S	26	8,736	5	None	Yes	8	LED - Linear Tubes: (3) 2' Lamps	High/Low Control	26	6,028	0.1	597	0	\$88	\$280	\$280	0.0
Corridor 4th	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 5	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.2	1,981	0	\$292	\$530	\$230	1.0
Janitorial - 417	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial - 430	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen - 422	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	311	0	\$46	\$50	\$10	0.9
Kitchen - 438	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	S	29	6,028		None	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Elevator 1	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	8,736	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	1,283	0	\$189	\$330	\$40	1.5
Mechanical - Elevator 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	311	0	\$46	\$50	\$10	0.9
Mechanical - Elevator 3	2	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch	S	88	8,736	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	1,283	0	\$189	\$330	\$40	1.5
Mechanical - Penthouse	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	311	0	\$46	\$50	\$10	0.9
Office - 405	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 408	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - 409	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	1,139	0	\$168	\$480	\$70	2.4
Office - 413	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	8,372		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	8,372	0.0	0	0	\$0	\$0	\$0	0.0
Office - 413	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Office - 413	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,372	0.0	262	0	\$39	\$90	\$10	2.1
Office - 418	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Office - 425	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - 431	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Office - 440	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9



Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - 442	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,372		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	8,372	0.0	0	0	\$0	\$0	\$0	0.0
Office - 442	4	LED - Linear Tubes: (3) 2' Lamps	Wall Switch	S	26	8,372	4	None	Yes	4	LED - Linear Tubes: (3) 2' Lamps	Occupancy Sensor	26	5,777	0.0	286	0	\$42	\$330	\$40	6.9
Office - 446	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - 447	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Office - 449	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Office - 451	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - 452	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	8,372	0.1	506	0	\$75	\$90	\$20	0.9
Restroom - 403	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	5,460		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 418	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 425	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 428	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 440	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 442	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	5,460		None	No	1	LED - Fixtures: Ceiling Mount	Wall Switch	20	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - 446	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Female 423	2	LED Lamps: (3) 12W A19 Screw-In Lamps	Occupancy Sensor	S	36	5,460		None	No	2	LED Lamps: (3) 12W A19 Screw-In Lamps	Occupancy Sensor	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Female 436	2	LED Lamps: (3) 12W A19 Screw-In Lamps	Occupancy Sensor	S	36	5,460		None	No	2	LED Lamps: (3) 12W A19 Screw-In Lamps	Occupancy Sensor	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Male 424	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Occupancy Sensor	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Occupancy Sensor	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Male 439	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Occupancy Sensor	S	36	5,460		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Occupancy Sensor	36	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Storage - 411	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,912	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,912	0.1	176	0	\$26	\$90	\$20	2.7
Storage - 429	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - 435	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,912	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,912	0.1	176	0	\$26	\$90	\$20	2.7
Corridor - Basement	9	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	9	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor - Basement	7	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,736	5	None	Yes	7	LED Lamps: (1) 12W A19 Screw-In Lamp	High/Low Control	12	6,028	0.0	246	0	\$36	\$280	\$250	0.8
Corridor - Basement	2	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	Wall Switch	S	25	8,736	5	None	Yes	2	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	High/Low Control	25	6,028	0.0	146	0	\$22	\$0	\$0	0.0
Corridor - Basement	5	LED - Fixtures: Ceiling Mount	Wall Switch	S	20	8,736	5	None	Yes	5	LED - Fixtures: Ceiling Mount	High/Low Control	20	6,028	0.0	292	0	\$43	\$280	\$180	2.3



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Corridor - Basement	5	LED - Fixtures: Wall Pack	Wall Switch	S	20	8,736	5	None	Yes	5	LED - Fixtures: Wall Pack	High/Low Control	20	6,028	0.0	292	0	\$43	\$280	\$180	2.3
Corridor - Basement	8	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 5	Relamp	Yes	8	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,028	0.4	3,169	-1	\$467	\$960	\$360	1.3
Corridor - Basement	1	Metal Halide: (1) 70W Lamp	Wall Switch	S	95	8,736	1	Fixture Replacement	No	1	LED - Fixtures: Low-Bay	Wall Switch	29	8,736	0.1	623	0	\$92	\$730	\$50	7.4
Corridor - Service Tunnel Main to Food Service	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor - Service Tunnel Main to Food Service	12	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,736	5	None	Yes	12	LED Lamps: (1) 12W A19 Screw-In Lamp	High/Low Control	12	6,028	0.0	421	0	\$62	\$560	\$420	2.3
Corridor - Service Tunnel Main to Food Service	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	311	0	\$46	\$50	\$10	0.9
Corridor - Service Tunnel Side	8	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,736	5	None	Yes	8	LED Lamps: (1) 12W A19 Screw-In Lamp	High/Low Control	12	6,028	0.0	281	0	\$41	\$280	\$280	0.0
Electrical Room - M14	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,736		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Electrical Room - M14	3	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	Wall Switch	S	25	8,736	4	None	Yes	3	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	Occupancy Sensor	25	6,028	0.0	219	0	\$32	\$330	\$40	9.0
Electrical Room F25	2	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	Wall Switch	S	25	8,736	4	None	Yes	2	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	Occupancy Sensor	25	6,028	0.0	146	0	\$22	\$330	\$40	13.5
Electrical Room F80	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	1,189	0	\$175	\$480	\$70	2.3
Electrical Room M56	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,736		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Electrical Room M71	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	8,736	3	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Wall Switch	33	8,736	0.0	274	0	\$40	\$90	\$10	2.0
Garage - M21	4	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,736	4	None	Yes	4	LED Lamps: (1) 12W A19 Screw-In Lamp	Occupancy Sensor	12	6,028	0.0	140	0	\$21	\$330	\$40	14.0
Janitorial F13	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Janitorial M32	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Locker Room M30	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.2	1,585	0	\$234	\$530	\$80	1.9
Locker Room M58C	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	6,028	0.1	1,189	0	\$175	\$280	\$50	1.3
Locker Room M58C	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.3	2,792	-1	\$412	\$680	\$120	1.4
Lounge - 45B	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.1	792	0	\$117	\$250	\$40	1.8
Lounge M29	6	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	6	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.5	4,188	-1	\$617	\$860	\$160	1.1
Lounge M58A	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,736	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.2	1,585	0	\$234	\$530	\$80	1.9
Lounge M6	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	8,736		None	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - M16	3	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	Wall Switch	S	25	8,736	4	None	Yes	3	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	Occupancy Sensor	25	6,028	0.0	219	0	\$32	\$330	\$40	9.0
Mechanical F4	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.2	1,396	0	\$206	\$330	\$60	1.3



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical F6	4	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	Wall Switch	S	25	8,736	4	None	Yes	4	LED Lamps: (1) 25W Corn Bulb Screw-In Lamp	Occupancy Sensor	25	6,028	0.0	292	0	\$43	\$330	\$40	6.7
Mechanical M43	2	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,736	4	None	Yes	2	LED Lamps: (1) 12W A19 Screw-In Lamp	Occupancy Sensor	12	6,028	0.0	70	0	\$10	\$150	\$20	12.6
Office - F1	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F11	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - F11	5	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	5	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.4	3,345	-1	\$493	\$770	\$140	1.3
Office - F18	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - F20	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - F20	6	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	6	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.5	4,013	-1	\$592	\$860	\$160	1.2
Office - F80	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,898	0	\$280	\$580	\$90	1.8
Office - F9	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M-11	6	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	6	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.5	4,013	-1	\$592	\$860	\$160	1.2
Office - M-8	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.3	2,658	-1	\$392	\$680	\$110	1.5
Office - M-8	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	None	S	93	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	5,777	0.1	1,139	0	\$168	\$280	\$50	1.4
Office - M1	5	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	5	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.4	3,345	-1	\$493	\$770	\$140	1.3
Office - M41	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - M45	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M46	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M49	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M50	5	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	5	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.4	3,345	-1	\$493	\$770	\$140	1.3
Office - M52	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.1	759	0	\$112	\$250	\$40	1.9
Office - M52	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.2	1,338	0	\$197	\$330	\$60	1.4
Office - M58E	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M73	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3, 4	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	5,777	0.2	1,519	0	\$224	\$530	\$80	2.0
Office - M73A	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	8,372		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	8,372	0.0	0	0	\$0	\$0	\$0	0.0
Office - M73A	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	S	36	8,372		None	No	1	LED Lamps: (3) 12W A19 Screw-In Lamps	Wall Switch	36	8,372	0.0	0	0	\$0	\$0	\$0	0.0



Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - M73A	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,372	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,372	0.0	298	0	\$44	\$50	\$10	0.9
Office - M79	10	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,372	3, 4	Relamp	Yes	10	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	5,777	0.8	6,689	-1	\$986	\$1,210	\$240	1.0
Restroom - F14	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - F15	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - M29	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - M3	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,767	0.2	872	0	\$129	\$330	\$60	2.1
Restroom - M45	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	5,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	5,460	0.0	195	0	\$29	\$50	\$10	1.4
Restroom - M5	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	5,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,767	0.2	872	0	\$129	\$330	\$60	2.1
Restroom - M69	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	5,460		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - M70	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	5,460		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	5,460	0.0	0	0	\$0	\$0	\$0	0.0
Storage - M17	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912	4	None	Yes	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Occupancy Sensor	12	2,009	0.0	35	0	\$5	\$150	\$20	25.1
Storage - M18	4	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912	4	None	Yes	4	LED Lamps: (1) 12W A19 Screw-In Lamp	Occupancy Sensor	12	2,009	0.0	47	0	\$7	\$150	\$20	18.8
Storage - M20	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.2	660	0	\$97	\$580	\$90	5.0
Storage - M24	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.5	1,321	0	\$195	\$840	\$140	3.6
Storage - M26	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912		None	No	1	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	12	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage - M26	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4
Storage - M33	4	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912	4	None	Yes	4	LED Lamps: (1) 12W A19 Screw-In Lamp	Occupancy Sensor	12	2,009	0.0	47	0	\$7	\$150	\$20	18.8
Storage F14A	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	S	24	2,912		None	No	1	LED Lamps: (2) 12W A19 Screw-In Lamps	Wall Switch	24	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Storage F17	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	104	0	\$15	\$50	\$10	2.6
Storage F23	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.3	792	0	\$117	\$630	\$100	4.5
Storage F24	6	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,912	3, 4	Relamp	Yes	6	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,009	0.5	1,396	0	\$206	\$860	\$160	3.4
Storage M53	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Wall Switch	S	12	2,912	4	None	Yes	3	LED Lamps: (1) 12W A19 Screw-In Lamp	Occupancy Sensor	12	2,009	0.0	35	0	\$5	\$150	\$20	25.1
Storage M7	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	104	0	\$15	\$50	\$10	2.6
Storage M71	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4
Storage M78	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,912	3, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,009	0.1	264	0	\$39	\$250	\$40	5.4



Existing Conditions							Proposed Conditions								Energy Impact & Financial Analysis						
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Verizon Server Room - 44	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	8,736		None	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Verizon Server Room - 44	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	8,736	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	6,028	0.2	1,396	0	\$206	\$330	\$60	1.3
Verizon Server Room - 44	2	Metal Halide: (1) 70W Lamp	Wall Switch	S	95	8,736	1, 4	Fixture Replacement	Yes	2	LED - Fixtures: Low-Bay	Occupancy Sensor	29	6,028	0.2	1,415	0	\$209	\$1,620	\$120	7.2
Exterior	1	Compact Fluorescent: (1) 42W Triple Biaxial Plug-In Lamp	Photocell		42	4,380	3	Relamp	No	1	LED Lamps: PL-L (Biax) Lamps	Photocell	30	4,380	0.0	53	0	\$8	\$10	\$0	1.3
Exterior Wall	3	High-Pressure Sodium: (1) 150W Lamp	Photocell		188	4,380	1	Fixture Replacement	No	3	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	57	4,380	0.0	1,721	0	\$258	\$1,520	\$150	5.3
Exterior	15	LED - Fixtures: Ceiling Mount	Photocell		20	4,380		None	No	15	LED - Fixtures: Ceiling Mount	Photocell	20	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior	8	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell		20	4,380		None	No	8	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	20	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior	14	Metal Halide: (1) 150W Lamp	Photocell		190	4,380	1	Fixture Replacement	No	14	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	57	4,380	0.0	8,156	0	\$1,222	\$7,080	\$700	5.2
Roof	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Roof	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell		100	4,380		None	No	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	100	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Roof	5	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell		20	4,380		None	No	5	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	20	4,380	0.0	0	0	\$0	\$0	\$0	0.0



Motor Inventory & Recommendations

		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - 2010 Dental	Air Compressor	1	Air Compressor	1.50	84.0%	No			W	1,825		No	84.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical F6	Air Compressor	2	Air Compressor	2.00	78.5%	No			W	1,825		No	78.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior	Chilled Water System	2	Chilled Water Pump	40.00	94.1%	Yes	Weg	PSE-274655-1-A	W	3,200		No	94.1%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Penthouse	Condensate Pump	2	Condensate Pump	0.33	76.2%	No	Marathon	5kC33FN4180X	W	3,157		No	76.2%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical F6	Condensate Pump	2	Condensate Pump	2.00	86.5%	No			W	3,157		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical M43	Condensate Pump	2	Condensate Pump	2.00	86.5%	No	Marathon		W	3,157		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Electrical Room F80	Fan Coil Unit	1	Supply Fan	0.25	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Penthouse	Heating Hot Water Pump	1	Heating Hot Water Pump	5.00	85.5%	No	Marathon	UVB-184TTDR7026DF	W	3,294	7	No	89.5%	Yes	1	0.6	5,822	0	\$872	\$5,600	\$900	5.4
Mechanical - Penthouse	Heating Hot Water Pump	1	Heating Hot Water Pump	5.00	81.0%	No			W	3,294	7	No	89.5%	Yes	1	0.7	6,661	0	\$998	\$5,600	\$900	4.7
Mechanical - M16	Heating Hot Water Pump	1	Heating Hot Water Pump	2.00	81.5%	No	Marathon		W	3,294	7	No	86.5%	Yes	1	0.2	2,497	0	\$374	\$4,700	\$100	12.3
Mechanical - M16	Heating Hot Water Pump	1	Heating Hot Water Pump	2.00	86.5%	No	Weg		W	3,294	7	No	86.5%	Yes	1	0.2	2,131	0	\$319	\$4,700	\$100	14.4
Mechanical - M16	Heating Hot Water Pump-DHW	2	DHW Circulation Pump	0.08	65.0%	No			W	8,760		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical F6	Heating Hot Water Pump-DHW	1	DHW Circulation Pump	0.08	65.0%	No			W	8,760		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - 2010 Dental	Dental Vacuum Pump	1	Process Pump	2.00	84.0%	No	Air Techniques	VS-40	W	2,745		No	84.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Elevator 1	Elevator 1	1	Other	22.00	80.0%	No			W	400		No	80.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Elevator 2	Elevator 2	1	Other	22.00	80.0%	No			W	400		No	80.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Elevator 3	Elevator 3	1	Other	22.00	90.0%	No	Loher	LNMA-2.2MB-22A	W	400		No	90.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Garage - M21	Garage Door Lift	1	Other	0.25	65.0%	No			W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Penthouse	Process Pumps	2	Process Pump	2.00	80.0%	No	Continental	H224X	W	2,745		No	80.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - M16	Sump Pump	2	Other	0.75	80.0%	No	Baldor		W	2,745		No	80.0%	No		0.0	0	0	\$0	\$0	\$0	0.0



		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical F6	Sump Pump	2	Other	0.75	80.0%	No			W	2,745		No	80.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Elevator 1	Exhaust Fan	1	Exhaust Fan	0.13	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Elevator 3	Exhaust Fan	1	Exhaust Fan	0.13	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Electrical Room - M14	Exhaust Fan	1	Exhaust Fan	0.13	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Electrical Room F25	Exhaust Fan	1	Exhaust Fan	0.13	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - M16	Exhaust Fan	1	Exhaust Fan	0.50	75.0%	No			W	3,431		No	75.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical F6	Exhaust Fan	1	Exhaust Fan	0.50	75.0%	No			W	3,431		No	75.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Exhaust Fan	1	Exhaust Fan	1.00	80.0%	No			W	3,431		No	80.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Storage F130	Storage F130 - Cooling	1	Supply Fan	0.25	65.0%	No	Friedrich		W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Storage M130	Storage M130 - Cooling	1	Supply Fan	0.25	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Electrical Room F80	Electrical Room F80 - Cooling	1	Supply Fan	0.25	65.0%	No	Daikin		W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Office - M79	Office - M79 - Cooling	2	Supply Fan	0.25	65.0%	No	Fujitsu		W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Verizon Server Room - 44	Verizon Server Room - 44 - Cooling	1	Supply Fan	0.25	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Various Location	Unit Ventilator	130	Supply Fan	0.25	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical F4	Fire Controller Pump	1	Other	60.00	93.0%	No	Marathon		W	52		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical F4	Fire Controller Pump	1	Other	1.50	74.4%	No	Marathon		W	52		No	74.4%	No		0.0	0	0	\$0	\$0	\$0	0.0
Various Location	Fan Coil Unit	151	Supply Fan	0.25	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Penthouse	Air Handling Unit	1	Supply Fan	15.00	90.0%	No			W	4,239		No	90.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Penthouse	Air Handling Unit - E1	1	Supply Fan	20.00	91.0%	No	Strobic Air	TD36M25A1ZY	W	4,239	6	No	93.0%	Yes	1	5.9	27,070	0	\$4,055	\$12,200	\$1,300	2.7
Electrical Room F80	Air Handling Unit	1	Supply Fan	0.50	70.0%	No		RCMDD2248S008	W	3,431		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0



		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - M16	AHU-4 & AHU-7	2	Supply Fan	5.00	87.0%	No			W	3,431	6	No	89.5%	Yes	2	3.0	11,588	0	\$1,736	\$11,300	\$1,800	5.5
Mechanical F6	AHU-1, 2, 3	3	Supply Fan	5.00	87.0%	No			W	3,431	6	No	89.5%	Yes	3	4.5	17,382	0	\$2,604	\$16,900	\$2,700	5.5
Mechanical M43	AHU-2	1	Supply Fan	1.50	84.0%	No	York	NL090C00B2BAA2	W	3,431		No	84.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical M43	AHU-6	1	Supply Fan	3.00	89.5%	No	Dayton	2MXU4B	W	3,431	6	No	89.5%	Yes	1	0.9	3,218	0	\$482	\$5,400	\$200	10.8
Roof	HRU	1	Supply Fan	15.00	91.0%	No	ACS- Hoval	PC1140	B	3,431	6	No	93.0%	Yes	1	4.4	16,435	0	\$2,462	\$10,300	\$1,200	3.7
Roof	HRU	1	Return Fan	15.00	91.0%	No	ACS- Hoval	PC1141	B	3,431	6	No	93.0%	Yes	1	4.6	16,435	0	\$2,462	\$10,300	\$1,200	3.7
Roof	Package Unit - MUA-1	1	Supply Fan	7.50	89.5%	No			W	3,431	6	No	91.0%	Yes	1	2.2	8,282	0	\$1,241	\$6,700	\$1,000	4.6
Roof	Package Unit - MUA-1	1	Return Fan	7.50	89.5%	No			W	3,431	6	No	91.0%	Yes	1	2.3	8,282	0	\$1,241	\$6,700	\$1,000	4.6
Roof	Package Unit - MUA-1	2	Other	0.17	60.0%	No			W	2,745		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Roof	Package Unit - MUA-3	1	Supply Fan	7.50	89.5%	No			B	3,431	6	No	91.0%	Yes	1	2.2	8,282	0	\$1,241	\$6,700	\$1,000	4.6
Roof	Package Unit - MUA-3	1	Return Fan	5.00	89.5%	No			B	3,431	6	No	89.5%	Yes	1	1.5	5,363	0	\$803	\$5,600	\$900	5.9
Roof	Package Unit - MUA-3	2	Other	0.17	60.0%	No			B	2,745		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior	Condensing Unit- Basement	1	Supply Fan	0.33	65.0%	No			W	3,431		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior	Condensing Unit- Basement	1	Fan Coil Unit	0.33	65.0%	No			W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0



Packaged HVAC Inventory & Recommendations

		Existing Conditions									Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Exterior	Condensing Unit-Basement	1	Split-System	7.50		11.40		York	YC090C00A4AAA5	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Exterior	Condensing Unit-Basement	1	Split-System	4.00		9.28		Ducane	2AC13B48T-1A	B	8	Yes	1	Split-System	4.00		16.00		1.1	3,561	0	\$533	\$8,100	\$400	14.4
Office - 3018	Office - 3018 - Heating	1	Unit Heater		17.06		1 COP			W		No							0.0	0	0	\$0	\$0	\$0	0.0
Office - 3021	Office - 3021 - Heating	1	Unit Heater		25.59		1 COP			W		No							0.0	0	0	\$0	\$0	\$0	0.0
Corridor 4th	Corridor 4th - Heating	2	Unit Heater		17.06		1 COP			W		No							0.0	0	0	\$0	\$0	\$0	0.0
Exterior	Exhaust Fan	1	Ductless Mini-Split AC	0.75		10.00		Friedrich	MR09Y3J	B	8	Yes	1	Ductless Mini-Split AC	0.75		18.00		0.2	655	0	\$98	\$2,500	\$0	25.5
Exterior	Basement- Cooling	1	Ductless Mini-Split HP	3.00	33.00	8.50	9 HSPF	Fujitsu	AOU36RLXB	B	9	Yes	1	Ductless Mini-Split HP	3.00	33.00	18.00	3.8 COP	1.1	7,435	0	\$1,114	\$6,700	\$0	6.0
Exterior	Basement- Cooling	1	Ductless Mini-Split HP	2.50	30.00	9.50	9 HSPF	Fujitsu	AOU30RLXB	B	9	Yes	1	Ductless Mini-Split HP	2.50	30.00	18.00	3.8 COP	0.8	5,874	0	\$880	\$5,800	\$0	6.6
Exterior	Basement- Cooling	1	Split-System	3.00		10.50		Mitsubishi Electric	PUY-A36NHA	B	8	Yes	1	Split-System	3.00		16.00		0.6	1,930	0	\$289	\$6,000	\$300	19.7
Exterior	Basement- Cooling	1	Ductless Mini-Split HP	3.00	36.00	9.20	12.2 HSPF	Daikin	4MXS36NMVJU	W	9	Yes	1	Ductless Mini-Split HP	3.00	36.00	18.00	3.8 COP	1.0	3,719	0	\$557	\$6,700	\$0	12.0
Office - 1015	Office - 1015 - Cooling	1	Window AC	1.00		10.81		Friedrich	CP12E10	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Storage M136	Storage M136 - Cooling	1	Window AC	1.00		10.00		Frigidiare		W		No							0.0	0	0	\$0	\$0	\$0	0.0
Office - 2027	Office - 2027 - Cooling	1	Window AC	0.83		10.87		Friedrich	CP10E10	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Office - 303	Office - 303 - Cooling	1	Window AC	0.83		8.90		Frigidaire	FFPA1022R11	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Conference - 406	Conference - 406 - Cooling	1	Window AC	1.00		9.73		IDYLIS	416710	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Locker Room M30	Locker Room M30 - Cooling	1	Window AC	1.00		10.00		Whirpool		B	8	Yes	1	Window AC	1.00		12.00		0.1	328	0	\$49	\$1,000	\$0	20.4
Lounge - 45B	Lounge - 45B - Cooling	1	Window AC	1.00		10.80		Kenmore	263.70121	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Lounge M29	Lounge M29 - Cooling	1	Window AC	1.00		12.00		Frigidaire	FFRE1233S10	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Lounge M58A	Lounge M58A - Cooling	1	Window AC	1.26		11.80		Frigidaire	FFRE153WAE	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Office - M45	Office - M45 - Cooling	1	Window AC	1.00		10.80		Kenmore	263.70121	W		No							0.0	0	0	\$0	\$0	\$0	0.0



		Existing Conditions									Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - M73A	Office - M73A - Cooling	1	Window AC	1.00		12.00		Frigidaire	FFRE1233S10	W	8	Yes	1	Window AC	1.00		12.00		0.0	0	0	\$0	\$1,000	\$0	0.0
Roof	Package Unit - MUA1	1	Package Unit	26.00		12.00		Aaon	RN-026-8-0-EA09-EHJ	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Roof	Package Unit - MUA3	1	Package Unit	26.00		11.00		Aaon	RN-026-8-0-EA09-EHJ	B	8	Yes	1	Package Unit	26.00		12.50		1.7	5,574	0	\$835	\$31,700	\$2,200	35.3
Electrical Room F80	Air Handling Unit	1	Package Unit	4.00		10.00			RCMDD2248S008	B	8	Yes	1	Package Unit	4.00		16.00		0.9	2,948	0	\$442	\$8,100	\$400	17.4
Mechanical M43	Air Handling Unit	1	Package Unit	7.50		8.50		York	NL090C00B2BAA2	W		No							0.0	0	0	\$0	\$0	\$0	0.0

Electric Chiller Inventory & Recommendations

		Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Exterior Ground	Air-Cooled Chiller	2	Air-Cooled Screw Chiller	200.00	Carrier	30XVA2006M4016D-2	W		No							0.0	0	0	\$0	\$0	\$0	0.0

Space Heating Boiler Inventory & Recommendations

		Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Output Capacity per Unit (MBh)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Central Power Plant	Main Hospital	1	Forced Draft Steam Boiler	33,837	Proxy Boiler		W		No						0.0	0	0	\$0	\$0	\$0	0.0

Pipe Insulation Recommendations

		Recommendation Inputs			Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Affected	ECM #	Length of Uninsulated Pipe (ft)	Pipe Diameter (in)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Heat Exchanger Section	10	15	1.25	0.0	0	11	\$123	\$270	\$30	2.0
Mechanical Room	Heat Exchanger Section- HW Pumps	10	12	1.25	0.0	0	7	\$77	\$180	\$20	2.1



DHW Inventory & Recommendations

		Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Manufacturer	Model	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen - F360	Kitchen Hot water	3	Tankless Water Heater			W		No						0.0	0	0	\$0	\$0	\$0	0.0
Kitchen - M360	Kitchen Hot water	3	Tankless Water Heater			W		No						0.0	0	0	\$0	\$0	\$0	0.0
Central Power Plant	Main Hospital-DHW system (Heat Exchanger)	1	Boiler			W		No						0.0	0	0	\$0	\$0	\$0	0.0

Low-Flow Device Recommendations

		Recommendation Inputs				Energy Impact & Financial Analysis						
Location	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Various Restrooms	11	65	Faucet Aerator (Lavatory)	0.50	0.50	0.0	0	0	\$0	\$550	\$260	0.0
Various Restrooms	11	32	Faucet Aerator (Lavatory)	2.20	0.50	0.0	0	91	\$1,020	\$270	\$130	0.1

Commercial Refrigerator/Freezer Inventory & Recommendations

		Existing Conditions				Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Refrigerator/ Freezer Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Storage M116	1	Stand-Up Freezer, Solid Door (31 - 50 cu. ft.)	Accucold	AFS49ML	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Office - M125	1	Stand-Up Refrigerator, Solid Door (16 - 30 cu. ft.)	Everest		No		No	0.0	0	0	\$0	\$0	\$0	0.0
Storage M116	1	Stand-Up Refrigerator, Solid Door (31 - 50 cu. ft.)	Accucold	ARS49ML	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen - F220A	1	Stand-Up Refrigerator, Solid Door (16 - 30 cu. ft.)	TRUE	T-23-HC	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0



Commercial Ice Maker Inventory & Recommendations

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Ice Maker Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen - M154	1	Self-Contained Unit (<175 lbs/day), Batch	Hoshizaki	DCM-450BAB	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Lounge F154	1	Self-Contained Unit (<175 lbs/day), Batch	Manitowoc	CNF0202A-161L	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen - F220A	1	Self-Contained Unit (≥175 lbs/day), Batch	Manitowoc	CNF0202A-161	No		No	0.0	0	0	\$0	\$0	\$0	0.0

Plug Load Inventory

Existing Conditions						
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?	Manufacturer	Model
Various Location	3	Clothes Dryer	5,000	No		
Various Location	4	Clothes Washer	5,000	No		
Various Location	11	Coffee Machine	900	No		
Various Offices	247	Desktop	150	No		
Various Location	21	Microwave	1,000	No		
Office - 440	1	Paper Shredder	150	No		
Various Offices	168	Printer (Medium/Small)	200	No		
Various Offices	14	Printer/Copier (Large)	600	No		
Conference 1006	1	Projector	200	No		
Various Offices	21	Refrigerator (Mini)	153	No		
Various Location	25	Refrigerator (Residential)	218	No		
Classroom F144	1	Smart Board	240	No		
Conference - 3028	1	Smart Board	240	No		
Office - 3018	1	Smart Board	240	No		
Office - M1	1	Smart Board	240	No		
Various Location	20	Television	190	No		
Corridor - 1st Floor	1	Water Fountain	92	No		
Laboratory - X Ray 3009	1	X-Ray Machine	12,000	No	Progeny Inc.	MC-150
Server Room - 44	1	UPS	15,340	No	Power	1CR6-30TC120S-120-H225-UL
Various Spaces	10	Misc Plug Load	1,000	No		



Vending Machine Inventory & Recommendations

Existing Conditions		Proposed Conditions		Energy Impact & Financial Analysis							
Location	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Corridor - Basement	1	Non-Refrigerated	12	Yes	0.0	343	0	\$51	\$270	\$0	5.3
Corridor - Basement	1	Refrigerated	12	Yes	0.2	1,612	0	\$241	\$270	\$50	0.9

Custom (High Level) Measure Analysis


Installation of an Energy Management System

Building Square Footage	138,778	Fuel Utility Rate	\$11.192	MMBtu
Percent of Conditioned Area Impacted	100%	Blended Electric Utility Rate	\$0.150	kWh

Existing Conditions						Proposed Conditions					Energy Impact & Financial Analysis											
Description	Area(s)/System(s) Served	Remaining Useful Life	Total HVAC Motor Usage kWh	Total HVAC Electric Usage kWh	Total HVAC Fuel Usage MMBtu	Description	% Savings HVAC Motor Usage kWh	% Savings HVAC Electric Usage kWh	% Savings HVAC Fuel Usage MMBtu	Estimated Cost per Sqft	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Base Incentives	Enhanced Incentives	Total Incentives	Total Net Cost	Payback w/o Incentives in Years	Simple Payback w/ Incentives in Years	
Limited/No HVAC Controls	HVAC Equipment & Systems	15	719,812	916,611	35,529	Installation of an Energy Management System	15%	15%	10%	\$5.00	0.00	245,464	3,553	\$76,533	\$807,700	\$0	\$0	\$0	\$807,700	10.55	10.55	

APPENDIX B: ENERGY STAR STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of site energy and source energy. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.



ENERGY STAR® Statement of Energy Performance

N/A

DHS - Ancora Psychiatric Hospital (APH Campus)

Primary Property Type: Other - Specialty Hospital
Gross Floor Area (ft²): 833,680
Built: 1953

ENERGY STAR®
Score¹

For Year Ending: April 30, 2023
Date Generated: August 05, 2024

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
Property Address DHS - Ancora Psychiatric Hospital (APH Campus) 301 Spring Garden Road Hammonton, New Jersey 08037	Property Owner State of New Jersey 428 East State Street Trenton, NJ 08625 (609) 940-4129	Primary Contact New Jersey Board of Public Utilities State Energy Services 44 South Clinton Ave Trenton, NJ 08625 (609) 633-9886 BPU.EnergyServices@bpu.nj.gov	
Property ID: 298865004 Unique Building Identifier (UBID): 87F7M4MQ+39R-448-488-439-512			

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI	Annual Energy by Fuel	National Median Comparison	
212.3 kBtu/ft²	Natural Gas (kBtu)	National Median Site EUI (kBtu/ft²)	340.9
	Electric - Grid (kBtu)	National Median Source EUI (kBtu/ft²)	433.9
	% Diff from National Median Source EUI	-38%	
Source EUI		Annual Emissions	
270.2 kBtu/ft²		Total (Location-Based) GHG Emissions (Metric Tons CO2e/year)	10,229

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: _____ Date: _____

Licensed Professional

() - _____



Professional Engineer or Registered
Architect Stamp
(if applicable)

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
Btu	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
CHP	<i>Combined heat and power</i> . Also referred to as cogeneration.
COP	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
DCV	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
US DOE	<i>United States Department of Energy</i>
EC Motor	<i>Electronically commutated motor</i>
ECM	<i>Energy conservation measure</i>
EER	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
EUI	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
ENERGY STAR	ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA.
EPA	<i>United States Environmental Protection Agency</i>
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
GHG	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
gpf	<i>Gallons per flush</i>

gpm	<i>Gallon per minute</i>
HID	<i>High intensity discharge:</i> high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
hp	<i>Horsepower</i>
HPS	<i>High-pressure sodium:</i> a type of HID lamp.
HSPF	<i>Heating seasonal performance factor:</i> a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
HVAC	<i>Heating, ventilating, and air conditioning</i>
IHP 2014	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
IPLV	<i>Integrated part load value:</i> a measure of the part load efficiency usually applied to chillers.
kBtu	One thousand British thermal units
kW	<i>Kilowatt:</i> equal to 1,000 Watts.
kWh	<i>Kilowatt-hour:</i> 1,000 Watts of power expended over one hour.
LED	<i>Light emitting diode:</i> a high-efficiency source of light with a long lamp life.
LGEA	<i>Local Government Energy Audit</i>
Load	The total power a building or system is using at any given time.
Measure	A single activity, or installation of a single type of equipment, which is implemented in a building system to reduce total energy consumption.
MH	<i>Metal halide:</i> a type of HID lamp.
MBh	<i>Thousand Btu per hour</i>
MBtu	<i>One thousand British thermal units</i>
MMBtu	<i>One million British thermal units</i>
MV	<i>Mercury Vapor:</i> a type of HID lamp.
NJBPU	<i>New Jersey Board of Public Utilities</i>
NJCEP	<i>New Jersey's Clean Energy Program:</i> NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment.
psig	<i>Pounds per square inch gauge</i>
Plug Load	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
PV	<i>Photovoltaic:</i> refers to an electronic device capable of converting incident light directly into electricity (direct current).

SEER	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
SEP	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR Portfolio Manager.
Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
SREC (II)	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
therm	100,000 Btu. Typically used as a measure of natural gas consumption.
tons	A unit of cooling capacity equal to 12,000 Btu/hr.
Turnkey	Provision of a complete product or service that is ready for immediate use.
VAV	<i>Variable air volume</i>
VFD	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
WaterSense	The symbol for water efficiency. The WaterSense program is managed by the EPA.
Watt (W)	Unit of power commonly used to measure electricity use.