



# Local Government Energy Audit Report

February 14, 2025

*Prepared for:*

Vernon Township School District  
30 Sammis Rd  
Vernon, New Jersey 07462

*Prepared by:*

TRC  
317 George Street  
New Brunswick, New Jersey 08901



## Disclaimer

---

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based on previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2025 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product, or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks, or copyrights.

# Table of Contents

---

<b>1</b>	<b>Executive Summary</b>	<b>1</b>
1.1	Planning Your Project	4
	Pick Your Installation Approach	4
	Options from Your Utility Company	4
	Options from New Jersey's Clean Energy Program	5
<b>2</b>	<b>Existing Conditions</b>	<b>6</b>
2.1	Site Overview	6
2.2	Building Occupancy	6
2.3	Building Envelope	6
2.4	Lighting Systems	7
2.5	Air Handling Systems	9
	Unit Ventilators	9
	Unitary Electric HVAC Equipment	9
	Unitary Heating Equipment	10
	Packaged Units	10
	Air Handling Units (AHUs)	11
2.6	Heating Hot Water Systems	11
2.7	Chilled Water Systems	12
2.8	Domestic Hot Water	12
2.9	Food Service Equipment	13
2.10	Refrigeration	13
2.11	Plug Loads	14
2.12	Water-Using Systems	14
<b>3</b>	<b>Energy Use and Costs</b>	<b>15</b>
3.1	Electricity	17
3.2	No. 2 Fuel Oil	18
3.3	Propane	19
3.4	Benchmarking	20
	Tracking your Energy Performance	21
3.5	Understanding Your Utility Bills	21
<b>4</b>	<b>Energy Conservation Measures</b>	<b>22</b>

4.1	Lighting.....	25
	ECM 1: Retrofit Fluorescent Fixtures with LED Lamps and Drivers .....	25
	ECM 2: Retrofit Fixtures with LED Lamps.....	25
4.2	Lighting Controls .....	26
	ECM 3: Install Occupancy Sensor Lighting Controls.....	26
	ECM 4: Install High/Low Lighting Controls.....	26
4.3	Motors.....	27
	ECM 5: Premium Efficiency Motors .....	27
4.4	Variable Frequency Drives (VFD) .....	27
	ECM 6: Install VFDs on Constant Volume (CV) Fans .....	28
4.5	Unitary HVAC .....	28
	ECM 7: Install High Efficiency Air Conditioning Units .....	28
	ECM 8: Install High Efficiency Heat Pumps .....	28
4.6	Gas-Fired Heating.....	29
	ECM 9: Install High Efficiency Hot Water Boilers.....	29
4.7	Domestic Water Heating.....	29
	ECM 10: Install Low-Flow DHW Devices .....	29
4.8	Food Service and Refrigeration Measures .....	30
	ECM 11: Refrigerator/Freezer Electrically Commutated Motors .....	30
	ECM 12: Refrigeration Controls .....	30
4.9	Measures for Future Consideration.....	30
	VRF Systems .....	31
<b>5</b>	<b>Energy Efficient Best Practices.....</b>	<b>32</b>
	Energy Tracking with ENERGY STAR Portfolio Manager .....	32
	Lighting Maintenance .....	32
	Lighting Controls .....	32
	Motor Maintenance.....	32
	Chiller Maintenance.....	33
	Thermostat Schedules and Temperature Resets.....	33
	AC System Evaporator/Condenser Coil Cleaning.....	33
	HVAC Filter Cleaning and Replacement.....	33
	Ductwork Maintenance .....	33
	Boiler Maintenance.....	34
	Water Heater Maintenance .....	34



Refrigeration Equipment Maintenance ..... 34

Procurement Strategies ..... 34

**6 Water Best Practices.....35**

    Getting Started..... 35

    Leak Detection and Repair ..... 35

    Toilets and Urinals ..... 35

    Faucets and Showerheads ..... 36

    Ice Machines ..... 37

**7 On-Site Generation .....38**

    7.1 Solar Photovoltaic ..... 39

    7.2 Combined Heat and Power ..... 41

**8 Electric Vehicles.....42**

    8.1 EV Charging ..... 42

**9 Project Funding and Incentives .....44**

    9.1 New Jersey’s Clean Energy Program ..... 45

    9.2 Utility Energy Efficiency Programs ..... 52

**10 Project Development .....54**

**11 Energy Purchasing and Procurement Strategies .....55**

    11.1 Retail Electric Supply Options ..... 55

    11.2 Retail Natural Gas Supply Options ..... 55

**Appendix A: Equipment Inventory & Recommendations ..... A-1**


**Appendix B: ENERGY STAR Statement of Energy Performance ..... B-1**

**Appendix C: Glossary ..... C-1**


# 1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Loundsberry Hollow Middle School. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

## BUILDING PERFORMANCE REPORT

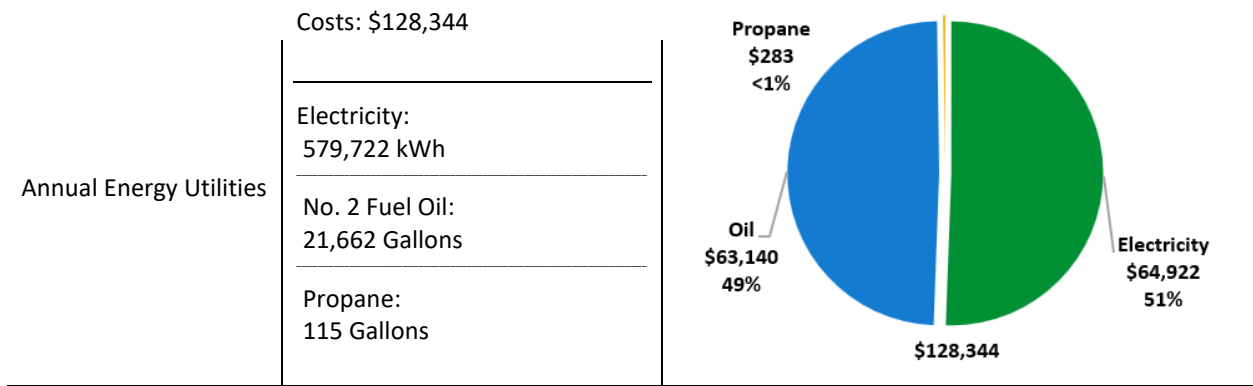

ENERGY STAR® Benchmarking Score	86 <i>(1-100 scale)</i>	Congratulations, your building performs better than the national average. This report has suggestions about how to keep your building running efficiently, further improve performance, and lower your energy bills even more.
---------------------------------	----------------------------	--

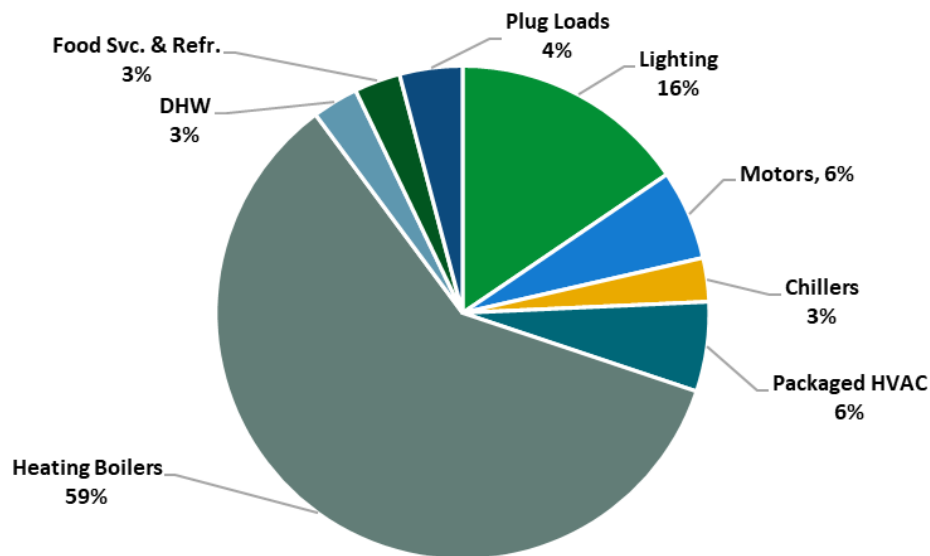

*Energy Use by System*


## POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


### Scenario 1: Full Package (All Evaluated Measures)

Installation Cost	\$308,630
Potential Rebates & Incentives <sup>1</sup>	\$30,640
Annual Cost Savings	\$19,933
Annual Energy Savings	Electricity: 155,552 kWh No. 2 Fuel Oil: 862 Gallons
Greenhouse Gas Emission Savings	88 Tons
Simple Payback	13.9 Years
Site Energy Savings (All Utilities)	13%

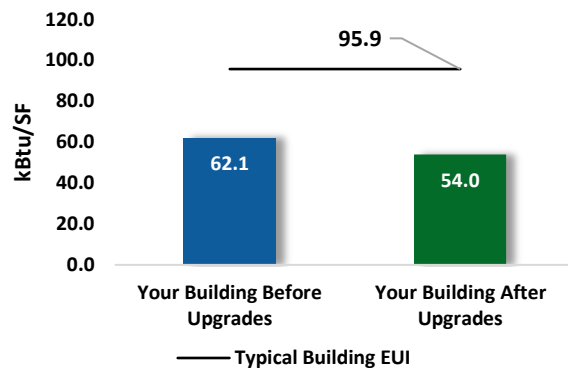

### Scenario 2: Cost Effective Package<sup>2</sup>

Installation Cost	\$140,530
Potential Rebates & Incentives	\$23,040
Annual Cost Savings	\$15,975
Annual Energy Savings	Electricity: 153,150 kWh No. 2 Fuel Oil: -403 Gallons
Greenhouse Gas Emission Savings	73 Tons
Simple Payback	7.4 Years
Site Energy Savings (all utilities)	9%

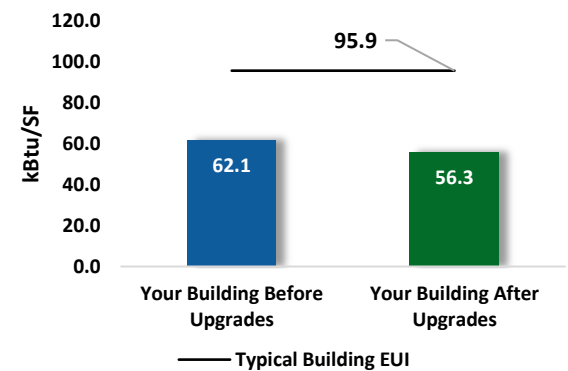

### On-site Generation Potential

Photovoltaic	Medium
Combined Heat and Power	None

<sup>1</sup> Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

<sup>2</sup> A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>127,359</b>	<b>41.9</b>	<b>-53</b>	<b>\$13,143</b>	<b>\$86,720</b>	<b>\$16,730</b>	<b>\$69,990</b>	<b>5.3</b>	<b>119,536</b>
ECM 1	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	710	0.2	0	\$73	\$590	\$70	\$520	7.1	666
ECM 2	Retrofit Fixtures with LED Lamps	Yes	126,650	41.7	-53	\$13,069	\$86,130	\$16,660	\$69,470	5.3	118,870
<b>Lighting Control Measures</b>			<b>12,008</b>	<b>2.5</b>	<b>-5</b>	<b>\$1,239</b>	<b>\$20,590</b>	<b>\$4,920</b>	<b>\$15,670</b>	<b>12.6</b>	<b>11,270</b>
ECM 3	Install Occupancy Sensor Lighting Controls	Yes	8,402	1.9	-4	\$867	\$15,240	\$1,850	\$13,390	15.4	7,886
ECM 4	Install High/Low Lighting Controls	Yes	3,605	0.6	-2	\$372	\$5,350	\$3,070	\$2,280	6.1	3,384
<b>Motor Upgrades</b>			<b>319</b>	<b>0.1</b>	<b>0</b>	<b>\$36</b>	<b>\$2,100</b>	<b>\$0</b>	<b>\$2,100</b>	<b>58.7</b>	<b>322</b>
ECM 5	Premium Efficiency Motors	No	319	0.1	0	\$36	\$2,100	\$0	\$2,100	58.7	322
<b>Variable Frequency Drive (VFD) Measures</b>			<b>6,294</b>	<b>2.1</b>	<b>0</b>	<b>\$705</b>	<b>\$6,700</b>	<b>\$1,000</b>	<b>\$5,700</b>	<b>8.1</b>	<b>6,338</b>
ECM 6	Install VFDs on Constant Volume (CV) Fans	Yes	6,294	2.1	0	\$705	\$6,700	\$1,000	\$5,700	8.1	6,338
<b>Unitary HVAC Measures</b>			<b>5,626</b>	<b>4.5</b>	<b>0</b>	<b>\$630</b>	<b>\$33,500</b>	<b>\$0</b>	<b>\$33,500</b>	<b>53.2</b>	<b>5,665</b>
ECM 7	Install High Efficiency Air Conditioning Units	No	2,082	2.0	0	\$233	\$13,300	\$0	\$13,300	57.0	2,097
ECM 8	Install High Efficiency Heat Pumps	Yes	3,544	2.5	0	\$397	\$20,200	\$0	\$20,200	50.9	3,569
<b>Gas Heating (HVAC/Process) Replacement</b>			<b>0</b>	<b>0.0</b>	<b>175</b>	<b>\$3,689</b>	<b>\$152,700</b>	<b>\$7,600</b>	<b>\$145,100</b>	<b>39.3</b>	<b>28,701</b>
ECM 9	Install High Efficiency Hot Water Boilers	No	0	0.0	175	\$3,689	\$152,700	\$7,600	\$145,100	39.3	28,701
<b>Domestic Water Heating Upgrade</b>			<b>82</b>	<b>0.0</b>	<b>2</b>	<b>\$59</b>	<b>\$60</b>	<b>\$20</b>	<b>\$40</b>	<b>0.7</b>	<b>470</b>
ECM 10	Install Low-Flow DHW Devices	Yes	82	0.0	2	\$59	\$60	\$20	\$40	0.7	470
<b>Food Service &amp; Refrigeration Measures</b>			<b>3,863</b>	<b>0.2</b>	<b>0</b>	<b>\$433</b>	<b>\$6,260</b>	<b>\$370</b>	<b>\$5,890</b>	<b>13.6</b>	<b>3,890</b>
ECM 11	Refrigerator/Freezer Case Electrically Commutated Motors	Yes	917	0.1	0	\$103	\$1,500	\$160	\$1,340	13.0	924
ECM 12	Refrigeration Controls	Yes	2,946	0.0	0	\$330	\$4,760	\$210	\$4,550	13.8	2,966
<b>TOTALS (COST EFFECTIVE MEASURES)</b>			<b>153,150</b>	<b>49.2</b>	<b>-56</b>	<b>\$15,975</b>	<b>\$140,530</b>	<b>\$23,040</b>	<b>\$117,490</b>	<b>7.4</b>	<b>145,074</b>
<b>TOTALS (ALL MEASURES)</b>			<b>155,552</b>	<b>51.4</b>	<b>120</b>	<b>\$19,933</b>	<b>\$308,630</b>	<b>\$30,640</b>	<b>\$277,990</b>	<b>13.9</b>	<b>176,193</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

*All Evaluated Energy Improvements<sup>3</sup>*

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

<sup>3</sup> TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations.



## 1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decision to make, such as:

- ◆ How will the project be funded/and or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

### Pick Your Installation Approach

Utility-run energy efficiency programs and New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives *before* purchasing materials or starting installation.

### Options from Your Utility Company

#### *Prescriptive and Custom Rebates*

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the Prescriptive and Custom Rebates program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval may be required for some incentives. Contact your utility company for more details prior to project installation.

#### *Direct Install*

The Direct Install program provides turnkey installation of multiple measures through an authorized contractor. This program can provide incentives up to 70% or 80% of the cost of selected measures. A Direct Install contractor will assess and verify individual measure eligibility and perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

#### *Engineered Solutions*

The Engineered Solutions program provides tailored energy-efficiency assistance and turnkey engineering services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. The program provides all professional services from audit, design, construction administration, to commissioning and measurement and verification for custom whole-building energy-efficiency projects. Engineered Solutions allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs.

For more details on these programs please contact your utility provider.

## **Options from New Jersey's Clean Energy Program**

### *Financing and Planning Support with the Energy Savings Improvement Program (ESIP)*

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

### *Resiliency with Return on Investment through Combined Heat and Power (CHP)*

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

### *Successor Solar Incentive Program (SuSI)*

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

### *Ongoing Electric Savings with Demand Response*

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

### *Large Energy User Program (LEUP)*

LEUP is designed to promote self-investment in energy efficiency for the largest energy consumers in the state. Customers in this category spend about \$5 million a year on energy bills. This program incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

For more details on these programs please visit [New Jersey's Clean Energy Program website](#).



## 2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Loundsberry Hollow Middle School. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

### 2.1 Site Overview

On August 7, 2024, TRC performed an energy audit at Loundsberry Hollow Middle School located in Vernon, New Jersey. TRC met with facility staff to review the facility operations and help focus our investigation on specific energy-using systems.

Loundsberry Hollow Middle School and Maintenance Building is a two-story, 80,400 square foot building complex built in 1968. Spaces include classrooms, a gymnasium, offices, a cafeteria, corridors, stairwells, a commercial kitchen, and mechanical spaces.

### 2.2 Building Occupancy

The school is fully occupied from September through June. Typical weekday occupancy is 166 staff and 427 students. Summer occupancy includes continuing maintenance activities. Weekend activities vary throughout the year.

Building Name	Weekday/Weekend	Operating Schedule
Loundsberry Hollow Middle School	Weekday	6:00 AM - 11:00 PM
	Weekend	Varied
Loundsberry Maintenance Building	Weekday	6:00 AM - 5:00 PM
	Weekend	Varied

*Building Occupancy Schedule*

### 2.3 Building Envelope

The walls of the middle school are concrete block over structural steel with a brick facade. The roof is flat and covered with black membrane, which is in poor condition.



*Interior Structure and Roof/Exterior Building*

Most of the windows are double glazed and have aluminum frames. The glass-to-frame seals are in fair condition. The operable window weather seals are in fair condition, showing little evidence of excessive wear. Exterior doors have aluminum frames and are in fair condition with undamaged door seals. Degraded window and door seals increase drafts and outside air infiltration.



*Windows and Exterior Door*

The Loundsberry Hollow School Maintenance building is a wood framed, steel sided and steel roofed building with offices a maintenance and repair shop a rest room and storage spaces.



*Maintenance Building Exterior*

## 2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. There are also some fixtures with 75-Watt T12 lamps. Fixture types include 1-, 2-, 3-, or 4-lamp, 2- or 4-foot-long recessed troffers and surface mounted fixtures. There are also 2-foot fixtures with U-bend or linear tube lamps. Typically, T8 fluorescent lamps use electronic ballasts and T12 fluorescent lamps use less efficient magnetic ballasts.

Some of the linear fixtures have been converted to operate LED tube lamps. Additionally, there are some compact fluorescent lamp (CFL) plug-in, incandescent and LED general purpose lamps.

Gymnasium fixtures have manually controlled high bay, high output, (HO) linear fluorescent LED lamps. All exit signs are LED. Most fixtures are in fair condition. Interior lighting levels were generally sufficient.



*Linear Recessed Troffer and Surface Mounted Fixtures*

Most lighting fixtures are controlled manually and the remainder by occupancy sensors.



*Wall Mounted Sensor*

Exterior fixtures include LED wall packs and flood light fixtures. Exterior fixtures are photocell controlled.



*Wall Pack and Flood Light Fixtures*

## 2.5 Air Handling Systems

### Unit Ventilators

Unit ventilators are equipped with supply fan motors and electronically controlled outside air dampers and fan coil valves connected to the hot water distribution system. They provide heating and ventilation to classrooms. This system is original to the building and appears to be in fair operating condition.



*Unit Ventilators*

### Unitary Electric HVAC Equipment

Classrooms use window air conditioning (AC) units. These vary in capacity between 0.42 and 2.0 tons. The units are in fair condition and range in efficiency between 8.03 EER to 11.20 EER. Some are ENERGY STAR® labeled.



*Window AC Units*

Some areas of the school are conditioned by ductless mini split AC and heat pump systems. They range in size between 1- and 3.50-tons of cooling, while the heat pumps heating capacity range between 16 and 36.50 MBh. These units are in poor condition and some units have been recommended for replacement.



*Mini Split System Outdoor Unit and Indoor Console.*

**Unitary Heating Equipment**

Garage bays in the Maintenance Garage are heated by electric resistance unit heaters. These vary in capacity between 24.49 and 102.36 MBh. The units are in fair condition. Equipment is controlled by a manual dial thermostat.



*Unit Heaters*

**Packaged Units**

A few offices are served with packaged terminal heat pump (PTHP) units with on-board controls. These 10 EER units have a heating capacity of 11.60 MBh and a one-ton cooling capacity.



*PTHP Unit*

### Air Handling Units (AHUs)

The gymnasium and mechanical rooms are heated by air handling units. They provide heating and ventilation. Units are controlled locally at the unit.



*Air Handling Unit*

## 2.6 Heating Hot Water Systems

Two Weil-McLain hot water boilers serve the building heating load. They are 3,734 and 3,553 MBh respectively. The burners are fully-modulating with a nominal efficiency of 80 percent. The boilers are configured in an automated control scheme. Both boilers are required under high load conditions. They are in fair condition. There is no service contract in place.

The hydronic distribution system is a 4- pipe heating and cooling system.

The boilers are configured in a constant flow primary distribution with two 5 hp constant speed hot water pumps operating with a lead-lag control scheme. The boilers provide hot water to fin tube radiators, unit ventilators, and fan coil units throughout the building.



*Hot Water Boilers and Heating Hot Water Pumps*



## 2.7 Chilled Water Systems

The chiller plant consists of an 80-ton Trane air-cooled scroll chiller running R-410a. The chiller shares the circulation pumps with the hot water system. The two-pipe system distributes chilled water throughout the building. The chilled water system was downsized. Originally two chillers, each larger than the 80-tons. The school is compensating for the smaller chiller with window ac units. Both the chiller and the window units are controlled by the BAS system.



Chiller and BMS Diagram

## 2.8 Domestic Hot Water

Hot water in the school is produced by a 50 gallon 140.10 MBh oil-fired storage water heater with an efficiency of 64 percent. The maintenance building is served by a 10-gallon 2 kW electric resistance heater. A fractional hp circulation pump circulates water to end uses. The circulation pump operates continuously.



Storage Tank Water Heater and Circulation Pump

## 2.9 Food Service Equipment

The kitchen has a mix of propane and electric equipment that is used to prepare meals for students and staff. Most cooking is done using a propane-fired oven. Bulk prepared foods are held in several electric holding cabinets. Equipment is not high efficiency and is in fair condition.

The dishwasher is a non-ENERGY STAR high temperature, door type unit. Hot water for the kitchen is partially served by 36 kW electric booster water heater.

Visit [https://www.energystar.gov/products/commercial\\_food\\_service\\_equipment](https://www.energystar.gov/products/commercial_food_service_equipment) for the latest information on high efficiency food service equipment.



*Ovens, Oven/Steamer, and Insulated Food Holding Cabinets*

## 2.10 Refrigeration

The kitchen has a freezer and refrigerator chest. The refrigerator chest is ENERGY STAR qualified. Both are in fair condition. The walk-in refrigerator has an estimated 1.12-ton compressor located outside and a two-fan evaporator. The walk-in medium temperature freezer has a 0.75-ton compressor located outside and a two-fan evaporator.

Visit [https://www.energystar.gov/products/commercial\\_food\\_service\\_equipment](https://www.energystar.gov/products/commercial_food_service_equipment) for the latest information on high efficiency food service equipment.



*Outside Condensing Unit and Indoor Evaporator Fans*

## 2.11 Plug Loads

You may wish to consider paying particular attention to minimizing your plug load usage. This report makes suggestions for ECMs in this area as well as energy efficient best practices.

There are approximately 28 computer workstations throughout the facility. Plug loads include general cafe and office equipment. There are classroom typical loads such as smart boards, projectors, and fans.

There are several residential style refrigerators throughout the building. These vary in condition and efficiency. The maintenance building has basic office equipment as well as shop equipment for the maintenance team.



*Kitchen Plug Loads and Water Fountain*

## 2.12 Water-Using Systems

Water is mainly provided by on-site well.

Potable water is used for drinking, cleaning, cooking, sanitary fixtures, building conditioning, landscaping, and vehicle washing.

EPA WaterSense® has set maximum flow rates for sanitary fixtures. They are: 1.28 gallons per flush (gpf) for toilets, 0.5 gpf for urinals, 1.5 gallons per minute (gpm) for lavatory faucets, and 2.0 gpm for showerheads. There are 15 restrooms with toilets and sinks. Faucet flow rates are at 0.5 gallons per minute (gpm) or higher.




*Lavatory Sink*

### 3 ENERGY USE AND COSTS


Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	579,722 kWh	\$64,922
No. 2 fuel oil	21,662 Gallons	\$63,140
Propane	115 Gallons	\$283
<b>Total</b>		<b>\$128,344</b>

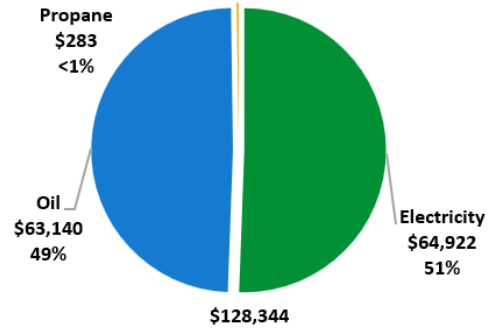

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.


The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.

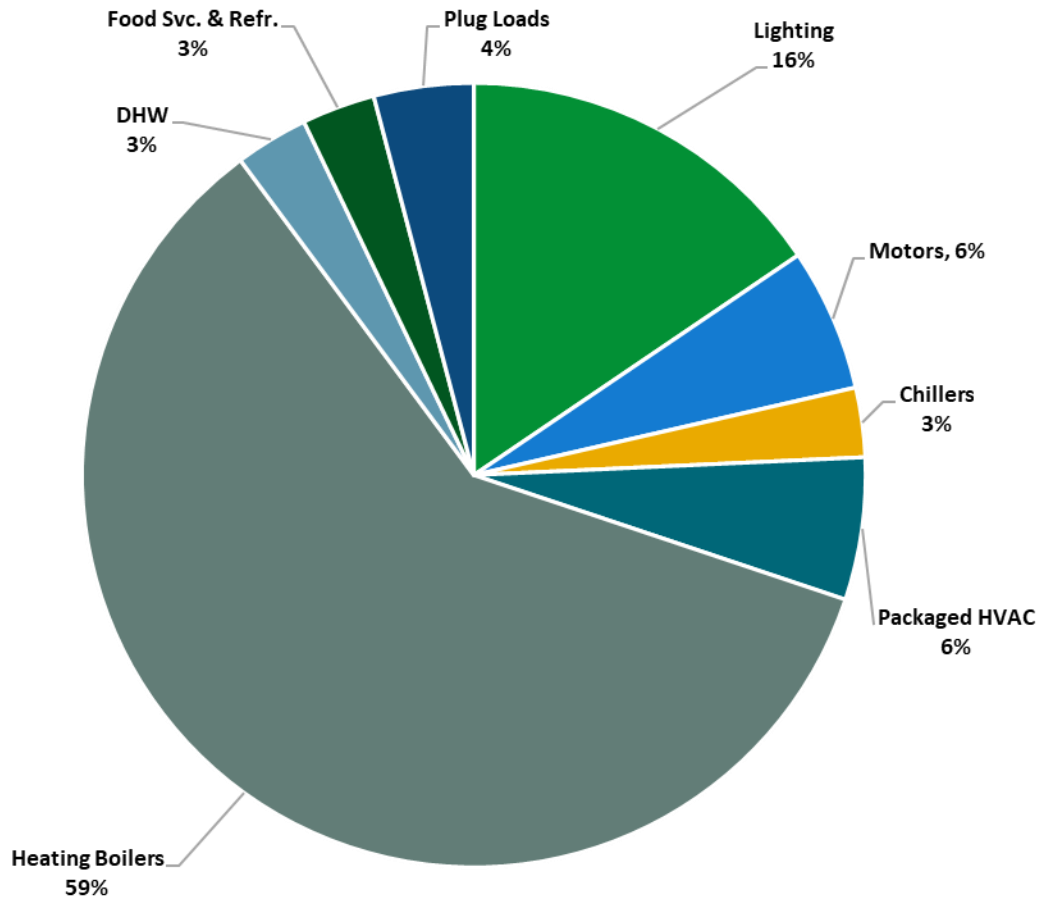

*Energy Balance by System*

### 3.1 Electricity

Sussex Rural Electric Cooperative delivers electricity under rate class 205 Net LPU 1000 KVA.

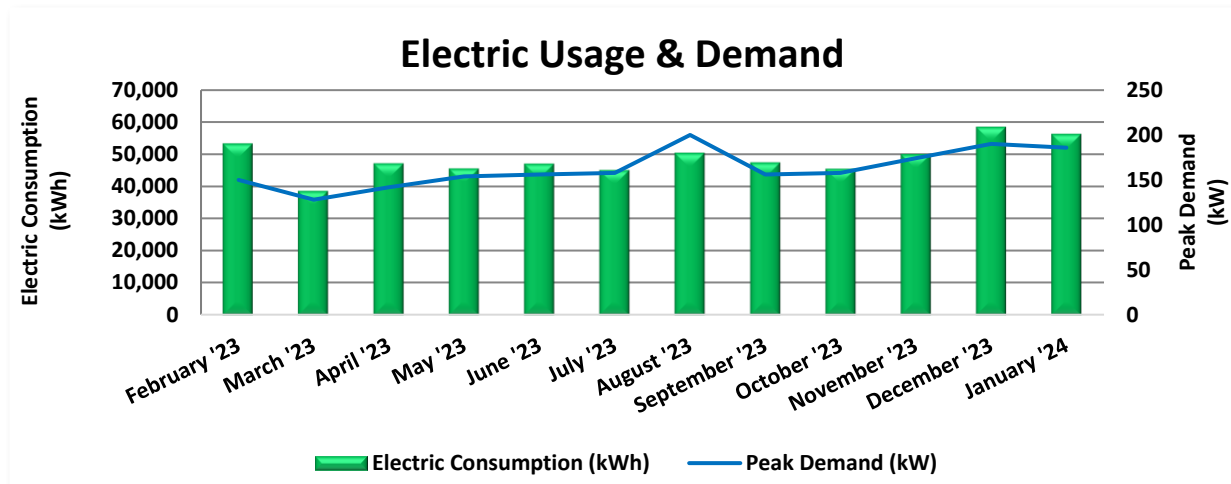


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
3/1/23	31	53,239	150	\$1,500	\$5,520
4/1/23	31	38,566	128	\$1,280	\$5,989
5/1/23	30	47,149	142	\$1,420	\$7,649
6/1/23	31	45,531	154	\$1,540	\$5,901
7/1/23	30	46,990	156	\$1,560	\$6,183
8/1/23	31	45,032	158	\$1,580	\$6,374
9/1/23	31	50,357	200	\$2,000	\$6,054
10/1/23	30	47,414	156	\$1,560	\$5,215
11/1/23	31	45,461	158	\$1,580	\$4,168
12/1/23	30	50,029	174	\$1,740	\$3,474
1/1/24	31	58,494	190	\$1,900	\$3,006
2/1/24	31	56,224	186	\$1,860	\$5,923
<b>Totals</b>	<b>368</b>	<b>584,487</b>	<b>200</b>	<b>\$19,520</b>	<b>\$65,455</b>
<b>Annual</b>	<b>365</b>	<b>579,722</b>	<b>200</b>	<b>\$19,361</b>	<b>\$64,922</b>

Notes:

- Peak demand of 200 kW occurred in August '23.
- Average demand over the past 12 months was 163 kW.
- The average electric cost over the past 12 months was \$0.112/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

### 3.2 No. 2 Fuel Oil

Bottini Fuel delivers No. 2 fuel oil to the project site.

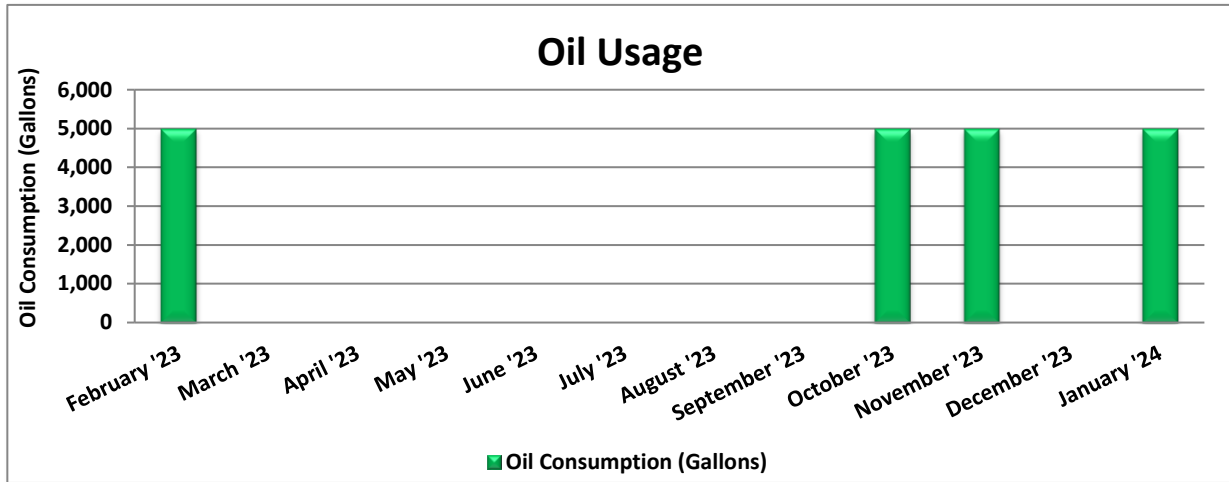


No. 2 fuel oil Billing Data			
Period Ending	Days in Period	Oil Usage (Gallons)	Fuel Cost
3/1/23		5,000	\$14,228
4/1/23	31	0	\$0
5/1/23	30	0	\$0
6/1/23	31	0	\$0
7/1/23	30	0	\$0
8/1/23	31	0	\$0
9/1/23	31	0	\$0
10/1/23	30	0	\$0
11/1/23	31	5,000	\$15,443
12/1/23	30	5,000	\$13,962
1/1/24	31	0	\$0
2/1/24	31	5,000	\$14,664
<b>Totals</b>	<b>337</b>	<b>20,000</b>	<b>\$58,296</b>
<b>Annual</b>	<b>365</b>	<b>21,662</b>	<b>\$63,140</b>

Notes:

- The average No. 2 fuel oil cost for the past 12 months is \$2.915/Gallon, which is the blended rate used throughout the analysis.
- Fuel deliveries do not necessarily correspond to periods of use.

### 3.3 Propane

Suburban Propane delivers Propane to the project site.

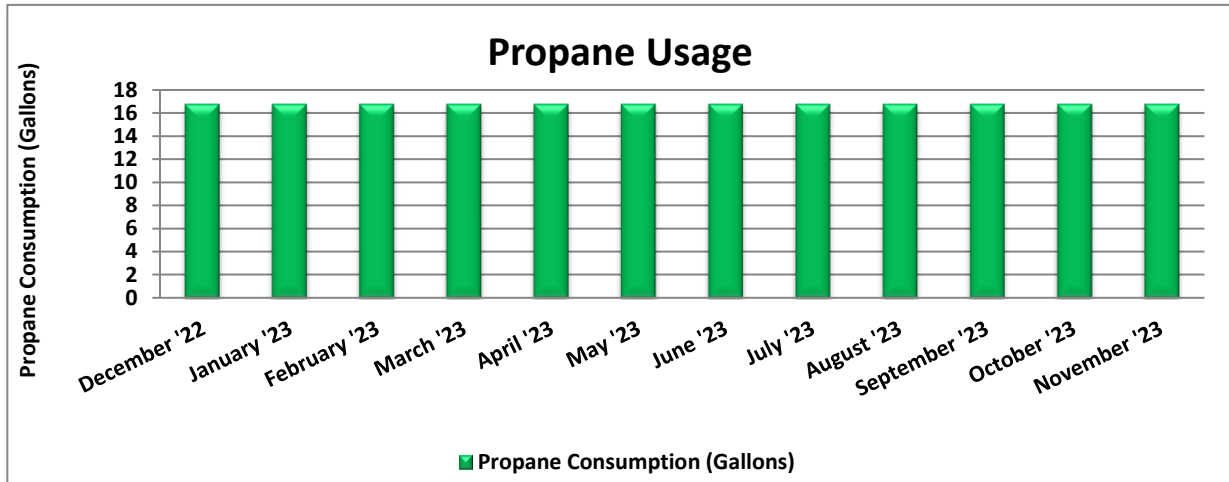

Propane Billing Data			
Period Ending	Days in Period	Propane Usage (Gallons)	Fuel Cost
1/1/23	305	17	\$41
2/1/23	31	17	\$41
3/1/23	28	17	\$41
4/1/23	31	17	\$41
5/1/23	30	17	\$41
6/1/23	31	17	\$41
7/1/23	30	17	\$41
8/1/23	31	17	\$41
9/1/23	31	17	\$41
10/1/23	30	17	\$41
11/1/23	31	17	\$41
12/1/23	30	17	\$41
<b>Totals</b>	<b>639</b>	<b>201</b>	<b>\$495</b>
<b>Annual</b>	<b>365</b>	<b>115</b>	<b>\$283</b>

Notes:

- The average Propane cost for the past 12 months is \$2.468/Gallon, which is the blended rate used throughout the analysis.
- Fuel deliveries do not necessarily correspond to periods of use.




### 3.4 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency’s (EPA) Portfolio Manager® software. Benchmarking compares your building’s energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building’s energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR benchmarking score provides a comprehensive snapshot of your building’s energy performance. It assesses the building’s physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

<b>Benchmarking Score</b>	<b>86</b>
---------------------------	-----------

Congratulations, your building performs better than the national average. This report has suggestions about how to keep your building running efficiently, further improve performance, and lower your energy bills even more.

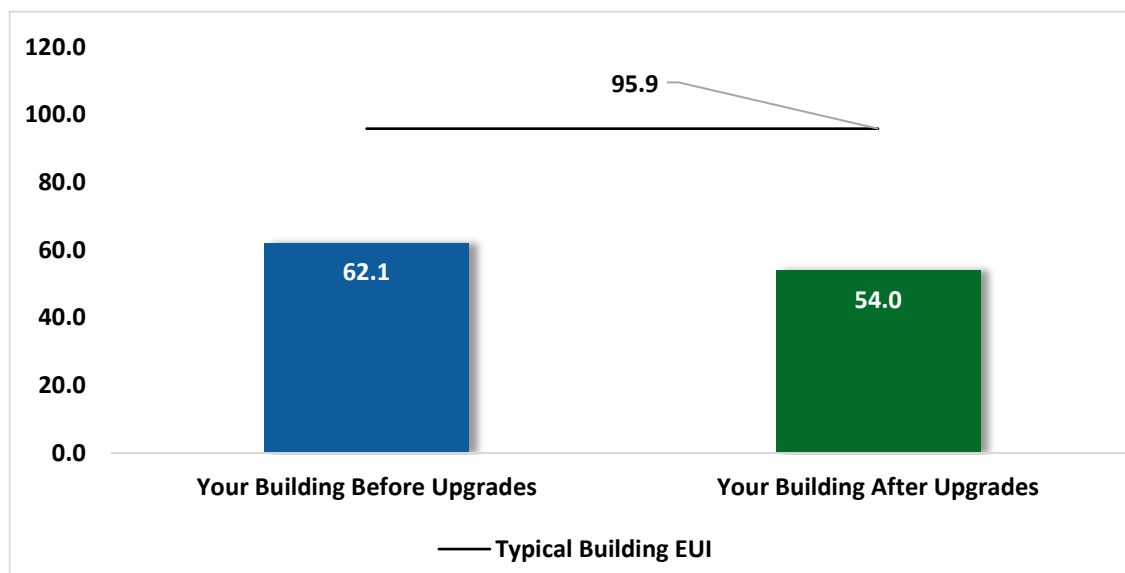

*Energy Use Intensity Comparison<sup>4</sup>*

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings’ energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building’s energy use and the benchmarking score.

<sup>4</sup> Based on all evaluated ECMs

## **Tracking your Energy Performance**

Keeping track of your energy and water use on a monthly basis is one of the best ways to keep utility costs in check and keep your facility operating efficiently. Update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance.

**We have created a Portfolio Manager account for your facility and have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.**

Free online training is available to help you use ENERGY STAR Portfolio Manager to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR and Portfolio Manager, visit their [website](#).

## 3.5 Understanding Your Utility Bills

The State of New Jersey Department of the Public Advocate provides detailed information on how to read natural gas and electric bills. Your bills contain important information including account numbers, meter numbers, rate schedules, meter readings, and the supply and delivery charges. Gas and electric bills both provide comparisons of current energy consumption with prior usage.

Sample bills, with annotation, may be viewed at:

[https://www.nj.gov/rpa/docs/Understanding\\_Electric\\_Bill.pdf](https://www.nj.gov/rpa/docs/Understanding_Electric_Bill.pdf)

[https://www.nj.gov/rpa/docs/Understanding\\_Gas\\_Bill.pdf](https://www.nj.gov/rpa/docs/Understanding_Gas_Bill.pdf)

### **Why Utility Bills Vary**

Utility bills vary from one month to another for many reasons. For this reason, assessing the effects of your energy savings efforts can be difficult.

Billing periods vary, typically ranging between 28 and 33 days. Electric bills provide the kilowatt-hours (kWh) used per month while gas bills provide therms (or hundreds of cubic feet - CCF) per month consumption information. Monthly consumption information can be helpful as a tool to assess your efforts to reduce energy, particularly when compared to monthly usage from a similar calendar period in a prior year.

Bills typically vary seasonally, often with more gas consumed in the winter for heating, and more electricity used in the summer when air conditioning is used. Facilities with electric heating may experience higher electricity use in the winter. Seasonal variance will be impacted by the type of heating and cooling systems used. Normal seasonal fluctuations are further impacted by the weather. Extremely cold or hot weathers causes HVAC equipment to run longer, increasing usage. Other monthly fluctuations in usage can be caused by changes in building occupancy. Utility bills provide a comparison of usage between the current period and comparable billing month period of the prior year. Year-to-year monthly use comparisons can point to trends with energy savings for measures/projects that were implemented within the timeframe, but these comparisons do not account for changing weather or occupancy patterns.

The price of fuel and purchased power used to produce and delivery electricity and gas fluctuates. Any increase or decrease in these costs will be reflected in your monthly bill. Additionally, billing rates occasionally change after justification and approval of the NJBPU. For this reason, it is more useful to review energy use rather than cost when assessing energy use trends or the impact of energy conservation measures implemented.

## 4 ENERGY CONSERVATION MEASURES

---

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives in this report are based on the previously run state rebate program SmartStart, which has been retired. Now, all investor-owned gas and electric utility companies are offering complementary energy efficiency programs directly to their customers. Some measures and proposed upgrades may be eligible for higher incentives than those shown below. The incentives in the summary tables should be used for high-level planning purposes. To verify incentives, reach out to your utility provider or visit the [NJCEP website](#) for more information.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>127,359</b>	<b>41.9</b>	<b>-53</b>	<b>\$13,143</b>	<b>\$86,720</b>	<b>\$16,730</b>	<b>\$69,990</b>	<b>5.3</b>	<b>119,536</b>
ECM 1	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	710	0.2	0	\$73	\$590	\$70	\$520	7.1	666
ECM 2	Retrofit Fixtures with LED Lamps	Yes	126,650	41.7	-53	\$13,069	\$86,130	\$16,660	\$69,470	5.3	118,870
<b>Lighting Control Measures</b>			<b>12,008</b>	<b>2.5</b>	<b>-5</b>	<b>\$1,239</b>	<b>\$20,590</b>	<b>\$4,920</b>	<b>\$15,670</b>	<b>12.6</b>	<b>11,270</b>
ECM 3	Install Occupancy Sensor Lighting Controls	Yes	8,402	1.9	-4	\$867	\$15,240	\$1,850	\$13,390	15.4	7,886
ECM 4	Install High/Low Lighting Controls	Yes	3,605	0.6	-2	\$372	\$5,350	\$3,070	\$2,280	6.1	3,384
<b>Motor Upgrades</b>			<b>319</b>	<b>0.1</b>	<b>0</b>	<b>\$36</b>	<b>\$2,100</b>	<b>\$0</b>	<b>\$2,100</b>	<b>58.7</b>	<b>322</b>
ECM 5	Premium Efficiency Motors	No	319	0.1	0	\$36	\$2,100	\$0	\$2,100	58.7	322
<b>Variable Frequency Drive (VFD) Measures</b>			<b>6,294</b>	<b>2.1</b>	<b>0</b>	<b>\$705</b>	<b>\$6,700</b>	<b>\$1,000</b>	<b>\$5,700</b>	<b>8.1</b>	<b>6,338</b>
ECM 6	Install VFDs on Constant Volume (CV) Fans	Yes	6,294	2.1	0	\$705	\$6,700	\$1,000	\$5,700	8.1	6,338
<b>Unitary HVAC Measures</b>			<b>5,626</b>	<b>4.5</b>	<b>0</b>	<b>\$630</b>	<b>\$33,500</b>	<b>\$0</b>	<b>\$33,500</b>	<b>53.2</b>	<b>5,665</b>
ECM 7	Install High Efficiency Air Conditioning Units	No	2,082	2.0	0	\$233	\$13,300	\$0	\$13,300	57.0	2,097
ECM 8	Install High Efficiency Heat Pumps	Yes	3,544	2.5	0	\$397	\$20,200	\$0	\$20,200	50.9	3,569
<b>Gas Heating (HVAC/Process) Replacement</b>			<b>0</b>	<b>0.0</b>	<b>175</b>	<b>\$3,689</b>	<b>\$152,700</b>	<b>\$7,600</b>	<b>\$145,100</b>	<b>39.3</b>	<b>28,701</b>
ECM 9	Install High Efficiency Hot Water Boilers	No	0	0.0	175	\$3,689	\$152,700	\$7,600	\$145,100	39.3	28,701
<b>Domestic Water Heating Upgrade</b>			<b>82</b>	<b>0.0</b>	<b>2</b>	<b>\$59</b>	<b>\$60</b>	<b>\$20</b>	<b>\$40</b>	<b>0.7</b>	<b>470</b>
ECM 10	Install Low-Flow DHW Devices	Yes	82	0.0	2	\$59	\$60	\$20	\$40	0.7	470
<b>Food Service &amp; Refrigeration Measures</b>			<b>3,863</b>	<b>0.2</b>	<b>0</b>	<b>\$433</b>	<b>\$6,260</b>	<b>\$370</b>	<b>\$5,890</b>	<b>13.6</b>	<b>3,890</b>
ECM 11	Refrigerator/Freezer Case Electrically Commutated Motors	Yes	917	0.1	0	\$103	\$1,500	\$160	\$1,340	13.0	924
ECM 12	Refrigeration Controls	Yes	2,946	0.0	0	\$330	\$4,760	\$210	\$4,550	13.8	2,966
<b>TOTALS</b>			<b>155,552</b>	<b>51.4</b>	<b>120</b>	<b>\$19,933</b>	<b>\$308,630</b>	<b>\$30,640</b>	<b>\$277,990</b>	<b>13.9</b>	<b>176,193</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

*All Evaluated ECMs*

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>127,359</b>	<b>41.9</b>	<b>-53</b>	<b>\$13,143</b>	<b>\$86,720</b>	<b>\$16,730</b>	<b>\$69,990</b>	<b>5.3</b>	<b>119,536</b>
ECM 1	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	710	0.2	0	\$73	\$590	\$70	\$520	7.1	666
ECM 2	Retrofit Fixtures with LED Lamps	126,650	41.7	-53	\$13,069	\$86,130	\$16,660	\$69,470	5.3	118,870
<b>Lighting Control Measures</b>		<b>12,008</b>	<b>2.5</b>	<b>-5</b>	<b>\$1,239</b>	<b>\$20,590</b>	<b>\$4,920</b>	<b>\$15,670</b>	<b>12.6</b>	<b>11,270</b>
ECM 3	Install Occupancy Sensor Lighting Controls	8,402	1.9	-4	\$867	\$15,240	\$1,850	\$13,390	15.4	7,886
ECM 4	Install High/Low Lighting Controls	3,605	0.6	-2	\$372	\$5,350	\$3,070	\$2,280	6.1	3,384
<b>Variable Frequency Drive (VFD) Measures</b>		<b>6,294</b>	<b>2.1</b>	<b>0</b>	<b>\$705</b>	<b>\$6,700</b>	<b>\$1,000</b>	<b>\$5,700</b>	<b>8.1</b>	<b>6,338</b>
ECM 6	Install VFDs on Constant Volume (CV) Fans	6,294	2.1	0	\$705	\$6,700	\$1,000	\$5,700	8.1	6,338
<b>Unitary HVAC Measures</b>		<b>3,544</b>	<b>2.5</b>	<b>0</b>	<b>\$397</b>	<b>\$20,200</b>	<b>\$0</b>	<b>\$20,200</b>	<b>50.9</b>	<b>3,569</b>
ECM 8	Install High Efficiency Heat Pumps	3,544	2.5	0	\$397	\$20,200	\$0	\$20,200	50.9	3,569
<b>Domestic Water Heating Upgrade</b>		<b>82</b>	<b>0.0</b>	<b>2</b>	<b>\$59</b>	<b>\$60</b>	<b>\$20</b>	<b>\$40</b>	<b>0.7</b>	<b>470</b>
ECM 10	Install Low-Flow DHW Devices	82	0.0	2	\$59	\$60	\$20	\$40	0.7	470
<b>Food Service &amp; Refrigeration Measures</b>		<b>3,863</b>	<b>0.2</b>	<b>0</b>	<b>\$433</b>	<b>\$6,260</b>	<b>\$370</b>	<b>\$5,890</b>	<b>13.6</b>	<b>3,890</b>
ECM 11	Refrigerator/Freezer Case Electrically Commutated Motors	917	0.1	0	\$103	\$1,500	\$160	\$1,340	13.0	924
ECM 12	Refrigeration Controls	2,946	0.0	0	\$330	\$4,760	\$210	\$4,550	13.8	2,966
<b>TOTALS</b>		<b>153,150</b>	<b>49.2</b>	<b>-56</b>	<b>\$15,975</b>	<b>\$140,530</b>	<b>\$23,040</b>	<b>\$117,490</b>	<b>7.4</b>	<b>145,074</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

*Cost Effective ECMs*

## 4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>127,359</b>	<b>41.9</b>	<b>-53</b>	<b>\$13,143</b>	<b>\$86,720</b>	<b>\$16,730</b>	<b>\$69,990</b>	<b>5.3</b>	<b>119,536</b>
ECM 1	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	710	0.2	0	\$73	\$590	\$70	\$520	7.1	666
ECM 2	Retrofit Fixtures with LED Lamps	126,650	41.7	-53	\$13,069	\$86,130	\$16,660	\$69,470	5.3	118,870

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

### **ECM 1: Retrofit Fluorescent Fixtures with LED Lamps and Drivers**

Retrofit fluorescent fixtures by removing the fluorescent tubes and ballasts and replacing them with LED tubes and LED drivers (if necessary), which are designed to be used in retrofitted fluorescent fixtures.

The measure uses the existing fixture housing but replaces the electric components with more efficient lighting technology, which use less power than other lighting technologies but provides equivalent lighting output. Maintenance savings may also be achieved since LED tubes last longer than fluorescent tubes and, therefore, do not need to be replaced as often.

**Affected Building Areas:** mechanical room, garage, and storage room

### **ECM 2: Retrofit Fixtures with LED Lamps**

Replace fluorescent, CFL, or incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

**Affected Building Areas:** all areas with fluorescent fixtures with T8, CFL, or incandescent lamps

## 4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Control Measures</b>		<b>12,008</b>	<b>2.5</b>	<b>-5</b>	<b>\$1,239</b>	<b>\$20,590</b>	<b>\$4,920</b>	<b>\$15,670</b>	<b>12.6</b>	<b>11,270</b>
ECM 3	Install Occupancy Sensor Lighting Controls	8,402	1.9	-4	\$867	\$15,240	\$1,850	\$13,390	15.4	7,886
ECM 4	Install High/Low Lighting Controls	3,605	0.6	-2	\$372	\$5,350	\$3,070	\$2,280	6.1	3,384

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

### **ECM 3: Install Occupancy Sensor Lighting Controls**

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

**Affected Building Areas:** offices, classrooms, library, restrooms, and storage rooms

### **ECM 4: Install High/Low Lighting Controls**

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as occupants approach the area. This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

**Affected Building Areas:** hallways and stairwells

### 4.3 Motors

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Motor Upgrades</b>		<b>319</b>	<b>0.1</b>	<b>0</b>	<b>\$36</b>	<b>\$2,100</b>	<b>\$0</b>	<b>\$2,100</b>	<b>58.7</b>	<b>322</b>
ECM 5	Premium Efficiency Motors	319	0.1	0	\$36	\$2,100	\$0	\$2,100	58.7	322

#### ECM 5: Premium Efficiency Motors

We evaluated replacing standard efficiency motors with IHP 2014 efficiency motors. This evaluation assumes that existing motors will be replaced with motors of equivalent size and type. In some cases, additional savings may be possible by downsizing motors to better meet the motor’s current load requirements.

The potential savings from installing new fan coils with electronically commutated (EC) motors was evaluated. EC motors are generally more efficient than other fractional hp motors and have the capability of operating at variable speeds. In general, replacing the fan coils should be considered a capital improvement measure that has the potential to provide energy savings and improve occupant comfort.

#### Affected Motors:

Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Additional Motor Description
Exterior 1	Loundsberry Hollow Middle School	1	Exhaust Fan	0.5	Exhaust Fan
Exterior 4, 2nd roof	Loundsberry Hollow Middle School	1	Exhaust Fan	0.5	Exhaust Fan
Mechanical 1	Loundsberry Hollow Middle School	1	Heating Hot Water Pump	0.3	Heating Hot Water Pump

Savings are based on the difference between baseline and proposed efficiencies and the assumed annual operating hours. The base case motor energy consumption is estimated using the efficiencies found on nameplates or estimated based on the age of the motor and our best estimates of motor run hours. Efficiencies of proposed motor upgrades are obtained from the current *New Jersey’s Clean Energy Program Protocols to Measure Resource Savings*.

### 4.4 Variable Frequency Drives (VFD)

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Variable Frequency Drive (VFD) Measures</b>		<b>6,294</b>	<b>2.1</b>	<b>0</b>	<b>\$705</b>	<b>\$6,700</b>	<b>\$1,000</b>	<b>\$5,700</b>	<b>8.1</b>	<b>6,338</b>
ECM 6	Install VFDs on Constant Volume (CV) Fans	6,294	2.1	0	\$705	\$6,700	\$1,000	\$5,700	8.1	6,338

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed



VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

**ECM 6: Install VFDs on Constant Volume (CV) Fans**

Install VFDs to control constant volume fan motor speeds. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

**Affected Air Handlers:** gymnasium

4.5 Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Unitary HVAC Measures</b>		<b>5,626</b>	<b>4.5</b>	<b>0</b>	<b>\$630</b>	<b>\$33,500</b>	<b>\$0</b>	<b>\$33,500</b>	<b>53.2</b>	<b>5,665</b>
ECM 7	Install High Efficiency Air Conditioning Units	2,082	2.0	0	\$233	\$13,300	\$0	\$13,300	57.0	2,097
ECM 8	Install High Efficiency Heat Pumps	3,544	2.5	0	\$397	\$20,200	\$0	\$20,200	50.9	3,569

We evaluated replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the ductless mini split units are eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

**ECM 7: Install High Efficiency Air Conditioning Units**

We evaluated replacing standard efficiency packaged air conditioning units with high efficiency packaged air conditioning units. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling and heating load, and the estimated annual operating hours.

**Affected Units:** split systems

**ECM 8: Install High Efficiency Heat Pumps**

We evaluated replacing standard efficiency heat pumps with high efficiency heat pumps. A higher EER or SEER rating indicates a more efficient cooling system, and a higher HSPF rating indicates more efficient heating mode. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average heating and cooling loads, and the estimated annual operating hours.

**Affected Units:** ductless mini split units

## 4.6 Gas-Fired Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Gas Heating (HVAC/Process) Replacement</b>		<b>0</b>	<b>0.0</b>	<b>175</b>	<b>\$3,689</b>	<b>\$152,700</b>	<b>\$7,600</b>	<b>\$145,100</b>	<b>39.3</b>	<b>28,701</b>
ECM 9	Install High Efficiency Hot Water Boilers	0	0.0	175	\$3,689	\$152,700	\$7,600	\$145,100	39.3	28,701

### **ECM 9: Install High Efficiency Hot Water Boilers**

We evaluated replacing older inefficient hot water boilers with high efficiency hot water boilers. Energy savings may improve from improved combustion efficiency and reduced standby losses at low loads.

For the purposes of this analysis, we evaluated the replacement of boilers on a one-for-one basis with equipment of the same capacity. We recommend that you work with your mechanical design team to select boilers that are sized appropriately for the heating load. In many cases installing multiple modular boilers, rather than one or two large boilers, will result in higher overall plant efficiency while providing additional system redundancy.

Replacing the boilers has a long payback and may not be justifiable based simply on energy considerations. However, the boilers have reached the end of their normal useful life. Typically, the marginal cost of purchasing high efficiency boilers can be justified by the marginal savings from the improved efficiency. When the boiler is eventually replaced, consider purchasing boilers that exceed the minimum efficiency required by building codes. We also recommend working with your mechanical design team to determine whether the heating system can operate with return water temperatures below 130°F, which would allow the use of condensing boilers.

## 4.7 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Domestic Water Heating Upgrade</b>		<b>82</b>	<b>0.0</b>	<b>2</b>	<b>\$59</b>	<b>\$60</b>	<b>\$20</b>	<b>\$40</b>	<b>0.7</b>	<b>470</b>
ECM 10	Install Low-Flow DHW Devices	82	0.0	2	\$59	\$60	\$20	\$40	0.7	470

### **ECM 10: Install Low-Flow DHW Devices**

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing.

## 4.8 Food Service and Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Food Service &amp; Refrigeration Measures</b>		<b>3,863</b>	<b>0.2</b>	<b>0</b>	<b>\$433</b>	<b>\$6,260</b>	<b>\$370</b>	<b>\$5,890</b>	<b>13.6</b>	<b>3,890</b>
ECM 11	Refrigerator/Freezer Case Electrically Commutated Motors	917	0.1	0	\$103	\$1,500	\$160	\$1,340	13.0	924
ECM 12	Refrigeration Controls	2,946	0.0	0	\$330	\$4,760	\$210	\$4,550	13.8	2,966

### **ECM 11: Refrigerator/Freezer Electrically Commutated Motors**

Replace shaded pole or permanent split capacitor (PSC) motors with electronically commutated (EC) motors in walk-in, coolers and freezers. Fractional horsepower EC motors are significantly more efficient than mechanically commutated, brushed motors, particularly at low speeds or partial load. By using variable-speed technology, EC motors can optimize fan usage. Because these motors are brushless and use DC power, losses due to friction and phase shifting are eliminated.

Savings for this measure consider both the increased efficiency of the motor as well as the reduction in refrigeration load due to motor heat loss.

### **ECM 12: Refrigeration Controls**

Install additional controls to optimize the operation of walk-in coolers and freezers.

Many walk-in coolers and freezers have continuously operating electric heaters on the doors to prevent condensation formation. This measure adds a control system feature to shut off the door heaters when the humidity level is low enough that condensation will not occur if the heaters are off. This is done by measuring the ambient humidity and temperature of the store, comparing that to the dewpoint, and using pulse width modulation to control the anti-sweat door heaters.

Defrost controllers can be used to override defrost of evaporator fans when the defrost operation is not necessary, which reduces annual energy consumption. This measure is applicable to existing evaporator fans with a traditional electric de-frost mechanism.

Many walk-in coolers and freezers have evaporator fans that run continuously. The measure adds a control system feature to automatically shut off evaporator fans when not needed.

Energy savings for each of the control measures account for reduction in compressor and fan operating hours as well as reduction in the refrigeration heat load as appropriate.

## 4.9 Measures for Future Consideration

There are additional opportunities for improvement that Vernon Township BOE may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment, and/or include significant system reconfiguration. These measure(s) are therefore beyond the scope of this energy audit. These measure(s) are described here to support a whole building approach to energy efficiency and sustainability.

Vernon Township BOE may wish to consider the Energy Savings Improvement Program (ESIP) or other whole building approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to:

- Evaluate these measures further.
- Develop firm costs.
- Determine measure savings.
- Prepare detailed implementation plans.

Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

### **VRF Systems**

Consider variable refrigerant flow (VRF) systems as part of a comprehensive package unit upgrade project. (VRF systems use direct expansion (DX) heat pumps to transport heat between an outdoor condensing unit and a network of indoor evaporators, located near or within the conditioned space, through refrigerant piping installed in the building. Attributes that distinguish VRF from other DX system types are:

- Multiple indoor units connected to a common outdoor unit.
- Scalability
- Variable capacity
- Distributed control
- Simultaneous heating and cooling capability

VRF provides flexibility by allowing for many different indoor units (with different capacities and configurations), individual zone control, the unique ability to offer simultaneous heating and cooling in separate zones on a common refrigerant circuit, and heat recovery from one zone to another. VRF systems are equipped with at least one variable-speed and/or variable-capacity compressor.

To match the building's load profiles, energy is transferred from one indoor space to another through the refrigerant line, and only one energy source is necessary to provide both heating and cooling. VRF systems also operate efficiently at part load because of the compressor's variable capacity control. VRF systems are ideal for applications with varying loads or where zoning is required. Some other advantages of VRF systems include consistent comfort, quiet operation, energy efficiency, installation flexibility, zoned heating and cooling, state-of-the-art controls, and reliability.

VRF systems are more expensive than conventional heat pump systems; however, the higher initial cost can be offset by improved cooling efficiency during part load operation—a SEER (cooling) rating of 18.0 is not uncommon for small packaged VRF-equipped heat pumps.

When you are replacing packaged HVAC equipment, we recommend a comprehensive approach. Work with your contractor or design engineer to make sure your systems are sized and zoned according to current space configurations and occupancy. Select high efficiency equipment and controls that match your heating and cooling needs. Commission the system and controls to ensure proper operation, comfort, ventilation, and energy use.

## 5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5%–20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Energy Tracking with ENERGY STAR Portfolio Manager**



You've heard it before—you cannot manage what you do not measure. ENERGY STAR Portfolio Manager is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions<sup>5</sup>. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

### **Lighting Maintenance**



Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.

In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

### **Lighting Controls**

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly. Adjust exterior lighting time clock controls seasonally as needed to match your lighting requirements.

### **Motor Maintenance**

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and

<sup>5</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>

tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

### **Chiller Maintenance**

Service chillers regularly to keep them operating properly. Chillers are responsible for a substantial portion of a commercial building's overall energy usage, and when they do not work well, there is usually a noticeable increase in energy bills and increased occupant complaints. Regular diagnostics and service can save five to ten percent of the cost of operating your chiller. If you already have a maintenance contract in place, your existing service company should be able to provide these services.

### **Thermostat Schedules and Temperature Resets**



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

### **AC System Evaporator/Condenser Coil Cleaning**

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

### **HVAC Filter Cleaning and Replacement**

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

### **Ductwork Maintenance**

Duct maintenance has two primary goals: keep the ducts clean to avoid air quality problems and seal leaks to save energy. Check for cleanliness, obstructions that block airflow, water damage, and leaks. Ducts should be inspected at least every two years.

The biggest symptoms of clogged air ducts are differing temperatures throughout the building and areas with limited airflow from supply registers. If a particular air duct is clogged, then air flow will only be cut off to some rooms in the building—not all of them. The reduced airflow will make it more difficult for those areas to reach the temperature setpoint, which will cause the HVAC system to run longer to cool or heat that area properly. If you suspect clogged air ducts, ensure that all areas in front of supply registers are clear of items that may block or restrict air flow, and you should check for fire dampers or balancing dampers that have failed closed.

Duct leakage in commercial buildings can account for 5%–25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Check ductwork for leakage. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.

Distribution system losses are dependent on air system temperature, the size of the distribution system, and the level of insulation of the ductwork. Significant energy savings can be achieved when insulation

has not been well maintained. When the insulation is missing or worn, the system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

### **Boiler Maintenance**

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely and efficiently. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the boiler sections to improve heat transfer.

### **Water Heater Maintenance**

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues, and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

### **Refrigeration Equipment Maintenance**

Preventative maintenance keeps commercial refrigeration equipment running reliably and efficiently. Commercial refrigerators and freezers are mission-critical equipment that can cost a fortune when they go down. Even when they appear to be working properly, refrigeration units can be consuming too much energy. Have walk-in refrigeration and freezer and other commercial systems serviced at least annually. This practice will allow systems to perform to their highest capabilities and will help identify system issues if they exist.

Maintaining your commercial refrigeration equipment can save between five and ten percent on energy costs. When condenser coils are dirty, your commercial refrigerators and freezers work harder to maintain the temperature inside. Worn gaskets, hinges, door handles or faulty seals cause cold air to leak from the unit, forcing the unit to run longer and use more electricity.

Regular cleaning and maintenance also help your commercial refrigeration equipment to last longer.

### **Procurement Strategies**

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR products where available.

## 6 WATER BEST PRACTICES

### **Getting Started**



The commercial and institutional sector is the second largest consumer of publicly supplied water in the United States, accounting for 17% of the withdrawals from public water supplies<sup>6</sup>. In New Jersey, excluding water used for power generation, approximately 80% of total water use was attributed to potable supply during the period of 2009 to 2018. Water withdrawals for potable supply have not changed noticeably during the period from 1990 to 2018<sup>7</sup>.

Water management planning serves as the foundation for any successful water reduction effort. It is the first step a commercial or institutional facility owner or manager should take to achieve and sustain long-term water savings. Understanding how water is used within a facility is critical for the water management planning process. A water assessment provides a comprehensive account of all known water uses at the facility. It allows the water management team to establish a baseline from which progress and program success can be measured. It also enables the water management team to set achievable goals and identify and prioritize specific projects based on the relative savings opportunities and project cost-effectiveness.

Water conservation devices may significantly reduce your water and sewer usage costs. Any reduction in water use reduces grid-level electricity use since a significant amount of electricity is used to treat and deliver water from reservoirs to end users.

For more information regarding water conservation or additional details regarding the practices shown below go to the EPA's WaterSense website<sup>8</sup> or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"<sup>9</sup> to get ideas for creating a water management plan and best practices for a wide range of water using systems.

### **Leak Detection and Repair**

Identifying and repairing leaks and other water use anomalies within a facility's water distribution system or from processes or equipment can keep a facility from wasting significant quantities of water. Examples of common leaks include leaking toilets and faucets, drip irrigation malfunctions, stuck float valves, and broken distribution lines. Reading meters, installing failure abatement technologies, and conducting visual and auditory inspections are important best practices to detect leaks. Train building occupants, employees, and visitors to report any leaks that they detect. To reduce unnecessary water loss, detected leaks should be repaired quickly. Repairing leaks in water distribution that is pressurized by on-site pumps or in heated or chilled water piping will also reduce energy use.

### **Toilets and Urinals**

Toilets and urinals are considered sanitary fixtures and are found in most facilities. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously flushing, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment

<sup>6</sup> Estimated from analyzing data in: [Solley, Wayne B., et al, "Estimated Use of Water in the United States in 1995", U.S Geological Survey Circular 1200, \(1998\)](#)

<sup>7</sup> <https://dep.nj.gov/wp-content/uploads/dsr/trends-water-supply.pdf>

<sup>8</sup> <https://www.epa.gov/watersense>

<sup>9</sup> <https://www.epa.gov/watersense/watersense-work-0>



and the frequency of use, it may be cost effective to replace older inefficient fixtures with current generation WaterSense labeled equipment.

Commercial facilities typically use tank toilets or wall-mount flushometers. Educate and inform users with restroom signage and other means to avoid flushing inappropriate objects. For tank toilets, periodically check to ensure fill valves are working properly and that water level is set correctly. Annually test toilets to ensure the flappers are not worn or allowing water to seep from the tank into the bowl and down the sewer. Control stops and piston valves on flushometer toilets should be checked at least annually.

Most urinals use water to flush liquid. These standard single-user fixtures are present in most facilities. Non-water urinals use a specially designed trap that allows liquid waste to drain out of the fixture through a trap seal, and into the drainage system. Flushing urinals should be inspected at least annually for proper valve and sensor operation. For non-water urinals, follow maintenance practices as directed by the manufacturer to ensure products perform as expected. Non-water urinals can be considered during urinal replacement, however, review the condition and design of the existing plumbing system and the expected usage patterns to ensure that these products will provide the anticipated performance.

### **Faucets and Showerheads**

Faucets and showerheads are sanitary fixtures that generally dispense heated water. Reducing water use by these fixtures translates into a reduction of site fuel or electric use depending on how water is heated. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously dripping, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment and the frequency of use, it may be cost effective to replace older fixtures with current generation WaterSense labeled equipment.

Faucets are used for a variety of purposes, and standard flow rates are dictated by the intended use. Public use lavatory faucets and kitchen faucets are subject to maximum flow rates while service sinks are not. Periodically inspect faucet aerators for scale buildup to ensure flow is not being restricted. Clean or replace the aerator or other spout end device as needed. Check and adjust automatic sensors (where installed) to ensure they are operating properly to avoid faucets running longer than necessary. Post materials in restrooms and kitchens to ensure user awareness of the facility's water-efficiency goals. Remind users to turn off the tap when they are done and to consider turning the tap off during sanitation activities when it is not being used. Consider installing lavatory and kitchen faucet fixtures with reduced flow. Federal standards limit kitchen and restroom faucet flows to 2.2 gpm. To qualify for a WaterSense label a faucet cannot exceed 1.5 gpm.

Effective in 1992, the maximum allowable flow rate for all showerheads sold in the United States is 2.5 gpm. Since this standard was enacted, many showerheads have been designed to use even less water. WaterSense labeled equipment is designed to use 2.0 gpm, or less. For optimum showerhead efficiency, the system pressure should be tested to make sure that it is between 20 and 80 pounds per square inch (psi). Verify that plumbing lines are routed through a shower valve to prevent water pressure fluctuations. Periodically inspect showerheads for scale buildup to ensure flow is not being restricted. In general, replace showerheads with 2.5 gpm flow rates or higher with WaterSense labeled models. Note: Use of poor performing replacement reduced flow showerheads may result in increased use if the duration of use is increased to compensate for reduced performance. WaterSense labeled showerheads are independently certified to meet or exceed minimum performance requirements for spray coverage and force.

## Ice Machines

Commercial ice machines use refrigeration units to freeze water into ice. Ice machines typically use water for two purposes: cooling the refrigeration unit and making ice. Because the ice-making process generates a significant amount of heat, either water or air is used to remove this waste heat from the ice machine's refrigeration unit.

Water-cooled ice machines generally pass water through the machine once to cool it and then dispose of the single-pass water down the drain. Water-cooled systems can use less water by recirculating the cooling water through a chiller or a cooling tower to lower the temperature, returning the water to the machine for reuse. To eliminate using water to cool the refrigeration unit altogether, air can be used to cool the unit. Air-cooled ice machines use motor-driven fans or centrifugal blowers to move air through the refrigeration unit to remove heat. In general, water-cooled units are more energy efficient than air-cooled units but use more water. Commercial ice machines that are ENERGY STAR qualified are, on average, 15% more energy-efficient and 10% more water-efficient than standard air-cooled models.

For optimal ice machine efficiency, consider the following:

- Clean the ice machine to remove lime and scale buildup; sanitize it to kill bacteria and fungi. Run the self-cleaning sequence if available. For machines without a self-cleaning mode, shut down the machine, empty the bin of ice, add cleaning or sanitizing solution to the machine, switch it to cleaning mode, and then switch it to ice production mode. For health and safety purposes, create and discard several batches of ice to remove residual cleaning solution.
- Keep the ice machine's coils clean to ensure the heat exchange process is running efficiently.
- Keep the lid closed to preserve cool air and maintain the appropriate temperature.
- Install a timer to shift ice production to off-peak hours to decrease peak energy demand.
- Work with the manufacturer to ensure that the ice machine's rinse cycle is set to the lowest possible frequency that still provides sufficient ice quality and meets local water quality and site requirements.
- Follow the manufacturer's use and care instructions for the specific ice machine model.
- Train users to report leaking or otherwise improperly operating ice machines to the appropriate personnel.

If the machine is cooled using single-pass water, modify the machine to operate on a closed loop that recirculates the cooling water through a cooling tower or heat exchanger, if possible.

When replacing an ice machine or installing a new one, ensure that the new model is sized appropriately to fit the facility's need. Choose an ice machine that is appropriate for the quality of ice needed. Producing ice of higher quality than required will use water unnecessarily. Look for ENERGY STAR qualified models, all of which are air-cooled. Also consider air- or water-cooled ice machines that meet the efficiency specifications outlined by the Consortium for Energy Efficiency. If feasible, consider selecting air-cooled flake or nugget ice machines, which use less water and energy than cubed ice machines.

## 7 ON-SITE GENERATION

---

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


## 7.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has medium potential for installing a PV array.

The amount of free area, ease of installation (location), and the lack of shading elements contribute to the medium potential. A PV array located in the parking lot be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

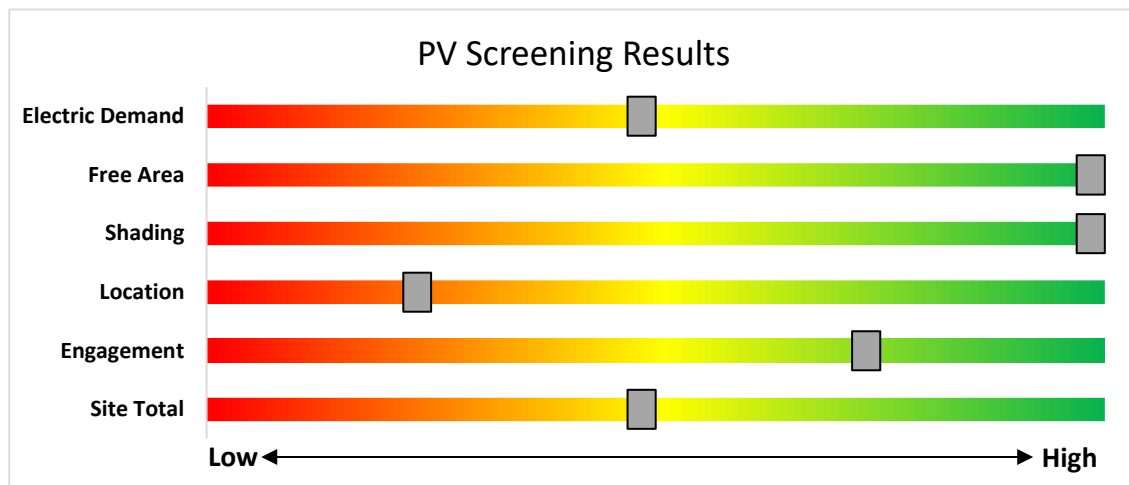

Potential	Medium	
<b>System Potential</b>	163	kW DC STC
<b>Electric Generation</b>	194,193	kWh/yr
<b>Displaced Cost</b>	\$21,750	/yr
<b>Installed Cost</b>	\$550,900	

*Photovoltaic Screening*

### Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners must register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- ◆ **Successor Solar Incentive Program (SuSI):** <https://www.njcleanenergy.com/renewable-energy/programs/susi-program>
- ◆ **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- ◆ **NJ Solar Market FAQs:** [www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs](http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs)
- ◆ **Approved Solar Installers in the NJ Market:** [http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/?id=60&start=1](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1)

## 7.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.


CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

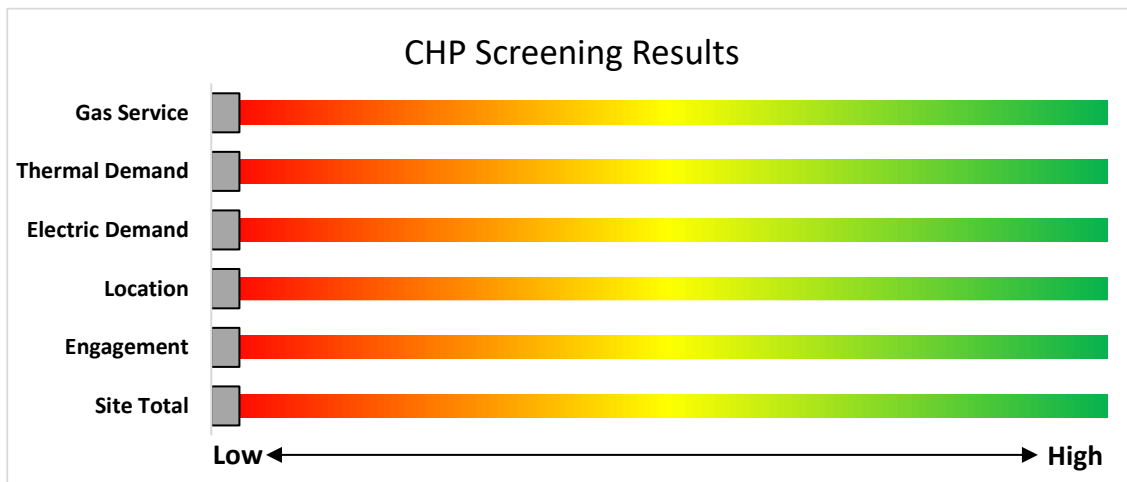

*Combined Heat and Power Screening*

Find a qualified firm that specializes in commercial CHP cost assessment and installation: [http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/)

## 8 ELECTRIC VEHICLES

All electric vehicles (EVs) have an electric motor instead of an internal combustion engine. EVs function by plugging into a charge point, taking electricity from the grid, and then storing it in rechargeable batteries. Although electricity production may contribute to air pollution, the U.S. EPA categorizes all electric vehicles as zero-emission vehicles because they produce no direct exhaust or tailpipe emissions.

EVs are typically more expensive than similar conventional and hybrid vehicles, although some cost can be recovered through fuel savings, federal tax credit, or state incentives.

### 8.1 EV Charging

EV charging stations provide a means for electric vehicle operators to recharge their batteries at a facility. While many EV drivers charge at home, others do not have access to regular home charging, and the ability to charge at work or in public locations is critical to making EVs practical for more drivers. Charging can also be used for electric fleet vehicles, which can reduce fuel and maintenance costs for fleets that replace gas or diesel vehicles with EVs.

EV charging comes in three main types. For this assessment, the screening considers addition of Level 2 charging, which is most common at workplaces and other public locations. Depending on the site type and usage, other levels of charging power may be more appropriate.


The preliminary assessment of EV charging at the facility shows that there is high potential for adding EV chargers to the facility's parking, based on potential costs of installation and other site factors.

The primary costs associated with installing EV charging are the charger hardware and the cost to extend power from the facility to parking spaces. This may include upgrades to electric panels to serve increased loads.


The type and size of the parking area impact the costs and feasibility of adding EV charging. Parking structure installations can be less costly than surface lot installations as power may be readily available, and equipment and wiring can be surface mounted. Parking lot installations often require trenching through concrete or asphalt surface. Large parking areas provide greater flexibility in charger siting than smaller lots.

The location and capacity of facility electric panels also impact charger installation costs. A Level 2 charger generally requires a dedicated 208-240V, 40 Amp circuit. The electric panel nearest the planned installation may not have available capacity and may need to be upgraded to serve new EV charging loads. Alternatively, chargers could be powered from a more distant panel. The distance from the panel to the location of charging stations ties directly to costs, as conduits, cables, and potential trenching costs all increase on a per-foot basis. The more charging stations planned, the more likely it is that additional electrical capacity will be needed.

Other factors to consider when planning for EV charging at a facility include who the intended users are, how long they park vehicles at the site, and whether they will need to pay for the electricity they use.

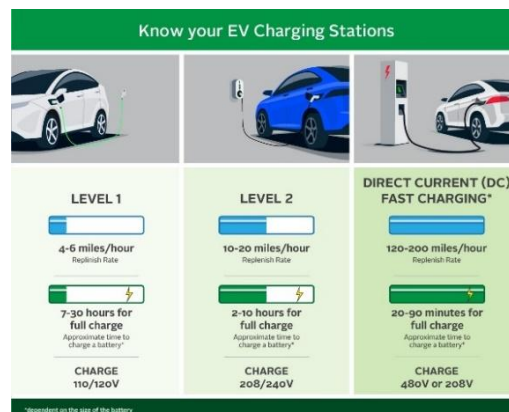

The graphic below displays the results of the EV charging assessment conducted as part of this audit. The position of each slider indicates the impact each factor has on the feasibility of installing EV charging at the site.

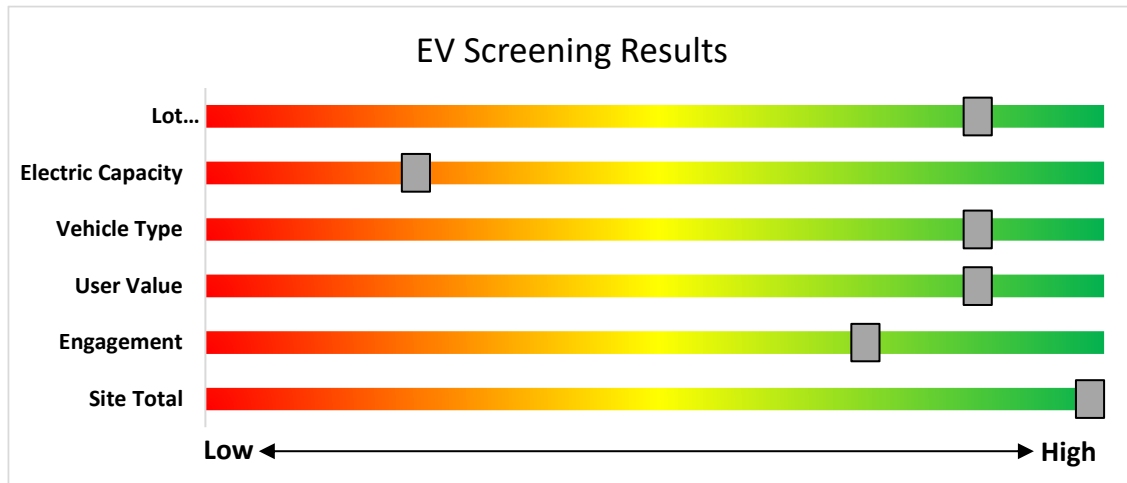

EV Charger Screening

### Electric Vehicle Programs Available

New Jersey is leading the way on electric vehicle (EV) adoption on the East Coast. There are several programs designed to encourage EV adoption in New Jersey, which is crucial to reaching a 100% clean energy future.

NJCEP offers a variety of EV programs for vehicles, charging stations, and fleets. Certain EV charging stations that receive electric utility service from Atlantic City Electric Company (ACE), Public Service Electric and Gas Company (PSE&G) or Jersey Central Power and Light (JCP&L), may be eligible for additional electric vehicle charging incentives directly from the utility. Projects may be eligible for both the incentives offered by this BPU program and incentives offered by ACE, PSE&G or JCP&L, up to 90% of the combined charger purchase and installation costs. Please check ACE, PSE&G or JCP&L program eligibility requirements before purchasing EV charging equipment, as additional conditions on types of eligible chargers may apply for utility incentives.

EV Charging incentive information is available from Atlantic City Electric, PSE&G and JCP&L. For more information and to keep up to date on all EV programs please visit <https://www.njcleanenergy.com/commercial-industrial/programs/electric-vehicle-programs>



## 9 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs and Utility Energy Efficiency Programs can help. Pick the program that works best for you. This section provides an overview of currently available incentive programs in New Jersey.

### NJBPU and NJCEP Administered Programs



- New Construction (residential, commercial, industrial, government)
  - Large Energy Users
  - Energy Savings Improvement Program (financing)
  - State Facilities Initiative\*
  - Local Government Energy Audits
  - Combined Heat & Power & Fuel Cells
- \*State facilities are also eligible for utility programs

### Utility Administered Programs



- Existing buildings (residential, commercial, industrial, government)
- Efficient Products
  - Lighting & Marketplace
  - HVAC
  - Appliance Rebates
  - Appliance Recycling

## 9.1 New Jersey's Clean Energy Program

Save money while saving the planet! New Jersey's Clean Energy Program is a statewide program that offers incentives, programs, and services that benefit New Jersey residents, businesses, educational, non-profit, and government entities to help them save energy, money, and the environment.

### Large Energy Users

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers. To qualify entities must have incurred at least \$5 million in total energy costs in the prior fiscal year.

#### **Incentives**

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually.

#### **How to Participate**

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEED). Once the FEED is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at <http://www.njcleanenergy.com/LEUP>.

## Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation. ≤

### Incentives<sup>10</sup>

Eligible Technology	Size (Installed Rated Capacity)	Incentive (\$/Watt) <sup>5</sup>	% of Total Cost Cap per Project	\$ Cap per Project
CHPs powered by non-renewable or renewable fuel source, or a combination: <sup>4</sup> - Gas Internal Combustion Engine - Gas Combustion Turbine - Microturbine	≤500 kW <sup>1</sup>	\$2.00	30-40% <sup>2</sup>	\$2 million
	>500 kW - 1 MW <sup>1</sup>	\$1.00		
	> 1 MW - 3 MW <sup>1</sup>	\$0.55	30%	\$3 million
	>3 MW <sup>1</sup>	\$0.35		
Fuel Cells ≥60%	Same as above <sup>1</sup>	Applicable amount above	30%	\$1 million
Waste Heat to Power (WHP) <sup>3</sup> Powered by non-renewable fuel source. Heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine)	≤1MW <sup>1</sup>	\$1.00	30%	\$2 million
	> 1MW <sup>1</sup>	\$.50	30%	\$3 million

<sup>10</sup>

<sup>1</sup> Incentives are tiered, which means the incentive levels vary based upon the installed rated capacity, as listed in the chart above. For example, a 4 MW CHP system would receive \$2.00/watt for the first 500 kW, \$1.00/watt for the second 500 kW, \$0.55/watt for the next 2 MW and \$0.35/watt for the last 1 MW (up to the caps listed).

<sup>2</sup> The maximum incentive will be limited to 30% of total project. For CHP projects up to 1 MW, this cap will be increased to 40% where a cooling application is used or included with the CHP system (e.g. absorption chiller).

<sup>3</sup> Projects will be eligible for incentives shown above, not to exceed the lesser of % of total project cost per project cap or maximum \$ per project cap. Projects installing CHP or FC with WHP will be eligible for incentive shown above, not to exceed the lesser caps of the CHP or FC incentive. Minimum efficiency will be calculated based on annual total electricity generated, utilized waste heat at the host site (i.e. not lost/rejected), and energy input.

<sup>4</sup> Systems fueled by a Class 1 Renewable Fuel Source, as defined by N.J.A.C. 14:8-2.5, are eligible for a 30% incentive bonus. If the fuel is mixed, the bonus will be prorated accordingly. For example, if the mix is 60/40 (60% being a Class 1 renewable), the bonus will be 18%. This bonus will be included in the final performance incentive payment, based on system performance and fuel mix consumption data. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.

<sup>5</sup> CHP-FC systems located at Critical Facility and incorporating blackstart and islanding technology are eligible for a 25% incentive bonus. This bonus incentive will be paid with the second/Installation incentive payment. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.



### **How to Participate**

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at <http://www.njcleanenergy.com/CHP>.

## Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects must register their projects prior to the start of construction to establish the project’s eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two sub-programs. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

### **Administratively Determined Incentive (ADI) Program**

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

Market Segments	Size MW dc	Incentive Value (\$/SREC II)	Public Entities Incentive Value - \$20 Adder (\$/SRECII)
Net Metered Residential	All types and sizes	\$90	N/A
Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects smaller than 1 MW	\$100	\$120
Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects 1 MW to 5 MW	\$90	\$110
Small Net Metered Non-Residential Ground Mount	Projects smaller than 1 MW	\$85	\$105
Large Net Metered Non-Residential Ground Mount	Projects 1 MW to 5 MW	\$80	\$100
LMI Community Solar	Up to 5 MW	\$90	N/A
Non-LMI Community Solar	Up to 5 MW	\$70	N/A
Interim Subsection (t)	All types and sizes	\$100	N/A

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations.

### **Competitive Solar Incentive (CSI) Program**

The CSI Program opened on April 15, 2023, and will serve as the permanent program within the SuSI Program providing incentives to larger solar facilities. The CSI Program is open to qualifying grid supply solar facilities, non-residential net metered solar installations with a capacity greater than five (5) megawatts (“MW”), and to eligible grid supply solar facilities installed in combination with energy storage.

CSI eligible facilities will only be allowed to register in the CSI program upon award of a bid pursuant to N.J.A.C. 14:8-11.10.

The CSI program structure has separate categories, or tranches, to ensure that a range of solar project types, including those on preferred sites, are able to participate despite potentially different project cost profiles. The Board has approved four tranches for grid supply and large net metered solar and an additional fifth tranche for storage in combination with grid supply solar. The following table lists procurement targets for the first solicitation:

Tranche	Project Type	MW (dc) Targets
Tranche 1.	Basic Grid Supply	140
Tranche 2.	Grid Supply on the Built Environment	80
Tranche 3.	Grid Supply on Contaminated Sites and Landfills	40
Tranche 4.	Net Metered Non- Residential	40
Tranche 5.	*Storage Paired with Grid	160 MWh

\*The storage tranche of 160 MWh corresponds to a 4-hour storage pairing of 40 MW of solar

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state's Energy Master Plan.

If you are considering installing solar on your building, visit the following link for more information: <https://njcleanenergy.com/renewable-energy/programs/susi-program>

## Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

### **How to Participate**

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at [www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

*ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.*

## Demand Response (DR) Energy Aggregator

Demand Response Energy Aggregator is a program designed to reduce the electric load when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Grid operators call upon curtailment service providers and commercial facilities to reduce electric usage during times of peak demand, making the grid more reliable and reducing transmission costs for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary and participants receive payments whether or not their facility is called upon to curtail its electric usage.

Typically, an electric customer must be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with greater capability to quickly curtail their demand during peak hours receive higher payments. Customers with back-up generators on site may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in DR programs often find it to be a valuable source of revenue for their facility, because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature setpoints on thermostats (so that air conditioning units run less frequently) or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a DR activity in most situations.

The first step toward participation in a DR program is to contact a curtailment service provider. A list of these providers is available on the website of the independent system operator, PJM, and it includes contact information for each company, as well as the states where they have active business<sup>11</sup>. PJM also posts training materials for program members interested in specific rules and requirements regarding DR activity along with a variety of other DR program information<sup>12</sup>.

Curtailment service providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities, and they may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

---

<sup>11</sup> <http://www.pjm.com/markets-and-operations/demand-response.aspx>.

<sup>12</sup> <http://www.pjm.com/training/training-events.aspx>.



## 9.2 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey's investor-owned gas and electric utilities to reduce their customers' use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

### Prescriptive and Custom

The Prescriptive and Custom rebate program through your utility provider offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

#### **Equipment Examples**

*Lighting*

*Lighting Controls*

*HVAC Equipment*

*Refrigeration*

*Gas Heating*

*Gas Cooling*

*Commercial Kitchen Equipment*

*Food Service Equipment*

*Variable Frequency Drives*

*Electronically Commutate Motors*

*Variable Frequency Drives*

*Plug Loads Controls*

*Washers and Dryers*

*Agricultural*

*Water Heating*

The Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type. The Custom program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives.

### Direct Install

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW or less over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

#### **Incentives**

The program pays up to 70% of the total installed cost of eligible measures.

#### **How to Participate**

To participate in Direct Install, you will work with a participating contractor. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the Direct Install program, subject to program rules and eligibility, while the remaining percent of the cost is paid to the contractor by the customer.

## Engineered Solutions


The Engineered Solutions Program provides tailored energy-efficiency assistance and services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. Customers receive expert guided services, including investment-grade energy auditing, engineering design, installation assistance, construction administration, commissioning, and measurement and verification (M&V) services to support the implementation of cost-effective and comprehensive efficiency projects. Engineered Solutions is generally a good option for medium to large sized facilities with a peak demand over 200 kW looking to implement as many measures as possible under a single project to achieve deep energy savings. Engineered Solutions has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Incentives for this program are based on project scope and energy savings achieved.

---

For more information on any of these programs, contact your local utility provider or visit <https://www.njcleanenergy.com/transition>.

## 10 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

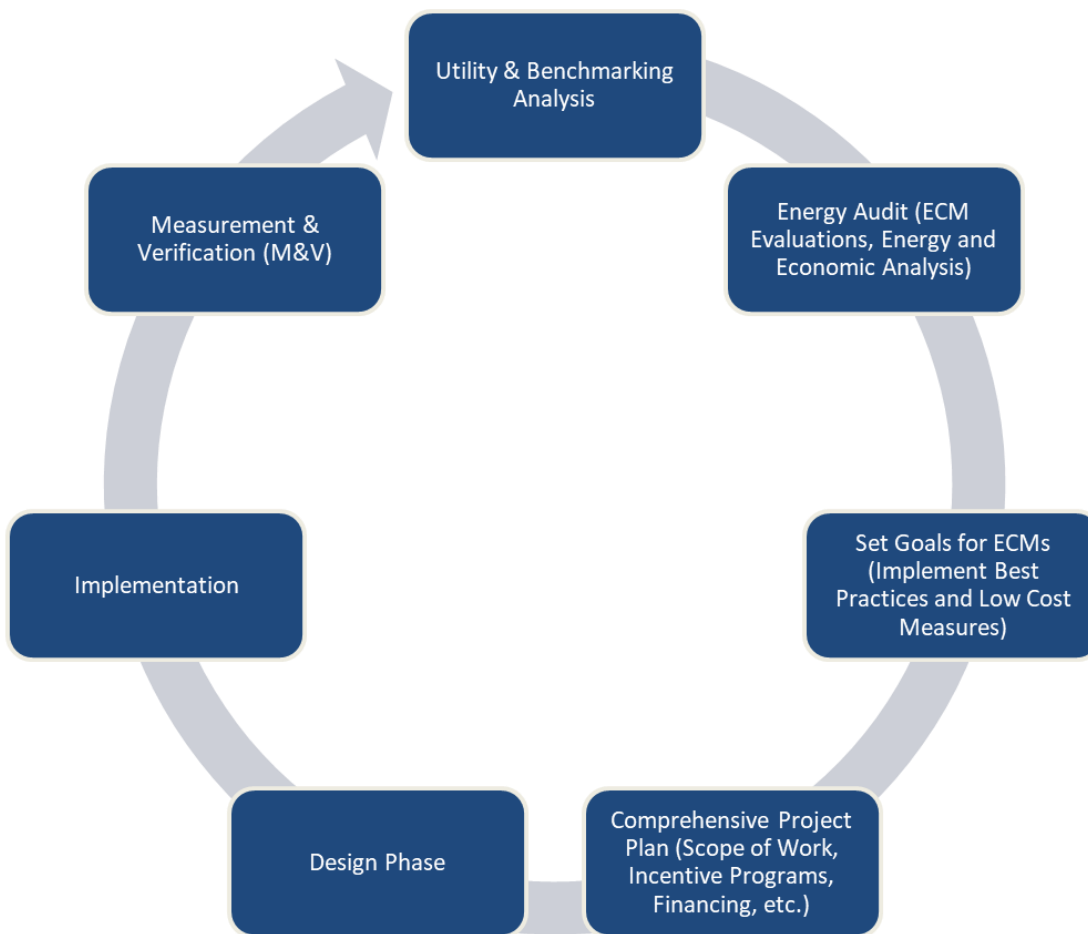

*Project Development Cycle*

## 11 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 11.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website<sup>13</sup>.

### 11.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website<sup>14</sup>.

---

<sup>13</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html)

<sup>14</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html)

# APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

## Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 118	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 118	15	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	2,000	2	Relamp	No	15	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,000	0.6	1,848	-1	\$191	\$1,330	\$300	5.4
Classroom 122	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,400	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,400	0.0	86	0	\$9	\$90	\$20	7.9
Classroom 130	7	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	1,400	2, 3	Relamp	Yes	7	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	966	0.1	237	0	\$24	\$510	\$80	17.6
Classroom 130	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.0	51	0	\$5	\$50	\$10	7.6
Classroom 126	7	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Occupancy Sensor	S	32	1,400	2, 3	Relamp	Yes	7	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	966	0.1	237	0	\$24	\$510	\$80	17.6
Classroom 128	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.3	610	0	\$63	\$610	\$120	7.8
Classroom 131	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.4	915	0	\$94	\$910	\$180	7.7
Classroom 132	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 133	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.1	305	0	\$31	\$300	\$60	7.6
Classroom 134	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 135	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.4	915	0	\$94	\$910	\$180	7.7
Classroom 136	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 138	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 140	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 142	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 147	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 147	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.0	51	0	\$5	\$50	\$10	7.6
Classroom 147	7	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,400	2	Relamp	No	7	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,400	0.3	604	0	\$62	\$620	\$140	7.7
Classroom 148	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 148	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.0	51	0	\$5	\$50	\$10	7.6
Classroom 148	13	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,400	2	Relamp	No	13	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,400	0.5	1,121	0	\$116	\$1,150	\$260	7.7
Classroom 149	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 149	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.0	51	0	\$5	\$50	\$10	7.6
Classroom 149	13	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,400	2	Relamp	No	13	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,400	0.5	1,121	0	\$116	\$1,150	\$260	7.7

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 150	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 150	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.0	51	0	\$5	\$50	\$10	7.6
Classroom 150	8	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,400	2	Relamp	No	8	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,400	0.3	690	0	\$71	\$710	\$160	7.7
Classroom 200	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 204	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 205	25	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	25	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,271	-1	\$131	\$1,260	\$250	7.7
Classroom 210	56	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	56	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	1.3	2,846	-1	\$294	\$2,830	\$560	7.7
Classroom 211	55	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	55	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	1.3	2,795	-1	\$288	\$2,780	\$550	7.7
Classroom 213	30	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	30	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.7	1,525	-1	\$157	\$1,520	\$300	7.8
Classroom 216	30	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	30	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.7	1,525	-1	\$157	\$1,520	\$300	7.8
Classroom 217	55	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	55	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	1.3	2,795	-1	\$288	\$2,780	\$550	7.7
Corridor 2	6	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	6	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 2	17	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,000	2, 4	Relamp	Yes	17	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,760	0.5	3,141	-1	\$324	\$1,710	\$770	2.9
Corridor 2	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	2, 4	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,044	0.2	2,023	-1	\$209	\$530	\$230	1.4
Corridor 3	1	Exit Signs: LED - 2 W Lamp	None		6	4,380		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 3	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	4,000	2, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	High/Low Control	17	2,760	0.0	187	0	\$19	\$360	\$80	14.5
Corridor 3	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	2, 4	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	6,044	0.1	809	0	\$84	\$380	\$90	3.5
Corridor 3	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,000	2, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,760	0.2	1,109	0	\$114	\$580	\$270	2.7
Corridor 5	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 5	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	4,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	4,000	0.0	224	0	\$23	\$30	\$0	1.3
Corridor 5	13	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	4,380	2	Relamp	No	13	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	4,380	0.3	2,067	-1	\$213	\$660	\$130	2.5
Corridor 5	17	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	4,000	2, 4	Relamp	Yes	17	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	2,760	0.5	2,934	-1	\$303	\$2,350	\$770	5.2
Exterior 7	1	LED - Fixtures: Flood Fixture	Photocell		45	4,380		None	No	1	LED - Fixtures: Flood Fixture	Photocell	45	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior 7	3	LED - Fixtures: Flood Fixture	Photocell		75	4,380		None	No	3	LED - Fixtures: Flood Fixture	Photocell	75	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior 7	2	LED - Fixtures: Wall Pack	Photocell		15	4,380		None	No	2	LED - Fixtures: Wall Pack	Photocell	15	4,380	0.0	0	0	\$0	\$0	\$0	0.0

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Exterior 7	1	LED - Fixtures: Wall Pack	PhotoCell		20	4,380		None	No	1	LED - Fixtures: Wall Pack	PhotoCell	20	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior 7	3	LED - Fixtures: Wall Pack	PhotoCell		45	4,380		None	No	3	LED - Fixtures: Wall Pack	PhotoCell	45	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Gymnasium 1	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Gymnasium 1	32	Linear Fluorescent - T5HO: 4' T5HO (54W) - 6L	Occupancy Sensor	S	358	2,581	2	Relamp	No	32	LED - Linear Tubes: (6) 4' T5HO (25W) Lamps	Occupancy Sensor	153	2,581	4.7	18,622	-8	\$1,922	\$4,850	\$960	2.0
Janitorial 2	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	1,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	1,000	0.0	56	0	\$6	\$30	\$0	5.2
Janitorial 202	1	LED Lamps: (2) 9W A19 Screw-In Lamps	Wall Switch	S	18	1,000		None	No	1	LED Lamps: (2) 9W A19 Screw-In Lamps	Wall Switch	18	1,000	0.0	0	0	\$0	\$0	\$0	0.0
Library 1	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Library 1	4	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,000	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	2,070	0.1	281	0	\$29	\$480	\$60	14.5
Library 1	35	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	35	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	1.1	4,850	-2	\$500	\$2,760	\$460	4.6
Locker Room 1	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	3,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	3,000	0.0	168	0	\$17	\$30	\$0	1.7
Locker Room 1	2	LED - Fixtures: Ambient - 4' - Direct Fixture	Wall Switch	S	30	3,000	3	None	Yes	2	LED - Fixtures: Ambient - 4' - Direct Fixture	Occupancy Sensor	30	2,070	0.0	61	0	\$6	\$150	\$20	20.5
Locker Room 1	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	3,000	2, 3	Relamp	Yes	5	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,070	0.1	363	0	\$37	\$460	\$70	10.4
Locker Room 1	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,000	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,000	0.0	53	0	\$5	\$40	\$10	5.5
Locker Room 1	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.3	1,247	-1	\$129	\$790	\$130	5.1
Lounge 1	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,581	2	Relamp	No	7	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,581	0.2	656	0	\$68	\$350	\$70	4.1
Mechanical 1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	8	LED - Fixtures: Ambient - 4' - Direct Fixture	Wall Switch	S	20	1,000		None	No	8	LED - Fixtures: Ambient - 4' - Direct Fixture	Wall Switch	20	1,000	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	S	15	1,000		None	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	1,000	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	1,000	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	1,000	0.0	18	0	\$2	\$40	\$10	16.5
Mechanical 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,000	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,000	0.0	36	0	\$4	\$50	\$10	10.7
Mechanical 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,000	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,000	0.0	36	0	\$4	\$50	\$10	10.7
Office - Enclosed	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	S	40	2,581		None	No	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	40	2,581	0.0	0	0	\$0	\$0	\$0	0.0
Office - Enclosed 119	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,581	2	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,581	0.0	187	0	\$19	\$100	\$20	4.1
Office - Enclosed 121C	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.2	693	0	\$71	\$580	\$90	6.9
Office - Enclosed 124	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.2	693	0	\$71	\$580	\$90	6.9

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - Enclosed 14	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,581	2	Relamp	No	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,581	0.2	843	0	\$87	\$460	\$90	4.3
Office - Enclosed 15	11	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,581	2	Relamp	No	11	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,581	0.3	1,030	0	\$106	\$560	\$110	4.2
Office - Enclosed 16	1	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	S	25	3,000		None	No	1	LED - Fixtures: Ambient 2x2 Fixture	Wall Switch	25	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Office - Enclosed 18	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.1	277	0	\$29	\$250	\$40	7.3
Office - Enclosed 19	1	Compact Fluorescent: (2) 13W Biaxial Plug-In Lamps	Wall Switch	S	26	3,000	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Wall Switch	19	3,000	0.0	23	0	\$2	\$40	\$0	16.8
Office - Enclosed 19	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,000	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,000	0.0	53	0	\$5	\$40	\$10	5.5
Office - Enclosed 19	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.1	416	0	\$43	\$480	\$70	9.6
Office - Enclosed 206	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	3,000	2, 3	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,070	0.1	624	0	\$64	\$520	\$90	6.7
Office - Enclosed 4	20	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,581	2	Relamp	No	20	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,581	0.5	1,874	-1	\$193	\$1,010	\$200	4.2
Office - Enclosed 7	2	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	S	25	2,581		None	No	2	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	25	2,581	0.0	0	0	\$0	\$0	\$0	0.0
Office - Enclosed 8	2	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	S	25	2,581		None	No	2	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	25	2,581	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Female 103	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,200	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	828	0.1	111	0	\$11	\$250	\$40	18.4
Restroom - Female 203	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,200	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	828	0.1	111	0	\$11	\$250	\$40	18.4
Restroom - Female 5	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Occupancy Sensor	S	33	840	2	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	840	0.0	30	0	\$3	\$80	\$10	22.9
Restroom - Female 5	1	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	840	2	Relamp	No	1	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	840	0.0	27	0	\$3	\$90	\$10	28.9
Restroom - Female 5 (1)	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Occupancy Sensor	S	33	840	2	Relamp	No	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	840	0.0	30	0	\$3	\$80	\$10	22.9
Restroom - Female 5 (1)	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	840	2	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	840	0.0	54	0	\$6	\$180	\$20	28.9
Restroom - Female 6	2	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	1,200	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	828	0.0	56	0	\$6	\$230	\$30	34.5
Restroom - Female 6	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,200	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,200	0.0	44	0	\$4	\$50	\$10	8.9
Restroom - Male 101	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,200	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	828	0.1	111	0	\$11	\$250	\$40	18.4
Restroom - Male 2	5	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Occupancy Sensor	S	33	840	2	Relamp	No	5	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	840	0.1	74	0	\$8	\$190	\$30	21.0
Restroom - Male 3	5	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Occupancy Sensor	S	33	840	2	Relamp	No	5	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	840	0.1	74	0	\$8	\$190	\$30	21.0
Restroom - Male 201	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,200	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	828	0.1	111	0	\$11	\$250	\$40	18.4
Restroom - Male 6	4	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	1,200	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	828	0.1	112	0	\$12	\$300	\$40	22.4
Restroom - Unisex Boiler Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,200	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,200	0.0	44	0	\$4	\$50	\$10	8.9



Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Storage Gym A	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	1,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	1,000	0.0	56	0	\$6	\$30	\$0	5.2
Storage Gym B	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	1,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	1,000	0.0	56	0	\$6	\$30	\$0	5.2
Theater Stage	4	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	3,000	2, 3	Relamp	Yes	4	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,070	0.1	290	0	\$30	\$430	\$60	12.3
Theater Stage	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.2	831	0	\$86	\$630	\$100	6.2
Theater Stage	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.1	416	0	\$43	\$480	\$70	9.6
Classroom 218	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 220	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 219	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 221	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 222	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 223	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 225	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 226	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 227	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 229	2	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	2,000	2, 3	Relamp	Yes	2	LED Lamps: A19 Lamps	Occupancy Sensor	9	1,380	0.1	237	0	\$24	\$200	\$20	7.4
Classroom 231	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 233	29	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	29	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.7	1,474	-1	\$152	\$1,470	\$290	7.8
Classroom 234	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 234	6	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,400	2	Relamp	No	6	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,400	0.2	517	0	\$53	\$530	\$120	7.7
Classroom 235	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 235	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.0	51	0	\$5	\$50	\$10	7.6
Classroom 235	8	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,400	2	Relamp	No	8	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,400	0.3	690	0	\$71	\$710	\$160	7.7
Classroom 236	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 236	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,760	0.0	318	0	\$33	\$50	\$10	1.2
Classroom 236	7	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,400	2	Relamp	No	7	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,400	0.3	604	0	\$62	\$620	\$140	7.7

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 237	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 237	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	8,760	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,760	0.0	318	0	\$33	\$50	\$10	1.2
Classroom 237	7	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	1,400	2	Relamp	No	7	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,400	0.3	604	0	\$62	\$620	\$140	7.7
Corridor 1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 1	1	LED - Fixtures: Ambient 2x4 Fixture	Wall Switch	S	40	3,000		None	No	1	LED - Fixtures: Ambient 2x4 Fixture	Wall Switch	40	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 1	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,070	0.1	416	0	\$43	\$430	\$140	6.8
Corridor 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,000	2	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	3,000	0.0	185	0	\$19	\$90	\$20	3.7
Corridor 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,000	2, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	High/Low Control	58	2,070	0.1	488	0	\$50	\$460	\$110	6.9
Corridor 4	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 4	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 4	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,070	0.2	831	0	\$86	\$580	\$270	3.6
Corridor 4	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	8,760	2	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	8,760	0.1	1,908	-1	\$197	\$300	\$60	1.2
Dining Area 1	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Dining Area 1	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.2	693	0	\$71	\$580	\$90	6.9
Dining Area 1	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.5	2,079	-1	\$214	\$1,090	\$190	4.2
Dining Area 1	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.5	2,079	-1	\$214	\$1,090	\$190	4.2
Dining Area 2	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Dining Area 2	25	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	25	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.8	3,464	-1	\$357	\$1,920	\$320	4.5
Elevator 1	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	3,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	3,000	0.0	168	0	\$17	\$30	\$0	1.7
Kitchen	3	Compact Fluorescent: (1) 13W Biaxial Plug-In Lamp	Wall Switch	S	13	3,000	2, 3	Relamp	Yes	3	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	10	2,070	0.0	60	0	\$6	\$370	\$40	53.0
Kitchen	2	Compact Fluorescent: (2) 13W Biaxial Plug-In Lamps	Wall Switch	S	26	3,000	2, 3	Relamp	Yes	2	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,070	0.0	85	0	\$9	\$230	\$20	23.9
Kitchen	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	3,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	3,000	0.0	168	0	\$17	\$30	\$0	1.7
Kitchen	5	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	3,000	2, 3	Relamp	Yes	5	LED Lamps: A19 Lamps	Occupancy Sensor	9	2,070	0.2	888	0	\$92	\$460	\$50	4.5
Kitchen	1	LED - Fixtures: Ambient - 4' - Direct Fixture	Wall Switch	S	20	3,000		None	No	1	LED - Fixtures: Ambient - 4' - Direct Fixture	Wall Switch	20	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	3,000	2	Relamp	No	1	LED - Linear Tubes: (1) 4' Lamp	Wall Switch	15	3,000	0.0	58	0	\$6	\$30	\$10	3.4

Location	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.1	554	0	\$57	\$530	\$80	7.9
Kitchen	23	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	23	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.7	3,187	-1	\$329	\$1,820	\$300	4.6
Kitchen 2	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.2	693	0	\$71	\$580	\$90	6.9
Mechanical 2	1	Compact Fluorescent: (1) 13W Biaxial Plug-In Lamp	Wall Switch	S	13	1,000	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Wall Switch	10	1,000	0.0	3	0	\$0	\$10	\$0	29.4
Mechanical 2	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	1,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	1,000	0.0	56	0	\$6	\$30	\$0	5.2
Mechanical 5	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	1,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	1,000	0.0	56	0	\$6	\$30	\$0	5.2
Office - Enclosed Kitchen	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	3,000	2, 3	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,070	0.1	488	0	\$50	\$330	\$60	5.4
Restroom - Female 1	1	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	S	25	840		None	No	1	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	25	840	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Female 1	3	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Occupancy Sensor	S	33	840	2	Relamp	No	3	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	840	0.0	44	0	\$5	\$110	\$20	19.7
Restroom - Male 1	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	1,200	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	1,200	0.0	67	0	\$7	\$30	\$0	4.3
Restroom - Male 1	1	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	S	25	840		None	No	1	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	25	840	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Male 1	4	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Occupancy Sensor	S	33	840	2	Relamp	No	4	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	840	0.0	59	0	\$6	\$150	\$20	21.3
Restroom - Male 1	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Occupancy Sensor	S	62	840	2	Relamp	No	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	840	0.0	54	0	\$6	\$180	\$20	28.9
Storage 1	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,000	2, 3	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	690	0.1	185	0	\$19	\$530	\$80	23.6
Classroom 100	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 104	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 105	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 111	22	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	22	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.5	1,118	0	\$115	\$1,110	\$220	7.7
Classroom 112	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 113	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Classroom 115	24	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,400	2	Relamp	No	24	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,400	0.6	1,220	-1	\$126	\$1,210	\$240	7.7
Corridor 6	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 6	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	S	9	3,000		None	No	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	9	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 6	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 4	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	2,070	0.3	1,386	-1	\$143	\$1,070	\$450	4.3
Corridor 6	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	3,000	2, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	High/Low Control	44	2,070	0.1	416	0	\$43	\$410	\$100	7.2

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Corridor 6	15	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 4	Relamp	Yes	15	LED - Linear Tubes: (2) U-Lamp	High/Low Control	33	2,070	0.4	1,942	-1	\$200	\$2,180	\$680	7.5
Locker Room 2	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	3,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	3,000	0.0	168	0	\$17	\$30	\$0	1.7
Locker Room 2	1	Incandescent: (1) 60W A19 Screw-In Lamp	Wall Switch	S	60	3,000	2	Relamp	No	1	LED Lamps: A19 Lamps	Wall Switch	9	3,000	0.0	168	0	\$17	\$30	\$0	1.7
Locker Room 2	2	LED - Fixtures: Ambient - 4' - Direct Fixture	Wall Switch	S	30	3,000	3	None	Yes	2	LED - Fixtures: Ambient - 4' - Direct Fixture	Occupancy Sensor	30	2,070	0.0	61	0	\$6	\$150	\$20	20.5
Locker Room 2	5	Linear Fluorescent - T8: 4' T8 (32W) - 1L	Wall Switch	S	32	3,000	2, 3	Relamp	Yes	5	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	2,070	0.1	363	0	\$37	\$460	\$70	10.4
Locker Room 2	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	3,000	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	3,000	0.0	53	0	\$5	\$40	\$10	5.5
Locker Room 2	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.4	1,940	-1	\$200	\$1,040	\$180	4.3
Mechanical 8	4	Compact Fluorescent: (1) 13W Biaxial Plug-In Lamp	Wall Switch	S	13	1,000	2	Relamp	No	4	LED Lamps: GX23 (Plug-In) Lamps	Wall Switch	10	1,000	0.0	13	0	\$1	\$50	\$0	36.7
Mechanical 8	3	Linear Fluorescent - EST12: 4' T12 (34W) - 2L	Wall Switch	S	72	1,000	1	Relamp & Reballast	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,000	0.1	142	0	\$15	\$270	\$30	16.4
Mechanical 8	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,000	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,000	0.0	36	0	\$4	\$50	\$10	10.7
Office - 107A	15	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	15	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	2,070	0.4	1,942	-1	\$200	\$1,660	\$190	7.3
Office - 107B	6	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	6	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	2,070	0.2	777	0	\$80	\$860	\$100	9.5
Office - 107C	11	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	S	25	2,581		None	No	11	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	25	2,581	0.0	0	0	\$0	\$0	\$0	0.0
Office - 107D	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.1	277	0	\$29	\$250	\$40	7.3
Office - Enclosed 105	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	S	9	3,000		None	No	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	9	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Office - Enclosed 26	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.1	277	0	\$29	\$250	\$40	7.3
Office - Enclosed 27	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.1	277	0	\$29	\$250	\$40	7.3
Office - Enclosed 27	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,000	0.0	109	0	\$11	\$50	\$10	3.6
Office - Enclosed 28	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.1	277	0	\$29	\$250	\$40	7.3
Office - Enclosed locker	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	3,000	2, 3	Relamp	Yes	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,070	0.1	624	0	\$64	\$520	\$90	6.7
Restroom - Female 7	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	1,200	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	1,200	0.0	21	0	\$2	\$40	\$10	13.8
Restroom - Female 7	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,200	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	828	0.1	166	0	\$17	\$480	\$70	23.9
Restroom - Male 7	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	1,200	2	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	1,200	0.0	21	0	\$2	\$40	\$10	13.8
Restroom - Male 7	2	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch	S	62	1,200	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	828	0.1	104	0	\$11	\$330	\$40	27.1
Stairs 1	1	Compact Fluorescent: (2) 13W Biaxial Plug-In Lamps	Wall Switch		26	4,000	2	Relamp	No	1	LED Lamps: GX23 (Plug-In) Lamps	Wall Switch	19	4,000	0.0	31	0	\$3	\$40	\$0	12.6

Location	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Stairs 1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs 1	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch		114	4,000	2, 3	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	2,760	0.2	977	0	\$101	\$600	\$100	5.0
Stairs 2	3	U-Bend Fluorescent - T8: U T8 (32W) - 2L	Wall Switch		62	4,000	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) U-Lamp	Occupancy Sensor	33	2,760	0.1	518	0	\$53	\$600	\$70	9.9
Stairs 3	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs 3	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	4,000	2, 3	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,760	0.1	370	0	\$38	\$250	\$40	5.5
Stairs 4	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs 4	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch		9	4,000		None	No	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	9	4,000	0.0	0	0	\$0	\$0	\$0	0.0
Stairs 4	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	4,000	2, 3	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,760	0.1	554	0	\$57	\$480	\$70	7.2
Exterior 1	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell		20	4,380		None	No	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	20	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior 1	1	LED - Fixtures: Architectural Flood/Spot Luminaire	Photocell		75	4,380		None	No	1	LED - Fixtures: Architectural Flood/Spot Luminaire	Photocell	75	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior 1	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell		20	4,380		None	No	1	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	20	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Garage 1	1	Linear Fluorescent - T12: 8' T12 (75W) - 2L	Wall Switch	S	158	3,000	1	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 8' Lamps	Wall Switch	72	3,000	0.1	284	0	\$29	\$160	\$20	4.8
Garage 1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Garage 1	1	LED - Fixtures: Ambient 1x4 Fixture	Wall Switch	S	30	3,000		None	No	1	LED - Fixtures: Ambient 1x4 Fixture	Wall Switch	30	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Garage 1	4	LED - Linear Tubes: (6) 4' Lamps	Wall Switch	S	87	3,000	3	None	Yes	4	LED - Linear Tubes: (6) 4' Lamps	Occupancy Sensor	87	2,070	0.1	356	0	\$37	\$330	\$40	7.9
Garage 2	5	LED - Linear Tubes: (6) 4' Lamps	Wall Switch	S	87	3,000		None	No	5	LED - Linear Tubes: (6) 4' Lamps	Wall Switch	87	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Unisex 1	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	S	9	3,000		None	No	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	9	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Unisex 1	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	S	9	3,000		None	No	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	9	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Storage 1	1	Linear Fluorescent - T12: 8' T12 (75W) - 2L	Wall Switch	S	158	3,000	1	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 8' Lamps	Wall Switch	72	3,000	0.1	284	0	\$29	\$160	\$20	4.8
Storage 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	3,000	2	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,000	0.0	109	0	\$11	\$50	\$10	3.6
Storage 2	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	3,000	3	None	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,070	0.0	119	0	\$12	\$330	\$40	23.7
Storage 3	1	LED - Fixtures: Ambient - 4' - Direct Fixture	Wall Switch	S	20	3,000		None	No	1	LED - Fixtures: Ambient - 4' - Direct Fixture	Wall Switch	20	3,000	0.0	0	0	\$0	\$0	\$0	0.0
Storage 3	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	3,000		None	No	5	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	3,000	0.0	0	0	\$0	\$0	\$0	0.0

**Motor Inventory & Recommendations**

Location	Area(s)/System(s) Served	Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical 1	Loundsberry Hollow Middle School	2	Air Compressor	1.00	85.5%	No	US Motors	P63AGU-1308	W	500		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior 1	Loundsberry Hollow Middle School	1	Exhaust Fan	0.50	70.0%	No	Trane	5GRA24500A1G A000	W	2,745	5	Yes	78.2%	No		0.0	115	0	\$13	\$800	\$0	62.1
Exterior 1	Loundsberry Hollow Middle School	9	Exhaust Fan	0.10	65.0%	No	Unknown	Unknown	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior 4, 2nd roof	Loundsberry Hollow Middle School	11	Exhaust Fan	0.10	65.0%	No	Unknown	Unknown	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior 4, 2nd roof	Loundsberry Hollow Middle School	1	Exhaust Fan	0.50	70.0%	No	Unknown	Unknown	W	2,745	5	Yes	78.2%	No		0.0	115	0	\$13	\$800	\$0	62.1
Exterior 4, 2nd roof	Loundsberry Hollow Middle School	3	Exhaust Fan	1.00	82.5%	No	Unknown	Unknown	W	2,745		No	82.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	Loundsberry Hollow Middle School	1	Heating Hot Water Pump	0.33	65.0%	No	Unknown	Unknown	W	2,745	5	Yes	73.4%	No		0.0	89	0	\$10	\$500	\$0	50.0
Mechanical 1	Loundsberry Hollow Middle School	2	Heating Hot Water Pump	5.00	89.5%	No	Weg	00518OT3E184T C-S	W	2,745		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Storage Gym B	Loundsberry Hollow Middle School	1	Heating Hot Water Pump	0.33	65.0%	No	Rotom	CP-R1358	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 8	Loundsberry Hollow Middle School	1	Heating Hot Water Pump	0.33	65.0%	No	Bell & Gossett	56A17D11003B	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	Loundsberry Hollow Middle School	1	Other	0.75	70.0%	No	Unknown	Unknown	W	100		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Elevator 1	Loundsberry Hollow Middle School	1	Other	7.50	88.5%	No	General Electric	5KL1G2AL5	W	100		No	88.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 8	AHU - Loundsberry Hollow Middle School	1	Return Fan	5.00	89.5%	No	Joy	42-21-860	W	2,745		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 8	AHU - Loundsberry Hollow Middle School	1	Supply Fan	7.50	91.5%	No	Unknown	Unknown	W	2,745	6	No	91.5%	Yes	1	2.1	6,294	0	\$705	\$6,700	\$1,000	8.1
Corridors	Loundsberry Hollow Middle School	3	Fan Coil Unit	0.17	65.0%	No	Unknown	Unknown	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Storage Gym B	AHU - Loundsberry Hollow Middle School	1	Supply Fan	2.00	82.0%	No	Unknown	Unknown	W	2,745		No	82.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical Room 5	AHU - Loundsberry Hollow Middle School	1	Supply Fan	0.50	70.0%	No	Unknown	Unknown	W	2,745		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Various Classrooms	Unit Ventilatos - Classrooms	43	Fan Coil Unit	0.17	60.0%	No	Unknown	Unknown	W	2,745		No	60.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	Combustion Air Fan	2	Combustion Air Fan	2.00	82.0%	No	Unknown	Unknown	W	2,745		No	82.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

**Packaged HVAC Inventory & Recommendations**

Location	Area(s)/System(s) Served	Existing Conditions									Proposed Conditions						Energy Impact & Financial Analysis								
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 130 (1)	Loundsberry Hollow Middle School	1	Window AC	0.83		8.03		LG	LP1017WSR	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Classrooms	Loundsberry Hollow Middle School	10	Window AC	1.00		9.50		Kenmore	580.75123700	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Classrooms	Loundsberry Hollow Middle School	8	Window AC	1.00		9.50		Unknown	Unknown	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Classrooms	Loundsberry Hollow Middle School	4	Window AC	0.83		10.40		Frigidaire	FHSC102WB1	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Classroom 138	Loundsberry Hollow Middle School	1	Window AC	0.50		9.50		Kenmore	580.75063700	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Classrooms	Loundsberry Hollow Middle School	4	Window AC	0.83		10.40		Frigidaire	FFRS1022R1E	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Classrooms	Loundsberry Hollow Middle School	10	Window AC	2.00		9.40		Kenmore	580.75251800	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Classrooms	Loundsberry Hollow Middle School	3	Window AC	2.00		10.30		LG	LW2516ER	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Classroom 211	Loundsberry Hollow Middle School	1	Window AC	0.83		10.40		Keystone	KTSTW10A	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Offices	Loundsberry Hollow Middle School	2	Window AC	1.00		9.50		Unknown	Unknown	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Office - Enclosed 119	Loundsberry Hollow Middle School	1	Window AC	1.00		9.50		LG	LP1215GXRY7	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Office - Enclosed 124	Loundsberry Hollow Middle School	1	Window AC	0.42		11.20		General Electric	AEL05LVW1	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Office - Enclosed 14 (1)	Loundsberry Hollow Middle School	1	Window AC	0.42		9.70		General Electric	AEL05LQL1	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Office - Enclosed 18	Loundsberry Hollow Middle School	1	Window AC	0.67		8.20		EVERSTAR	MPM-08CR-BB4	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Exterior 7	Loundsberry Hollow Middle School	1	Ductless Mini-Split HP	3.00	36.50	8.10	2.94 COP	Fujitsu	AOU36RLX	B	8	Yes	1	Ductless Mini-Split HP	3.00	36.50	18.00	3.8 COP	1.2	1,656	0	\$185	\$6,700	\$0	36.1
Exterior 7	Loundsberry Hollow Middle School	4	Ductless Mini-Split HP	1.00	16.00	12.50	3.22 COP	Fujitsu	AOU12RFLW	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Exterior 7	Loundsberry Hollow Middle School	1	Ductless Mini-Split HP	3.00	34.00	8.50	2.94 COP	Fujitsu	AOU36RLXB	W		No						0.0	0	0	\$0	\$0	\$0	0.0	
Exterior 4, 2nd roof	Condensing Unit Loundsberry Hollow Middle School	1	Ductless Mini-Split AC	3.50		9.90		Mitsubishi	PU42EK2	B	7	Yes	1	Ductless Mini-Split AC	3.50		18.00		1.0	972	0	\$109	\$4,700	\$0	43.2
Exterior 1	Loundsberry Hollow Middle School	2	Ductless Mini-Split HP	3.00	34.00	11.00	3.1 COP	Samsung	AQV36JAX	B	8	Yes	2	Ductless Mini-Split HP	3.00	34.00	18.00	3.8 COP	1.3	1,888	0	\$211	\$13,500	\$0	63.9
Exterior 4, 2nd roof	Loundsberry Hollow Middle School	2	Ductless Mini-Split AC	2.00		9.90		Mitsubishi	PU24EK	B	7	Yes	2	Ductless Mini-Split AC	2.00		18.00		1.1	1,111	0	\$124	\$8,600	\$0	69.2

		Existing Conditions									Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (kBtu/hr)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Offices	Loundsberry Hollow Middle School	3	Packaged Terminal HP	1.00	11.60	10.00	3 COP	LG	Unknown	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Classrooms	Loundsberry Hollow Middle School	43	Unit Ventilator		12.00			Unknown	Unknown	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Maintenance Exterior 1	Maintenance Building	1	Ductless Mini-Split AC	1.50		12.00		Fujitsu	AOU18RLB	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Maintenance Garage 1	Maintenance Building	1	Unit Heater		102.36		1 COP	TPI	5130CA1LHF3B	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Maintenance Garage 2	Maintenance Building	1	Unit Heater		24.49		1 COP	Dyno-Glo	EG7500DGP	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Maintenance Garage 1	Maintenance Building	1	Split-System	5.00		8.00		Unknown	Unknown	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Exterior 7	Loundsberry Hollow Middle School	1	Ductless Mini-Split HP	1.00	16.00	12.50	3.22 COP	Fujitsu	AOU12RLFV	W		No							0.0	0	0	\$0	\$0	\$0	0.0

### Electric Chiller Inventory & Recommendations

		Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Exterior 7	Loundsberry Hollow Middle School	1	Air-Cooled Scroll Chiller	80.00	Trane	CGAM080A2Y02 AXB2A1A1A1AXA1D1A4XXXXXX B1A3A1D1XXLX	W		No							0.0	0	0	\$0	\$0	\$0	0.0

### Space Heating Boiler Inventory & Recommendations

		Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Output Capacity per Unit (MBh)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical 1	Loundsberry Hollow Middle School	1	Non-Condensing Hot Water Boiler	2,976	Weil-McLain	Model 88 Series 2	B	9	Yes	1	Non-Condensing Hot Water Boiler	2,976	85.00%	Ec	0.0	0	90	\$1,887	\$77,300	\$3,900	38.9
Mechanical 1	Loundsberry Hollow Middle School	1	Non-Condensing Hot Water Boiler	2,843	Weil-McLain	Model 88 Series 1	B	9	Yes	1	Non-Condensing Hot Water Boiler	2,843	85.00%	Ec	0.0	0	86	\$1,802	\$75,400	\$3,700	39.8



**DHW Inventory & Recommendations**

		Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Manufacturer	Model	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	Loundsberry Hollow Middle School - Kitchen Dishwasher	1	Booster Water Heater	Hatco	C-36	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Mechanical	Loundsberry Hollow Middle School	1	Storage Tank Water Heater (≤ 50 Gal)	Bock	50ES	W		No						0.0	0	0	\$0	\$0	\$0	0.0
Maintenance Garage	Maintenance Building	1	Storage Tank Water Heater (≤ 50 Gal)	GE	GE10P06SAG	W		No						0.0	0	0	\$0	\$0	\$0	0.0

**Low-Flow Device Recommendations**

		Recommendation Inputs				Energy Impact & Financial Analysis						
Location	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Restroom - Male 2	10	5	Faucet Aerator (Lavatory)	2.20	0.50	0.0	0	2	\$50	\$40	\$20	0.4
Maintenance Garage	10	1	Faucet Aerator (Kitchen)	1.50	1.50	0.0	0	0	\$0	\$10	\$0	0.0
Maintenance Restroom	10	1	Faucet Aerator (Lavatory)	1.50	0.50	0.0	82	0	\$9	\$10	\$0	1.1

**Walk-In Cooler/Freezer Inventory & Recommendations**

		Existing Conditions				Proposed Conditions			Energy Impact & Financial Analysis						
Location	Cooler/Freezer Quantity	Case Type/Temperature	Manufacturer	Model	ECM #	Install EC Evaporator Fan Motors?	Install Electric Defrost Control?	Install Evaporator Fan Control?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Cooler (35F to 55F)	Russell	AA28-134B-AS	11, 12	Yes	No	Yes	0.1	1,132	0	\$127	\$2,810	\$160	20.9
Kitchen	1	Medium Temp Freezer (0F to 30F)	Unknown	Unknown	11, 12	Yes	Yes	Yes	0.1	2,731	0	\$306	\$3,450	\$210	10.6

**Commercial Refrigerator/Freezer Inventory & Recommendations**

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Refrigerator/ Freezer Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Freezer Chest	Excellence	VL-3L	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Refrigerator Chest	Powers Equipment	780HC	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0

**Commercial Ice Maker Inventory & Recommendations**

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Ice Maker Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Self-Contained Unit (<175 lbs/day), Batch	Hoshizaki	KM-500MWH	No		No	0.0	0	0	\$0	\$0	\$0	0.0

**Cooking Equipment Inventory & Recommendations**

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Equipment Type	Manufacturer	Model	High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Electric Combination Oven/Steam Cooker (<15 Pans)	Southbend A Middleby	ECX-2S	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	3	Insulated Food Holding Cabinet (3/4 Size)	Unknown	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	2	Electric Steamer	Groen	EE-40	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	2	Gas Rack Oven (Double)	Unknown	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0

**Dishwasher Inventory & Recommendations**

Existing Conditions								Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Dishwasher Type	Manufacturer	Model	Water Heater Fuel Type	Booster Heater Fuel Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Payback w/ Incentives in Years
Kitchen	1	Multi-Tank Conveyor (High Temp)	Hobart	CRS66A	Electric	None	No		No	0.0	0	0	\$0	\$0	\$0	0.0

**Plug Load Inventory**

Existing Conditions						
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?	Manufacturer	Model
Mechanical 1	1	Clothes Dryer	2,000	No	Kenmore	Unknown
Mechanical 1	1	Clothes Washer	800	No	Amana	Unknown
Loundsberry Hollow Middle School	6	Coffee Machine	900	No	Unknown	Unknown
Loundsberry Hollow Middle School	4	Dehumidifier	480	No	Unknown	Unknown
Loundsberry Hollow Middle School	28	Desktop	100	No	Unknown	Unknown
Office	2	Electric Soace Heater	200	No	Unknown	Unknown
Loundsberry Hollow Middle School	5	Fan (Portable)	200	No	Unknown	Unknown
Classroom	15	Laptop	75	No	Unknown	Unknown
Loundsberry Hollow Middle School	14	Microwave	1,500	No	General Electric	Unknown
Classroom	2	Oven/stove top	5,000	No	Unknown	Unknown
Office	1	Paper Shredder	200	No	Unknown	Unknown
Loundsberry Hollow Middle School	13	Printer (Medium/Small)	566	No	Savin	IM 350F
Loundsberry Hollow Middle School	8	Printer/Copier (Large)	700	No	Savin	Varied
Classroom	44	Projector	320	No	Unknown	Unknown
Loundsberry Hollow Middle School	12	Refrigerator (Mini)	126	No	Unknown	Unknown
Loundsberry Hollow Middle School	5	Refrigerator (Residential)	463	No	Unknown	Unknown
Classroom	50	Smart Board	100	No	Unknown	Unknown
Loundsberry Hollow Middle School	11	Television	133	No	Unknown	Unknown
Office	3	Toaster Oven	1,500	No	Unknown	Unknown
Dining Area	1	Water Fountain	370	No	Elkay	LZS8SSP
Office	4	Water Cooler	200	No	Unknown	Unknown

# APPENDIX B: ENERGY STAR STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of site energy and source energy. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

## ENERGY STAR® Statement of Energy Performance

LEARN MORE AT [energystar.gov](http://energystar.gov)

# 86

**ENERGY STAR®  
Score<sup>1</sup>**

### Loundsberry Hollow School (Campus)

**Primary Property Type:** K-12 School  
**Gross Floor Area (ft²):** 80,400  
**Built:** 1980

**For Year Ending:** February 29, 2024  
**Date Generated:** November 19, 2024

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
<b>Property Address</b> Loundsberry Hollow School (Campus) 30 Sammis Road Vernon, New Jersey 07462	<b>Property Owner</b> Vernon Township School District 625 Route 517 PO Box 99 Vernon, NJ 07462 973-764-6494	<b>Primary Contact</b> Joe Van Kirk 625 Route 517 BO Box 99 Vernon, NJ 07462 973-764-6494 jvankirk@vtsd.com	
<b>Property ID:</b> 35122011			

Energy Consumption and Energy Use Intensity (EUI)			
<b>Site EUI</b> 59.6 kBtu/ft²	<b>Annual Energy by Fuel</b>		<b>Annual Emissions</b>
	Electric - Solar (kBtu)	936,319 (20%)	Total (Location-Based) GHG Emissions (Metric Tons CO2e/year) <span style="float: right;">380</span>
	Fuel Oil (No. 1) (kBtu)	2,780,000 (58%)	
	Propane (kBtu)	18,446 (0%)	
	Electric - Grid (kBtu)	1,055,673 (22%)	
<b>Source EUI</b> 83.6 kBtu/ft²	<b>National Median Comparison</b>		<b>Green Power</b>
	National Median Site EUI (kBtu/ft²)	95.9	Green Power – Onsite (kWh) <span style="float: right;">0</span>
	National Median Source EUI (kBtu/ft²)	134.5	Green Power – Offsite (kWh) <span style="float: right;">0</span>
	% Diff from National Median Source EUI	-38%	Percent of RECs Retained <span style="float: right;">0%</span>

### Signature & Stamp of Verifying Professional

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**Licensed Professional**

\_\_\_\_\_  
( ) \_\_\_\_\_



**Professional Engineer or Registered Architect Stamp (if applicable)**

## APPENDIX C: GLOSSARY

TERM	DEFINITION
<b>Blended Rate</b>	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
<b>Btu</b>	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
<b>CHP</b>	<i>Combined heat and power</i> . Also referred to as cogeneration.
<b>COP</b>	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
<b>Demand Response</b>	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
<b>DCV</b>	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
<b>US DOE</b>	<i>United States Department of Energy</i>
<b>EC Motor</b>	<i>Electronically commutated motor</i>
<b>ECM</b>	<i>Energy conservation measure</i>
<b>EER</b>	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
<b>EUI</b>	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
<b>Energy Efficiency</b>	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
<b>ENERGY STAR</b>	ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA.
<b>EPA</b>	<i>United States Environmental Protection Agency</i>
<b>Generation</b>	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
<b>GHG</b>	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
<b>gpf</b>	<i>Gallons per flush</i>

<b>gpm</b>	<i>Gallon per minute</i>
<b>HID</b>	<i>High intensity discharge</i> : high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
<b>hp</b>	<i>Horsepower</i>
<b>HPS</b>	<i>High-pressure sodium</i> : a type of HID lamp.
<b>HSPF</b>	<i>Heating seasonal performance factor</i> : a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
<b>HVAC</b>	<i>Heating, ventilating, and air conditioning</i>
<b>IHP 2014</b>	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
<b>IPLV</b>	<i>Integrated part load value</i> : a measure of the part load efficiency usually applied to chillers.
<b>kBtu</b>	One thousand British thermal units
<b>kW</b>	<i>Kilowatt</i> : equal to 1,000 Watts.
<b>kWh</b>	<i>Kilowatt-hour</i> : 1,000 Watts of power expended over one hour.
<b>LED</b>	<i>Light emitting diode</i> : a high-efficiency source of light with a long lamp life.
<b>LGEA</b>	<i>Local Government Energy Audit</i>
<b>Load</b>	The total power a building or system is using at any given time.
<b>Measure</b>	A single activity, or installation of a single type of equipment, which is implemented in a building system to reduce total energy consumption.
<b>MH</b>	<i>Metal halide</i> : a type of HID lamp.
<b>MBh</b>	<i>Thousand Btu per hour</i>
<b>MBtu</b>	<i>One thousand British thermal units</i>
<b>MMBtu</b>	<i>One million British thermal units</i>
<b>MV</b>	<i>Mercury Vapor</i> : a type of HID lamp.
<b>NJBPU</b>	<i>New Jersey Board of Public Utilities</i>
<b>NJCEP</b>	<i>New Jersey's Clean Energy Program</i> : NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment.
<b>psig</b>	Pounds per square inch gauge
<b>Plug Load</b>	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
<b>PV</b>	<i>Photovoltaic</i> : refers to an electronic device capable of converting incident light directly into electricity (direct current).

<b>SEER</b>	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
<b>SEP</b>	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR Portfolio Manager.
<b>Simple Payback</b>	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
<b>SREC (II)</b>	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
<b>T5, T8, T12</b>	A reference to a linear lamp diameter. The number represents increments of 1/8 <sup>th</sup> of an inch.
<b>Temperature Setpoint</b>	The temperature at which a temperature regulating device (thermostat, for example) has been set.
<b>therm</b>	100,000 Btu. Typically used as a measure of natural gas consumption.
<b>tons</b>	A unit of cooling capacity equal to 12,000 Btu/hr.
<b>Turnkey</b>	Provision of a complete product or service that is ready for immediate use.
<b>VAV</b>	<i>Variable air volume</i>
<b>VFD</b>	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
<b>WaterSense®</b>	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
<b>Watt (W)</b>	Unit of power commonly used to measure electricity use.