



# Local Government Energy Audit Report

Community Center - Main Building and Annex

February 24, 2025

*Prepared for:*

Verona Township

880 Bloomfield Avenue

Verona, New Jersey 07044

*Prepared by:*

TRC

317 George Street

New Brunswick, New Jersey 08901



## Disclaimer

---

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based on previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2025 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product, or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks, or copyrights.

# Table of Contents

---

|          |  |           |
|----------|--|-----------|
| <b>1</b> | <b>Executive Summary</b>                       | <b>1</b>  |
| 1.1      | Planning Your Project                          | 4         |
|          | Pick Your Installation Approach                | 4         |
|          | Options from Your Utility Company              | 4         |
|          | Options from New Jersey's Clean Energy Program | 5         |
| <b>2</b> | <b>Existing Conditions</b>                     | <b>6</b>  |
| 2.1      | Site Overview                                  | 6         |
| 2.2      | Building Occupancy                             | 6         |
| 2.3      | Building Envelope                              | 7         |
| 2.4      | Lighting Systems                               | 9         |
| 2.5      | Air Handling Systems                           | 11        |
|          | Unitary Heating Equipment                      | 11        |
|          | Infrared Heating                               | 12        |
|          | Packaged Units                                 | 12        |
|          | Air Handling Units (AHUs)                      | 13        |
| 2.6      | Heating Hot Water Systems                      | 14        |
| 2.7      | Domestic Hot Water                             | 15        |
| 2.8      | Food Service Equipment                         | 16        |
| 2.9      | Refrigeration                                  | 16        |
| 2.10     | Plug Load and Vending Machines                 | 17        |
| 2.11     | Water-Using Systems                            | 18        |
| <b>3</b> | <b>Energy Use and Costs</b>                    | <b>19</b> |
| 3.1      | Electricity                                    | 21        |
| 3.2      | Natural Gas                                    | 22        |
| 3.3      | Benchmarking                                   | 23        |
|          | Tracking your Energy Performance               | 24        |
| 3.4      | Understanding Your Utility Bills               | 24        |
| <b>4</b> | <b>Energy Conservation Measures</b>            | <b>25</b> |
| 4.1      | Lighting                                       | 28        |
|          | ECM 1: Install LED Fixtures                    | 28        |
|          | ECM 2: Retrofit Fixtures with LED Lamps        | 28        |



|          |  |           |
|----------|--|-----------|
| 4.2      | Lighting Controls .....  | 29        |
|          | ECM 3: Install Occupancy Sensor Lighting Controls.....                   | 29        |
|          | ECM 4: Install High/Low Lighting Controls.....                           | 29        |
| 4.3      | Motors.....  | 30        |
|          | ECM 5: Premium Efficiency Motors .....                                   | 30        |
| 4.4      | Variable Frequency Drives (VFD) .....                                    | 31        |
|          | ECM 6: Install VFDs on Constant Volume (CV) Fans .....                   | 31        |
|          | ECM 7: Install VFDs on Heating Water Pumps.....                          | 31        |
| 4.5      | Unitary HVAC .....   | 32        |
|          | ECM 8: Install High Efficiency Air Conditioning Units .....              | 32        |
| 4.6      | Gas-Fired Heating.....   | 32        |
|          | ECM 9: Install High Efficiency Hot Water Boilers.....                    | 32        |
|          | ECM 10: Install High Efficiency Furnaces .....                           | 33        |
| 4.7      | HVAC Improvements.....   | 33        |
|          | ECM 11: Install Pipe Insulation .....                                    | 33        |
| 4.8      | Domestic Water Heating.....  | 33        |
|          | ECM 12: Install Low-Flow DHW Devices .....                               | 33        |
| 4.9      | Food Service and Refrigeration Measures .....                            | 34        |
|          | ECM 13: Vending Machine Control.....                                     | 34        |
| 4.10     | Custom Measures .....  | 34        |
|          | ECM 14: Replace Gas Fired Water Heater with Heat Pump Water Heater ..... | 34        |
| 4.11     | Measures for Future Consideration.....                                   | 36        |
|          | Upgrade to a Heat Pump System.....                                       | 36        |
|          | VRF Systems .....  | 37        |
| <b>5</b> | <b>Energy Efficient Best Practices.....</b>                              | <b>39</b> |
|          | Energy Tracking with ENERGY STAR Portfolio Manager .....                 | 39        |
|          | Weatherization .....   | 39        |
|          | Doors and Windows.....   | 39        |
|          | Window Treatments/Coverings.....   | 39        |
|          | Lighting Maintenance .....   | 40        |
|          | Lighting Controls .....  | 40        |
|          | Motor Maintenance.....   | 40        |
|          | Thermostat Schedules and Temperature Resets.....                         | 40        |
|          | AC System Evaporator/Condenser Coil Cleaning.....                        | 40        |



HVAC Filter Cleaning and Replacement ..... 40

Ductwork Maintenance ..... 41

Boiler Maintenance..... 41

Label HVAC Equipment ..... 41

Optimize HVAC Equipment Schedules ..... 41

Water Heater Maintenance ..... 42

Procurement Strategies ..... 42

**6 Water Best Practices.....43**

    Getting Started..... 43

    Water Metering and Submetering..... 43

    Leak Detection and Repair ..... 44

    Toilets and Urinals ..... 44

    Faucets and Showerheads ..... 44

**7 On-Site Generation .....46**

    7.1 Solar Photovoltaic ..... 47

    7.2 Combined Heat and Power ..... 49

**8 Electric Vehicles.....50**

    8.1 EV Charging ..... 50

**9 Project Funding and Incentives .....52**

    9.1 New Jersey’s Clean Energy Program ..... 53

    9.2 Utility Energy Efficiency Programs ..... 60

**10 Project Development .....62**

**11 Energy Purchasing and Procurement Strategies .....63**

    11.1 Retail Electric Supply Options ..... 63

    11.2 Retail Natural Gas Supply Options ..... 63

**Appendix A: Equipment Inventory & Recommendations ..... A-1**


**Appendix B: ENERGY STAR Statement of Energy Performance ..... B-1**

**Appendix C: Glossary ..... C-1**


# 1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Community Center - Main Building and VCC Annex. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

## BUILDING PERFORMANCE REPORT

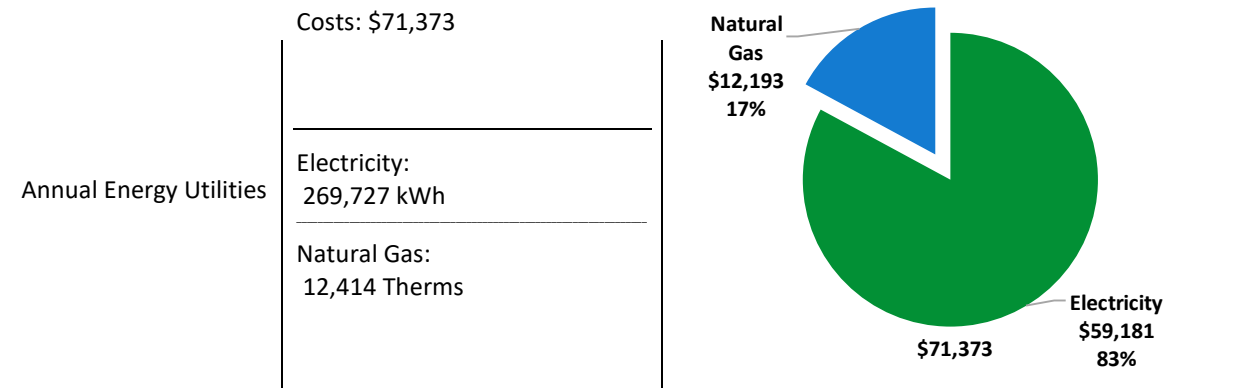

|                                 |                             |  |
|---------------------------------|-----------------------------|--|
| ENERGY STAR® Benchmarking Score | N/A<br><i>(1-100 scale)</i> | A standard energy use benchmark is not available for this facility type. This report contains suggestions about how to improve building performance and reduce energy costs. |
|---------------------------------|-----------------------------|--|

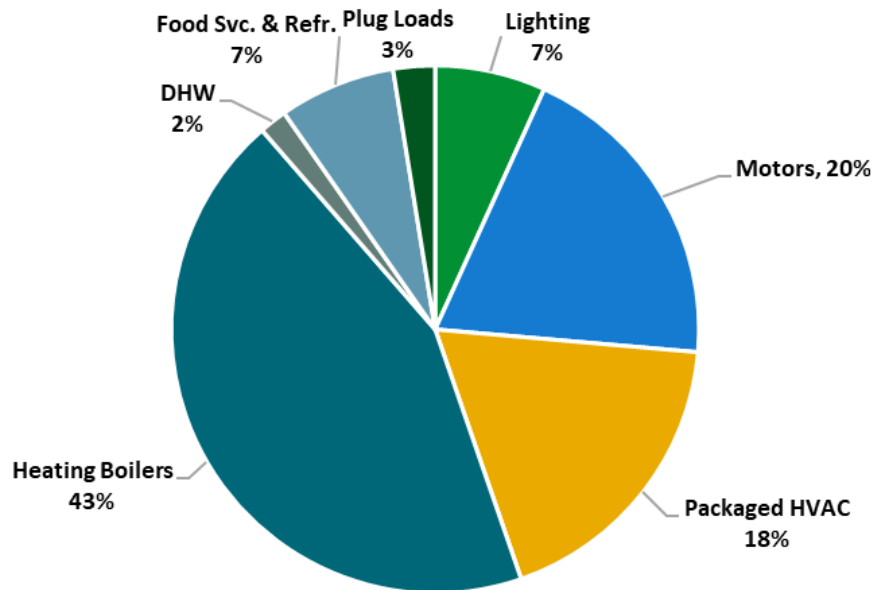

*Energy Use by System*


## POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


### Scenario 1: Full Package (All Evaluated Measures)

|   |  |
|---|--|
| Installation Cost                           | \$281,900  |
| Potential Rebates & Incentives <sup>1</sup> | \$20,520   |
| Annual Cost Savings                         | \$17,087   |
| Annual Energy Savings                       | Electricity: 72,020 kWh<br>Natural Gas: 1,309 Therms |
| Greenhouse Gas Emission Savings             | 44 Tons  |
| Simple Payback                              | 15.3 Years   |
| Site Energy Savings (All Utilities)         | 17%  |

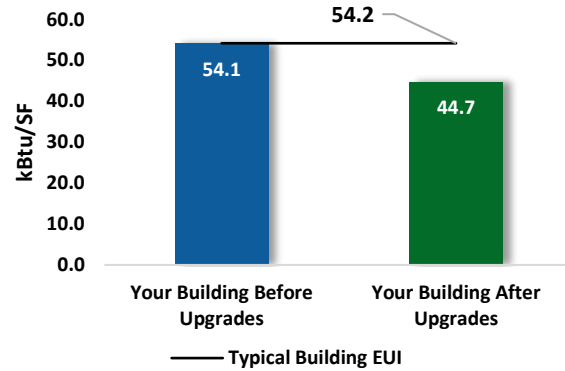

### Scenario 2: Cost Effective Package<sup>2</sup>

|                                     |  |
|-------------------------------------|--|
| Installation Cost                   | \$219,900  |
| Potential Rebates & Incentives      | \$17,320   |
| Annual Cost Savings                 | \$16,332   |
| Annual Energy Savings               | Electricity: 73,982 kWh<br>Natural Gas: 101 Therms |
| Greenhouse Gas Emission Savings     | 38 Tons  |
| Simple Payback                      | 12.4 Years   |
| Site Energy Savings (all utilities) | 12%  |

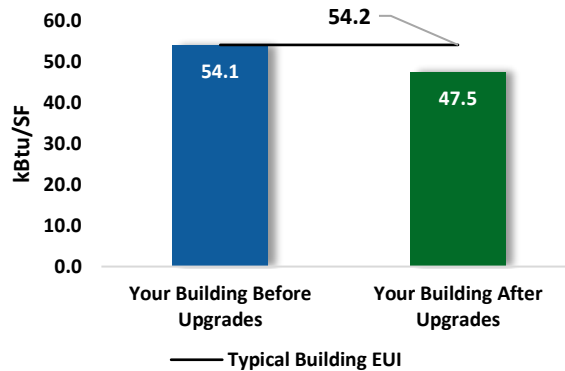

### On-site Generation Potential

|                         |      |
|-------------------------|------|
| Photovoltaic            | High |
| Combined Heat and Power | None |

<sup>1</sup> Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

<sup>2</sup> A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

| #  | Energy Conservation Measure                                   | Cost Effective? | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|--|---|-----------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Lighting Upgrades</b>                         |   |                 | <b>7,024</b>                  | <b>3.4</b>               | <b>-1</b>                   | <b>\$1,531</b>                  | <b>\$15,510</b>         | <b>\$3,020</b>            | <b>\$12,490</b>             | <b>8.2</b>                    | <b>6,947</b>                                |
| ECM 1  | Install LED Fixtures  | Yes             | 1,971                         | 0.0                      | 0                           | \$432                           | \$9,780                 | \$1,800                   | \$7,980                     | 18.5                          | 1,985                                       |
| ECM 2  | Retrofit Fixtures with LED Lamps                              | Yes             | 5,053                         | 3.4                      | -1                          | \$1,098                         | \$5,730                 | \$1,220                   | \$4,510                     | 4.1                           | 4,963                                       |
| <b>Lighting Control Measures</b>                 |   |                 | <b>7,743</b>                  | <b>3.3</b>               | <b>-2</b>                   | <b>\$1,683</b>                  | <b>\$22,230</b>         | <b>\$4,310</b>            | <b>\$17,920</b>             | <b>10.6</b>                   | <b>7,604</b>                                |
| ECM 3  | Install Occupancy Sensor Lighting Controls                    | Yes             | 7,075                         | 3.1                      | -2                          | \$1,537                         | \$18,300                | \$2,190                   | \$16,110                    | 10.5                          | 6,948                                       |
| ECM 4  | Install High/Low Lighting Controls                            | Yes             | 669                           | 0.3                      | 0                           | \$145                           | \$3,930                 | \$2,120                   | \$1,810                     | 12.5                          | 657   |
| <b>Motor Upgrades</b>                            |   |                 | <b>992</b>                    | <b>0.3</b>               | <b>0</b>                    | <b>\$218</b>                    | <b>\$4,300</b>          | <b>\$0</b>                | <b>\$4,300</b>              | <b>19.8</b>                   | <b>999</b>                                  |
| ECM 5  | Premium Efficiency Motors                                     | No              | 992                           | 0.3                      | 0                           | \$218                           | \$4,300                 | \$0                       | \$4,300                     | 19.8                          | 999   |
| <b>Variable Frequency Drive (VFD) Measures</b>   |   |                 | <b>49,291</b>                 | <b>15.3</b>              | <b>0</b>                    | <b>\$10,815</b>                 | <b>\$90,300</b>         | <b>\$5,900</b>            | <b>\$84,400</b>             | <b>7.8</b>                    | <b>49,636</b>                               |
| ECM 6  | Install VFDs on Constant Volume (CV) Fans                     | Yes             | 41,851                        | 14.3                     | 0                           | \$9,182                         | \$79,600                | \$4,800                   | \$74,800                    | 8.1                           | 42,143                                      |
| ECM 7  | Install VFDs on Heating Water Pumps                           | Yes             | 7,440                         | 1.1                      | 0                           | \$1,632                         | \$10,700                | \$1,100                   | \$9,600                     | 5.9                           | 7,492                                       |
| <b>Unitary HVAC Measures</b>                     |   |                 | <b>6,418</b>                  | <b>7.6</b>               | <b>0</b>                    | <b>\$1,408</b>                  | <b>\$93,000</b>         | <b>\$3,900</b>            | <b>\$89,100</b>             | <b>63.3</b>                   | <b>6,463</b>                                |
| ECM 8  | Install High Efficiency Air Conditioning Units                | Yes             | 6,418                         | 7.6                      | 0                           | \$1,408                         | \$93,000                | \$3,900                   | \$89,100                    | 63.3                          | 6,463                                       |
| <b>Gas Heating (HVAC/Process) Replacement</b>    |   |                 | <b>0</b>                      | <b>0.0</b>               | <b>89</b>                   | <b>\$872</b>                    | <b>\$53,500</b>         | <b>\$3,200</b>            | <b>\$50,300</b>             | <b>57.7</b>                   | <b>10,393</b>                               |
| ECM 9  | Install High Efficiency Hot Water Boilers                     | No              | 0                             | 0.0                      | 68                          | \$664                           | \$48,600                | \$2,700                   | \$45,900                    | 69.1                          | 7,918                                       |
| ECM 10   | Install High Efficiency Furnaces                              | No              | 0                             | 0.0                      | 21                          | \$208                           | \$4,900                 | \$500                     | \$4,400                     | 21.2                          | 2,475                                       |
| <b>HVAC System Improvements</b>                  |   |                 | <b>0</b>                      | <b>0.0</b>               | <b>9</b>                    | <b>\$85</b>                     | <b>\$240</b>            | <b>\$30</b>               | <b>\$210</b>                | <b>2.5</b>                    | <b>1,018</b>                                |
| ECM 11   | Install Pipe Insulation                                       | Yes             | 0                             | 0.0                      | 9                           | \$85                            | \$240                   | \$30                      | \$210                       | 2.5                           | 1,018                                       |
| <b>Domestic Water Heating Upgrade</b>            |   |                 | <b>0</b>                      | <b>0.0</b>               | <b>4</b>                    | <b>\$41</b>                     | <b>\$140</b>            | <b>\$60</b>               | <b>\$80</b>                 | <b>2.0</b>                    | <b>487</b>                                  |
| ECM 12   | Install Low-Flow DHW Devices                                  | Yes             | 0                             | 0.0                      | 4                           | \$41                            | \$140                   | \$60                      | \$80                        | 2.0                           | 487   |
| <b>Food Service &amp; Refrigeration Measures</b> |   |                 | <b>3,506</b>                  | <b>0.4</b>               | <b>0</b>                    | <b>\$769</b>                    | <b>\$1,080</b>          | <b>\$100</b>              | <b>\$980</b>                | <b>1.3</b>                    | <b>3,530</b>                                |
| ECM 13   | Vending Machine Control                                       | Yes             | 3,506                         | 0.4                      | 0                           | \$769                           | \$1,080                 | \$100                     | \$980                       | 1.3                           | 3,530                                       |
| <b>Custom Measures***</b>                        |   |                 | <b>-2,954</b>                 | <b>0.0</b>               | <b>32</b>                   | <b>-\$334</b>                   | <b>\$4,200</b>          | <b>\$0</b>                | <b>\$4,200</b>              | <b>-12.6</b>                  | <b>772</b>                                  |
| ECM 14   | Replace Gas Fired Water Heater with Heat Pump Water Heater*** | No              | -2,954                        | 0.0                      | 32                          | -\$334                          | \$4,200                 | \$0                       | \$4,200                     | -12.6                         | 772   |
| <b>TOTALS (COST EFFECTIVE MEASURES)</b>          |   |                 | <b>73,982</b>                 | <b>30.1</b>              | <b>10</b>                   | <b>\$16,332</b>                 | <b>\$222,500</b>        | <b>\$17,320</b>           | <b>\$205,180</b>            | <b>12.6</b>                   | <b>75,685</b>                               |
| <b>TOTALS (ALL MEASURES)</b>                     |   |                 | <b>72,020</b>                 | <b>30.4</b>              | <b>131</b>                  | <b>\$17,087</b>                 | <b>\$284,500</b>        | <b>\$20,520</b>           | <b>\$263,980</b>            | <b>15.4</b>                   | <b>87,849</b>                               |

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

\*\*\* - Negative payback explained in section 4.10

*All Evaluated Energy Improvements<sup>3</sup>*

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

<sup>3</sup> TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations.



## 1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decision to make, such as:

- ◆ How will the project be funded/and or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

### Pick Your Installation Approach

Utility-run energy efficiency programs and New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives *before* purchasing materials or starting installation.

### Options from Your Utility Company

#### *Prescriptive and Custom Rebates*

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the Prescriptive and Custom Rebates program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval may be required for some incentives. Contact your utility company for more details prior to project installation.

#### *Direct Install*

The Direct Install program provides turnkey installation of multiple measures through an authorized contractor. This program can provide incentives up to 70% or 80% of the cost of selected measures. A Direct Install contractor will assess and verify individual measure eligibility and perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

#### *Engineered Solutions*

The Engineered Solutions program provides tailored energy-efficiency assistance and turnkey engineering services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. The program provides all professional services from audit, design, construction administration, to commissioning and measurement and verification for custom whole-building energy-efficiency projects. Engineered Solutions allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs.

For more details on these programs please contact your utility provider.

## **Options from New Jersey's Clean Energy Program**

### *Financing and Planning Support with the Energy Savings Improvement Program (ESIP)*

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

### *Resiliency with Return on Investment through Combined Heat and Power (CHP)*

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

### *Successor Solar Incentive Program (SuSI)*

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

### *Ongoing Electric Savings with Demand Response*

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

### *Large Energy User Program (LEUP)*

LEUP is designed to promote self-investment in energy efficiency for the largest energy consumers in the state. Customers in this category spend about \$5 million a year on energy bills. This program incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

For more details on these programs please visit [New Jersey's Clean Energy Program website](#).



## 2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) report for Community Center - Main Building and VCC Annex. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

### 2.1 Site Overview

On May 10, 2024, TRC performed an energy audit at Community Center - Main Building and VCC Annex located in Verona, New Jersey. TRC met with Lenny Waterman to review the facility operations and help focus our investigation on specific energy-using systems.

The Community Center is a two-story building with an accompanying annex. The community center was built in 1997 and is 39,955 square feet. It contains hallways, offices, firehouse garage, gymnasium, mechanical rooms, storage rooms, restrooms, lobbies, conference rooms, kitchen, and kitchenette. The Annex was built in 2004 and is 4,025 square foot building separate from the main building. The annex is a separate building that has multiple storage garages, water treatment facility, and two indoor rooms for senior citizen activities. Occasionally the gym and ballroom in the community center are rented out for activities like pickleball, parties, holidays, and graduations. The occupancy varies by the season. There is solar on the roof, but it is no longer operational, and the facility is interested in more solar. The primary interior lighting is LED linear tubes in both buildings with a few compact fluorescent lamps (CFL). LED lamps, integrated fixtures, and metal halides illuminate the exterior of the building and the parking lot. The main building is conditioned by multiple rooftop units and hot water boilers in the mechanical room. The annex garages corridors, restrooms, and stairway are conditioned by various QMark electric resistance heaters. The activities rooms on the second floor are conditioned by a split system York air handling unit and a Thermal Zone condensing unit on the exterior of the building.

#### Recent Improvements and Facility Concerns

In the annex, the facility is retrofitting the municipal water treatment plant to filter PFAS. They have plans of renovating the annex over the next year or two to upgrade it to fit current standards. They have plans of knocking down the wall between the third and fourth garage to expand the treatment facility. The roof is in poor condition and is set to be replaced soon.

### 2.2 Building Occupancy

The facility is occupied Monday through Friday from 8:30 am to 4:00 pm and occasionally after hours until 10:00 pm for activities in the gym and ballroom of the community center. Janitorial services are performed as needed. The occupancy of the facility afterhours varies by season.

| Building Name                  | Weekday/Weekend | Operating Schedule |
|--------------------------------|-----------------|--------------------|
| Community Center Main Building | Weekday         | 8:30 AM - 4:30 PM  |
|                                | Weekend         | N/A                |
| Community Center Annex         | Weekday         | 8:30 AM - 4:30 PM  |
|                                | Weekend         | N/A                |

*Building Occupancy Schedule*

## 2.3 Building Envelope

The main building and annex are concrete over a steel frame with a brick façade and steel trusses supporting the roof. The roof is pitched in most places with asphalt shingles and insulated with Styrofoam. The HVAC systems are positioned on flat parts of the roof that are covered with a black membrane which is in poor condition. The roof of the annex is pitched with asphalt shingles.

The windows are double paned with aluminum frames and are in good condition. Both the glass-to-frame seals are in good condition showing little evidence of excessive wear and the operable window weather-seals are also in good condition. The exterior doors are metal and glass and have undamaged door seals. Degraded window and door seals increase drafts and outside air infiltration. The community center has a firehouse with three overhead garage doors and the annex has four overhead garage doors.



*Community Center Windows*



*Community Center Door*



*Firehouse Garage Doors*



*VCC Annex Door*



*Community Center Roof*

*Community Center Exterior Windows*



*VCC Annex Exterior*

## 2.4 Lighting Systems

The primary interior lighting system for both buildings a variety of LED lamps and fixtures. The fixture types include 2-lamp, 3-lamp, 4-lamp, and 6-lamp; 4-foot-long LED troffers and LED strips. The VCC annex has a corridor and a deck illuminated by 32-Watt CFLs. The gymnasium fixtures have manually controlled high bay LED fixtures. Interior fixtures are controlled by wall switch. The only lights controlled by occupancy sensors are the LED fixtures in the office tax assessors' room and zoning department restroom.

All exit signs are LED.

Most fixtures are in good condition and interior lighting levels were generally sufficient.

The exterior lighting fixtures in the parking lot are acorn top metal halides. These lights are controlled by a photocell. Exterior lights on the annex and main building are LED wall sconces, cove mounts, downlights, pendants, and wall mounted fixtures.



*1-Lamp LED Tube*



*2-Lamp LED Tube*



*4-Lamp LED Tube*



*LED Chandelier*



*Wall Mount*



*LED Can*



*LED Can*




*Exit Sign*



*Gymnasium High Bay*



*LED 4-foot Direct*

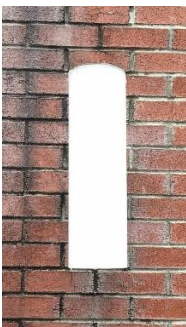

*Main Building and Annex Exterior Wall Mounts and Wall Sconces*

## 2.5 Air Handling Systems

### Unitary Heating Equipment

The firehouse apparatus room is the only portion of the main building that is conditioned by gas-fired heating equipment. There is a 40 MBh suspended Trane gas-fired heater with an efficiency of 80% and a Trane AHU suspended on the ceiling. The Trane AHU has a heating output of 160 MBh, 10 hp supply fan motor, and an efficiency of 80% and is a heating-only unit. The annex building is almost entirely heated by electric resistance heaters. Suspended QMark electric resistance heaters heat the garages, stairway, lobby, and restrooms in the annex. The capacity of these units was estimated to be 7.5 kw. There is an electric resistance heater in the exterior men's restroom that should be replaced.



*Trane Unit Heater*



*AHU-1 Furnace*



*Electric Resistance Heater*



*Electric Resistance Heater*





### Infrared Heating

The garages of the annex building are heated by infrared heaters, each with a heating capacity of 32 MBh. This equipment is operating within its useful lifetime and is in good condition. There is a manual dial thermostat on the wall that controls the interior space temperature.



*Annex Garage Infrared Heater*

### Packaged Units

Various offices and spaces in the main building are conditioned by packaged rooftop units controlled by room thermostats. The units only provide cooling. Heating is provided by the boiler serving baseboard heating across the facility. There are five units with cooling capacities ranging from 3 tons to 10 tons. Three of the five units, RTU-3, RTU-4, and ACC-4 are in fair to poor condition and operating beyond their useful lifetime. RTU 1 is a 10-ton unit with a Seer of 14 and serves the firehouse. RTU-2 is a 4-ton unit with a SEER of 12 and serves the training room. ACC-4 and RTU-3 are 6-ton units, both with a SEER of 10, serving the 1<sup>st</sup> floor offices and the 2<sup>nd</sup> floor conference rooms. RTU-4 is a 3-ton unit also with a SEER of 10 serving the Activities Room.

| Unit        | Area Served                           | Size    | Cooling Efficiency (SEER) |
|-------------|---------------------------------------|---------|---------------------------|
| Trane RTU-1 | Firehouse<br>Offices/Inspectors       | 4 Tons  | 12 SEER                   |
| Trane RTU 2 | Firehouse<br>Offices/Inspectors       | 10 Tons | 14 SEER                   |
| Trane ACC-4 | 1 <sup>st</sup> Floor Offices         | 6 Tons  | 10 SEER                   |
| Trane RTU-3 | 2 <sup>nd</sup> Floor Conference Room | 6 Tons  | 10 SEER                   |
| Trane RTU 4 | Activities Room                       | 3 Tons  | 10 SEER                   |

Refer to Appendix A for detailed information about each unit.



*Trane RTU 1*



*Trane RTU 2*



*RTU-3*



*RTU-4*

### **Air Handling Units (AHUs)**

Several spaces in the main building are conditioned by air handling units equipped with refrigerant coils for cooling and supply fan motors. There are four of these units across the building. AHU-2 conditions the gym storage room, AHU-3 conditions the ballroom, AHU-4 conditions the recreation and tax offices, and AHU-5 conditions the lobby. Three rooftop condensing units serve these air handlers. AHU-2 has a supply fan motor of 3 hp, AHU 3 has a supply fan motor hp of 7.5 hp, AHU-4 has a supply fan motor hp of 5, and AHU-5 has a supply fan hp of 3.

This system includes three outdoor rooftop condensing units that have cooling capacities ranging from 6 tons to 25 tons. All the split systems are operating beyond their useful life and have a SEER range of 9.5 SEER to 10 SEER. ACC-3 has a cooling capacity of 25 tons and a SEER of 9.5 and serves the ballroom AHU. ACC-2 and ACC-4 have cooling capacities of 6 tons and a SEER of 10. These units serve the 1<sup>st</sup> floor offices and the common area. This is a split air-conditioning (AC) system configuration. The heating coil is supplied by the hot water boiler, which is described in the section that follows.

The annex building activities rooms are conditioned by two air handling units. Both the units were in the annex activities room closet. This unit is equipped with a supply fan motor and a refrigerant coil for cooling. The supply fan motor is 0.5 hp, constant speed, and standard efficiency.

This system includes two outdoor condensing units that have a cooling capacity of 5 tons. It is high efficiency with an energy efficiency ratio of 11 EER and is in good condition. This is a split air-conditioning (AC) system configuration. The HVAC systems are controlled by local automated thermostats.



ACC-2



ACC-3



ACC-4



AHU-3



VCC Annex Split System

## 2.6 Heating Hot Water Systems

Two hot water boilers serve both building's heating load. A 1246 MBh Smith cast iron boiler with an efficiency of 82% and a Lochinvar condensing hot water boiler with an efficiency of 93.3% operate in a lead-lag control scheme. The condensing hot water boiler is the primary boiler, and the non-condensing hot water boiler is used when demand is high. Both boilers are required under high load conditions. Hot water serves baseboard heaters across the site. The Lochinvar condensing hot water boiler is in good condition and was manufactured in 2019. The non-condensing Smith cast iron boiler was manufactured in 1996 and is operating beyond its useful life.

Five heating hot water pumps, ranging from .25 hp to 5 hp, distribute hot water to end uses. The hot water pumps do not have VFDs.



*Non-condensing Hot Water Boiler*



*Condensing Hot Water Boiler*



*Heating Hot Water Pumps*



## 2.7 Domestic Hot Water

Hot water is produced by two storage tank hot water heaters. The community center hot water is produced by an 85-gallon, 300 MBh gas-fired Rheem storage water heater with an efficiency of 80%. Hot water in the annex is produced by a 50-gallon, 4.5 kW Bradford White hot water heater. Water is delivered to end uses with fractional horsepower domestic hot water circulation pumps.

The domestic hot water pipes are insulated, and the insulation is in good condition.



*Main Building DHW Heater*



*Annex DHW Heater*



*Circulation Pump*

## 2.8 Food Service Equipment

The kitchen has all gas cooking equipment used to prepare meals during events. The gas griddle in the ballroom kitchen is used to prepare meals during events where the ballroom is rented out to the public for parties and events. The oven in the upstairs kitchenette attached to the firehouse conference room is used to prepare meals for events in that room. Both rooms have all electric dishwashers that are used periodically to clean dishes. Equipment is not high efficiency and is in good condition.

The dishwasher in the ballroom kitchen is a non-ENERGY STAR high-temperature, door type unit. The dishwashers in the fireman's room and the two in the firehouse ready-room are low-temperature under counter non-ENERGY STAR rated door type units.

Visit [https://www.energystar.gov/products/commercial\\_food\\_service\\_equipment](https://www.energystar.gov/products/commercial_food_service_equipment) for the latest information on high efficiency food service equipment.



*Kitchen Griddle*



*Oven*



*Door Type Dishwasher*

## 2.9 Refrigeration

The ballroom kitchen has a 23-cubic foot TRUE stand-up solid door refrigerator and freezer used to store food during events. All equipment is high efficiency and in good condition. Additionally mini fridges across the facility are used to store employee lunches and food.

Visit [https://www.energystar.gov/products/commercial\\_food\\_service\\_equipment](https://www.energystar.gov/products/commercial_food_service_equipment) for the latest information on high efficiency food service equipment.



*Stand-up Fridge/Freezer*

## 2.10 Plug Load and Vending Machines

The location is doing a great job managing the electrical plug loads. This report makes additional suggestions for ECMs in this area as well as energy efficient best practices.

There are ten computer workstations throughout the facility. Plug loads include general cafe and office equipment like coffee machines, microwaves, paper shredders, printer/copiers, and televisions. There are several residential-style refrigerators throughout the building that are used to store employee lunches and prepared meals. These vary in condition and efficiency.

There are two refrigerated beverage vending machines and two non-refrigerated vending machines. That are not equipped with occupancy-based controls.




*Vending Machines*



*Residential Fridge*



*Printer/Copier*

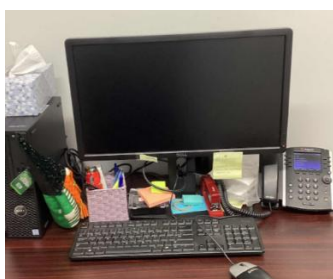

*Desktop & Microwave*



*Desktop & Microwave*

## 2.11 Water-Using Systems

Water is currently being provided by a Passaic Valley municipal water company. The facility is in the process of reconnecting municipal well water after the redesign of the water treatment facility in the annex. Potable water is used for drinking, cleaning, cooking, sanitary fixtures, building conditioning, and laundry. No water leaks were reported on site

There are several restrooms with toilets, urinals, and sinks. Faucet flow rates are between 1.2 and 2.2 gallons per minute (gpm) or higher. There are kitchen faucets used for dish cleaning rated at 2.2 gallons per minute also.



*Kitchen Sink*




*Restroom Sink*

### 3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.


| Utility Summary |               |                 |
|-----------------|---------------|-----------------|
| Fuel            | Usage         | Cost            |
| Electricity     | 269,727 kWh   | \$59,181        |
| Natural Gas     | 12,414 Therms | \$12,193        |
| <b>Total</b>    |               | <b>\$71,373</b> |

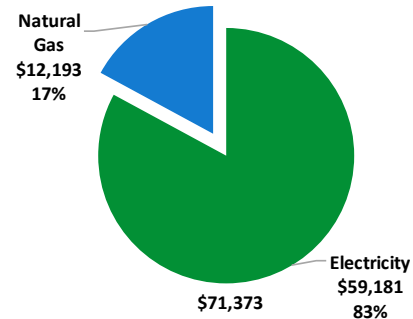

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.




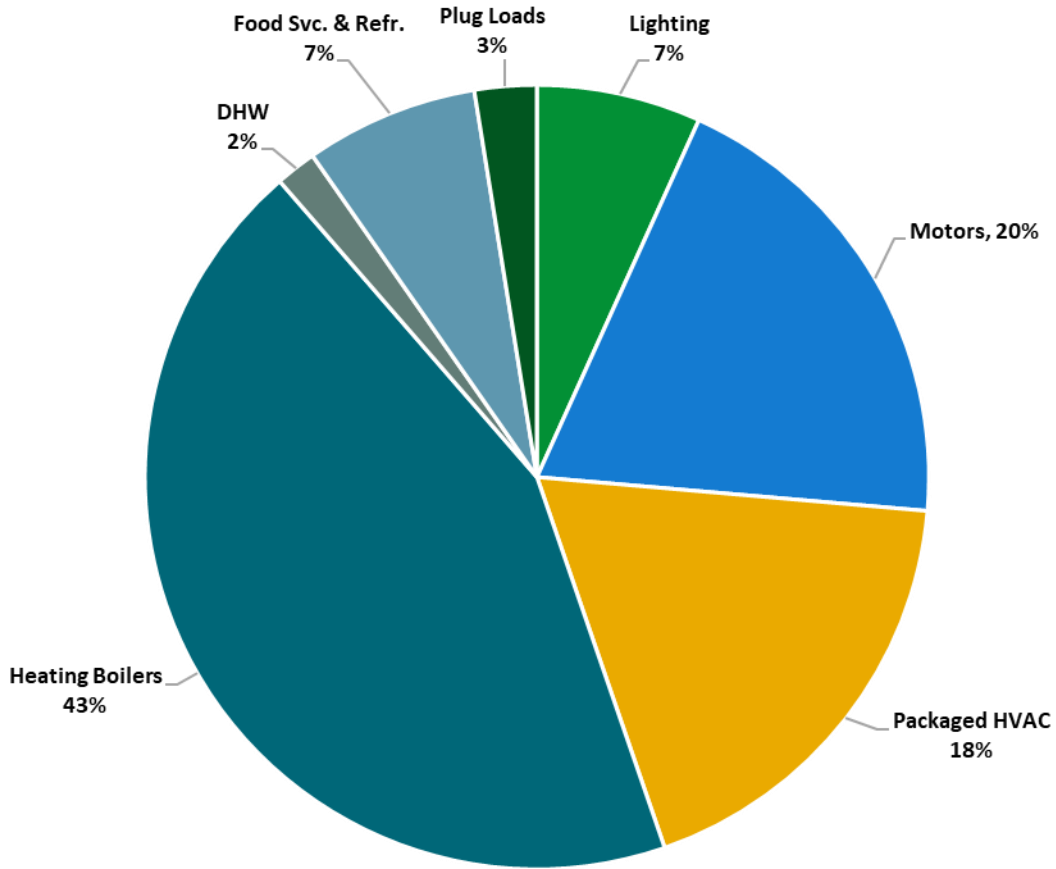

*Energy Balance by System*

### 3.1 Electricity

PSE&G delivers electricity under rate class General Lighting & Power (GLP).

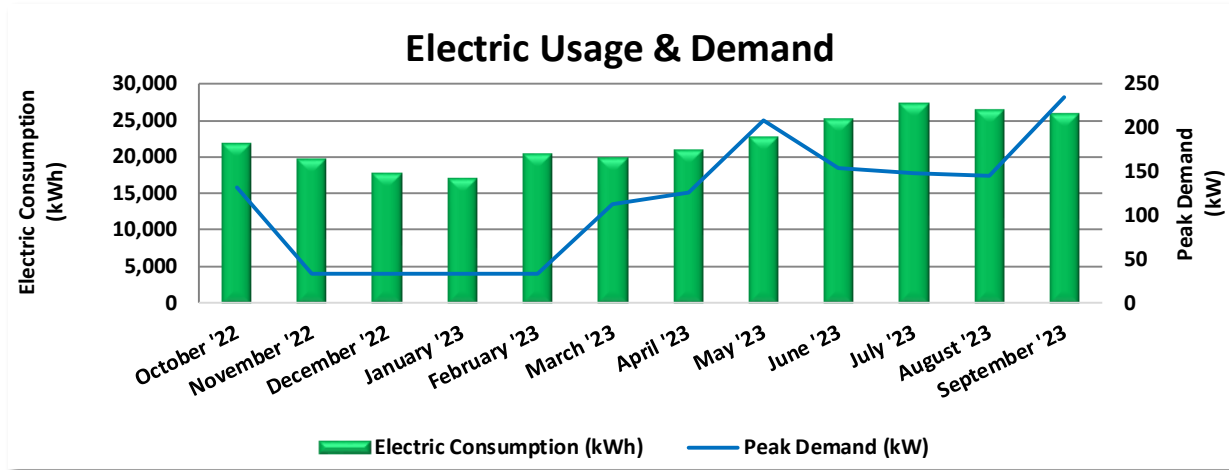


| Electric Billing Data |                |                      |             |                 |                     |
|-----------------------|----------------|----------------------|-------------|-----------------|---------------------|
| Period Ending         | Days in Period | Electric Usage (kWh) | Demand (kW) | Demand Cost     | Total Electric Cost |
| 11/4/22               | 24             | 21,937               | 132         | 615             | 4,581               |
| 12/5/22               | 31             | 19,761               | 33          | 402             | 4,006               |
| 1/5/23                | 31             | 17,766               | 33          | 402             | 3,707               |
| 2/5/23                | 31             | 17,222               | 33          | 402             | 3,625               |
| 3/9/23                | 32             | 20,578               | 33          | 402             | 3,757               |
| 4/10/23               | 32             | 19,881               | 113         | 524             | 4,183               |
| 5/9/23                | 29             | 20,960               | 126         | 588             | 4,353               |
| 6/8/23                | 30             | 22,779               | 208         | 1,300           | 5,223               |
| 7/10/23               | 32             | 25,255               | 154         | 2,356           | 6,504               |
| 8/8/23                | 29             | 27,395               | 148         | 2,199           | 6,550               |
| 9/7/23                | 30             | 26,477               | 146         | 2,161           | 6,191               |
| 10/6/23               | 29             | 26,020               | 235         | 1,587           | 5,690               |
| <b>Totals</b>         | <b>360</b>     | <b>266,032</b>       | <b>235</b>  | <b>\$12,937</b> | <b>\$58,370</b>     |
| <b>Annual</b>         | <b>365</b>     | <b>269,727</b>       | <b>235</b>  | <b>\$13,117</b> | <b>\$59,181</b>     |

Notes:

- Peak demand of 235 kW occurred in September '23.
- Average demand over the past 12 months was 116 kW.
- The average electric cost over the past 12 months was \$0.219/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.
- The facility has a solar system on the roof that is currently not being used but the facility has interest in replacing the system.

### 3.2 Natural Gas

PSE&G delivers natural gas under rate class Large Volume Gas (LVG), with natural gas supply provided by Aggressive Energy, a third-party supplier.

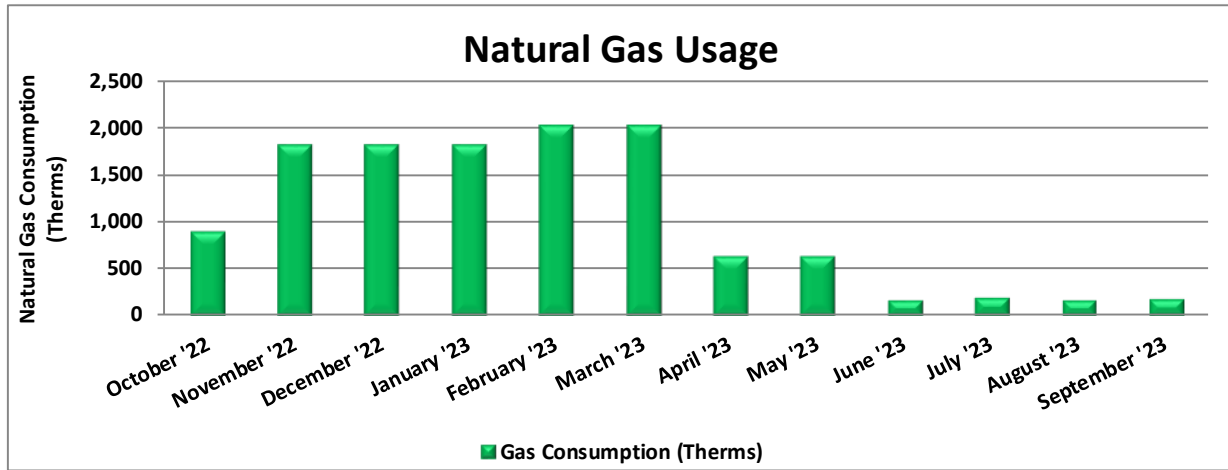

| Gas Billing Data |                |                            |                  |
|------------------|----------------|----------------------------|------------------|
| Period Ending    | Days in Period | Natural Gas Usage (Therms) | Natural Gas Cost |
| 11/2/22          | 34             | 903                        | \$1,051          |
| 12/2/22          | 30             | 1,825                      | \$1,936          |
| 1/2/23           | 31             | 1,825                      | \$1,936          |
| 2/3/23           | 32             | 1,825                      | \$1,936          |
| 3/3/23           | 28             | 2,026                      | \$2,020          |
| 4/5/23           | 33             | 2,026                      | \$2,020          |
| 5/2/23           | 27             | 635                        | \$264            |
| 6/1/23           | 30             | 635                        | \$264            |
| 6/30/23          | 29             | 171                        | \$192            |
| 7/30/23          | 30             | 189                        | \$193            |
| 8/30/23          | 31             | 171                        | \$190            |
| 9/29/23          | 30             | 183                        | \$191            |
| <b>Totals</b>    | <b>365</b>     | <b>12,414</b>              | <b>\$12,193</b>  |
| <b>Annual</b>    | <b>365</b>     | <b>12,414</b>              | <b>\$12,193</b>  |

Notes:

- The average gas cost for the past 12 months is \$0.982/therm, which is the blended rate used throughout the analysis.


### 3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) Portfolio Manager® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

|                           |            |
|---------------------------|------------|
| <b>Benchmarking Score</b> | <b>N/A</b> |
|---------------------------|------------|

Due to its unique characteristics, this building type is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

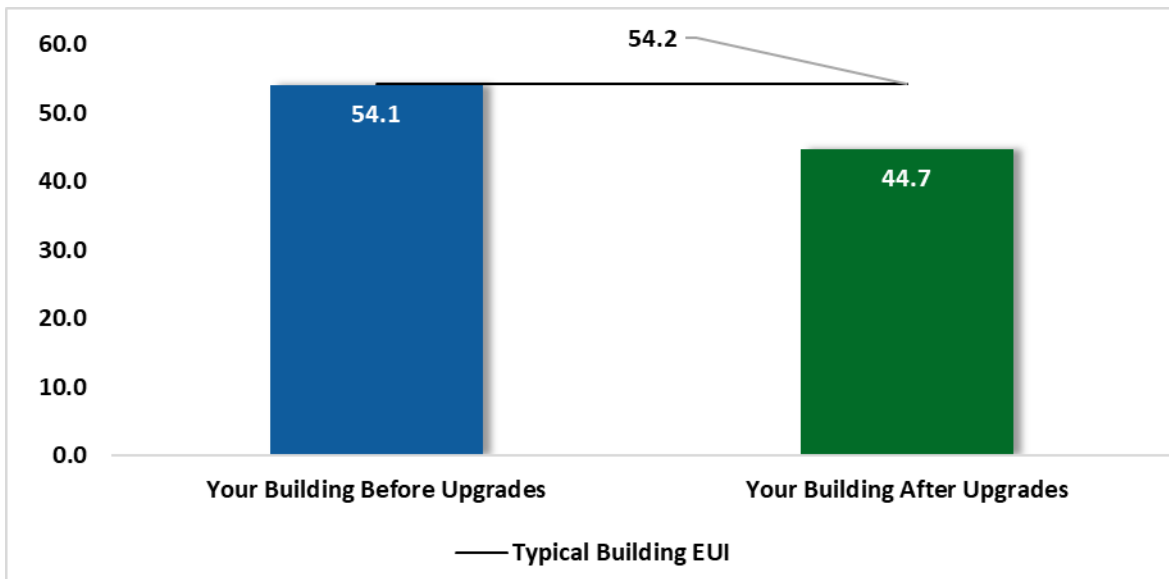

*Energy Use Intensity Comparison<sup>4</sup>*

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

<sup>4</sup> Based on all evaluated ECMs

## **Tracking your Energy Performance**

Keeping track of your energy and water use on a monthly basis is one of the best ways to keep utility costs in check and keep your facility operating efficiently. Update your utility information in Portfolio Manager regularly, so that you can keep track of your building's performance.

**We have created a Portfolio Manager account for your facility and have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.**

Free online training is available to help you use ENERGY STAR Portfolio Manager to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR and Portfolio Manager, visit their [website](#).

## 3.4 Understanding Your Utility Bills

The State of New Jersey Department of the Public Advocate provides detailed information on how to read natural gas and electric bills. Your bills contain important information including account numbers, meter numbers, rate schedules, meter readings, and the supply and delivery charges. Gas and electric bills both provide comparisons of current energy consumption with prior usage.

Sample bills, with annotation, may be viewed at:

[https://www.nj.gov/rpa/docs/Understanding\\_Electric\\_Bill.pdf](https://www.nj.gov/rpa/docs/Understanding_Electric_Bill.pdf)

[https://www.nj.gov/rpa/docs/Understanding\\_Gas\\_Bill.pdf](https://www.nj.gov/rpa/docs/Understanding_Gas_Bill.pdf)

### **Why Utility Bills Vary**

Utility bills vary from one month to another for many reasons. For this reason, assessing the effects of your energy savings efforts can be difficult.

Billing periods vary, typically ranging between 28 and 33 days. Electric bills provide the kilowatt-hours (kWh) used per month while gas bills provide therms (or hundreds of cubic feet - CCF) per month consumption information. Monthly consumption information can be helpful as a tool to assess your efforts to reduce energy, particularly when compared to monthly usage from a similar calendar period in a prior year.

Bills typically vary seasonally, often with more gas consumed in the winter for heating, and more electricity used in the summer when air conditioning is used. Facilities with electric heating may experience higher electricity use in the winter. Seasonal variance will be impacted by the type of heating and cooling systems used. Normal seasonal fluctuations are further impacted by the weather. Extremely cold or hot weathers causes HVAC equipment to run longer, increasing usage. Other monthly fluctuations in usage can be caused by changes in building occupancy. Utility bills provide a comparison of usage between the current period and comparable billing month period of the prior year. Year-to-year monthly use comparisons can point to trends with energy savings for measures/projects that were implemented within the timeframe, but these comparisons do not account for changing weather or occupancy patterns.

The price of fuel and purchased power used to produce and delivery electricity and gas fluctuates. Any increase or decrease in these costs will be reflected in your monthly bill. Additionally, billing rates occasionally change after justification and approval of the NJBPU. For this reason, it is more useful to review energy use rather than cost when assessing energy use trends or the impact of energy conservation measures implemented.

## 4 ENERGY CONSERVATION MEASURES

---

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives in this report are based on the previously run state rebate program SmartStart, which has been retired. Now, all investor-owned gas and electric utility companies are offering complementary energy efficiency programs directly to their customers. Some measures and proposed upgrades may be eligible for higher incentives than those shown below. The incentives in the summary tables should be used for high-level planning purposes. To verify incentives, reach out to your utility provider or visit the [NJCEP website](#) for more information.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.

| #  | Energy Conservation Measure                                   | Cost Effective? | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|--|---|-----------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Lighting Upgrades</b>                         |   |                 | <b>7,024</b>                  | <b>3.4</b>               | <b>-1</b>                   | <b>\$1,531</b>                  | <b>\$15,510</b>         | <b>\$3,020</b>            | <b>\$12,490</b>             | <b>8.2</b>                    | <b>6,947</b>                                |
| ECM 1  | Install LED Fixtures  | Yes             | 1,971                         | 0.0                      | 0                           | \$432                           | \$9,780                 | \$1,800                   | \$7,980                     | 18.5                          | 1,985                                       |
| ECM 2  | Retrofit Fixtures with LED Lamps                              | Yes             | 5,053                         | 3.4                      | -1                          | \$1,098                         | \$5,730                 | \$1,220                   | \$4,510                     | 4.1                           | 4,963                                       |
| <b>Lighting Control Measures</b>                 |   |                 | <b>7,743</b>                  | <b>3.3</b>               | <b>-2</b>                   | <b>\$1,683</b>                  | <b>\$22,230</b>         | <b>\$4,310</b>            | <b>\$17,920</b>             | <b>10.6</b>                   | <b>7,604</b>                                |
| ECM 3  | Install Occupancy Sensor Lighting Controls                    | Yes             | 7,075                         | 3.1                      | -2                          | \$1,537                         | \$18,300                | \$2,190                   | \$16,110                    | 10.5                          | 6,948                                       |
| ECM 4  | Install High/Low Lighting Controls                            | Yes             | 669                           | 0.3                      | 0                           | \$145                           | \$3,930                 | \$2,120                   | \$1,810                     | 12.5                          | 657   |
| <b>Motor Upgrades</b>                            |   |                 | <b>992</b>                    | <b>0.3</b>               | <b>0</b>                    | <b>\$218</b>                    | <b>\$4,300</b>          | <b>\$0</b>                | <b>\$4,300</b>              | <b>19.8</b>                   | <b>999</b>                                  |
| ECM 5  | Premium Efficiency Motors                                     | No              | 992                           | 0.3                      | 0                           | \$218                           | \$4,300                 | \$0                       | \$4,300                     | 19.8                          | 999   |
| <b>Variable Frequency Drive (VFD) Measures</b>   |   |                 | <b>49,291</b>                 | <b>15.3</b>              | <b>0</b>                    | <b>\$10,815</b>                 | <b>\$90,300</b>         | <b>\$5,900</b>            | <b>\$84,400</b>             | <b>7.8</b>                    | <b>49,636</b>                               |
| ECM 6  | Install VFDs on Constant Volume (CV) Fans                     | Yes             | 41,851                        | 14.3                     | 0                           | \$9,182                         | \$79,600                | \$4,800                   | \$74,800                    | 8.1                           | 42,143                                      |
| ECM 7  | Install VFDs on Heating Water Pumps                           | Yes             | 7,440                         | 1.1                      | 0                           | \$1,632                         | \$10,700                | \$1,100                   | \$9,600                     | 5.9                           | 7,492                                       |
| <b>Unitary HVAC Measures</b>                     |   |                 | <b>6,418</b>                  | <b>7.6</b>               | <b>0</b>                    | <b>\$1,408</b>                  | <b>\$93,000</b>         | <b>\$3,900</b>            | <b>\$89,100</b>             | <b>63.3</b>                   | <b>6,463</b>                                |
| ECM 8  | Install High Efficiency Air Conditioning Units                | Yes             | 6,418                         | 7.6                      | 0                           | \$1,408                         | \$93,000                | \$3,900                   | \$89,100                    | 63.3                          | 6,463                                       |
| <b>Gas Heating (HVAC/Process) Replacement</b>    |   |                 | <b>0</b>                      | <b>0.0</b>               | <b>89</b>                   | <b>\$872</b>                    | <b>\$53,500</b>         | <b>\$3,200</b>            | <b>\$50,300</b>             | <b>57.7</b>                   | <b>10,393</b>                               |
| ECM 9  | Install High Efficiency Hot Water Boilers                     | No              | 0                             | 0.0                      | 68                          | \$664                           | \$48,600                | \$2,700                   | \$45,900                    | 69.1                          | 7,918                                       |
| ECM 10   | Install High Efficiency Furnaces                              | No              | 0                             | 0.0                      | 21                          | \$208                           | \$4,900                 | \$500                     | \$4,400                     | 21.2                          | 2,475                                       |
| <b>HVAC System Improvements</b>                  |   |                 | <b>0</b>                      | <b>0.0</b>               | <b>9</b>                    | <b>\$85</b>                     | <b>\$240</b>            | <b>\$30</b>               | <b>\$210</b>                | <b>2.5</b>                    | <b>1,018</b>                                |
| ECM 11   | Install Pipe Insulation                                       | Yes             | 0                             | 0.0                      | 9                           | \$85                            | \$240                   | \$30                      | \$210                       | 2.5                           | 1,018                                       |
| <b>Domestic Water Heating Upgrade</b>            |   |                 | <b>0</b>                      | <b>0.0</b>               | <b>4</b>                    | <b>\$41</b>                     | <b>\$140</b>            | <b>\$60</b>               | <b>\$80</b>                 | <b>2.0</b>                    | <b>487</b>                                  |
| ECM 12   | Install Low-Flow DHW Devices                                  | Yes             | 0                             | 0.0                      | 4                           | \$41                            | \$140                   | \$60                      | \$80                        | 2.0                           | 487   |
| <b>Food Service &amp; Refrigeration Measures</b> |   |                 | <b>3,506</b>                  | <b>0.4</b>               | <b>0</b>                    | <b>\$769</b>                    | <b>\$1,080</b>          | <b>\$100</b>              | <b>\$980</b>                | <b>1.3</b>                    | <b>3,530</b>                                |
| ECM 13   | Vending Machine Control                                       | Yes             | 3,506                         | 0.4                      | 0                           | \$769                           | \$1,080                 | \$100                     | \$980                       | 1.3                           | 3,530                                       |
| <b>Custom Measures***</b>                        |   |                 | <b>-2,954</b>                 | <b>0.0</b>               | <b>32</b>                   | <b>-\$334</b>                   | <b>\$4,200</b>          | <b>\$0</b>                | <b>\$4,200</b>              | <b>-12.6</b>                  | <b>772</b>                                  |
| ECM 14   | Replace Gas Fired Water Heater with Heat Pump Water Heater*** | No              | -2,954                        | 0.0                      | 32                          | -\$334                          | \$4,200                 | \$0                       | \$4,200                     | -12.6                         | 772   |
| <b>TOTALS</b>                                    |   |                 | <b>72,020</b>                 | <b>30.4</b>              | <b>131</b>                  | <b>\$17,087</b>                 | <b>\$284,500</b>        | <b>\$20,520</b>           | <b>\$263,980</b>            | <b>15.4</b>                   | <b>87,849</b>                               |

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

\*\*\* - Negative payback explained in section 4.10

*All Evaluated ECMs*

| #  | Energy Conservation Measure                    | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|--|--|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Lighting Upgrades</b>                         |  | <b>7,024</b>                  | <b>3.4</b>               | <b>-1</b>                   | <b>\$1,531</b>                  | <b>\$15,510</b>         | <b>\$3,020</b>            | <b>\$12,490</b>             | <b>8.2</b>                    | <b>6,947</b>                                |
| ECM 1  | Install LED Fixtures                           | 1,971                         | 0.0                      | 0                           | \$432                           | \$9,780                 | \$1,800                   | \$7,980                     | 18.5                          | 1,985                                       |
| ECM 2  | Retrofit Fixtures with LED Lamps               | 5,053                         | 3.4                      | -1                          | \$1,098                         | \$5,730                 | \$1,220                   | \$4,510                     | 4.1                           | 4,963                                       |
| <b>Lighting Control Measures</b>                 |  | <b>7,743</b>                  | <b>3.3</b>               | <b>-2</b>                   | <b>\$1,683</b>                  | <b>\$22,230</b>         | <b>\$4,310</b>            | <b>\$17,920</b>             | <b>10.6</b>                   | <b>7,604</b>                                |
| ECM 3  | Install Occupancy Sensor Lighting Controls     | 7,075                         | 3.1                      | -2                          | \$1,537                         | \$18,300                | \$2,190                   | \$16,110                    | 10.5                          | 6,948                                       |
| ECM 4  | Install High/Low Lighting Controls             | 669                           | 0.3                      | 0                           | \$145                           | \$3,930                 | \$2,120                   | \$1,810                     | 12.5                          | 657   |
| <b>Variable Frequency Drive (VFD) Measures</b>   |  | <b>49,291</b>                 | <b>15.3</b>              | <b>0</b>                    | <b>\$10,815</b>                 | <b>\$90,300</b>         | <b>\$5,900</b>            | <b>\$84,400</b>             | <b>7.8</b>                    | <b>49,636</b>                               |
| ECM 6  | Install VFDs on Constant Volume (CV) Fans      | 41,851                        | 14.3                     | 0                           | \$9,182                         | \$79,600                | \$4,800                   | \$74,800                    | 8.1                           | 42,143                                      |
| ECM 7  | Install VFDs on Heating Water Pumps            | 7,440                         | 1.1                      | 0                           | \$1,632                         | \$10,700                | \$1,100                   | \$9,600                     | 5.9                           | 7,492                                       |
| <b>Unitary HVAC Measures</b>                     |  | <b>6,418</b>                  | <b>7.6</b>               | <b>0</b>                    | <b>\$1,408</b>                  | <b>\$93,000</b>         | <b>\$3,900</b>            | <b>\$89,100</b>             | <b>63.3</b>                   | <b>6,463</b>                                |
| ECM 8  | Install High Efficiency Air Conditioning Units | 6,418                         | 7.6                      | 0                           | \$1,408                         | \$93,000                | \$3,900                   | \$89,100                    | 63.3                          | 6,463                                       |
| <b>HVAC System Improvements</b>                  |  | <b>0</b>                      | <b>0.0</b>               | <b>9</b>                    | <b>\$85</b>                     | <b>\$240</b>            | <b>\$30</b>               | <b>\$210</b>                | <b>2.5</b>                    | <b>1,018</b>                                |
| ECM 11   | Install Pipe Insulation                        | 0                             | 0.0                      | 9                           | \$85                            | \$240                   | \$30                      | \$210                       | 2.5                           | 1,018                                       |
| <b>Domestic Water Heating Upgrade</b>            |  | <b>0</b>                      | <b>0.0</b>               | <b>4</b>                    | <b>\$41</b>                     | <b>\$140</b>            | <b>\$60</b>               | <b>\$80</b>                 | <b>2.0</b>                    | <b>487</b>                                  |
| ECM 12   | Install Low-Flow DHW Devices                   | 0                             | 0.0                      | 4                           | \$41                            | \$140                   | \$60                      | \$80                        | 2.0                           | 487   |
| <b>Food Service &amp; Refrigeration Measures</b> |  | <b>3,506</b>                  | <b>0.4</b>               | <b>0</b>                    | <b>\$769</b>                    | <b>\$1,080</b>          | <b>\$100</b>              | <b>\$980</b>                | <b>1.3</b>                    | <b>3,530</b>                                |
| ECM 13   | Vending Machine Control                        | 3,506                         | 0.4                      | 0                           | \$769                           | \$1,080                 | \$100                     | \$980                       | 1.3                           | 3,530                                       |
| <b>TOTALS</b>                                    |  | <b>73,982</b>                 | <b>30.1</b>              | <b>10</b>                   | <b>\$16,332</b>                 | <b>\$222,500</b>        | <b>\$17,320</b>           | <b>\$205,180</b>            | <b>12.6</b>                   | <b>75,685</b>                               |

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

*Cost Effective ECMs*



## 4.1 Lighting

| #                        | Energy Conservation Measure      | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|--------------------------|----------------------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Lighting Upgrades</b> |                                  | <b>7,024</b>                  | <b>3.4</b>               | <b>-1</b>                   | <b>\$1,531</b>                  | <b>\$15,510</b>         | <b>\$3,020</b>            | <b>\$12,490</b>             | <b>8.2</b>                    | <b>6,947</b>                                |
| ECM 1                    | Install LED Fixtures             | 1,971                         | 0.0                      | 0                           | \$432                           | \$9,780                 | \$1,800                   | \$7,980                     | 18.5                          | 1,985                                       |
| ECM 2                    | Retrofit Fixtures with LED Lamps | 5,053                         | 3.4                      | -1                          | \$1,098                         | \$5,730                 | \$1,220                   | \$4,510                     | 4.1                           | 4,963                                       |

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

### **ECM 1: Install LED Fixtures**

Replace existing fixtures containing HID parking lot lamps with new LED light fixtures. This measure saves energy by installing LEDs, which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixture(s).

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

**Affected Building Areas:** exterior acorn top parking lot lights

### **ECM 2: Retrofit Fixtures with LED Lamps**

Replace fluorescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

**Affected Building Areas:** linear fluorescent T8s in the activity rooms 1 and 2, garages, water treatment garage, restrooms, stairs, storage room, and CFLs on the deck and corridor

## 4.2 Lighting Controls

| #                                | Energy Conservation Measure                | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|----------------------------------|--|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Lighting Control Measures</b> |  | <b>7,743</b>                  | <b>3.3</b>               | <b>-2</b>                   | <b>\$1,683</b>                  | <b>\$22,230</b>         | <b>\$4,310</b>            | <b>\$17,920</b>             | <b>10.6</b>                   | <b>7,604</b>                                |
| ECM 3                            | Install Occupancy Sensor Lighting Controls | 7,075                         | 3.1                      | -2                          | \$1,537                         | \$18,300                | \$2,190                   | \$16,110                    | 10.5                          | 6,948                                       |
| ECM 4                            | Install High/Low Lighting Controls         | 669                           | 0.3                      | 0                           | \$145                           | \$3,930                 | \$2,120                   | \$1,810                     | 12.5                          | 657   |

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

### **ECM 3: Install Occupancy Sensor Lighting Controls**

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

**Affected Building Areas: Main Building** mechanical room, activities room, ballroom, AV room, building and zoning offices, coat closets, conference rooms, fireman's room, gym lobby, gymnasium, gym storage, ballroom kitchen, fireman's kitchen, recreation office, 1<sup>st</sup> and 2<sup>nd</sup> floor lobby, firehouse offices, firehouse ready room, firehouse training and apparatus room, Annex garages, water treatment garage, exterior restrooms stairway, storage rooms, and annex activities room deck

### **ECM 4: Install High/Low Lighting Controls**

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as occupants approach the area.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

**Affected Building Areas:** all corridors in the Annex, corridors in the main building, and the main building 1<sup>st</sup> and 2<sup>nd</sup> floor lobbies

### 4.3 Motors

| #                     | Energy Conservation Measure | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|-----------------------|-----------------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Motor Upgrades</b> |                             | <b>992</b>                    | <b>0.3</b>               | <b>0</b>                    | <b>\$218</b>                    | <b>\$4,300</b>          | <b>\$0</b>                | <b>\$4,300</b>              | <b>19.8</b>                   | <b>999</b>                                  |
| ECM 5                 | Premium Efficiency Motors   | 992                           | 0.3                      | 0                           | \$218                           | \$4,300                 | \$0                       | \$4,300                     | 19.8                          | 999   |

#### ECM 5: Premium Efficiency Motors

Replace standard efficiency motors with IHP 2014 efficiency motors. This evaluation assumes that existing motors will be replaced with motors of equivalent size and type. In some cases, additional savings may be possible by downsizing motors to better meet the motor’s current load requirements.

The potential savings from installing new fan coils with electronically commutated (EC) motors was evaluated. EC motors are generally more efficient than other fractional hp motors and have the capability of operating at variable speeds. In general, replacing the fan coils should be considered a capital improvement measure that has the potential to provide energy savings and improve occupant comfort.

#### **Affected Motors:**

| Location                                | Area(s)/System(s) Served     | Motor Quantity | Motor Application | HP Per Motor | Additional Motor Description |
|---|------------------------------|----------------|-------------------|--------------|------------------------------|
| Community Center - 1st floor Mechanical | AHU-3 - Ballroom             | 1              | Supply Fan        | 7.5          | Supply Fan                   |
| Community Center - 1st floor Mechanical | AHU-4 - Rec Bdg & Tax Office | 1              | Supply Fan        | 5.0          | Supply Fan                   |
| Community Center - Gym AHU Room         | AHU-2 - Gym                  | 1              | Supply Fan        | 3.0          | Supply Fan                   |
| Community Center - Gym Mechanical Room  | Lobby                        | 1              | Supply Fan        | 3.0          | AHU-5                        |

Savings are based on the difference between baseline and proposed efficiencies and the assumed annual operating hours. The base case motor energy consumption is estimated using the efficiencies found on nameplates or estimated based on the age of the motor and our best estimates of motor run hours. Efficiencies of proposed motor upgrades are obtained from the current *New Jersey’s Clean Energy Program Protocols to Measure Resource Savings*.

## 4.4 Variable Frequency Drives (VFD)

| #  | Energy Conservation Measure               | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|--|---|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Variable Frequency Drive (VFD) Measures</b> |   | <b>49,291</b>                 | <b>15.3</b>              | <b>0</b>                    | <b>\$10,815</b>                 | <b>\$90,300</b>         | <b>\$5,900</b>            | <b>\$84,400</b>             | <b>7.8</b>                    | <b>49,636</b>                               |
| ECM 6  | Install VFDs on Constant Volume (CV) Fans | 41,851                        | 14.3                     | 0                           | \$9,182                         | \$79,600                | \$4,800                   | \$74,800                    | 8.1                           | 42,143                                      |
| ECM 7  | Install VFDs on Heating Water Pumps       | 7,440                         | 1.1                      | 0                           | \$1,632                         | \$10,700                | \$1,100                   | \$9,600                     | 5.9                           | 7,492                                       |

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

### **ECM 6: Install VFDs on Constant Volume (CV) Fans**

Install VFDs to control constant volume fan motor speeds. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature.

For air handlers with direct expansion (DX) cooling systems, the minimum air flow across the cooling coil required to prevent the coil from freezing must be determined during the final project design. The control system programming should maintain the minimum air flow whenever the compressor is operating. Prior to implementation, verify minimum fan speed in cooling mode with the manufacturer. Note that savings will vary depending on the operating characteristics of each AHU.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

**Affected Air Handlers & Fans:** AHUs 1 through 5, ACCs 2 through 4, RTUs 3 through 5, and exhaust fans 9 through 14

### **ECM 7: Install VFDs on Heating Water Pumps**

Install variable frequency drives (VFD) to control heating water pumps. Two-way valves must serve the hot water coils, and the hot water loop must have a differential pressure sensor installed. If three-way valves or a bypass leg are used in the hot water distribution, they will need to be modified when this measure is implemented. As the hot water valves close, the differential pressure increases and the VFD modulates the pump speed to maintain a differential pressure setpoint.

Energy savings result from reducing pump motor speed (and power) as hot water valves close. The magnitude of energy savings is based on the estimated amount of time that the system will operate at reduced load.

**Affected Pumps:** 3 hp heating hot water pump E790A and the 5 hp heating hot water pump suspended on the ceiling

## 4.5 Unitary HVAC

| #                            | Energy Conservation Measure                    | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|------------------------------|--|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Unitary HVAC Measures</b> |  | <b>6,418</b>                  | <b>7.6</b>               | <b>0</b>                    | <b>\$1,408</b>                  | <b>\$93,000</b>         | <b>\$3,900</b>            | <b>\$89,100</b>             | <b>63.3</b>                   | <b>6,463</b>                                |
| ECM 8                        | Install High Efficiency Air Conditioning Units | 6,418                         | 7.6                      | 0                           | \$1,408                         | \$93,000                | \$3,900                   | \$89,100                    | 63.3                          | 6,463                                       |

### **ECM 8: Install High Efficiency Air Conditioning Units**

Replace standard efficiency packaged air conditioning units with high efficiency packaged air conditioning units. All of the replacement units will incorporate efficient gas furnaces. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling and heating load, and the estimated annual operating hours.

**Affected Units:** ACC-2, -3, and -4

## 4.6 Gas-Fired Heating

| #   | Energy Conservation Measure               | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|---|---|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Gas Heating (HVAC/Process) Replacement</b> |   | <b>0</b>                      | <b>0.0</b>               | <b>89</b>                   | <b>\$872</b>                    | <b>\$53,500</b>         | <b>\$3,200</b>            | <b>\$50,300</b>             | <b>57.7</b>                   | <b>10,393</b>                               |
| ECM 9   | Install High Efficiency Hot Water Boilers | 0                             | 0.0                      | 68                          | \$664                           | \$48,600                | \$2,700                   | \$45,900                    | 69.1                          | 7,918                                       |
| ECM 10  | Install High Efficiency Furnaces          | 0                             | 0.0                      | 21                          | \$208                           | \$4,900                 | \$500                     | \$4,400                     | 21.2                          | 2,475                                       |

### **ECM 9: Install High Efficiency Hot Water Boilers**

Replace the older inefficient Smith Cast Iron Boiler hot water boiler with a high efficiency hot water boiler. Energy savings result from improved combustion efficiency and reduced standby losses at low loads.

The most notable efficiency improvement is condensing hydronic boilers that can achieve over 90% efficiency under the proper conditions. Condensing hydronic boilers typically operate at efficiencies between 85% and 87% (comparable to other high efficiency boilers) when the return water temperature is above 130°F. The boiler efficiency increases as the return water temperature drops below 130°F. Therefore, condensing hydronic boilers are evaluated when the return water temperature is less than 130°F during most of the operating hours.

For the purposes of this analysis, we evaluated the replacement of boilers on a one-for-one basis with equipment of the same capacity. We recommend that you work with your mechanical design team to select boilers that are sized appropriately for the heating load. In many cases installing multiple modular boilers, rather than one or two large boilers, will result in higher overall plant efficiency while providing additional system redundancy.

Replacing the boilers has a long payback and may not be justifiable based simply on energy considerations. However, the boilers have reached the end of their normal useful life. Typically, the marginal cost of purchasing high efficiency boilers can be justified by the marginal savings from the improved efficiency. When the boiler is eventually replaced, consider purchasing boilers that exceed the minimum efficiency required by building codes. We also recommend working with your mechanical

design team to determine whether the heating system can operate with return water temperatures below 130°F, which would allow the use of condensing boilers.

### **ECM 10: Install High Efficiency Furnaces**

Replace standard efficiency furnaces with condensing furnaces. Improved combustion technology and heat exchanger design optimize heat recovery from the combustion gases, which can significantly improve furnace efficiency. Savings result from improved system efficiency.

Note: these units produce acidic condensate that require proper drainage.

**Affected Units:** firehouse AHU-1

## 4.7 HVAC Improvements

| #                               | Energy Conservation Measure | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|---------------------------------|-----------------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>HVAC System Improvements</b> |                             | <b>0</b>                      | <b>0.0</b>               | <b>9</b>                    | <b>\$85</b>                     | <b>\$240</b>            | <b>\$30</b>               | <b>\$210</b>                | <b>2.5</b>                    | <b>1,018</b>                                |
| ECM 11                          | Install Pipe Insulation     | 0                             | 0.0                      | 9                           | \$85                            | \$240                   | \$30                      | \$210                       | 2.5                           | 1,018                                       |

### **ECM 11: Install Pipe Insulation**

Install insulation on heating water system piping. Distribution system thermal losses are dependent on system fluid temperature, the size of the distribution system, and the extent and condition of piping insulation. When the insulation has been damaged due to exposure to water, when the insulation has been removed from some areas of the pipe, or when valves have not been properly insulated, system thermal efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

**Affected Systems:** gym mechanical room heating hot water pipers

## 4.8 Domestic Water Heating

| #                                     | Energy Conservation Measure  | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|---------------------------------------|------------------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Domestic Water Heating Upgrade</b> |                              | <b>0</b>                      | <b>0.0</b>               | <b>4</b>                    | <b>\$41</b>                     | <b>\$140</b>            | <b>\$60</b>               | <b>\$80</b>                 | <b>2.0</b>                    | <b>487</b>                                  |
| ECM 12                                | Install Low-Flow DHW Devices | 0                             | 0.0                      | 4                           | \$41                            | \$140                   | \$60                      | \$80                        | 2.0                           | 487   |

### **ECM 12: Install Low-Flow DHW Devices**

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

| Device                          | Flow Rate |
|---------------------------------|-----------|
| Faucet aerators (lavatory)      | 0.5 gpm   |
| Faucet aerator (kitchen)        | 1.5 gpm   |
| Showerhead                      | 2.0 gpm   |
| Pre-rinse spray valve (kitchen) | 1.28 gpm  |

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing.

## 4.9 Food Service and Refrigeration Measures

| #  | Energy Conservation Measure | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|--|-----------------------------|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Food Service &amp; Refrigeration Measures</b> |                             | <b>3,506</b>                  | <b>0.4</b>               | <b>0</b>                    | <b>\$769</b>                    | <b>\$1,080</b>          | <b>\$100</b>              | <b>\$980</b>                | <b>1.3</b>                    | <b>3,530</b>                                |
| ECM 13   | Vending Machine Control     | 3,506                         | 0.4                      | 0                           | \$769                           | \$1,080                 | \$100                     | \$980                       | 1.3                           | 3,530                                       |

### ECM 13: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

## 4.10 Custom Measures

| #                      | Energy Conservation Measure                                   | Annual Electric Savings (kWh) | Peak Demand Savings (kW) | Annual Fuel Savings (MMBtu) | Annual Energy Cost Savings (\$) | Estimated M&L Cost (\$) | Estimated Incentive (\$)* | Estimated Net M&L Cost (\$) | Simple Payback Period (yrs)** | CO <sub>2</sub> e Emissions Reduction (lbs) |
|------------------------|---|-------------------------------|--------------------------|-----------------------------|---------------------------------|-------------------------|---------------------------|-----------------------------|-------------------------------|---|
| <b>Custom Measures</b> |   | <b>-2,954</b>                 | <b>0.0</b>               | <b>32</b>                   | <b>-\$334</b>                   | <b>\$4,200</b>          | <b>\$0</b>                | <b>\$4,200</b>              | <b>-12.6</b>                  | <b>772</b>                                  |
| ECM 14                 | Replace Gas Fired Water Heater with Heat Pump Water Heater*** | -2,954                        | 0.0                      | 32                          | -\$334                          | \$4,200                 | \$0                       | \$4,200                     | -12.6                         | 772   |

### ECM 14: Replace Gas Fired Water Heater with Heat Pump Water Heater

We evaluated replacing the existing 85 gallon Rheem gas water heater in the community center with a heat pump water heater (HPWH).

A gas fired water heater uses a burner to heat water. Air source heat pump water heaters use a refrigeration cycle to transfer heat from the surrounding air to the domestic water. Water heater efficiency is rated by the uniform energy factor (UEF). For a relative comparison of water heater UEFs, the criteria for certifying a water heater in the ENERGY STAR program are provided below. These values indicate that HPWH heaters are significantly more efficient than gas fired water heaters.

There are two types of HPWH: those integrated with the heat pump and storage tank in the same unit, and those that are split into two sections (with the storage tank separate from the heat pump). The measure considers an integrated HPWH.

**ENERGY STAR Uniform Energy Factor (UEF) Criteria for Certified Water Heaters \***

| <i>Water Heater Type</i> | <i>Minimum UEF</i> | <i>Other</i>                  |
|--------------------------|--------------------|-------------------------------|
| Integrated HPWH          | 3.3                |                               |
| Integrated HPWH          | 2.2                | 120 Volt, 15 Amp circuit      |
| Split System HPWH        | 2.2                |                               |
| Gas Fired Storage        | 0.64               | ≤ 55 gal, Medium Draw Pattern |
| Gas Fired Storage        | 0.68               | ≤ 55 gal, High Draw Pattern   |
| Gas Fired Storage        | 0.78               | > 55 gal, Medium Draw Pattern |
| Gas Fired Storage        | 0.80               | > 55 gal, High Draw Pattern   |
| Gas Fired Storage        | 0.80               | Residential Duty              |
| Gas Fired Instantaneous  | 0.87               |                               |

\* Note: Uniform Energy Factor (UEF): The newest measure of water heater overall efficiency. The higher the UEF value is, the more efficient the water heater. UEF is determined by the Department of Energy's test method outlined in 10 CFR Part 430, Subpart B, Appendix E.<sup>5</sup>

HPWH reject cold air. As such, they need to be installed in an unconditioned space of about 750 cubic feet with good ventilation<sup>6</sup>. Ideal locations are garages, large enclosed, unconditioned storage areas, or areas with excess heat such as a furnace or boiler room. The HPWH will also produce condensate so accommodations for draining the condensate need to be provided.

Most HPWH operate effectively down to an air temperature of 40 °F. Below that temperature, an electric resistance booster heater is typically required to achieve full heating capacity. It is critical that the HPWH controls are set up so that the electric resistance heat only engages when the air temperature is too cold for the HPWH to extract heat from it. HPWHs have a slow recovery. During periods of high demand, the electric resistance heating element, if enabled, may be energized to maintain set point, thus reducing the overall efficiency of the unit. It is recommended that a careful analysis of the hot water demand be conducted to determine if the application makes economic sense, and the HPWH heating capacity and storage are properly sized.

HPWH operate most effectively when the temperature difference between the incoming and outgoing water is high. Generally, this means that cold make-up water should be piped to the bottom of the tank and return water should be piped to the top of the tank to maintain stratification within the storage tank. Water should be drawn from the bottom of the tank to be heated. If there is a DHW recirculation pump, it should only be operated during high hot water demand periods.

<sup>5</sup> [https://www.energy.gov/sites/prod/files/2014/06/f17/rwh\\_tp\\_final\\_rule.pdf](https://www.energy.gov/sites/prod/files/2014/06/f17/rwh_tp_final_rule.pdf)

<sup>6</sup> <https://basc.pnnl.gov/code-compliance/heat-pump-water-heaters-code-compliance-brief#:~:text=HPWH%20must%20have%20unrestricted%20airflow,depending%20on%20size%20of%20system>



Switching from a gas fired water heater to a HPWH has the potential to reduce the sites overall greenhouse gas emissions. If the electricity for the HPWH is provided by an on-site photovoltaic (PV) system then there are essentially no greenhouse gas (GHG) emissions. A 2016 study conducted at Cornell<sup>7</sup> calculated the kg of methane (CH<sub>4</sub>) and carbon dioxide (CO<sub>2</sub>) produced per GJ of water heated. The study compared HPWH to gas and electric fired, storage and tankless water heaters. The study also considered electricity produced from natural gas and coal fired electric plants. In all cases the study found that HPWHs produced less methane than all of the other water heaters. The study also found that HPWH produced less carbon dioxide than electric resistance water heaters but more carbon dioxide than tankless gas water heaters and about the same amount of carbon dioxide as storage gas water heaters. The summary tables provide the reduction in CO<sub>2</sub> equivalent emissions based on the typical New Jersey electric utility.

This measure has a negative simple payback due to the relative cost of electricity to natural gas. At this site the cost per Btu for natural gas is significantly lower than for electricity. Therefore, even though this measure will result in a net energy savings in terms of Btu at this site it will increase the overall cost for providing domestic hot water.

**Affected Units:** community center 85-gallon Rheem DHW heater

#### 4.11 Measures for Future Consideration

There are additional opportunities for improvement that Verona Township may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment, and/or include significant system reconfiguration. These measure(s) are therefore beyond the scope of this energy audit. These measure(s) are described here to support a whole building approach to energy efficiency and sustainability.

Verona Township may wish to consider the Energy Savings Improvement Program (ESIP) or other whole building approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to:

- Evaluate these measures further.
- Develop firm costs.
- Determine measure savings.
- Prepare detailed implementation plans.

Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

#### **Upgrade to a Heat Pump System**

Electric resistance heating units work by passing an electric current through wires to heat them. The system is 100% efficient since for every unit of electricity consumed, one unit of heat is produced.

---

<sup>7</sup> [Greenhouse gas emissions from domestic hot water: Heat pumps compared to most commonly used systems. Bongghi Hong, Robert W. Howarth. Department of Ecology and Evolutionary Biology, Cornell University. Energy Science and Engineering 2016.](#)

But there is a way to convert electricity to create heat at better than a 1:1 ratio. Heat pumps operate on a more efficient principle, the refrigeration cycle. Instead of directly converting electricity to heat, electricity does the work, via a compressor, of moving refrigerant through a system that transfers heat from a cooler place to a warmer place. That system can move three to five as much energy as is available using electric resistance heating methods. Heat pumps work in a similar manner to an air conditioner, except they reverse the cooling process to circulate warm air instead of cold air. Also, heat pumps are generally capable of dispensing refrigerated air as they can typically be operated in air conditioning mode.

An electric furnace or boiler has no flue loss through a chimney. The AFUE rating for an all-electric furnace or boiler is between 95% and 100%. The lower values are for units installed outdoors because they have greater jacket heat loss. However, despite their high efficiency, the higher cost of electricity in most parts of the country makes all-electric furnaces or boilers an uneconomic choice. If you are interested in electric heating, consider installing a heat pump system.

Electric resistance heat, including electric furnaces and baseboard heaters, can be inexpensive to install but often expensive to run. Facilities with these systems can save substantial energy at a moderate cost by installing a heat pump when they replace a central air conditioner.

Even in buildings without central air-conditioning, there are opportunities to save energy when an existing electric furnace needs to be replaced, as well as opportunities to install ductless electric heat pumps in buildings with baseboard electric heaters and electric fan coils. Unit ventilators with built-in electric resistance heaters can be replaced with unit ventilators with integrated heat pumps.

Electric heat pumps have high coefficient of performance (COP) ratings and are substantially more efficient than traditional electric heating systems. Further investigation is required to determine whether installing a heat pump system is a cost-effective solution when replacing existing electrical heating systems.

### **VRF Systems**

Consider variable refrigerant flow (VRF) systems as part of a comprehensive package unit upgrade project. (VRF systems use direct expansion (DX) heat pumps to transport heat between an outdoor condensing unit and a network of indoor evaporators, located near or within the conditioned space, through refrigerant piping installed in the building. Attributes that distinguish VRF from other DX system types are:

- Multiple indoor units connected to a common outdoor unit
- Scalability
- Variable capacity
- Distributed control
- Simultaneous heating and cooling capability

VRF provides flexibility by allowing for many different indoor units (with different capacities and configurations), individual zone control, the unique ability to offer simultaneous heating and cooling in separate zones on a common refrigerant circuit, and heat recovery from one zone to another. VRF systems are equipped with at least one variable-speed and/or variable-capacity compressor.

To match the building's load profiles, energy is transferred from one indoor space to another through the refrigerant line, and only one energy source is necessary to provide both heating and cooling. VRF systems also operate efficiently at part load because of the compressor's variable capacity control. VRF systems are ideal for applications with varying loads or where zoning is required. Some other advantages of VRF systems include consistent comfort, quiet operation, energy efficiency, installation flexibility, zoned heating and cooling, state-of-the-art controls, and reliability.



VRF systems are more expensive than conventional heat pump systems; however, the higher initial cost can be offset by improved cooling efficiency during part load operation—a SEER (cooling) rating of 18.0 is not uncommon for small packaged VRF-equipped heat pumps.

When you are replacing packaged HVAC equipment, we recommend a comprehensive approach. Work with your contractor or design engineer to make sure your systems are sized and zoned according to current space configurations and occupancy. Select high efficiency equipment and controls that match your heating and cooling needs. Commission the system and controls to ensure proper operation, comfort, ventilation, and energy use.

## 5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5%–20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Energy Tracking with ENERGY STAR Portfolio Manager**



You've heard it before—you cannot manage what you do not measure. ENERGY STAR Portfolio Manager is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions<sup>8</sup>. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

### **Weatherization**

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. Materials used may include caulk, polyurethane foam, and other weather-stripping materials. There is an energy savings opportunity by reducing the uncontrolled air exchange between the outside and inside of the building. Blower door assisted comprehensive building air sealing will reduce the amount of air exchange, which will in turn reduce the load on the buildings heating and cooling equipment, providing energy savings and increased occupant comfort.

### **Doors and Windows**

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

### **Window Treatments/Coverings**

Use high-reflectivity films or cover windows with shades or shutters to reduce solar heat gain and reduce the load on cooling and heating systems. Older, single-pane windows and east- or west-facing windows are especially prone to solar heat gain. In addition, use shades or shutters at night during cold weather to reduce heat loss.

---

<sup>8</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>

## **Lighting Maintenance**



Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.

In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

## **Lighting Controls**

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly. Adjust exterior lighting time clock controls seasonally as needed to match your lighting requirements.

## **Motor Maintenance**

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

## **Thermostat Schedules and Temperature Resets**



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5°F-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

## **AC System Evaporator/Condenser Coil Cleaning**

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

## **HVAC Filter Cleaning and Replacement**

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less, and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

## **Ductwork Maintenance**

Duct maintenance has two primary goals: keep the ducts clean to avoid air quality problems and seal leaks to save energy. Check for cleanliness, obstructions that block airflow, water damage, and leaks. Ducts should be inspected at least every two years.

The biggest symptoms of clogged air ducts are differing temperatures throughout the building and areas with limited airflow from supply registers. If a particular air duct is clogged, then air flow will only be cut off to some rooms in the building—not all of them. The reduced airflow will make it more difficult for those areas to reach the temperature setpoint, which will cause the HVAC system to run longer to cool or heat that area properly. If you suspect clogged air ducts, ensure that all areas in front of supply registers are clear of items that may block or restrict air flow, and you should check for fire dampers or balancing dampers that have failed closed.

Duct leakage in commercial buildings can account for 5%–25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Check ductwork for leakage. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.

Distribution system losses are dependent on air system temperature, the size of the distribution system, and the level of insulation of the ductwork. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is missing or worn, the system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

## **Boiler Maintenance**

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely and efficiently. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the boiler tubes to improve heat transfer.

## **Label HVAC Equipment**

For improved coordination in maintenance practices, we recommend labeling or re-labeling the site HVAC equipment. Maintain continuity in labeling by following labeling conventions as indicated in the facility drawings or BAS building equipment list. Use weatherproof or heatproof labeling or stickers for permanence, but do not cover over original equipment nameplates, which should be kept clean and readable whenever possible. Besides equipment, label piping for service and direction of flow when possible. Ideally, maintain a log of HVAC equipment, including nameplate information, asset tag designation, areas served, installation year, service dates, and other pertinent information.

This investment in your equipment will enhance collaboration and communication between your staff and your contracted service providers and may help you with regulatory compliance.

## **Optimize HVAC Equipment Schedules**

Energy management systems (BAS) typically provide advanced controls for building HVAC systems, including chillers, boilers, air handling units, rooftop units and exhaust fans. The BAS monitors and reports operational status, schedules equipment start and stop times, locks out equipment operation based on outside air or space temperature, and often optimizes damper and valve operation based on complex algorithms. These BAS features, when in proper adjustment, can improve comfort for building occupants and save substantial energy.

Know your BAS scheduling capabilities. Regularly monitor HVAC equipment operating schedules and match them to building operating hours to eliminate unnecessary equipment operation and save energy. Monitoring should be performed often at sites with frequently changing usage patterns – daily in some cases. We recommend using the optimal start feature of the BAS (if available) to optimize the building warmup sequence. Most BAS scheduling programs provide for holiday schedules, which can be used during reduced use or shutdown periods. Finally, many systems are equipped with a one-time override function, which can be used to provide additional space conditioning due to a one-time, special event. When available this override feature should be used rather than changing the base operating schedule.

### **Water Heater Maintenance**

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues, and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

### **Procurement Strategies**

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR products where available.

## 6 WATER BEST PRACTICES

### **Getting Started**



The commercial and institutional sector is the second largest consumer of publicly supplied water in the United States, accounting for 17% of the withdrawals from public water supplies<sup>9</sup>. In New Jersey, excluding water used for power generation, approximately 80% of total water use was attributed to potable supply during the period of 2009 to 2018. Water withdrawals for potable supply have not changed noticeably during the period from 1990 to 2018<sup>10</sup>.

Water management planning serves as the foundation for any successful water reduction effort. It is the first step a commercial or institutional facility owner or manager should take to achieve and sustain long-term water savings. Understanding how water is used within a facility is critical for the water management planning process. A water assessment provides a comprehensive account of all known water uses at the facility. It allows the water management team to establish a baseline from which progress and program success can be measured. It also enables the water management team to set achievable goals and identify and prioritize specific projects based on the relative savings opportunities and project cost-effectiveness.

Water conservation devices may significantly reduce your water and sewer usage costs. Any reduction in water use reduces grid-level electricity use since a significant amount of electricity is used to treat and deliver water from reservoirs to end users.

For more information regarding water conservation or additional details regarding the practices shown below go to the EPA's WaterSense website<sup>11</sup> or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"<sup>12</sup> to get ideas for creating a water management plan and best practices for a wide range of water using systems.

### **Water Metering and Submetering**

Tracking a facility's total water use, as well as specific end uses, is a key component of a facility's water-efficiency efforts. Accurately measuring water use can help facility managers identify areas for targeted reductions and track progress from water-efficiency upgrades. If possible, install meters to measure all water conveyed to the facility, regardless of the source. Each source should be metered separately. Consider developing a metering plan and installing separate submeters to measure specific end uses. There are many types and sizes of meters intended for different uses. Installing the correct type and size of meter are critical to accurate water measurement. Sub-metering applications may include:

- Individual tenant spaces
- Cooling tower make-up and blowdown water supply
- Water lines serving other HVAC systems including water circulating loops
- Make up water supply for steam boiler plants with a capacity of 500,000 Btu/hr. or greater
- Systems or equipment that use single pass cooling water
- Irrigation systems

<sup>9</sup> Estimated from analyzing data in: [Solley, Wayne B., et al, "Estimated Use of Water in the United States in 1995", U.S Geological Survey Circular 1200, \(1998\)](#)

<sup>10</sup> <https://dep.nj.gov/wp-content/uploads/dsr/trends-water-supply.pdf>

<sup>11</sup> <https://www.epa.gov/watersense>

<sup>12</sup> <https://www.epa.gov/watersense/watersense-work-0>



- Roof spray systems (for irrigating vegetated roofs or thermal conditioning)
- Ornamental water features
- Indoor and outdoor pools and spas
- Industrial water using processes

### **Leak Detection and Repair**

Identifying and repairing leaks and other water use anomalies within a facility's water distribution system or from processes or equipment can keep a facility from wasting significant quantities of water. Examples of common leaks include leaking toilets and faucets, drip irrigation malfunctions, stuck float valves, and broken distribution lines. Reading meters, installing failure abatement technologies, and conducting visual and auditory inspections are important best practices to detect leaks. Train building occupants, employees, and visitors to report any leaks that they detect. To reduce unnecessary water loss, detected leaks should be repaired quickly. Repairing leaks in water distribution that is pressurized by on-site pumps or in heated or chilled water piping will also reduce energy use.

### **Toilets and Urinals**

Toilets and urinals are considered sanitary fixtures and are found in most facilities. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously flushing, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment and the frequency of use, it may be cost effective to replace older inefficient fixtures with current generation WaterSense labeled equipment.

Commercial facilities typically use tank toilets or wall-mount flushometers. Educate and inform users with restroom signage and other means to avoid flushing inappropriate objects. For tank toilets, periodically check to ensure fill valves are working properly and that water level is set correctly. Annually test toilets to ensure the flappers are not worn or allowing water to seep from the tank into the bowl and down the sewer. Control stops and piston valves on flushometer toilets should be checked at least annually.

Most urinals use water to flush liquid. These standard single-user fixtures are present in most facilities. Non-water urinals use a specially designed trap that allows liquid waste to drain out of the fixture through a trap seal, and into the drainage system. Flushing urinals should be inspected at least annually for proper valve and sensor operation. For non-water urinals, follow maintenance practices as directed by the manufacturer to ensure products perform as expected. Non-water urinals can be considered during urinal replacement, however, review the condition and design of the existing plumbing system and the expected usage patterns to ensure that these products will provide the anticipated performance.

### **Faucets and Showerheads**

Faucets and showerheads are sanitary fixtures that generally dispense heated water. Reducing water use by these fixtures translates into a reduction of site fuel or electric use depending on how water is heated. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously dripping, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment and the frequency of use, it may be cost effective to replace older fixtures with current generation WaterSense labeled equipment.

Faucets are used for a variety of purposes, and standard flow rates are dictated by the intended use. Public use lavatory faucets and kitchen faucets are subject to maximum flow rates while service sinks are not. Periodically inspect faucet aerators for scale buildup to ensure flow is not being restricted. Clean or replace the aerator or other spout end device as needed. Check and adjust automatic sensors (where

installed) to ensure they are operating properly to avoid faucets running longer than necessary. Post materials in restrooms and kitchens to ensure user awareness of the facility's water-efficiency goals. Remind users to turn off the tap when they are done and to consider turning the tap off during sanitation activities when it is not being used. Consider installing lavatory and kitchen faucet fixtures with reduced flow. Federal standards limit kitchen and restroom faucet flows to 2.2 gpm. To qualify for a WaterSense label a faucet cannot exceed 1.5 gpm.

Effective in 1992, the maximum allowable flow rate for all showerheads sold in the United States is 2.5 gpm. Since this standard was enacted, many showerheads have been designed to use even less water. WaterSense labeled equipment is designed to use 2.0 gpm, or less. For optimum showerhead efficiency, the system pressure should be tested to make sure that it is between 20 and 80 pounds per square inch (psi). Verify that plumbing lines are routed through a shower valve to prevent water pressure fluctuations. Periodically inspect showerheads for scale buildup to ensure flow is not being restricted. In general, replace showerheads with 2.5 gpm flow rates or higher with WaterSense labeled models. Note: Use of poor performing replacement reduced flow showerheads may result in increased use if the duration of use is increased to compensate for reduced performance. WaterSense labeled showerheads are independently certified to meet or exceed minimum performance requirements for spray coverage and force.

## 7 ON-SITE GENERATION

---

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


## 7.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building’s electrical distribution system.

A preliminary screening based on the facility’s electric demand, size and location of free area, and shading elements shows that the facility has high potential for installing a PV array.

The amount of free area, ease of installation (location), and the lack of shading elements contribute to the high potential. A PV array located on the roof may be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

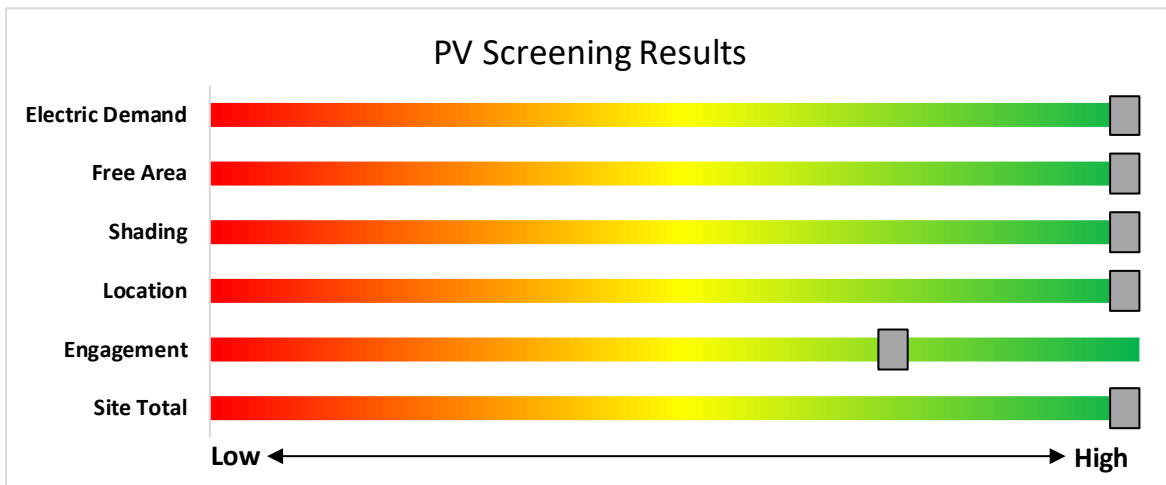

| Potential                  | High      |           |
|----------------------------|-----------|-----------|
| <b>System Potential</b>    | 107       | kW DC STC |
| <b>Electric Generation</b> | 127,477   | kWh/yr    |
| <b>Displaced Cost</b>      | \$27,970  | /yr       |
| <b>Installed Cost</b>      | \$278,200 |           |

*Photovoltaic Screening*

### **Successor Solar Incentive Program (SuSI)**

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners must register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- ◆ **Successor Solar Incentive Program (SuSI):** <https://www.njcleanenergy.com/renewable-energy/programs/susi-program>
- ◆ **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- ◆ **NJ Solar Market FAQs:** [www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs](http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs)
- ◆ **Approved Solar Installers in the NJ Market:** [http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/?id=60&start=1](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1)

## 7.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.


CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

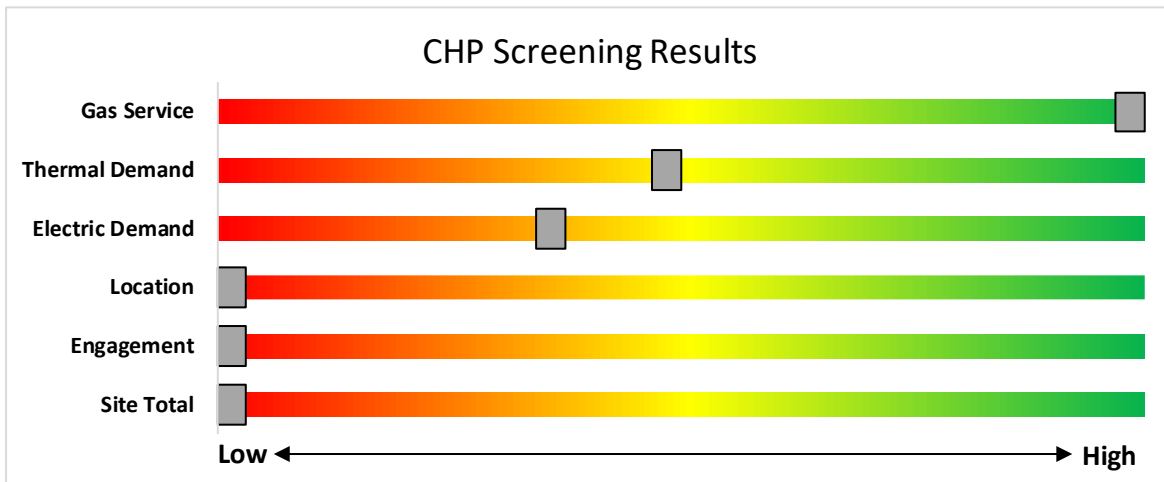

*Combined Heat and Power Screening*

Find a qualified firm that specializes in commercial CHP cost assessment and installation: [http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/)

## 8 ELECTRIC VEHICLES

All electric vehicles (EVs) have an electric motor instead of an internal combustion engine. EVs function by plugging into a charge point, taking electricity from the grid, and then storing it in rechargeable batteries. Although electricity production may contribute to air pollution, the U.S. EPA categorizes all electric vehicles as zero-emission vehicles because they produce no direct exhaust or tailpipe emissions.

EVs are typically more expensive than similar conventional and hybrid vehicles, although some cost can be recovered through fuel savings, federal tax credit, or state incentives

### 8.1 EV Charging

EV charging stations provide a means for electric vehicle operators to recharge their batteries at a facility. While many EV drivers charge at home, others do not have access to regular home charging, and the ability to charge at work or in public locations is critical to making EVs practical for more drivers. Charging can also be used for electric fleet vehicles, which can reduce fuel and maintenance costs for fleets that replace gas or diesel vehicles with EVs.

EV charging comes in three main types. For this assessment, the screening considers addition of Level 2 charging, which is most common at workplaces and other public locations. Depending on the site type and usage, other levels of charging power may be more appropriate.


The preliminary assessment of EV charging at the facility shows that there is medium potential for adding EV chargers to the facility's parking, based on potential costs of installation and other site factors.

The primary costs associated with installing EV charging are the charger hardware and the cost to extend power from the facility to parking spaces. This may include upgrades to electric panels to serve increased loads.


The type and size of the parking area impact the costs and feasibility of adding EV charging. Parking structure installations can be less costly than surface lot installations as power may be readily available, and equipment and wiring can be surface mounted. Parking lot installations often require trenching through concrete or asphalt surface. Large parking areas provide greater flexibility in charger siting than smaller lots.

The location and capacity of facility electric panels also impact charger installation costs. A Level 2 charger generally requires a dedicated 208-240V, 40 Amp circuit. The electric panel nearest the planned installation may not have available capacity and may need to be upgraded to serve new EV charging loads. Alternatively, chargers could be powered from a more distant panel. The distance from the panel to the location of charging stations ties directly to costs, as conduits, cables, and potential trenching costs all increase on a per-foot basis. The more charging stations planned, the more likely it is that additional electrical capacity will be needed.

Other factors to consider when planning for EV charging at a facility include who the intended users are, how long they park vehicles at the site, and whether they will need to pay for the electricity they use.

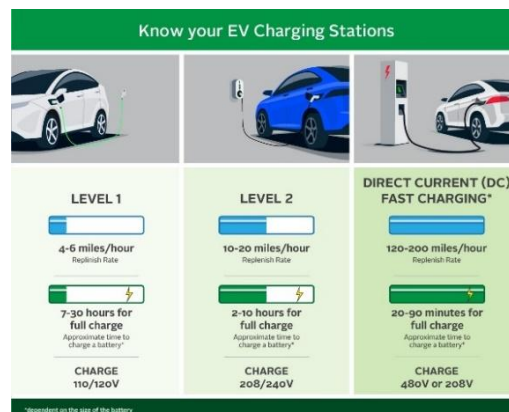

The graphic below displays the results of the EV charging assessment conducted as part of this audit. The position of each slider indicates the impact each factor has on the feasibility of installing EV charging at the site.

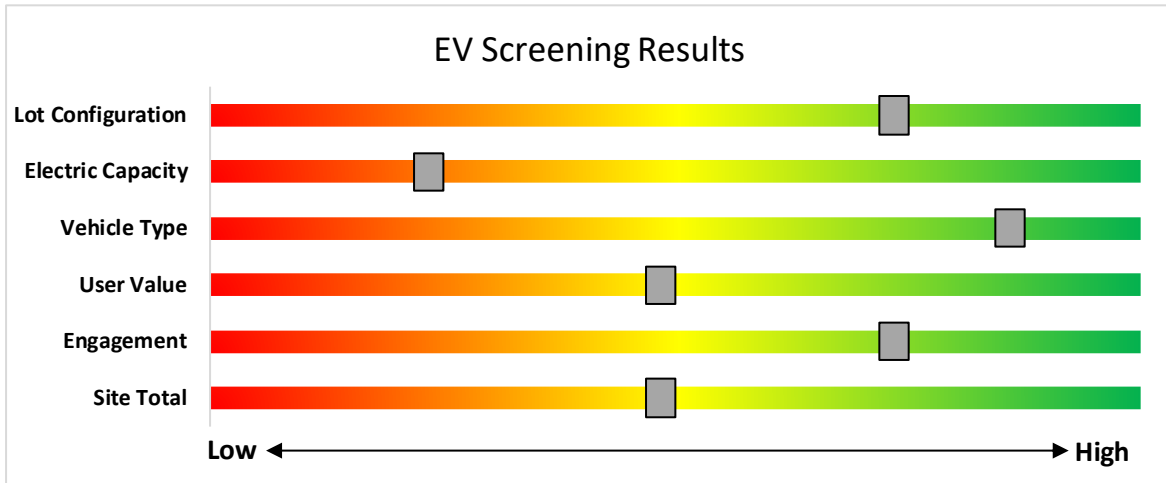

EV Charger Screening

### Electric Vehicle Programs Available

New Jersey is leading the way on electric vehicle (EV) adoption on the East Coast. There are several programs designed to encourage EV adoption in New Jersey, which is crucial to reaching a 100% clean energy future.

NJCEP offers a variety of EV programs for vehicles, charging stations, and fleets. Certain EV charging stations that receive electric utility service from Atlantic City Electric Company (ACE), Public Service Electric and Gas Company (PSE&G) or Jersey Central Power and Light (JCP&L), may be eligible for additional electric vehicle charging incentives directly from the utility. Projects may be eligible for both the incentives offered by this BPU program and incentives offered by ACE, PSE&G or JCP&L, up to 90% of the combined charger purchase and installation costs. Please check ACE, PSE&G or JCP&L program eligibility requirements before purchasing EV charging equipment, as additional conditions on types of eligible chargers may apply for utility incentives.

EV Charging incentive information is available from Atlantic City Electric, PSE&G and JCP&L. For more information and to keep up to date on all EV programs please visit <https://www.njcleanenergy.com/commercial-industrial/programs/electric-vehicle-programs>



## 9 PROJECT FUNDING AND INCENTIVES

Ready to improve your building’s performance? New Jersey’s Clean Energy Programs and Utility Energy Efficiency Programs can help. Pick the program that works best for you. This section provides an overview of currently available incentive programs in New Jersey.

### NJBPU and NJCEP Administered Programs



- New Construction (residential, commercial, industrial, government)
  - Large Energy Users
  - Energy Savings Improvement Program (financing)
  - State Facilities Initiative\*
  - Local Government Energy Audits
  - Combined Heat & Power & Fuel Cells
- \*State facilities are also eligible for utility programs

### Utility Administered Programs



- Existing buildings (residential, commercial, industrial, government)
- Efficient Products
  - Lighting & Marketplace
  - HVAC
  - Appliance Rebates
  - Appliance Recycling

## 9.1 New Jersey's Clean Energy Program

Save money while saving the planet! New Jersey's Clean Energy Program is a statewide program that offers incentives, programs, and services that benefit New Jersey residents, businesses, educational, non-profit, and government entities to help them save energy, money, and the environment.

### Large Energy Users

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers. To qualify entities must have incurred at least \$5 million in total energy costs in the prior fiscal year.

#### **Incentives**

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually

#### **How to Participate**

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEED). Once the FEED is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at <http://www.njcleanenergy.com/LEUP>.

## Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation. ≤

### Incentives<sup>13</sup>

| Eligible Technology   | Size (Installed Rated Capacity) | Incentive (\$/Watt) <sup>5</sup> | % of Total Cost Cap per Project | \$ Cap per Project |
|---|---------------------------------|----------------------------------|---------------------------------|--------------------|
| CHPs powered by non-renewable or renewable fuel source, or a combination: <sup>4</sup><br>- Gas Internal Combustion Engine<br>- Gas Combustion Turbine<br>- Microturbine  | ≤500 kW <sup>1</sup>            | \$2.00                           | 30-40% <sup>2</sup>             | \$2 million        |
|   | >500 kW - 1 MW <sup>1</sup>     | \$1.00                           |                                 |                    |
|   | > 1 MW - 3 MW <sup>1</sup>      | \$0.55                           | 30%                             | \$3 million        |
|   | >3 MW <sup>1</sup>              | \$0.35                           |                                 |                    |
| Fuel Cells ≥60%   | Same as above <sup>1</sup>      | Applicable amount above          | 30%                             | \$1 million        |
| Waste Heat to Power (WHP) <sup>3</sup><br>Powered by non-renewable fuel source. Heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine) | ≤1MW <sup>1</sup>               | \$1.00                           | 30%                             | \$2 million        |
|   | > 1MW <sup>1</sup>              | \$.50                            | 30%                             | \$3 million        |

<sup>13</sup>

<sup>1</sup> Incentives are tiered, which means the incentive levels vary based upon the installed rated capacity, as listed in the chart above. For example, a 4 MW CHP system would receive \$2.00/watt for the first 500 kW, \$1.00/watt for the second 500 kW, \$0.55/watt for the next 2 MW and \$0.35/watt for the last 1 MW (up to the caps listed).

<sup>2</sup> The maximum incentive will be limited to 30% of total project. For CHP projects up to 1 MW, this cap will be increased to 40% where a cooling application is used or included with the CHP system (e.g. absorption chiller).

<sup>3</sup> Projects will be eligible for incentives shown above, not to exceed the lesser of % of total project cost per project cap or maximum \$ per project cap. Projects installing CHP or FC with WHP will be eligible for incentive shown above, not to exceed the lesser caps of the CHP or FC incentive. Minimum efficiency will be calculated based on annual total electricity generated, utilized waste heat at the host site (i.e. not lost/rejected), and energy input.

<sup>4</sup> Systems fueled by a Class 1 Renewable Fuel Source, as defined by N.J.A.C. 14:8-2.5, are eligible for a 30% incentive bonus. If the fuel is mixed, the bonus will be prorated accordingly. For example, if the mix is 60/40 (60% being a Class 1 renewable), the bonus will be 18%. This bonus will be included in the final performance incentive payment, based on system performance and fuel mix consumption data. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.

<sup>5</sup> CHP-FC systems located at Critical Facility and incorporating blackstart and islanding technology are eligible for a 25% incentive bonus. This bonus incentive will be paid with the second/Installation incentive payment. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.



### **How to Participate**

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at <http://www.njcleanenergy.com/CHP>.

## Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects must register their projects prior to the start of construction to establish the project’s eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two sub-programs. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

### **Administratively Determined Incentive (ADI) Program**

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

| Market Segments  | Size MW dc                 | Incentive Value (\$/SREC II) | Public Entities Incentive Value - \$20 Adder (\$/SRECII) |
|--|----------------------------|------------------------------|--|
| Net Metered Residential  | All types and sizes        | \$90                         | N/A  |
| Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar | Projects smaller than 1 MW | \$100                        | \$120  |
| Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar | Projects 1 MW to 5 MW      | \$90                         | \$110  |
| Small Net Metered Non-Residential Ground Mount   | Projects smaller than 1 MW | \$85                         | \$105  |
| Large Net Metered Non-Residential Ground Mount   | Projects 1 MW to 5 MW      | \$80                         | \$100  |
| LMI Community Solar  | Up to 5 MW                 | \$90                         | N/A  |
| Non-LMI Community Solar  | Up to 5 MW                 | \$70                         | N/A  |
| Interim Subsection (t)   | All types and sizes        | \$100                        | N/A  |

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations.

### **Competitive Solar Incentive (CSI) Program**

The CSI Program opened on April 15, 2023, and will serve as the permanent program within the SuSI Program providing incentives to larger solar facilities. The CSI Program is open to qualifying grid supply solar facilities, non-residential net metered solar installations with a capacity greater than five (5) megawatts (“MW”), and to eligible grid supply solar facilities installed in combination with energy storage.

CSI eligible facilities will only be allowed to register in the CSI program upon award of a bid pursuant to N.J.A.C. 14:8-11.10.

The CSI program structure has separate categories, or tranches, to ensure that a range of solar project types, including those on preferred sites, are able to participate despite potentially different project cost profiles. The Board has approved four tranches for grid supply and large net metered solar and an additional fifth tranche for storage in combination with grid supply solar. The following table lists procurement targets for the first solicitation:

| Tranche    | Project Type                                    | MW (dc) Targets |
|------------|---|-----------------|
| Tranche 1. | Basic Grid Supply                               | 140             |
| Tranche 2. | Grid Supply on the Built Environment            | 80              |
| Tranche 3. | Grid Supply on Contaminated Sites and Landfills | 40              |
| Tranche 4. | Net Metered Non- Residential                    | 40              |
| Tranche 5. | *Storage Paired with Grid                       | 160 MWh         |

\*The storage tranche of 160 MWh corresponds to a 4-hour storage pairing of 40 MW of solar

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state's Energy Master Plan.

If you are considering installing solar on your building, visit the following link for more information: <https://njcleanenergy.com/renewable-energy/programs/susi-program>

## Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

### **How to Participate**

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at [www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

*ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.*

## Demand Response (DR) Energy Aggregator

Demand Response Energy Aggregator is a program designed to reduce the electric load when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Grid operators call upon curtailment service providers and commercial facilities to reduce electric usage during times of peak demand, making the grid more reliable and reducing transmission costs for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary, and participants receive payments whether or not their facility is called upon to curtail its electric usage.

Typically, an electric customer must be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with greater capability to quickly curtail their demand during peak hours receive higher payments. Customers with back-up generators on site may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in DR programs often find it to be a valuable source of revenue for their facility, because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature setpoints on thermostats (so that air conditioning units run less frequently) or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a DR activity in most situations.

The first step toward participation in a DR program is to contact a curtailment service provider. A list of these providers is available on the website of the independent system operator, PJM, and it includes contact information for each company, as well as the states where they have active business<sup>14</sup>. PJM also posts training materials for program members interested in specific rules and requirements regarding DR activity along with a variety of other DR program information<sup>15</sup>.

Curtailment service providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities, and they may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

---

<sup>14</sup> <http://www.pjm.com/markets-and-operations/demand-response.aspx>.

<sup>15</sup> <http://www.pjm.com/training/training-events.aspx>.



## 9.2 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey's investor-owned gas and electric utilities to reduce their customers' use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

### Prescriptive and Custom

The Prescriptive and Custom rebate program through your utility provider offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

#### **Equipment Examples**

*Lighting*

*Lighting Controls*

*HVAC Equipment*

*Refrigeration*

*Gas Heating*

*Gas Cooling*

*Commercial Kitchen Equipment*

*Food Service Equipment*

*Variable Frequency Drives*

*Electronically Commutate Motors*

*Variable Frequency Drives*

*Plug Loads Controls*

*Washers and Dryers*

*Agricultural*

*Water Heating*

The Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type. The Custom program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives.

### Direct Install

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW or less over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

#### **Incentives**

The program pays up to 70% of the total installed cost of eligible measures.

#### **How to Participate**

To participate in Direct Install, you will work with a participating contractor. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the Direct Install program, subject to program rules and eligibility, while the remaining percent of the cost is paid to the contractor by the customer.



## Engineered Solutions


The Engineered Solutions Program provides tailored energy-efficiency assistance and services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. Customers receive expert guided services, including investment-grade energy auditing, engineering design, installation assistance, construction administration, commissioning, and measurement and verification (M&V) services to support the implementation of cost-effective and comprehensive efficiency projects. Engineered Solutions is generally a good option for medium to large sized facilities with a peak demand over 200 kW looking to implement as many measures as possible under a single project to achieve deep energy savings. Engineered Solutions has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Incentives for this program are based on project scope and energy savings achieved.

---

For more information on any of these programs, contact your local utility provider or visit <https://www.njcleanenergy.com/transition>.

## 10 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

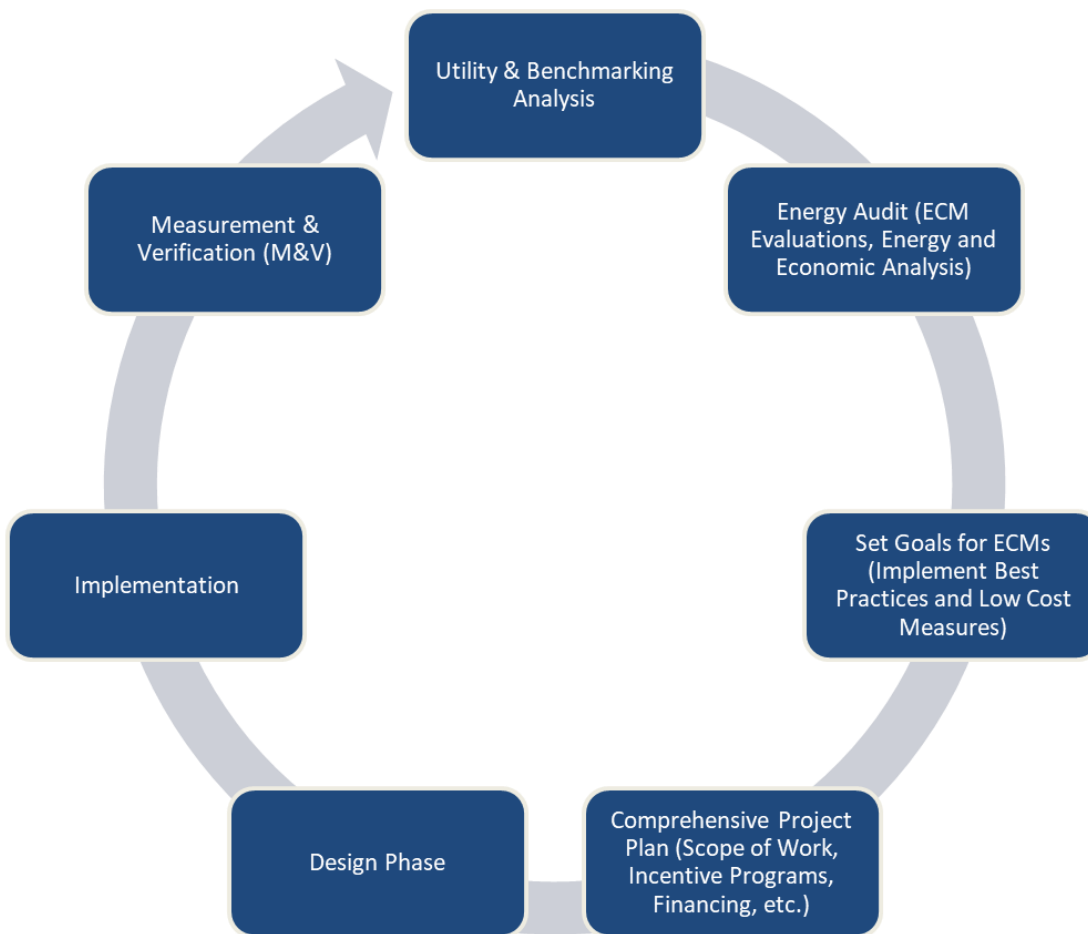

*Project Development Cycle*

## 11 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 11.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website<sup>16</sup>.

### 11.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website<sup>17</sup>.

---

<sup>16</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html)

<sup>17</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html)

# APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

## Lighting Inventory & Recommendations

| Location                      | Existing Conditions |   |                |             |                   |                        | Proposed Conditions |                        |               |                  |   |                  |                   |                        | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|-------------------------------|---------------------|---|----------------|-------------|-------------------|------------------------|---------------------|------------------------|---------------|------------------|---|------------------|-------------------|------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|                               | Fixture Quantity    | Fixture Description                     | Control System | Light Level | Watts per Fixture | Annual Operating Hours | ECM #               | Fixture Recommendation | Add Controls? | Fixture Quantity | Fixture Description                     | Control System   | Watts per Fixture | Annual Operating Hours | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| 1st floor Mechanical          | 6                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch    | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 6                | LED - Linear Tubes: (2) 4' Lamps        | Occupancy Sensor | 29                | 1,518                  | 0.0                                | 128                      | 0                          | \$28                             | \$330                   | \$40             | 10.4                                  |
| Activities Room               | 10                  | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch    | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 10               | LED - Linear Tubes: (2) 4' Lamps        | Occupancy Sensor | 29                | 1,518                  | 0.1                                | 214                      | 0                          | \$46                             | \$330                   | \$40             | 6.2                                   |
| AV Room                       | 2                   | LED - Linear Tubes: (4) 4' Lamps        | Wall Switch    | S           | 58                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Linear Tubes: (4) 4' Lamps        | Occupancy Sensor | 58                | 1,518                  | 0.0                                | 85                       | 0                          | \$19                             | \$150                   | \$20             | 7.0                                   |
| Ballroom                      | 4                   | LED Lamps: (10) 4.5W A17 Screw-In Lamps | Wall Switch    | S           | 45                | 2,200                  |                     | None                   | No            | 4                | LED Lamps: (10) 4.5W A17 Screw-In Lamps | Wall Switch      | 45                | 2,200                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Ballroom                      | 9                   | LED Lamps: (1) 7.5W A19 Screw-In Lamp   | Wall Switch    | S           | 8                 | 2,200                  |                     | None                   | No            | 9                | LED Lamps: (1) 7.5W A19 Screw-In Lamp   | Wall Switch      | 8                 | 2,200                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Ballroom                      | 37                  | LED - Fixtures: Cove Mount              | Wall Switch    | S           | 13                | 2,200                  | 3                   | None                   | Yes           | 37               | LED - Fixtures: Cove Mount              | Occupancy Sensor | 13                | 1,518                  | 0.1                                | 354                      | 0                          | \$77                             | \$990                   | \$110            | 11.4                                  |
| Ballroom                      | 16                  | LED - Linear Tubes: (1) 4' Lamp         | Wall Switch    | S           | 15                | 2,200                  |                     | None                   | No            | 16               | LED - Linear Tubes: (1) 4' Lamp         | Wall Switch      | 15                | 2,200                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Building and Zoning Office    | 12                  | LED - Fixtures: Linear Strip            | Wall Switch    | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 12               | LED - Fixtures: Linear Strip            | Occupancy Sensor | 18                | 1,518                  | 0.1                                | 159                      | 0                          | \$35                             | \$330                   | \$40             | 8.4                                   |
| Coat Room                     | 4                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch    | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 4                | LED - Linear Tubes: (2) 4' Lamps        | Occupancy Sensor | 29                | 1,518                  | 0.0                                | 85                       | 0                          | \$19                             | \$330                   | \$40             | 15.6                                  |
| Conference Room               | 10                  | LED Lamps: (1) 7.5W A19 Screw-In Lamp   | Wall Switch    | S           | 8                 | 2,200                  | 3                   | None                   | Yes           | 10               | LED Lamps: (1) 7.5W A19 Screw-In Lamp   | Occupancy Sensor | 8                 | 1,518                  | 0.0                                | 55                       | 0                          | \$12                             | \$330                   | \$40             | 24.2                                  |
| Conference Room               | 6                   | LED - Fixtures: Linear Strip            | Wall Switch    | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 6                | LED - Fixtures: Linear Strip            | Occupancy Sensor | 18                | 1,518                  | 0.0                                | 80                       | 0                          | \$17                             | \$330                   | \$40             | 16.8                                  |
| Corridor - Ballroom           | 4                   | LED - Fixtures: Linear Strip            | Wall Switch    | S           | 18                | 2,200                  | 4                   | None                   | Yes           | 4                | LED - Fixtures: Linear Strip            | High/Low Control | 18                | 1,518                  | 0.0                                | 53                       | 0                          | \$12                             | \$280                   | \$140            | 12.1                                  |
| Corridor - Recreation         | 4                   | Exit Signs: LED - 2 W Lamp              | None           |             | 6                 | 8,760                  |                     | None                   | No            | 4                | Exit Signs: LED - 2 W Lamp              | None             | 6                 | 8,760                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Corridor - Recreation         | 4                   | LED - Fixtures: Linear Strip            | Wall Switch    | S           | 18                | 2,200                  | 4                   | None                   | Yes           | 4                | LED - Fixtures: Linear Strip            | High/Low Control | 18                | 1,518                  | 0.0                                | 53                       | 0                          | \$12                             | \$280                   | \$140            | 12.1                                  |
| Corridor - Recreation Storage | 2                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch    | S           | 29                | 2,200                  | 4                   | None                   | Yes           | 2                | LED - Linear Tubes: (2) 4' Lamps        | High/Low Control | 29                | 1,518                  | 0.0                                | 43                       | 0                          | \$9                              | \$280                   | \$70             | 22.6                                  |
| Corridor - Zoning             | 1                   | LED - Fixtures: Linear Strip            | None           |             | 18                | 2,200                  |                     | None                   | No            | 1                | LED - Fixtures: Linear Strip            | None             | 18                | 2,200                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Corridor - Zoning             | 2                   | LED - Fixtures: Linear Strip            | Wall Switch    | S           | 18                | 2,200                  |                     | None                   | No            | 2                | LED - Fixtures: Linear Strip            | Wall Switch      | 18                | 2,200                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Corridor Fireman's            | 2                   | LED - Fixtures: Linear Strip            | Wall Switch    | S           | 18                | 2,200                  |                     | None                   | No            | 2                | LED - Fixtures: Linear Strip            | Wall Switch      | 18                | 2,200                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Fireman's Room                | 1                   | Exit Signs: LED - 2 W Lamp              | None           |             | 6                 | 8,760                  |                     | None                   | No            | 1                | Exit Signs: LED - 2 W Lamp              | None             | 6                 | 8,760                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Fireman's Room                | 12                  | LED - Fixtures: Linear Strip            | Wall Switch    | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 12               | LED - Fixtures: Linear Strip            | Occupancy Sensor | 18                | 1,518                  | 0.1                                | 159                      | 0                          | \$35                             | \$330                   | \$40             | 8.4                                   |
| Foyer                         | 1                   | LED Lamps: (10) 4.5W A17 Screw-In Lamps | Wall Switch    | S           | 45                | 2,200                  |                     | None                   | No            | 1                | LED Lamps: (10) 4.5W A17 Screw-In Lamps | Wall Switch      | 45                | 2,200                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Foyer                         | 6                   | LED - Fixtures: Cove Mount              | Wall Switch    | S           | 13                | 2,200                  | 3                   | None                   | Yes           | 6                | LED - Fixtures: Cove Mount              | Occupancy Sensor | 13                | 1,518                  | 0.0                                | 57                       | 0                          | \$12                             | \$330                   | \$40             | 23.2                                  |
| Gym AHU Room                  | 2                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch    | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Linear Tubes: (2) 4' Lamps        | Occupancy Sensor | 29                | 1,518                  | 0.0                                | 43                       | 0                          | \$9                              | \$150                   | \$20             | 14.0                                  |
| Gym First Aid Room            | 2                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch    | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Linear Tubes: (2) 4' Lamps        | Occupancy Sensor | 29                | 1,518                  | 0.0                                | 43                       | 0                          | \$9                              | \$150                   | \$20             | 14.0                                  |
| Gym Lobby                     | 1                   | Exit Signs: LED - 2 W Lamp              | None           |             | 6                 | 8,760                  |                     | None                   | No            | 1                | Exit Signs: LED - 2 W Lamp              | None             | 6                 | 8,760                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

| Location                      | Existing Conditions |                                  |                  |             |                   |                        | Proposed Conditions |                        |               |                  |                                  |                  | Energy Impact & Financial Analysis |                        |                       |                          |                            |                                  |                         |                  |                                       |
|-------------------------------|---------------------|----------------------------------|------------------|-------------|-------------------|------------------------|---------------------|------------------------|---------------|------------------|----------------------------------|------------------|------------------------------------|------------------------|-----------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|                               | Fixture Quantity    | Fixture Description              | Control System   | Light Level | Watts per Fixture | Annual Operating Hours | ECM #               | Fixture Recommendation | Add Controls? | Fixture Quantity | Fixture Description              | Control System   | Watts per Fixture                  | Annual Operating Hours | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Gym Lobby                     | 2                   | LED - Linear Tubes: (2) 4' Lamps | Wall Switch      | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29                                 | 1,518                  | 0.0                   | 43                       | 0                          | \$9                              | \$150                   | \$20             | 14.0                                  |
| Gym Mechanical Room           | 1                   | Exit Signs: LED - 2 W Lamp       | None             |             | 6                 | 8,760                  |                     | None                   | No            | 1                | Exit Signs: LED - 2 W Lamp       | None             | 6                                  | 8,760                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Gym Mechanical Room           | 7                   | LED - Linear Tubes: (2) 4' Lamps | Wall Switch      | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 7                | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29                                 | 1,518                  | 0.1                   | 150                      | 0                          | \$32                             | \$330                   | \$40             | 8.9                                   |
| Gym Storage Room              | 2                   | LED - Linear Tubes: (2) 4' Lamps | Wall Switch      | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29                                 | 1,518                  | 0.0                   | 43                       | 0                          | \$9                              | \$150                   | \$20             | 14.0                                  |
| Gymnasium                     | 30                  | LED - Linear Tubes: (6) 2' Lamps | Wall Switch      | S           | 51                | 2,200                  | 3                   | None                   | Yes           | 30               | LED - Linear Tubes: (6) 2' Lamps | Occupancy Sensor | 51                                 | 1,518                  | 0.4                   | 1,127                    | 0                          | \$245                            | \$540                   | \$70             | 1.9                                   |
| Janitorial Closet Zoning Dept | 1                   | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | S           | 15                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | 15                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Janitors Closet               | 1                   | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | S           | 15                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | 15                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Janitors Closet Gym           | 1                   | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | S           | 15                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | 15                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Kitchen Ballroom              | 1                   | Exit Signs: LED - 2 W Lamp       | None             |             | 6                 | 8,760                  |                     | None                   | No            | 1                | Exit Signs: LED - 2 W Lamp       | None             | 6                                  | 8,760                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Kitchen Ballroom              | 7                   | LED - Fixtures: Linear Strip     | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 7                | LED - Fixtures: Linear Strip     | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 93                       | 0                          | \$20                             | \$330                   | \$40             | 14.4                                  |
| Kitchen Fireman's Room        | 6                   | LED - Fixtures: Linear Strip     | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 6                | LED - Fixtures: Linear Strip     | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 80                       | 0                          | \$17                             | \$330                   | \$40             | 16.8                                  |
| Lobby First Floor             | 9                   | LED - Fixtures: Cove Mount       | Wall Switch      | S           | 13                | 2,200                  | 4                   | None                   | Yes           | 9                | LED - Fixtures: Cove Mount       | High/Low Control | 13                                 | 1,518                  | 0.0                   | 86                       | 0                          | \$19                             | \$560                   | \$320            | 12.8                                  |
| Lobby Second Floor            | 21                  | LED - Fixtures: Cove Mount       | Wall Switch      | S           | 13                | 2,200                  | 4                   | None                   | Yes           | 21               | LED - Fixtures: Cove Mount       | High/Low Control | 13                                 | 1,518                  | 0.1                   | 201                      | 0                          | \$44                             | \$1,130                 | \$740            | 8.9                                   |
| Office - Recreation 1         | 2                   | LED - Fixtures: Linear Strip     | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Fixtures: Linear Strip     | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 27                       | 0                          | \$6                              | \$150                   | \$20             | 22.6                                  |
| Office - Recreation 2         | 2                   | LED - Fixtures: Linear Strip     | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Fixtures: Linear Strip     | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 27                       | 0                          | \$6                              | \$150                   | \$20             | 22.6                                  |
| Office - Zoning 1             | 2                   | LED - Fixtures: Linear Strip     | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Fixtures: Linear Strip     | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 27                       | 0                          | \$6                              | \$150                   | \$20             | 22.6                                  |
| Office - Zoning 2             | 2                   | LED - Fixtures: Linear Strip     | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Fixtures: Linear Strip     | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 27                       | 0                          | \$6                              | \$150                   | \$20             | 22.6                                  |
| Office Tax Assessors          | 3                   | LED - Fixtures: Linear Strip     | Occupancy Sensor | S           | 18                | 2,200                  |                     | None                   | No            | 3                | LED - Fixtures: Linear Strip     | Occupancy Sensor | 18                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Office Tax Assessors 2        | 2                   | LED - Fixtures: Linear Strip     | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Fixtures: Linear Strip     | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 27                       | 0                          | \$6                              | \$150                   | \$20             | 22.6                                  |
| Office Tax Assessors 2        | 1                   | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | S           | 15                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | 15                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Recreation Office             | 12                  | LED - Fixtures: Linear Strip     | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 12               | LED - Fixtures: Linear Strip     | Occupancy Sensor | 18                                 | 1,518                  | 0.1                   | 159                      | 0                          | \$35                             | \$330                   | \$40             | 8.4                                   |
| Restroom 2nd Lobby 1          | 6                   | LED - Linear Tubes: (2) 4' Lamps | Wall Switch      | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 6                | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29                                 | 1,518                  | 0.0                   | 128                      | 0                          | \$28                             | \$330                   | \$40             | 10.4                                  |
| Restroom 2nd Lobby 2          | 6                   | LED - Linear Tubes: (2) 4' Lamps | Wall Switch      | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 6                | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29                                 | 1,518                  | 0.0                   | 128                      | 0                          | \$28                             | \$330                   | \$40             | 10.4                                  |
| Restroom Gym                  | 1                   | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | S           | 15                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | 15                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Restroom Kitchen              | 1                   | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | S           | 15                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (1) 4' Lamp  | Wall Switch      | 15                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

| Location                            | Existing Conditions |   |                  |             |                   |                        | Proposed Conditions |                        |               |                  |   |                  | Energy Impact & Financial Analysis |                        |                       |                          |                            |                                  |                         |                  |                                       |
|-------------------------------------|---------------------|---|------------------|-------------|-------------------|------------------------|---------------------|------------------------|---------------|------------------|---|------------------|------------------------------------|------------------------|-----------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|                                     | Fixture Quantity    | Fixture Description                     | Control System   | Light Level | Watts per Fixture | Annual Operating Hours | ECM #               | Fixture Recommendation | Add Controls? | Fixture Quantity | Fixture Description                     | Control System   | Watts per Fixture                  | Annual Operating Hours | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Restroom Lobby 1                    | 6                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch      | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 6                | LED - Linear Tubes: (2) 4' Lamps        | Occupancy Sensor | 29                                 | 1,518                  | 0.0                   | 128                      | 0                          | \$28                             | \$330                   | \$40             | 10.4                                  |
| Restroom Lobby 2                    | 6                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch      | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 6                | LED - Linear Tubes: (2) 4' Lamps        | Occupancy Sensor | 29                                 | 1,518                  | 0.0                   | 128                      | 0                          | \$28                             | \$330                   | \$40             | 10.4                                  |
| Restroom Zoning Dept                | 1                   | LED - Linear Tubes: (1) 4' Lamp         | Occupancy Sensor | S           | 15                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (1) 4' Lamp         | Occupancy Sensor | 15                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Stairs                              | 3                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch      | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 3                | LED - Linear Tubes: (2) 4' Lamps        | Occupancy Sensor | 29                                 | 1,518                  | 0.0                   | 64                       | 0                          | \$14                             | \$330                   | \$40             | 20.8                                  |
| Storage 1st Floor                   | 1                   | LED - Linear Tubes: (1) 4' Lamp         | Wall Switch      | S           | 15                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (1) 4' Lamp         | Wall Switch      | 15                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Storage 1st Floor                   | 6                   | LED - Linear Tubes: (3) 4' Lamps        | Wall Switch      | S           | 44                | 2,200                  | 3                   | None                   | Yes           | 6                | LED - Linear Tubes: (3) 4' Lamps        | Occupancy Sensor | 44                                 | 1,518                  | 0.1                   | 192                      | 0                          | \$42                             | \$330                   | \$40             | 6.9                                   |
| Storage Ballroom                    | 2                   | LED - Linear Tubes: (4) 4' Lamps        | Wall Switch      | S           | 58                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Linear Tubes: (4) 4' Lamps        | Occupancy Sensor | 58                                 | 1,518                  | 0.0                   | 85                       | 0                          | \$19                             | \$150                   | \$20             | 7.0                                   |
| Storage Kitchen                     | 1                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch      | S           | 29                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch      | 29                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Uniform Room                        | 2                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch      | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Linear Tubes: (2) 4' Lamps        | Occupancy Sensor | 29                                 | 1,518                  | 0.0                   | 43                       | 0                          | \$9                              | \$150                   | \$20             | 14.0                                  |
| Firehouse - Apparatus Room          | 2                   | Exit Signs: LED - 2 W Lamp              | None             |             | 6                 | 8,760                  |                     | None                   | No            | 2                | Exit Signs: LED - 2 W Lamp              | None             | 6                                  | 8,760                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Firehouse - Apparatus Room          | 64                  | LED - Linear Tubes: (1) 4' Lamp         | Wall Switch      | S           | 15                | 2,200                  | 3                   | None                   | Yes           | 64               | LED - Linear Tubes: (1) 4' Lamp         | Occupancy Sensor | 15                                 | 1,518                  | 0.3                   | 684                      | 0                          | \$149                            | \$1,650                 | \$180            | 9.9                                   |
| Firehouse - Communications Room     | 4                   | LED - Fixtures: Linear Strip            | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 4                | LED - Fixtures: Linear Strip            | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 53                       | 0                          | \$12                             | \$330                   | \$40             | 25.2                                  |
| Firehouse - Corridor 1st Floor      | 8                   | Exit Signs: LED - 2 W Lamp              | None             |             | 6                 | 8,760                  |                     | None                   | No            | 8                | Exit Signs: LED - 2 W Lamp              | None             | 6                                  | 8,760                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Firehouse - Corridor 1st Floor      | 11                  | LED - Fixtures: Linear Strip            | Wall Switch      | S           | 18                | 2,200                  | 4                   | None                   | Yes           | 11               | LED - Fixtures: Linear Strip            | High/Low Control | 18                                 | 1,518                  | 0.1                   | 146                      | 0                          | \$32                             | \$560                   | \$390            | 5.4                                   |
| Firehouse - Decontamination Showers | 1                   | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch      | S           | 29                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (2) 4' Lamps        | Wall Switch      | 29                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Exterior Cove Light                 | 9                   | LED - Fixtures: Cove Mount              | Photocell        |             | 13                | 4,380                  |                     | None                   | No            | 9                | LED - Fixtures: Cove Mount              | Photocell        | 13                                 | 4,380                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Exterior Recessed                   | 10                  | LED - Fixtures: Downlight Surface Mount | Photocell        |             | 23                | 4,380                  |                     | None                   | No            | 10               | LED - Fixtures: Downlight Surface Mount | Photocell        | 23                                 | 4,380                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Exterior Wall Sconce                | 2                   | LED - Fixtures: Wall Sconces            | Photocell        |             | 105               | 4,380                  |                     | None                   | No            | 2                | LED - Fixtures: Wall Sconces            | Photocell        | 105                                | 4,380                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Firehouse - Janitorial              | 1                   | LED - Linear Tubes: (1) 4' Lamp         | Wall Switch      | S           | 15                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (1) 4' Lamp         | Wall Switch      | 15                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Firehouse - Lobby Fire Chief        | 1                   | LED - Fixtures: Linear Strip            | Wall Switch      | S           | 18                | 2,200                  |                     | None                   | No            | 1                | LED - Fixtures: Linear Strip            | Wall Switch      | 18                                 | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Firehouse - Office Fire Chief       | 5                   | LED - Fixtures: Linear Strip            | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 5                | LED - Fixtures: Linear Strip            | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 66                       | 0                          | \$14                             | \$330                   | \$40             | 20.1                                  |
| Firehouse - Office Fire Marshall    | 4                   | LED - Fixtures: Linear Strip            | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 4                | LED - Fixtures: Linear Strip            | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 53                       | 0                          | \$12                             | \$330                   | \$40             | 25.2                                  |
| Firehouse - Office Fire Marshall 2  | 4                   | LED - Fixtures: Linear Strip            | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 4                | LED - Fixtures: Linear Strip            | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 53                       | 0                          | \$12                             | \$330                   | \$40             | 25.2                                  |
| Firehouse - Ready Room              | 6                   | LED Lamps: (1) 7.5W A19 Screw-In Lamp   | Wall Switch      | S           | 8                 | 2,200                  |                     | None                   | No            | 6                | LED Lamps: (1) 7.5W A19 Screw-In Lamp   | Wall Switch      | 8                                  | 2,200                  | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Firehouse - Ready Room              | 7                   | LED - Fixtures: Linear Strip            | Wall Switch      | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 7                | LED - Fixtures: Linear Strip            | Occupancy Sensor | 18                                 | 1,518                  | 0.0                   | 93                       | 0                          | \$20                             | \$330                   | \$40             | 14.4                                  |

| Location                               | Existing Conditions |   |                |             |                   |                        | Proposed Conditions |                        |               |                  |   |                  |                   | Energy Impact & Financial Analysis |                       |                          |                            |                                  |                         |                  |                                       |
|--|---------------------|---|----------------|-------------|-------------------|------------------------|---------------------|------------------------|---------------|------------------|---|------------------|-------------------|------------------------------------|-----------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|  | Fixture Quantity    | Fixture Description                       | Control System | Light Level | Watts per Fixture | Annual Operating Hours | ECM #               | Fixture Recommendation | Add Controls? | Fixture Quantity | Fixture Description   | Control System   | Watts per Fixture | Annual Operating Hours             | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Firehouse - Restroom - Female          | 5                   | LED - Linear Tubes: (2) 4' Lamps          | Wall Switch    | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 5                | LED - Linear Tubes: (2) 4' Lamps                              | Occupancy Sensor | 29                | 1,518                              | 0.0                   | 107                      | 0                          | \$23                             | \$330                   | \$40             | 12.5                                  |
| Firehouse - Restroom - Male            | 5                   | LED - Linear Tubes: (2) 4' Lamps          | Wall Switch    | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 5                | LED - Linear Tubes: (2) 4' Lamps                              | Occupancy Sensor | 29                | 1,518                              | 0.0                   | 107                      | 0                          | \$23                             | \$330                   | \$40             | 12.5                                  |
| Firehouse - Storage Apparatus Room     | 1                   | LED - Linear Tubes: (2) 4' Lamps          | Wall Switch    | S           | 29                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (2) 4' Lamps                              | Wall Switch      | 29                | 2,200                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Firehouse - Storage Apparatus Room 2   | 2                   | LED - Linear Tubes: (2) 4' Lamps          | Wall Switch    | S           | 29                | 2,200                  | 3                   | None                   | Yes           | 2                | LED - Linear Tubes: (2) 4' Lamps                              | Occupancy Sensor | 29                | 1,518                              | 0.0                   | 43                       | 0                          | \$9                              | \$150                   | \$20             | 14.0                                  |
| Firehouse - Storage Apparatus Room 3   | 1                   | LED - Linear Tubes: (2) 4' Lamps          | Wall Switch    | S           | 29                | 2,200                  |                     | None                   | No            | 1                | LED - Linear Tubes: (2) 4' Lamps                              | Wall Switch      | 29                | 2,200                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Firehouse - Training Room              | 16                  | LED - Fixtures: Linear Strip              | Wall Switch    | S           | 18                | 2,200                  | 3                   | None                   | Yes           | 16               | LED - Fixtures: Linear Strip                                  | Occupancy Sensor | 18                | 1,518                              | 0.1                   | 212                      | 0                          | \$46                             | \$660                   | \$70             | 12.8                                  |
| Exterior Wall Sconce                   | 2                   | LED - Fixtures: Wall Sconces              | Photocell      |             | 54                | 4,380                  |                     | None                   | No            | 2                | LED - Fixtures: Wall Sconces                                  | Photocell        | 54                | 4,380                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Exterior Decorative Light              | 1                   | LED - Fixtures: Decorative Pendant        | Photocell      |             | 35                | 4,380                  |                     | None                   | No            | 1                | LED - Fixtures: Decorative Pendant                            | Photocell        | 35                | 4,380                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Exterior Recessed                      | 1                   | LED - Fixtures: Downlight Surface Mount   | Photocell      |             | 35                | 4,380                  |                     | None                   | No            | 1                | LED - Fixtures: Downlight Surface Mount                       | Photocell        | 35                | 4,380                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Parking Lot                            | 18                  | Metal Halide: (1) 70W Lamp                | Photocell      |             | 95                | 4,380                  | 1                   | Fixture Replacement    | No            | 18               | LED - Fixtures: Outdoor Pole/Arm-Mounted Area/Roadway Fixture | Photocell        | 70                | 4,380                              | 0.0                   | 1,971                    | 0                          | \$432                            | \$9,780                 | \$1,800          | 18.5                                  |
| VCC Annex - Room Deck                  | 6                   | Compact Fluorescent: (2) 32W Plug-In Lamp | Wall Switch    | S           | 64                | 1,200                  | 2, 3                | Relamp                 | Yes           | 6                | LED Lamps: LED Plug-In Lamp                                   | Occupancy Sensor | 45                | 828                                | 0.2                   | 257                      | 0                          | \$56                             | \$710                   | \$100            | 10.9                                  |
| VCC Annex - Room 1                     | 1                   | Exit Signs: LED - 2 W Lamp                | None           |             | 6                 | 8,760                  |                     | None                   | No            | 1                | Exit Signs: LED - 2 W Lamp                                    | None             | 6                 | 8,760                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Room 1                     | 19                  | Linear Fluorescent - T8: 4' T8 (32W) - 3L | Wall Switch    | S           | 93                | 1,200                  | 2, 3                | Relamp                 | Yes           | 19               | LED - Linear Tubes: (3) 4' Lamps                              | Occupancy Sensor | 44                | 828                                | 1.1                   | 1,551                    | 0                          | \$337                            | \$1,860                 | \$360            | 4.5                                   |
| VCC Annex - Room 2                     | 2                   | Exit Signs: LED - 2 W Lamp                | None           |             | 6                 | 8,760                  |                     | None                   | No            | 2                | Exit Signs: LED - 2 W Lamp                                    | None             | 6                 | 8,760                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Room 2                     | 20                  | Linear Fluorescent - T8: 4' T8 (32W) - 3L | Wall Switch    | S           | 93                | 1,200                  | 2, 3                | Relamp                 | Yes           | 20               | LED - Linear Tubes: (3) 4' Lamps                              | Occupancy Sensor | 44                | 828                                | 1.1                   | 1,633                    | 0                          | \$355                            | \$1,920                 | \$370            | 4.4                                   |
| VCC Annex - Corridor 1                 | 2                   | Compact Fluorescent: (2) 32W Plug-In Lamp | Wall Switch    | S           | 64                | 1,200                  | 2, 4                | Relamp                 | Yes           | 2                | LED Lamps: LED Plug-In Lamp                                   | High/Low Control | 45                | 828                                | 0.1                   | 86                       | 0                          | \$19                             | \$410                   | \$90             | 17.2                                  |
| VCC Annex - Corridor 1                 | 1                   | Exit Signs: LED - 2 W Lamp                | None           |             | 6                 | 8,760                  |                     | None                   | No            | 1                | Exit Signs: LED - 2 W Lamp                                    | None             | 6                 | 8,760                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Corridor 1                 | 7                   | LED - Fixtures: Cove Mount                | Wall Switch    | S           | 18                | 1,200                  | 4                   | None                   | Yes           | 7                | LED - Fixtures: Cove Mount                                    | High/Low Control | 18                | 828                                | 0.0                   | 51                       | 0                          | \$11                             | \$560                   | \$250            | 28.2                                  |
| VCC Annex - Exterior                   | 12                  | LED Lamps: (1) 24W A17 Screw-In Lamp      | Photocell      |             | 24                | 4,380                  |                     | None                   | No            | 12               | LED Lamps: (1) 24W A17 Screw-In Lamp                          | Photocell        | 24                | 4,380                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage                     | 6                   | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2, 3                | Relamp                 | Yes           | 6                | LED - Linear Tubes: (2) 4' Lamps                              | Occupancy Sensor | 29                | 828                                | 0.2                   | 327                      | 0                          | \$71                             | \$630                   | \$100            | 7.5                                   |
| VCC Annex - Garage 2                   | 6                   | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2, 3                | Relamp                 | Yes           | 6                | LED - Linear Tubes: (2) 4' Lamps                              | Occupancy Sensor | 29                | 828                                | 0.2                   | 327                      | 0                          | \$71                             | \$630                   | \$100            | 7.5                                   |
| VCC Annex - Garage 3                   | 7                   | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2, 3                | Relamp                 | Yes           | 7                | LED - Linear Tubes: (2) 4' Lamps                              | Occupancy Sensor | 29                | 828                                | 0.3                   | 381                      | 0                          | \$83                             | \$680                   | \$110            | 6.9                                   |
| VCC Annex - Mechanical (N/A)           | 12                  | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2, 3                | Relamp                 | Yes           | 12               | LED - Linear Tubes: (2) 4' Lamps                              | Occupancy Sensor | 29                | 828                                | 0.4                   | 653                      | 0                          | \$142                            | \$940                   | \$160            | 5.5                                   |
| VCC Annex - Restroom - Female          | 1                   | LED - Fixtures: Ambient 2x4 Fixture       | Wall Switch    | S           | 32                | 1,200                  |                     | None                   | No            | 1                | LED - Fixtures: Ambient 2x4 Fixture                           | Wall Switch      | 32                | 1,200                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Restroom - Female Exterior | 2                   | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2, 3                | Relamp                 | Yes           | 2                | LED - Linear Tubes: (2) 4' Lamps                              | Occupancy Sensor | 29                | 828                                | 0.1                   | 109                      | 0                          | \$24                             | \$250                   | \$40             | 8.9                                   |



| Location                             | Existing Conditions |   |                |             |                   |                        | Proposed Conditions |                        |               |                  |                                  |                  |                   | Energy Impact & Financial Analysis |                       |                          |                            |                                  |                         |                  |                                       |
|--------------------------------------|---------------------|---|----------------|-------------|-------------------|------------------------|---------------------|------------------------|---------------|------------------|----------------------------------|------------------|-------------------|------------------------------------|-----------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|                                      | Fixture Quantity    | Fixture Description                       | Control System | Light Level | Watts per Fixture | Annual Operating Hours | ECM #               | Fixture Recommendation | Add Controls? | Fixture Quantity | Fixture Description              | Control System   | Watts per Fixture | Annual Operating Hours             | Total Peak kW Savings | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| VCC Annex - Restroom - Male          | 1                   | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2                   | Relamp                 | No            | 1                | LED - Linear Tubes: (2) 4' Lamps | Wall Switch      | 29                | 1,200                              | 0.0                   | 43                       | 0                          | \$9                              | \$50                    | \$10             | 4.3                                   |
| VCC Annex - Restroom - Male Exterior | 2                   | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2, 3                | Relamp                 | Yes           | 2                | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29                | 828                                | 0.1                   | 109                      | 0                          | \$24                             | \$250                   | \$40             | 8.9                                   |
| VCC Annex - Stairs 1                 | 5                   | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2, 3                | Relamp                 | Yes           | 5                | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29                | 828                                | 0.2                   | 272                      | 0                          | \$59                             | \$580                   | \$90             | 8.3                                   |
| VCC Annex - Storage 1                | 1                   | Exit Signs: LED - 2 W Lamp                | None           |             | 6                 | 8,760                  |                     | None                   | No            | 1                | Exit Signs: LED - 2 W Lamp       | None             | 6                 | 8,760                              | 0.0                   | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Storage 1                | 6                   | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2, 3                | Relamp                 | Yes           | 6                | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29                | 828                                | 0.2                   | 327                      | 0                          | \$71                             | \$630                   | \$100            | 7.5                                   |
| VCC Annex - Storage 2                | 8                   | Linear Fluorescent - T8: 4' T8 (32W) - 2L | Wall Switch    | S           | 62                | 1,200                  | 2, 3                | Relamp                 | Yes           | 8                | LED - Linear Tubes: (2) 4' Lamps | Occupancy Sensor | 29                | 828                                | 0.3                   | 435                      | 0                          | \$95                             | \$730                   | \$120            | 6.4                                   |

**Motor Inventory & Recommendations**

| Location   | Area(s)/System(s) Served     | Existing Conditions |                          |              |                      |              |                      |         |                       |                        | Proposed Conditions |                                 |                      |               |                | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|--|------------------------------|---------------------|--------------------------|--------------|----------------------|--------------|----------------------|---------|-----------------------|------------------------|---------------------|---------------------------------|----------------------|---------------|----------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|  |                              | Motor Quantity      | Motor Application        | HP Per Motor | Full Load Efficiency | VFD Control? | Manufacturer         | Model   | Remaining Useful Life | Annual Operating Hours | ECM #               | Install High Efficiency Motors? | Full Load Efficiency | Install VFDs? | Number of VFDs | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Community Center - 1st floor Mechanical          | Hot Water Loop               | 1                   | Heating Hot Water Pump   | 0.50         | 70.0%                | No           | US Motors            |         | W                     | 2,400                  |                     | No                              | 70.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - 1st floor Mechanical          | Hot Water Loop               | 1                   | Heating Hot Water Pump   | 0.25         | 65.0%                | No           | US Motors            | E6312   | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Gym Mechanical Room           | Hot Water Loop               | 1                   | Heating Hot Water Pump   | 3.00         | 78.5%                | No           | US Motors            | E790A   | W                     | 2,400                  | 7                   | No                              | 89.5%                | Yes           | 1              | 0.5                                | 3,134                    | 0                          | \$688                            | \$5,100                 | \$200            | 7.1                                   |
| Community Center - Gym Mechanical Room           | Hot Water Loop               | 1                   | Heating Hot Water Pump   | 5.00         | 85.0%                | No           | US Motors            |         | W                     | 2,400                  | 7                   | No                              | 89.5%                | Yes           | 1              | 0.6                                | 4,307                    | 0                          | \$945                            | \$5,600                 | \$900            | 5.0                                   |
| Community Center - Gym Mechanical Room           | Hot Water Loop               | 1                   | Heating Hot Water Pump   | 0.50         | 70.0%                | No           | US Motors            |         | W                     | 2,400                  |                     | No                              | 70.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Kitchen Fireman's Room        | Stove Top                    | 1                   | Kitchen Hood Exhaust Fan | 1.00         | 80.0%                | No           | Captive Aire Systems | 4230 ND | W                     | 400                    |                     | No                              | 80.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Electrical Room               | Elevator                     | 1                   | Other                    | 20.00        | 80.0%                | No           |                      |         | W                     | 300                    |                     | No                              | 80.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Gymnasium                     | Basketball Hoops             | 6                   | Other                    | 0.25         | 65.0%                | No           |                      |         | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Corridor - Recreation         | Hallway                      | 1                   | Supply Fan               | 0.20         | 65.0%                | No           |                      |         | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Corridor - Recreation Storage | Hallway                      | 1                   | Supply Fan               | 0.20         | 65.0%                | No           |                      |         | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Corridor - Zoning             | Hallway                      | 1                   | Supply Fan               | 0.20         | 65.0%                | No           |                      |         | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Office - Recreation 2         | Office                       | 1                   | Supply Fan               | 0.20         | 65.0%                | No           |                      |         | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Restroom 2nd Lobby 1          | Restroom                     | 1                   | Exhaust Fan              | 0.06         | 65.0%                | No           |                      |         | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Restroom 2nd Lobby 2          | Restroom                     | 1                   | Exhaust Fan              | 0.06         | 65.0%                | No           |                      |         | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Restroom Lobby 1              | Restroom                     | 1                   | Exhaust Fan              | 0.06         | 65.0%                | No           |                      |         | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Restroom Lobby 2              | Restroom                     | 1                   | Exhaust Fan              | 0.06         | 65.0%                | No           |                      |         | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - 1st floor Mechanical          | AHU-3 - Ballroom             | 1                   | Supply Fan               | 7.50         | 89.5%                | No           |                      |         | W                     | 2,400                  | 5, 6                | Yes                             | 91.0%                | Yes           | 1              | 2.2                                | 5,793                    | 0                          | \$1,271                          | \$6,600                 | \$1,000          | 4.4                                   |
| Community Center - 1st floor Mechanical          | AHU-4 - Rec Bdg & Tax Office | 1                   | Supply Fan               | 5.00         | 89.5%                | No           |                      |         | W                     | 2,400                  | 5, 6                | Yes                             | 89.5%                | Yes           | 1              | 1.4                                | 3,751                    | 0                          | \$823                            | \$5,600                 | \$900            | 5.7                                   |
| Community Center - Gym AHU Room                  | AHU-2 - Gym Storage          | 1                   | Supply Fan               | 3.00         | 82.5%                | No           |                      |         | W                     | 2,400                  | 5, 6                | Yes                             | 89.5%                | Yes           | 1              | 1.0                                | 2,785                    | 0                          | \$611                            | \$5,000                 | \$200            | 7.9                                   |
| Community Center - Gym Mechanical Room           | Lobby                        | 1                   | Supply Fan               | 3.00         | 80.0%                | No           |                      |         | W                     | 2,400                  | 5, 6                | Yes                             | 89.5%                | Yes           | 1              | 1.0                                | 2,999                    | 0                          | \$658                            | \$5,000                 | \$200            | 7.3                                   |

|   |                            | Existing Conditions |                          |              |                      |              |                         |                     |                       |                        | Proposed Conditions |                                 |                      |               |                | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|---|----------------------------|---------------------|--------------------------|--------------|----------------------|--------------|-------------------------|---------------------|-----------------------|------------------------|---------------------|---------------------------------|----------------------|---------------|----------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| Location                                      | Area(s)/System(s) Served   | Motor Quantity      | Motor Application        | HP Per Motor | Full Load Efficiency | VFD Control? | Manufacturer            | Model               | Remaining Useful Life | Annual Operating Hours | ECM #               | Install High Efficiency Motors? | Full Load Efficiency | Install VFDs? | Number of VFDs | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Community Center - Gym Mechanical Room        | Condensing Boiler          | 1                   | Boiler Feed Water Pump   | 0.50         | 65.0%                | No           |                         | ZXM101050A          | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Gym Mechanical Room        | Non-Condensing Boiler B2   | 1                   | Combustion Air Fan       | 0.30         | 65.0%                | No           | Power Flame Burner      | J50A-15HBS-6        | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Gym Mechanical Room        | DHW                        | 1                   | DHW Circulation Pump     | 0.04         | 65.0%                | No           | Taco                    | 007-BF5             | W                     | 8,760                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Firehouse - Apparatus Room | Tires for Trucks           | 1                   | Air Compressor           | 5.00         | 87.5%                | No           | Baldor Industrial Motor |                     | W                     | 80                     |                     | No                              | 87.5%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Firehouse - Apparatus Room | Garage Door                | 3                   | Other                    | 0.25         | 65.0%                | No           |                         |                     | W                     | 200                    |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Firehouse - Apparatus Room | AHU-1 - Apparatus Room     | 1                   | Supply Fan               | 10.00        | 91.0%                | No           |                         |                     |                       | 2,745                  | 6                   | No                              | 91.7%                | Yes           | 1              | 2.9                                | 8,555                    | 0                          | \$1,877                          | \$7,500                 | \$1,100          | 3.4                                   |
| Community Center - Roof                       | Apparatus Room             | 1                   | Exhaust Fan              | 2.00         | 75.0%                | No           | Carnes                  | VEBK30V             | B                     | 2,400                  | 6                   | No                              | 87.5%                | Yes           | 1              | 0.7                                | 2,251                    | 0                          | \$494                            | \$5,100                 | \$100            | 10.1                                  |
| Community Center - Roof                       | Training Room              | 1                   | Exhaust Fan              | 0.13         | 65.0%                | No           | Carnes                  | VEDK12J3A1CA20 SPC1 | B                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | Showers and Firehouse      | 1                   | Exhaust Fan              | 0.50         | 65.0%                | No           | Carnes                  |                     | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | Kitchen Hood - 2nd Floor   | 1                   | Kitchen Hood Exhaust Fan | 1.00         | 75.0%                | No           | Carnes                  | DDU-160             | W                     | 2,400                  |                     | No                              | 75.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | Kitchen Hood - 1st Floor   | 1                   | Kitchen Hood Exhaust Fan | 1.00         | 75.0%                | No           | Captive Aire Systems    | NCA14B              | W                     | 2,400                  |                     | No                              | 75.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | 2nd Floor Meeting Room     | 1                   | Exhaust Fan              | 1.50         | 75.0%                | No           |                         |                     | W                     | 2,400                  |                     | No                              | 75.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | 2nd Floor Restrooms        | 1                   | Exhaust Fan              | 0.33         | 65.0%                | No           | Carnes                  | VEBK12M1A1CA2 OAPC1 | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | Gymnasium                  | 1                   | Exhaust Fan              | 1.50         | 75.0%                | No           |                         |                     | W                     | 2,400                  | 6                   | No                              | 86.5%                | Yes           | 1              | 0.5                                | 1,664                    | 0                          | \$365                            | \$4,400                 | \$100            | 11.8                                  |
| Community Center - Roof                       | 1st Floor Meeting Room     | 1                   | Exhaust Fan              | 1.50         | 75.0%                | No           |                         |                     | W                     | 2,400                  | 6                   | No                              | 86.5%                | Yes           | 1              | 0.5                                | 1,664                    | 0                          | \$365                            | \$4,400                 | \$100            | 11.8                                  |
| Community Center - Roof                       | 1st Floor Meeting Room     | 1                   | Exhaust Fan              | 1.50         | 75.0%                | No           | Carnes                  | VEBK21R1C1NA2 OAPC  | B                     | 2,400                  | 6                   | No                              | 86.5%                | Yes           | 1              | 0.5                                | 1,664                    | 0                          | \$365                            | \$4,400                 | \$100            | 11.8                                  |
| Community Center - Roof                       | 1st Floor Community Center | 1                   | Exhaust Fan              | 1.00         | 75.0%                | No           |                         |                     | W                     | 2,400                  | 6                   | No                              | 85.5%                | Yes           | 1              | 0.4                                | 1,093                    | 0                          | \$240                            | \$3,900                 | \$100            | 15.8                                  |
| Community Center - Roof                       | 1st Floor Community Center | 1                   | Exhaust Fan              | 1.00         | 75.0%                | No           |                         |                     | W                     | 2,400                  | 6                   | No                              | 85.5%                | Yes           | 1              | 0.4                                | 1,093                    | 0                          | \$240                            | \$3,900                 | \$100            | 15.8                                  |
| Community Center - Restroom Ceiling           | 1st Floor Restrooms        | 1                   | Exhaust Fan              | 0.33         | 65.0%                | No           |                         |                     | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | Gym Restroom               | 1                   | Exhaust Fan              | 0.33         | 65.0%                | No           |                         |                     | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

|                                    |                              | Existing Conditions |                   |              |                      |              |              |                |                       |                        | Proposed Conditions |                                 |                      |               |                | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|------------------------------------|------------------------------|---------------------|-------------------|--------------|----------------------|--------------|--------------|----------------|-----------------------|------------------------|---------------------|---------------------------------|----------------------|---------------|----------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| Location                           | Area(s)/System(s) Served     | Motor Quantity      | Motor Application | HP Per Motor | Full Load Efficiency | VFD Control? | Manufacturer | Model          | Remaining Useful Life | Annual Operating Hours | ECM #               | Install High Efficiency Motors? | Full Load Efficiency | Install VFDs? | Number of VFDs | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Community Center - Roof            | 1st Floor Kitchen Restrooms  | 1                   | Exhaust Fan       | 0.33         | 65.0%                | No           |              |                | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage 1               | VCC Annex - Garage 1         | 1                   | Exhaust Fan       | 0.50         | 70.0%                | No           |              |                | W                     | 600                    |                     | No                              | 70.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage 2               | VCC Annex - Garage 2         | 1                   | Exhaust Fan       | 0.50         | 70.0%                | No           |              |                | W                     | 600                    |                     | No                              | 70.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage 3               | VCC Annex - Garage 3         | 1                   | Exhaust Fan       | 0.50         | 70.0%                | No           |              |                | W                     | 600                    |                     | No                              | 70.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Storage 1              | VCC Annex - Storage 1        | 1                   | Exhaust Fan       | 0.50         | 70.0%                | No           |              |                | W                     | 600                    |                     | No                              | 70.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Storage 2              | VCC Annex - Storage 2        | 1                   | Exhaust Fan       | 0.50         | 70.0%                | No           |              |                | W                     | 600                    |                     | No                              | 70.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Elevator Room          | Elevator                     | 1                   | Other             | 15.00        | 70.0%                | No           | Allweiler    | SUB140-39      | B                     | 400                    |                     | No                              | 70.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage                 | Garage Door                  | 1                   | Other             | 0.25         | 65.0%                | No           | Raynor       |                | W                     | 200                    |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage 2               | Garage Door                  | 2                   | Other             | 0.25         | 65.0%                | No           | Raynor       |                | W                     | 200                    |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Annex Room 1                       | Annex Room 1 & 2             | 2                   | Supply Fan        | 0.50         | 70.0%                | No           |              |                | B                     | 2,400                  |                     | No                              | 70.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Trane ACC-3                        | Ballroom                     | 2                   | Supply Fan        | 1.00         | 70.0%                | No           |              |                | B                     | 2,400                  | 6                   | No                              | 85.5%                | Yes           | 2              | 0.8                                | 2,544                    | 0                          | \$558                            | \$7,900                 | \$200            | 13.8                                  |
| Trane RTU-5                        | Fire Inspectors Offices      | 1                   | Supply Fan        | 3.00         | 82.0%                | No           |              |                | B                     | 2,400                  | 6                   | No                              | 89.5%                | Yes           | 1              | 1.0                                | 2,827                    | 0                          | \$620                            | \$5,100                 | \$200            | 7.9                                   |
| Trane ACC-4                        | 1st Floor Offices            | 1                   | Supply Fan        | 1.00         | 70.0%                | No           |              |                | B                     | 2,400                  | 6                   | No                              | 85.5%                | Yes           | 1              | 0.4                                | 1,272                    | 0                          | \$279                            | \$3,900                 | \$100            | 13.6                                  |
| Trane RTU-3                        | 2nd Floor Conference Room    | 1                   | Supply Fan        | 0.33         | 70.0%                | No           |              |                | B                     | 2,400                  | 6                   | No                              | 73.4%                | Yes           | 1              | 0.1                                | 343                      | 0                          | \$75                             | \$3,400                 | \$100            | 43.9                                  |
| Trane RTU-4                        | Activities Room              | 1                   | Supply Fan        | 1.00         | 70.0%                | No           |              |                | B                     | 2,400                  | 6                   | No                              | 85.5%                | Yes           | 1              | 0.4                                | 1,272                    | 0                          | \$279                            | \$3,900                 | \$100            | 13.6                                  |
| Trane ACC-2                        | Common Area                  | 1                   | Supply Fan        | 1.00         | 70.0%                | No           |              |                | B                     | 2,400                  | 6                   | No                              | 85.5%                | Yes           | 1              | 0.4                                | 1,272                    | 0                          | \$279                            | \$3,900                 | \$100            | 13.6                                  |
| VCC Annex - Water Treatment Garage | Water Treatment              | 1                   | Process Pump      | 25.00        | 93.0%                | No           | Marathon     | AVJ 284TTDR160 | W                     | 0                      |                     | No                              | 93.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Water Treatment Garage | Water Treatment              | 1                   | Process Pump      | 25.00        | 93.6%                | No           | Marathon     | UVN284TTDN160  | W                     | 0                      |                     | No                              | 93.6%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Annex Room 2           | Condensing Units - ACC-1 & 2 | 2                   | Supply Fan        | 0.20         | 60.0%                | No           |              |                | W                     | 2,400                  |                     | No                              | 60.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Annex Room 2                       | AHU - (F1 & F2)              | 2                   | Supply Fan        | 0.33         | 65.0%                | No           |              |                | W                     | 2,400                  |                     | No                              | 65.0%                | No            |                | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

**Packaged HVAC Inventory & Recommendations**

| Location                                      | Area(s)/System(s) Served              | Existing Conditions |                          |                                  |                                 |   |                         |              |               |                       | Proposed Conditions |                                 |                 |                    |                                  |                                 |   |                         | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|---|---------------------------------------|---------------------|--------------------------|----------------------------------|---------------------------------|---|-------------------------|--------------|---------------|-----------------------|---------------------|---------------------------------|-----------------|--------------------|----------------------------------|---------------------------------|---|-------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|   |                                       | System Quantity     | System Type              | Cooling Capacity per Unit (Tons) | Heating Capacity per Unit (MBh) | Cooling Mode Efficiency (SEER/IEER/EER) | Heating Mode Efficiency | Manufacturer | Model         | Remaining Useful Life | ECM #               | Install High Efficiency System? | System Quantity | System Type        | Cooling Capacity per Unit (Tons) | Heating Capacity per Unit (MBh) | Cooling Mode Efficiency (SEER/IEER/EER) | Heating Mode Efficiency | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Community Center - Firehouse - Apparatus Room | Apparatus Room                        | 1                   | Unit Heater              |                                  | 40.00                           |   | 0.8 AFUE                | Trane        |               | B                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | ACC3 - Ballroom                       | 1                   | Split-System             | 25.00                            |                                 | 9.50                                    |                         | Carrier      | 38AH-034-511A | B                     | 8                   | Yes                             | 1               | Split-System       | 25.00                            |                                 | 12.50                                   |                         | 3.8                                | 3,221                    | 0                          | \$707                            | \$52,500                | \$2,100          | 71.3                                  |
| Community Center - Roof                       | RTU 2 - Firehouse Offices/ Inspectors | 1                   | Package Unit             | 10.00                            |                                 | 14.00                                   |                         | Trane        | THC120F3R0A0  | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | RTU 1 - Training Room                 | 1                   | Package Unit             | 4.00                             |                                 | 12.00                                   |                         | Trane        | TSC048G3R0A0  | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Roof                       | ACC2 - Common Area                    | 1                   | Split-System             | 6.00                             |                                 | 10.00                                   |                         | Trane        |               | B                     | 8                   | Yes                             | 1               | Split-System       | 6.00                             |                                 | 14.00                                   |                         | 1.0                                | 874                      | 0                          | \$192                            | \$12,000                | \$500            | 60.0                                  |
| Community Center - Roof                       | ACC4 - 1st Floor Offices              | 1                   | Split-System             | 6.00                             |                                 | 10.00                                   |                         | Trane        |               | B                     | 8                   | Yes                             | 1               | Split-System       | 6.00                             |                                 | 14.00                                   |                         | 1.0                                | 874                      | 0                          | \$192                            | \$12,000                | \$500            | 60.0                                  |
| Community Center - Roof                       | RTU 3 - 2nd Floor Conference Room     | 1                   | Package Unit             | 6.00                             |                                 | 10.00                                   |                         | Trane        | TCD075C30ABC  | B                     | 8                   | Yes                             | 1               | Package Unit       | 6.00                             |                                 | 14.00                                   |                         | 1.0                                | 874                      | 0                          | \$192                            | \$9,400                 | \$500            | 46.4                                  |
| Community Center - Roof                       | RTU 4 - Activities Room               | 1                   | Package Unit             | 3.00                             |                                 | 10.00                                   |                         | Trane        | TCD036C30ABC  | B                     | 8                   | Yes                             | 1               | Package Unit       | 3.00                             |                                 | 16.00                                   |                         | 0.7                                | 574                      | 0                          | \$126                            | \$7,100                 | \$300            | 54.0                                  |
| Community Center - Firehouse - Apparatus Room | AHU-1 - Fire House                    | 1                   | Forced Air Furnace       |                                  | 160.00                          |   | 0.8 AFUE                |              |               | W                     | 10                  | Yes                             | 1               | Forced Air Furnace |                                  | 160.00                          |   | 0.97 AFUE               | 0.0                                | 0                        | 21                         | \$208                            | \$4,900                 | \$500            | 21.2                                  |
| VCC Annex - Corridor 1                        | CUH-1 - Lobby                         | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Reiner       |               | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Elevator Room                     | CUH-6 - Elevator Room                 | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Reiner       |               | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage                            | Garage                                | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Qmark        | MUH074        | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage 2                          | Garage                                | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Qmark        | MUH074        | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Water Treatment Garage            | Water Treatment Garage                | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Qmark        | MUH074        | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Restroom - Female                 | EWB-4 - Female Restroom               | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Qmark        |               | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Restroom - Female Exterior        | EWB-2 - Female Restroom               | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Qmark        |               | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Restroom - Male Exterior          | Male Restroom                         | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   |              |               | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Stairs 1                          | CUH-4 - Stairs                        | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Reiner       |               | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Storage 1                         | Storage                               | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Qmark        |               | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Storage 2                         | CUH-5 - Storage                       | 1                   | Electric Resistance Heat |                                  | 25.59                           |   | 1 COP                   | Reiner       |               | W                     |                     | No                              |                 |                    |                                  |                                 |   |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

|                          |                          | Existing Conditions |                 |                                  |                                 |   |                         |                |                |                       | Proposed Conditions |                                 |                 |             |                                  |                                     |                                    |                         | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|--------------------------|--------------------------|---------------------|-----------------|----------------------------------|---------------------------------|---|-------------------------|----------------|----------------|-----------------------|---------------------|---------------------------------|-----------------|-------------|----------------------------------|-------------------------------------|------------------------------------|-------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| Location                 | Area(s)/System(s) Served | System Quantity     | System Type     | Cooling Capacity per Unit (Tons) | Heating Capacity per Unit (MBh) | Cooling Mode Efficiency (SEER/IEER/EER) | Heating Mode Efficiency | Manufacturer   | Model          | Remaining Useful Life | ECM #               | Install High Efficiency System? | System Quantity | System Type | Cooling Capacity per Unit (Tons) | Heating Capacity per Unit (kBTU/hr) | Cooling Mode Efficiency (SEER/EER) | Heating Mode Efficiency | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| VCC Annex - Garage       | Garage                   | 1                   | Infrared Heater |                                  | 32.00                           |   | 0.8 AFUE                | Roberts Gordon | BH-40          | W                     |                     | No                              |                 |             |                                  |                                     |                                    |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage 2     | Garage                   | 1                   | Infrared Heater |                                  | 32.00                           |   | 0.8 AFUE                | Roberts Gordon | BH-40          | W                     |                     | No                              |                 |             |                                  |                                     |                                    |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Garage 3     | Garage                   | 1                   | Infrared Heater |                                  | 32.00                           |   | 0.8 AFUE                | Roberts Gordon | BH-40          | W                     |                     | No                              |                 |             |                                  |                                     |                                    |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Storage 2    | Storage                  | 1                   | Infrared Heater |                                  | 32.00                           |   | 0.8 AFUE                | Roberts Gordon | BH-40          | W                     |                     | No                              |                 |             |                                  |                                     |                                    |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| VCC Annex - Ground Floor | ACC-1 & 2 - F1 & F2      | 2                   | Split-System    | 5.00                             |                                 | 11.00                                   |                         | Thermal Zone   | TZAA-360-DA757 | W                     |                     | No                              |                 |             |                                  |                                     |                                    |                         | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

**Space Heating Boiler Inventory & Recommendations**

|                       |                              | Existing Conditions |                                 |                                |                         |              |                       | Proposed Conditions |                                 |                 |                             |                                |                    |                          | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|-----------------------|------------------------------|---------------------|---------------------------------|--------------------------------|-------------------------|--------------|-----------------------|---------------------|---------------------------------|-----------------|-----------------------------|--------------------------------|--------------------|--------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| Location              | Area(s)/System(s) Served     | System Quantity     | System Type                     | Output Capacity per Unit (MBh) | Manufacturer            | Model        | Remaining Useful Life | ECM #               | Install High Efficiency System? | System Quantity | System Type                 | Output Capacity per Unit (MBh) | Heating Efficiency | Heating Efficiency Units | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Mechanical Room - Gym | Boiler B2 - Community Center | 1                   | Non-Condensing Hot Water Boiler | 1,246                          | Smith Cast Iron Boilers | Series 28A-6 | B                     | 9                   | Yes                             | 1               | Condensing Hot Water Boiler | 1,246                          | 91.00%             | Et                       | 0.0                                | 0                        | 68                         | \$664                            | \$48,600                | \$2,700          | 69.1                                  |
| Mechanical Room - Gym | Community Center             | 1                   | Condensing Hot Water Boiler     | 560                            | Lochinvar               | KBN601       | W                     |                     | No                              |                 |                             |                                |                    |                          | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

**Pipe Insulation Recommendations**

|                     |                            | Recommendation Inputs |                                 |                    | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|---------------------|----------------------------|-----------------------|---------------------------------|--------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| Location            | Area(s)/System(s) Affected | ECM #                 | Length of Uninsulated Pipe (ft) | Pipe Diameter (in) | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Gym Mechanical Room | Heating Hot Water Pipes    | 11                    | 13                              | 1.50               | 0.0                                | 0                        | 9                          | \$85                             | \$240                   | \$30             | 2.5                                   |

**DHW Inventory & Recommendations**

|                     |                          | Existing Conditions |                                      |                |            |                       | Proposed Conditions |          |                 |             |           |                   |                  | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|---------------------|--------------------------|---------------------|--------------------------------------|----------------|------------|-----------------------|---------------------|----------|-----------------|-------------|-----------|-------------------|------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
| Location            | Area(s)/System(s) Served | System Quantity     | System Type                          | Manufacturer   | Model      | Remaining Useful Life | ECM #               | Replace? | System Quantity | System Type | Fuel Type | System Efficiency | Efficiency Units | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Gym Mechanical Room | Community Center         | 1                   | Storage Tank Water Heater (> 50 Gal) | Rheem          | G85-300A-1 | W                     |                     | No       |                 |             |           |                   |                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Storage Room 2      | VCC Annex                | 1                   | Storage Tank Water Heater (≤ 50 Gal) | Bardford White | MI50S6DS13 | W                     |                     | No       |                 |             |           |                   |                  | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

**Low-Flow Device Recommendations**

| Location         | Recommendation Inputs |                 |                           |                          |                          | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|------------------|-----------------------|-----------------|---------------------------|--------------------------|--------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|                  | ECM #                 | Device Quantity | Device Type               | Existing Flow Rate (gpm) | Proposed Flow Rate (gpm) | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Community Center | 12                    | 4               | Faucet Aerator (Kitchen)  | 2.20                     | 1.50                     | 0.0                                | 0                        | 1                          | \$8                              | \$30                    | \$10             | 2.6                                   |
| Community Center | 12                    | 10              | Faucet Aerator (Lavatory) | 1.20                     | 0.50                     | 0.0                                | 0                        | 2                          | \$19                             | \$80                    | \$40             | 2.1                                   |
| Community Center | 12                    | 3               | Faucet Aerator (Lavatory) | 2.20                     | 0.50                     | 0.0                                | 0                        | 1                          | \$14                             | \$30                    | \$10             | 1.4                                   |

**Commercial Refrigerator/Freezer Inventory & Recommendations**

| Location                            | Existing Conditions |   |              |       |                        | Proposed Conditions |                                | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|-------------------------------------|---------------------|---|--------------|-------|------------------------|---------------------|--------------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|                                     | Quantity            | Refrigerator/ Freezer Type                          | Manufacturer | Model | ENERGY STAR Qualified? | ECM #               | Install ENERGY STAR Equipment? | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Community Center - Kitchen Ballroom | 1                   | Stand-Up Freezer, Solid Door (16 - 30 cu. ft.)      | TRUE         | T-23F | Yes                    |                     | No                             | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Kitchen Ballroom | 1                   | Stand-Up Refrigerator, Solid Door (16 - 30 cu. ft.) | TRUE         | T-23  | Yes                    |                     | No                             | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

**Commercial Ice Maker Inventory & Recommendations**

| Location                                    | Existing Conditions |  |              |            |                        | Proposed Conditions |                                | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|---|---------------------|--|--------------|------------|------------------------|---------------------|--------------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|   | Quantity            | Ice Maker Type                             | Manufacturer | Model      | ENERGY STAR Qualified? | ECM #               | Install ENERGY STAR Equipment? | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Community Center - Firehouse Apparatus Room | 1                   | Ice Making Head (<450 lbs/day), Continuous | Ice-O-Matic  | ICE0806FA3 | No                     |                     | No                             | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

**Cooking Equipment Inventory & Recommendations**

| Location                                  | Existing Conditions |                                 |              |       |                            | Proposed Conditions |                                    | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|---|---------------------|---------------------------------|--------------|-------|----------------------------|---------------------|------------------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|   | Quantity            | Equipment Type                  | Manufacturer | Model | High Efficiency Equipment? | ECM #               | Install High Efficiency Equipment? | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Community Center - Kitchen Fireman's Room | 1                   | Gas Convection Oven (Full Size) | GE           |       | No                         |                     | No                                 | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |
| Community Center - Kitchen Ballroom       | 1                   | Gas Griddle (5 Feet Width)      | Vulcan       |       | No                         |                     | No                                 | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                                   |

**Dishwasher Inventory & Recommendations**

| Location                                  | Existing Conditions |                           |              |                  |                        |                          |                        | Proposed Conditions |                                | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                |
|---|---------------------|---------------------------|--------------|------------------|------------------------|--------------------------|------------------------|---------------------|--------------------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|--------------------------------|
|   | Quantity            | Dishwasher Type           | Manufacturer | Model            | Water Heater Fuel Type | Booster Heater Fuel Type | ENERGY STAR Qualified? | ECM #               | Install ENERGY STAR Equipment? | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Payback w/ Incentives in Years |
| Community Center - Kitchen Ballroom       | 1                   | Under Counter (High Temp) | Hobart       | LX30H            | Electric               | None                     | No                     |                     | No                             | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                            |
| Community Center - Kitchen Fireman's Room | 1                   | Under Counter (Low Temp)  | GE           | Potsscrubber 725 | Electric               | None                     | No                     |                     | No                             | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                            |
| Community Center - Firehouse Ready Room   | 1                   | Under Counter (Low Temp)  | GE           | Potsscrubber 726 | Electric               | None                     | No                     |                     | No                             | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                            |
| Community Center - Firehouse Ready Room   | 1                   | Under Counter (Low Temp)  | GE           |                  | Electric               | None                     | No                     |                     | No                             | 0.0                                | 0                        | 0                          | \$0                              | \$0                     | \$0              | 0.0                            |



**Plug Load Inventory**

| Existing Conditions          |          |                            |                 |                        |              |       |
|------------------------------|----------|----------------------------|-----------------|------------------------|--------------|-------|
| Location                     | Quantity | Equipment Description      | Energy Rate (W) | ENERGY STAR Qualified? | Manufacturer | Model |
| Community Center             | 1        | Coffee Machine             | 600             | No                     |              |       |
| Community Center             | 16       | Desktop                    | 150             | No                     |              |       |
| Community Center             | 2        | Fan (Large)                | 55              | No                     |              |       |
| Community Center             | 4        | Microwave                  | 1,000           | No                     |              |       |
| Community Center             | 1        | Paper Shredder             | 224             | No                     |              |       |
| Community Center             | 2        | Printer/Copier (Large)     | 600             | No                     |              |       |
| Community Center             | 2        | Refrigerator (Residential) | 450             | No                     |              |       |
| Community Center             | 1        | Refrigerator (Mini)        | 155             | No                     |              |       |
| Community Center             | 3        | Television                 | 125             | No                     |              |       |
| Community Center             | 1        | Toaster                    | 500             | No                     |              |       |
| Community Center             | 1        | Water Cooler               | 80              | No                     |              |       |
| Community Center             | 8        | Hand Dryer                 | 250             | No                     |              |       |
| Community Center - Firehouse | 1        | Coffee Machine             | 600             | No                     |              |       |
| Community Center - Firehouse | 9        | Desktop                    | 150             | No                     |              |       |
| Community Center - Firehouse | 1        | Microwave                  | 1,000           | No                     |              |       |
| Community Center - Firehouse | 1        | Paper Shredder             | 224             | No                     |              |       |
| Community Center - Firehouse | 3        | Printer (Medium/Small)     | 185             | No                     |              |       |
| Community Center - Firehouse | 1        | Printer/Copier (Large)     | 600             | No                     |              |       |
| Community Center - Firehouse | 1        | Projector                  | 224             | No                     |              |       |
| Community Center - Firehouse | 1        | Refrigerator (Residential) | 450             | No                     |              |       |
| Community Center - Firehouse | 1        | Speakers (Medium/Small)    | 15              | No                     |              |       |
| Community Center - Firehouse | 2        | Television                 | 125             | No                     |              |       |
| Community Center - Firehouse | 1        | Water Cooler               | 80              | No                     |              |       |

**Vending Machine Inventory & Recommendations**

| Location              | Existing Conditions |                            | Proposed Conditions |                   | Energy Impact & Financial Analysis |                          |                            |                                  |                         |                  |                                       |
|-----------------------|---------------------|----------------------------|---------------------|-------------------|------------------------------------|--------------------------|----------------------------|----------------------------------|-------------------------|------------------|---------------------------------------|
|                       | Quantity            | Vending Machine Type       | ECM #               | Install Controls? | Total Peak kW Savings              | Total Annual kWh Savings | Total Annual MMBtu Savings | Total Annual Energy Cost Savings | Estimated M&L Cost (\$) | Total Incentives | Simple Payback w/ Incentives in Years |
| Lobby Second Floor    | 1                   | Refrigerated               | 13                  | Yes               | 0.2                                | 1,612                    | 0                          | \$354                            | \$270                   | \$50             | 0.6                                   |
| Lobby Second Floor    | 1                   | Non-Refrigerated           | 13                  | Yes               | 0.0                                | 343                      | 0                          | \$75                             | \$270                   | \$0              | 3.6                                   |
| Lobby Second Floor    | 1                   | Glass Fronted Refrigerated | 13                  | Yes               | 0.1                                | 1,209                    | 0                          | \$265                            | \$270                   | \$50             | 0.8                                   |
| Fire House Ready Room | 1                   | Non-Refrigerated           | 13                  | Yes               | 0.0                                | 343                      | 0                          | \$75                             | \$270                   | \$0              | 3.6                                   |

# APPENDIX B: ENERGY STAR STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of site energy and source energy. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

## ENERGY STAR® Statement of Energy Performance

LEARN MORE AT [energystar.gov](http://energystar.gov)

N/A

### Verona Community Center (Campus)

**Primary Property Type:** Fitness Center/Health Club/Gym  
**Gross Floor Area (ft²):** 39,955  
**Built:** 1997

**For Year Ending:** August 31, 2023  
**Date Generated:** July 18, 2024

**ENERGY STAR® Score<sup>1</sup>**

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

| Property & Contact Information   |   |  |
|--|---|--|
| <b>Property Address</b><br>Verona Community Center (Campus)<br>880 Bloomfield Avenue<br>Verona, New Jersey 07044 | <b>Property Owner</b><br>Verona Township<br>600 Bloomfield Avenue<br>Verona, NJ 07044<br>(973) 239-4921 | <b>Primary Contact</b><br>Kevin O'Sullivan<br>600 Bloomfield Avenue<br>Verona, NJ 07044<br>(973) 239-4921<br>kosullivan@veronanj.org |
| <b>Property ID:</b> 33524118   |   |  |

| Energy Consumption and Energy Use Intensity (EUI) |                              |                 |   |      |
|---|------------------------------|-----------------|---|------|
| <b>Site EUI</b><br>54.2 kBtu/ft²                  | <b>Annual Energy by Fuel</b> |                 | <b>National Median Comparison</b>                               |      |
|   | Electric - Grid (kBtu)       | 883,138 (41%)   | National Median Site EUI (kBtu/ft²)                             | 63.5 |
|   | Natural Gas (kBtu)           | 1,284,087 (59%) | National Median Source EUI (kBtu/ft²)                           | 112  |
|   |                              |                 | % Diff from National Median Source EUI                          | -15% |
| <b>Source EUI</b><br>95.6 kBtu/ft²                |                              |                 | <b>Annual Emissions</b>   |      |
|   |                              |                 | Total (Location-Based) GHG Emissions<br>(Metric Tons CO2e/year) | 148  |

### Signature & Stamp of Verifying Professional

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**Licensed Professional**

\_\_\_\_\_  
 (\_\_\_\_) - \_\_\_\_\_  
 \_\_\_\_\_



**Professional Engineer or Registered Architect Stamp (if applicable)**



NJCEP uses the EPA's ENERGY STAR Portfolio Manager system to generate baseline energy usage results and comparable building EUIs. Portfolio Manager is specifically designed for benchmarking energy consumption within a building. It is believed that the utility bills for the Community Center Main building and annex have errors as the consumption seems too low for a building this size. For this reason, NJCEP is unable to provide an ENERGY STAR Score for this facility. Utility bills have been entered into Portfolio Manager for this facility. We encourage you to keep the utility bills updated monthly within Portfolio Manager for energy and cost savings purposes. However, the ENERGY STAR score (if applicable) and any median Energy Use Intensity (EUI) results shown within the building profile cannot be considered accurate due to the potential billing errors.

## APPENDIX C: GLOSSARY

| TERM                     | DEFINITION   |
|--------------------------|--|
| <b>Blended Rate</b>      | Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.  |
| <b>Btu</b>               | <i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.  |
| <b>CHP</b>               | <i>Combined heat and power</i> . Also referred to as cogeneration.   |
| <b>COP</b>               | <i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.   |
| <b>Demand Response</b>   | Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.   |
| <b>DCV</b>               | <i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.  |
| <b>US DOE</b>            | <i>United States Department of Energy</i>  |
| <b>EC Motor</b>          | <i>Electronically commutated motor</i>   |
| <b>ECM</b>               | <i>Energy conservation measure</i>   |
| <b>EER</b>               | <i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.  |
| <b>EUI</b>               | <i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.  |
| <b>Energy Efficiency</b> | Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service. |
| <b>ENERGY STAR</b>       | ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA.  |
| <b>EPA</b>               | <i>United States Environmental Protection Agency</i>   |
| <b>Generation</b>        | The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).   |
| <b>GHG</b>               | <i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.                                       |
| <b>gpf</b>               | <i>Gallons per flush</i>   |

|                  |   |
|------------------|---|
| <b>gpm</b>       | <i>Gallon per minute</i>  |
| <b>HID</b>       | <i>High intensity discharge</i> : high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.   |
| <b>hp</b>        | <i>Horsepower</i>   |
| <b>HPS</b>       | <i>High-pressure sodium</i> : a type of HID lamp.   |
| <b>HSPF</b>      | <i>Heating seasonal performance factor</i> : a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.   |
| <b>HVAC</b>      | <i>Heating, ventilating, and air conditioning</i>   |
| <b>IHP 2014</b>  | US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.   |
| <b>IPLV</b>      | <i>Integrated part load value</i> : a measure of the part load efficiency usually applied to chillers.  |
| <b>kBtu</b>      | One thousand British thermal units  |
| <b>kW</b>        | <i>Kilowatt</i> : equal to 1,000 Watts.   |
| <b>kWh</b>       | <i>Kilowatt-hour</i> : 1,000 Watts of power expended over one hour.   |
| <b>LED</b>       | <i>Light emitting diode</i> : a high-efficiency source of light with a long lamp life.  |
| <b>LGEA</b>      | <i>Local Government Energy Audit</i>  |
| <b>Load</b>      | The total power a building or system is using at any given time.  |
| <b>Measure</b>   | A single activity, or installation of a single type of equipment, which is implemented in a building system to reduce total energy consumption.   |
| <b>MH</b>        | <i>Metal halide</i> : a type of HID lamp.   |
| <b>MBh</b>       | <i>Thousand Btu per hour</i>  |
| <b>MBtu</b>      | <i>One thousand British thermal units</i>   |
| <b>MMBtu</b>     | <i>One million British thermal units</i>  |
| <b>MV</b>        | <i>Mercury Vapor</i> : a type of HID lamp.  |
| <b>NJBPU</b>     | <i>New Jersey Board of Public Utilities</i>   |
| <b>NJCEP</b>     | <i>New Jersey's Clean Energy Program</i> : NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment. |
| <b>psig</b>      | Pounds per square inch gauge  |
| <b>Plug Load</b> | Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.   |
| <b>PV</b>        | <i>Photovoltaic</i> : refers to an electronic device capable of converting incident light directly into electricity (direct current).   |

|                             |   |
|-----------------------------|---|
| <b>SEER</b>                 | <i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input. |
| <b>SEP</b>                  | <i>Statement of energy performance</i> : a summary document from the ENERGY STAR Portfolio Manager.   |
| <b>Simple Payback</b>       | The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.      |
| <b>SREC (II)</b>            | <i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.                    |
| <b>T5, T8, T12</b>          | A reference to a linear lamp diameter. The number represents increments of 1/8 <sup>th</sup> of an inch.                                      |
| <b>Temperature Setpoint</b> | The temperature at which a temperature regulating device (thermostat, for example) has been set.  |
| <b>therm</b>                | 100,000 Btu. Typically used as a measure of natural gas consumption.  |
| <b>tons</b>                 | A unit of cooling capacity equal to 12,000 Btu/hr.  |
| <b>Turnkey</b>              | Provision of a complete product or service that is ready for immediate use.   |
| <b>VAV</b>                  | <i>Variable air volume</i>  |
| <b>VFD</b>                  | <i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.   |
| <b>WaterSense®</b>          | The symbol for water efficiency. The WaterSense® program is managed by the EPA.   |
| <b>Watt (W)</b>             | Unit of power commonly used to measure electricity use.   |