



Local Government Energy Audit Report

Chestnut Ridge Middle School

September 4, 2024

Prepared for:

Washington Township BOE
641 Hurffville-Cross Keys Road
Sewell, New Jersey 08080

Prepared by:

TRC
317 George Street
New Brunswick, New Jersey 08901



Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based on previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2024 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product, or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks, or copyrights.

Table of Contents

1	Executive Summary	1
1.1	Planning Your Project	4
	Pick Your Installation Approach	4
	Options from Your Utility Company	4
	Options from New Jersey's Clean Energy Program	5
2	Existing Conditions	6
2.1	Site Overview	6
2.2	Building Occupancy	6
2.3	Building Envelope	7
2.4	Lighting Systems	8
2.5	Air Handling Systems	10
	Unit Ventilators	10
	Unitary Electric HVAC Equipment	11
	Unitary Heating Equipment	11
	Packaged Units	12
	Air Handling Units (AHUs)	14
2.6	Heating Hot Water Systems	15
2.7	Chilled Water Systems	17
2.8	Building Automation System (BAS)	19
2.9	Domestic Hot Water	19
2.10	Food Service Equipment	20
2.11	Refrigeration	21
2.12	Plug Load and Vending Machines	22
2.13	Water-Using Systems	22
3	Energy and Water Use and Costs	24
3.1	Electricity	26
3.2	Natural Gas	27
3.3	Water	28
3.4	Benchmarking	30
	Tracking your Energy Performance	31
3.5	Understanding Your Utility Bills	32

4	Energy Conservation Measures	33
4.1	Lighting.....	36
	ECM 1: Retrofit Fixtures with LED Lamps.....	36
4.2	Lighting Controls	36
	ECM 2: Install Occupancy Sensor Lighting Controls.....	36
	ECM 3: Install High/Low Lighting Controls.....	37
4.3	Variable Frequency Drives (VFD)	37
	ECM 4: Install VFDs on Constant Volume (CV) Fans	38
4.4	Unitary HVAC	38
	ECM 5: Install High Efficiency Air Conditioning Units	38
4.5	Gas-Fired Heating.....	39
	ECM 6: Install High Efficiency Hot Water Boilers.....	39
4.6	Domestic Water Heating.....	39
	ECM 7: Install Low-Flow DHW Devices	39
4.7	Food Service and Refrigeration Measures.....	40
	ECM 8: Dishwasher Replacement	40
	ECM 9: Refrigeration Controls	40
	ECM 10: Replace Refrigeration Equipment.....	40
	ECM 11: Vending Machine Control.....	40
4.8	Measures for Future Consideration.....	40
	Retro-Commissioning Study.....	41
	VRF Systems	41
5	Energy Efficient Best Practices.....	43
	Energy Tracking with ENERGY STAR Portfolio Manager	43
	Weatherization	43
	Doors and Windows.....	43
	Lighting Maintenance	43
	Lighting Controls	44
	Motor Controls.....	44
	Motor Maintenance.....	44
	Thermostat Schedules and Temperature Resets.....	44
	Economizer Maintenance	44
	Chiller Maintenance.....	44
	AC System Evaporator/Condenser Coil Cleaning.....	45



HVAC Filter Cleaning and Replacement 45

Ductwork Maintenance 45

Boiler Maintenance..... 45

Optimize HVAC Equipment Schedules 45

Water Heater Maintenance 46

Procurement Strategies 46

6 Water Best Practices.....47

 Getting Started..... 47

 Water Metering and Submetering..... 47

 Leak Detection and Repair 48

 Toilets and Urinals 48

 Faucets and Showerheads 48

 Commercial Kitchen Equipment 49

 Landscaping and Irrigation..... 50

7 On-Site Generation51

 7.1 Solar Photovoltaic 52

 7.2 Combined Heat and Power 54

8 Electric Vehicles.....55

 8.1 EV Charging 55

9 Project Funding and Incentives57

 9.1 New Jersey’s Clean Energy Program 58

 9.2 Utility Energy Efficiency Programs 65

10 Project Development67

11 Energy Purchasing and Procurement Strategies68

 11.1 Retail Electric Supply Options 68

 11.2 Retail Natural Gas Supply Options 68

Appendix A: Equipment Inventory & Recommendations A-1


Appendix B: ENERGY STAR Statement of Energy Performance..... B-1

Appendix C: Glossary C-1


1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Chestnut Ridge Middle School. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT

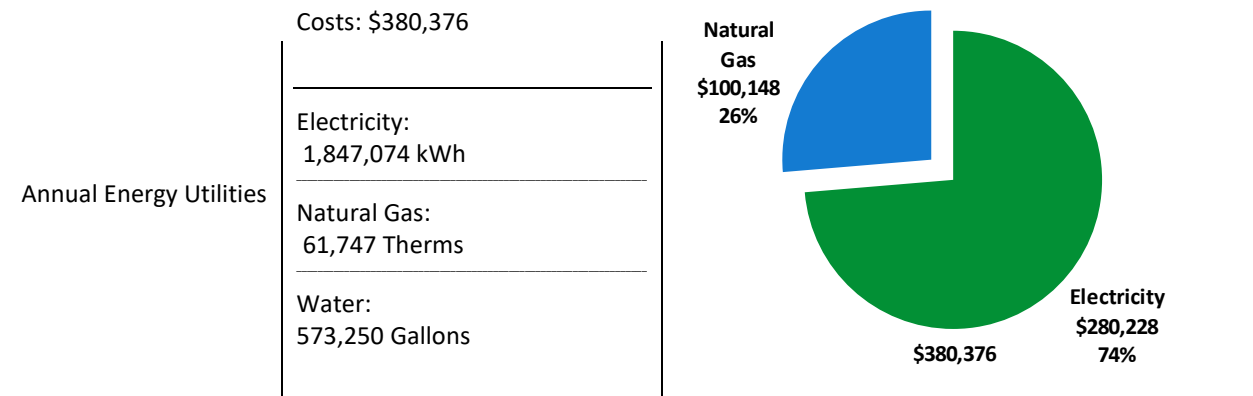

ENERGY STAR® Benchmarking Score	2 <i>(1-100 scale)</i>	This building performs at or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.
------------------------------------	---------------------------	--

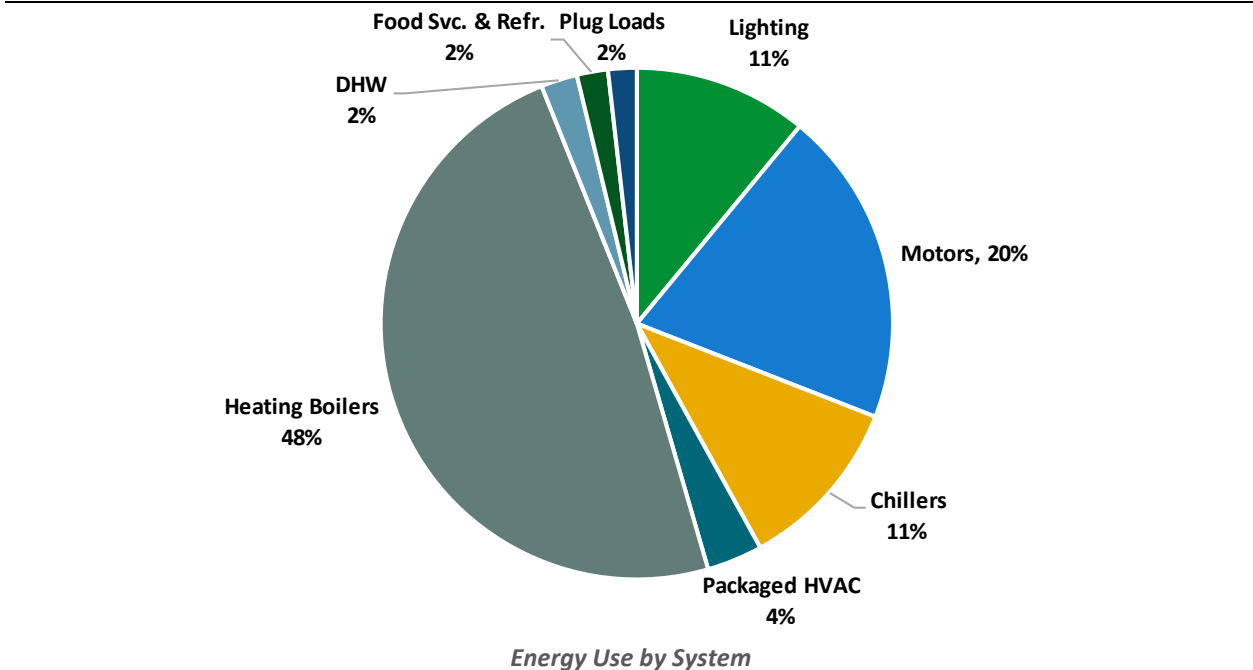


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (All Evaluated Measures)

Installation Cost	\$457,870
Potential Rebates & Incentives ¹	\$40,060
Annual Cost Savings	\$56,035
Annual Energy Savings	Electricity: 315,734 kWh Natural Gas: 5,015 Therms
Greenhouse Gas Emission Savings	188 Tons
Simple Payback	7.5 Years
Site Energy Savings (All Utilities)	13%

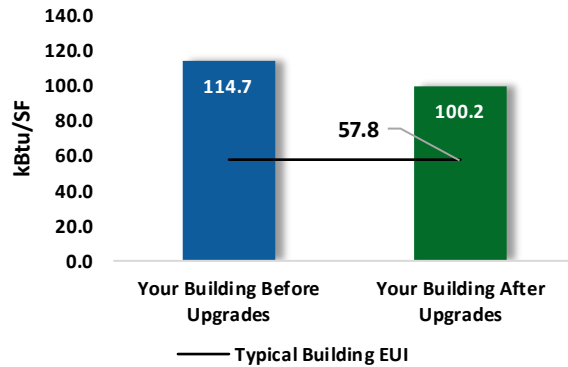

Scenario 2: Cost Effective Package²

Installation Cost	\$143,350
Potential Rebates & Incentives	\$24,800
Annual Cost Savings	\$44,307
Annual Energy Savings	Electricity: 290,383 kWh Natural Gas: 155 Therms
Greenhouse Gas Emission Savings	147 Tons
Simple Payback	2.7 Years
Site Energy Savings (all utilities)	8%

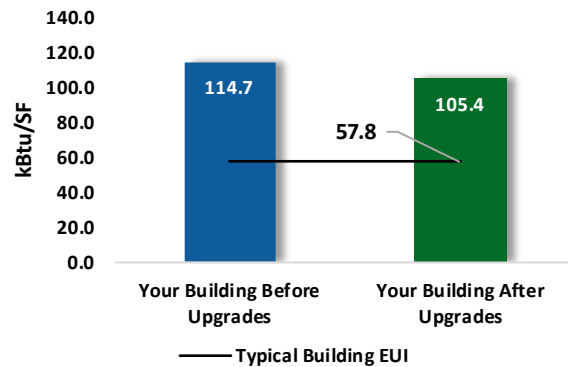

On-site Generation Potential

Photovoltaic	High
Combined Heat and Power	None

¹ Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			206,177	31.3	-43	\$30,581	\$65,680	\$13,310	\$52,370	1.7	202,571
ECM 1	Retrofit Fixtures with LED Lamps	Yes	206,177	31.3	-43	\$30,581	\$65,680	\$13,310	\$52,370	1.7	202,571
Lighting Control Measures			62,103	9.3	-13	\$9,211	\$46,730	\$10,200	\$36,530	4.0	61,017
ECM 2	Install Occupancy Sensor Lighting Controls	Yes	55,178	8.3	-12	\$8,184	\$38,290	\$4,510	\$33,780	4.1	54,213
ECM 3	Install High/Low Lighting Controls	Yes	6,925	1.0	-1	\$1,027	\$8,440	\$5,690	\$2,750	2.7	6,804
Variable Frequency Drive (VFD) Measures			16,997	5.3	0	\$2,579	\$32,800	\$1,200	\$31,600	12.3	17,116
ECM 4	Install VFDs on Constant Volume (CV) Fans	No	16,997	5.3	0	\$2,579	\$32,800	\$1,200	\$31,600	12.3	17,116
Unitary HVAC Measures			7,085	6.6	0	\$1,075	\$56,600	\$3,600	\$53,000	49.3	7,135
ECM 5	Install High Efficiency Air Conditioning Units	No	7,085	6.6	0	\$1,075	\$56,600	\$3,600	\$53,000	49.3	7,135
Gas Heating (HVAC/Process) Replacement			0	0.0	486	\$7,881	\$221,000	\$10,300	\$210,700	26.7	56,896
ECM 6	Install High Efficiency Hot Water Boilers	No	0	0.0	486	\$7,881	\$221,000	\$10,300	\$210,700	26.7	56,896
Domestic Water Heating Upgrade			0	0.0	20	\$326	\$400	\$190	\$210	0.6	2,353
ECM 7	Install Low-Flow DHW Devices	Yes	0	0.0	20	\$326	\$400	\$190	\$210	0.6	2,353
Food Service & Refrigeration Measures			23,372	2.6	52	\$4,382	\$34,660	\$1,260	\$33,400	7.6	29,569
ECM 8	Dishwasher Replacement	Yes	8,110	0.9	52	\$2,066	\$22,000	\$1,000	\$21,000	10.2	14,200
ECM 9	Refrigeration Controls	No	1,269	0.0	0	\$193	\$4,120	\$160	\$3,960	20.6	1,278
ECM 10	Replace Refrigeration Equipment	Yes	11,172	1.3	0	\$1,695	\$8,000	\$0	\$8,000	4.7	11,250
ECM 11	Vending Machine Control	Yes	2,821	0.3	0	\$428	\$540	\$100	\$440	1.0	2,840
TOTALS (COST EFFECTIVE MEASURES)			290,383	43.1	16	\$44,307	\$143,350	\$24,800	\$118,550	2.7	294,232
TOTALS (ALL MEASURES)			315,734	55.0	501	\$56,035	\$457,870	\$40,060	\$417,810	7.5	376,657

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

All Evaluated Energy Improvements³

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

³ TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations.

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decision to make, such as:

- ◆ How will the project be funded/and or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

Utility-run energy efficiency programs and New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives *before* purchasing materials or starting installation.

Options from Your Utility Company

Prescriptive and Custom Rebates

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the Prescriptive and Custom Rebates program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval may be required for some incentives. Contact your utility company for more details prior to project installation.

Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized contractor. This program can provide incentives up to 70% or 80% of the cost of selected measures. A Direct Install contractor will assess and verify individual measure eligibility and perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Engineered Solutions

The Engineered Solutions program provides tailored energy-efficiency assistance and turnkey engineering services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. The program provides all professional services from audit, design, construction administration, to commissioning and measurement and verification for custom whole-building energy-efficiency projects. Engineered Solutions allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs.

For more details on these programs please contact your utility provider.

Options from New Jersey's Clean Energy Program

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat and Power (CHP)

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Successor Solar Incentive Program (SuSI)

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

Large Energy User Program (LEUP)

LEUP is designed to promote self-investment in energy efficiency for the largest energy consumers in the state. Customers in this category spend about \$5 million a year on energy bills. This program incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

For more details on these programs please visit [New Jersey's Clean Energy Program website](#).



2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Chestnut Ridge Middle School. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On March 27, 2024, TRC performed an energy audit at Chestnut Ridge Middle School located in Sewell, New Jersey. TRC met with Bob Schoenfeldt to review the facility operations and help focus our investigation on specific energy-using systems.

Chestnut Ridge Middle School is a two-story, 108,813 square foot building built in 1989. Spaces include classrooms, gymnasium, theater stage, offices, cafeteria, corridors, stairwells, offices, commercial kitchen, and mechanical/janitorial spaces. All interior areas at this site are served by a single electric and gas meter. An additional electric meter is installed to serve outdoor/parking lot lighting. A natural gas generator is operated in case of a power emergency.

Lighting systems generally consist of combination of linear fluorescent lamps and LED sources. The facility is 100% heated and cooled by a combination of hot/chilled water systems connected to rooftop mounted air handlers and package units.

Recent Improvements and Facility Concerns

No recent improvements to the facility were noted during the energy audit.

Facility staff is in the process of replacing fluorescent tubes with new LED lamps as they fail.

2.2 Building Occupancy

Chestnut Ridge Middle School is fully occupied for ten months of the year. Typical weekday occupancy is 89 staff and 648 students. The facility is operated until approximately 11:00 PM for maintenance. This facility does experience summer occupancy for summer school activities, although this occupation is rotated between different facilities depending on the year. The facility's gymnasium is operational during weekends for six to eight hours from November to April.

It should be noted that the energy and economic analysis for the facilities is based on the use of the building during the utility billing period, and that results will vary based on changes to the building.

Building Name	Weekday/Weekend	Operating Schedule
Chestnut Ridge - Building Operation Hours	Weekday	6:00 AM - 11:00 PM
	Weekend	NA
Chestnut Ridge - Class Hours	Weekday	7:50 AM - 2:30 PM
	Weekend	NA
Chestnut Ridge - Winter Saturday Gymnasium Hours	Weekday	NA
	Weekend	10:00 AM - 4:00 PM
Chestnut Ridge - Winter Sunday Gymnasium Hours	Weekday	NA
	Weekend	10:00 AM - 6:00 PM

Building Occupancy Schedule

2.3 Building Envelope

Exterior building walls are made of painted concrete masonry units (CMUs). Interior walls are constructed of painted CMUs with an interior finish. The level of exterior wall insulation is unknown. Steel trusses support a flat roof with a black EDPM covering that is in good condition, having been replaced within the last ten years.

The majority of the windows are single pane and have sliding aluminum frames with a thermal break. The glass-to-frame seals are in fair condition. The operable window weather seals are in fair condition, showing little evidence of excessive wear. Exterior doors are insulated fiberglass, have aluminum frames, and are in good condition with undamaged door seals. Degraded window and door seals increase drafts and outside air infiltration.




Typical Windows



Exterior Walls



Flat Roof with Black Membrane

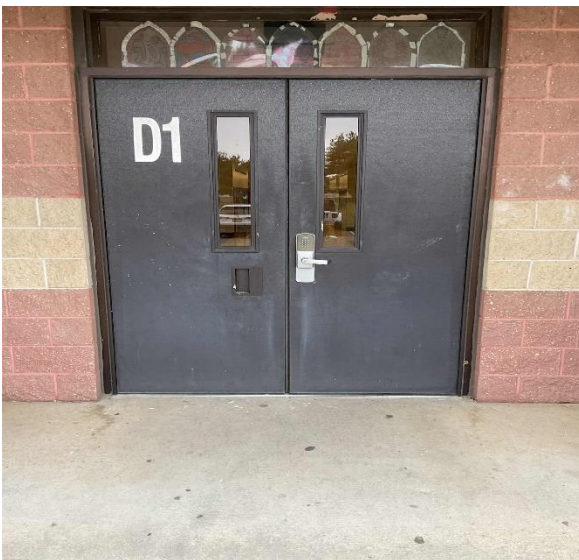

Typical Exterior Doors

2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. Linear fixture types include 1-lamp, 2-lamp, 3-lamp, or 4-lamp, 2-foot or 4-foot-long recessed and surface mounted fixtures. Typically, T8 fluorescent lamps use electronic ballasts.

The facility's main and adaptive gymnasiums have had their lighting updated to new LED high bay fixtures. Linear fixtures and screw-based lights in some restrooms, classrooms, and storage rooms have been replaced with LED lighting panels or LED equivalents to the previously installed lights. Incandescent and compact fluorescent lamps (CFL) are still found in some janitorial closets, kitchen, and shop classroom.

Most fixtures are in good condition and interior lighting levels are generally sufficient. All exit signs are LED. Light fixtures in spaces are either controlled by occupancy sensors or manual wall switches. Occupancy sensors are either wall or ceiling mounted.

Exterior building illumination is provided by LED wall packs. Parking lot/street lighting is provided by pole-mounted retrofit LED bulbs. These lights are controlled by photocells and timeclocks, respectively. The site lighting is fed from its own dedicated electric meter.




Typical T8 Linear Fluorescent Lighting



Kitchen CFLs



LED Light Panels in Restrooms

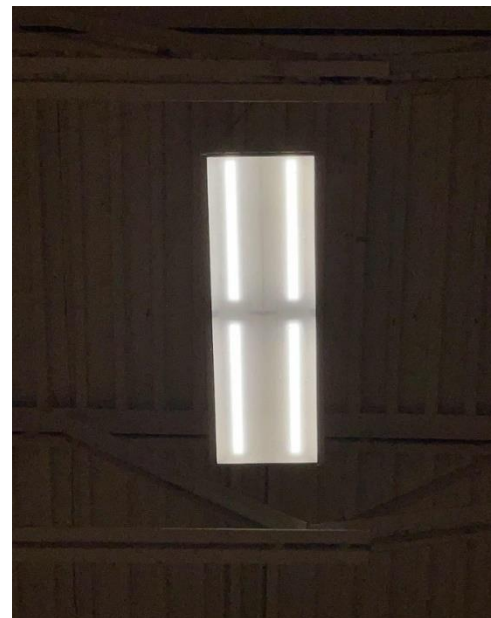

LED High Bay Lighting in Gymnasium



LED Wall Packs



LED-Retrofit Street Lighting

2.5 Air Handling Systems


Unit Ventilators

Variable air volume (VAV) boxes are utilized to condition most spaces within the facility. The VAV boxes are equipped with supply fan motors and pneumatically controlled air dampers and zone valves connected to the package units and air handlers on the roof. They provide heating, cooling, and ventilation to classrooms, offices, and corridors. This system is original to the building and appears to be in fair operating condition.

An additional unlabeled ceiling-mounted unit heater is installed in a second-floor storage room. This unit only provides heating and is supplied by the hot water boilers. The units appear to be in good condition.



Ceiling-Mounted Unit Heater

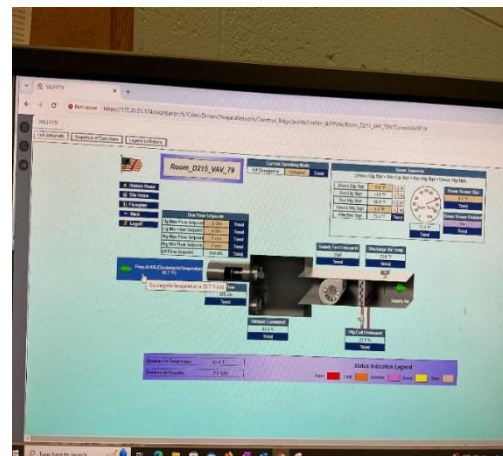

BAS Screenshot – Typical VAV Configuration

Unitary Electric HVAC Equipment

One of the facility's second story storage rooms utilizes a Fujitsu split-system air-sourced heat pump for conditioning. The unit has a cooling capacity of 1.83 tons with an efficiency rating of 16.5 SEER and a heating capacity of 24 MBh with an efficiency rating of 7.0 HSPF. The unit is in good condition and is not ENERGY STAR labeled.



Fujitsu Air-Sourced Heat Pump Outdoor Unit



Fujitsu Air-Sourced Heat Pump Indoor Unit

Unitary Heating Equipment

The facility's mechanical room is heated by a wall mounted electric resistance unit heater. This unit has a heating capacity of 4.39 MBh and a coefficient of performance (COP) of 1.00. The unit is in fair condition and is controlled by a manual dial thermostat.



Mechanical Room Unit Heater

Packaged Units

Larger building spaces are served by multiple roof-mounted packaged air conditioning units. The units provide cooling through direct expansion coils and heating from the hot water loop. They are a mix of single and multizone units. These vary in cooling capacity between 4.20 tons and 40 tons. The units are equipped with supply fans ranging from 1.0 hp to 15.0 hp. RTU-10A, RTU-10B, and RTU-15 are equipped with variable frequency drives (VFDs) The units are nearing the end of their useful life and have been evaluated for replacement except for two units (RTU 9 and RTU 11) that are in good condition. The units are controlled by the BAS.

Unit	Area Served	Cooling Size	Efficiency	Heating Size	Condition
RTU-8	Adaptive Gymnasium	8.40 Tons	10.0 SEER	N/A	Beyond Useful Life
RTU-9	Boy's Locker Room	10.0 Tons	13.0 SEER	120.0 MBh	Within Useful Life
RTU-10A	Gymnasium	35.0 Tons	10.53 SEER	420.0 MBh	Beyond Useful Life
RTU-10B	Gymnasium	35.0 Tons	10.53 SEER	420.0 MBh	Beyond Useful Life
RTU-11	Girl's Locker Room	15.0 Tons	13.0 SEER	180. MBh	Within Useful Life
RTU-13	Faculty Dining Room	4.20 Tons	10.26 SEER	N/A	Beyond Useful Life
RTU-14	Kitchen	17.8 Tons	10.53 SEER	N/A	Beyond Useful Life
RTU-15	Cafeteria	40.0 Tons	10.53 SEER	N/A	Beyond Useful Life
RTU-17	Media Center & Computer Labs	4.20 Tons	10.26 SEER	N/A	Beyond Useful Life
RTU-18	Media Center & Computer Labs	4.20 Tons	10.26 SEER	N/A	Beyond Useful Life

Refer to Appendix A for detailed information about each unit.



Typical RTU with Hot Water Heating



Typical Cooling-Only RTUs

Unit	Room Temp	Disch Temp	EF Disch Slpt	Room Humidity	Freeze Stat	Fan Command	Dr Dmper Command	Htg Valve Command	Dr Stages	Hot Gas Reshtr
RTU8	66.6 °F	67.3 °F	84.0 °F	0.0 %RH	Normal	Start	0.0 %	17.6 %	0	Disable
RTU9	70.4 °F	73.9 °F	70.3 °F	29.2 %RH	N/A	Start	0.0 %	0.0 %	100.0 %	0
RTU10A	69.2 °F	61.1 °F	81.4 °F	0.0 %RH	Normal	Start	0.0 %	17.8 %	0	Disable
RTU10B	70.0 °F	64.4 °F	78.6 °F	25.7 %RH	Normal	Start	0.0 %	0.0 %	0	Disable
RTU11	63.8 °F	64.4 °F	110.0 °F	N/A	N/A	Stop	0.0 %	0.0 %	0	100.0 %
RTU13	60.1 °F	62.8 °F	82.0 °F	29.7 %RH	Normal	Start	0.0 %	45.1 %	0	Disable
RTU14	70.2 °F	49.7 °F	65.0 °F	32.4 %RH	Normal	Start	0.0 %	19.0 %	0	Disable
RTU15	69.0 °F	66.6 °F	65.0 °F	27.9 %RH	Normal	Start	0.0 %	0.0 %	0	Disable
RTU17	71.1 °F	70.8 °F	65.3 °F	0.0 %RH	Normal	Stop	0.0 %	0.0 %	0	Disable
RTU18	70.1 °F	68.8 °F	71.4 °F	0.0 %RH	Normal	Start	0.0 %	0.0 %	0	Disable

Unit	Unocc Cdp Setpoint	Occ Cdp Setpoint	Occ Htg Setpoint	Unocc Htg Slpt	Defrost Setpoint	Defrost Status	Outdoor Embury	Zone Embury	Economizer Status
RTU8	60.0 °F	71.0 °F	69.0 °F	70.0 °F	50.0 %RH	Disable	0.0 BTU/lb	0.0 BTU/lb	Disabled
RTU9	60.0 °F	72.0 °F	70.0 °F	65.0 °F	N/A	N/A	N/A	N/A	N/A
RTU10A	75.0 °F	72.0 °F	78.0 °F	65.0 °F	65.0 %RH	Disable	0.0 BTU/lb	0.0 BTU/lb	Disabled
RTU10B	75.0 °F	71.0 °F	68.0 °F	65.0 °F	65.0 %RH	Disable	0.0 BTU/lb	0.0 BTU/lb	Disabled
RTU11	60.0 °F	72.0 °F	76.0 °F	65.0 °F	N/A	N/A	N/A	N/A	N/A
RTU13	60.0 °F	72.0 °F	76.0 °F	60.0 °F	50.0 %RH	Disable	0.0 BTU/lb	21.1 BTU/lb	Disabled
RTU14	60.0 °F	72.0 °F	76.0 °F	60.0 °F	65.0 %RH	Disable	0.0 BTU/lb	21.1 BTU/lb	Disabled
RTU15	60.0 °F	71.0 °F	69.0 °F	60.0 °F	50.0 %RH	Disable	0.0 BTU/lb	21.1 BTU/lb	Disabled
RTU17	60.0 °F	71.0 °F	68.0 °F	60.0 °F	50.0 %RH	Disable	0.0 BTU/lb	20.2 BTU/lb	Disabled
RTU18	60.0 °F	71.0 °F	69.0 °F	60.0 °F	50.0 %RH	Disable	0.0 BTU/lb	20.2 BTU/lb	Disabled

Outdoor Air Temperature: 43.4 °F
 Outdoor Air Humidity: 7.0 %RH


Status Indication Legend: Alarm (Red), Fault (Orange), Override (Green), Down (Purple), Start (Yellow)

BAS Screenshot - Rooftop Units

Air Handling Units (AHUs)

The two-story section of the facility is conditioned by seven York air-handling units which are each equipped with a supply fan, exhaust fan, chilled water coil, and hot water coil. The units are labeled AHU-1, AHU-2, AHU-3, AHU-5, AHU-6, and AHU-7. These units are located on the roof of the facility. An additional AHU, labeled AHU-12 is located within the mechanical room and has the same configuration as the other AHUs. The supply fan motors for the AHU's vary between 5.0 hp to 30.0 hp. The exhaust fan motors vary between 3.0 hp to 15.0 hp. They are all fractional horsepower multi-speed ECM fan motors. Cooling is provided by the chilled water system and the heating source is provided by the hot water boilers.

Unit	Area Served	Capacity	Condition
AHU-1	Sections 1C, 1D, 2C, and 2D	15.0 Tons	Beyond Useful Life
AHU-2	Sections 1C, 1D, 2C, and 2D	15.0 Tons	Beyond Useful Life
AHU-3	Sections 1C, 1D, 2C, and 2D	65.0 Tons	Beyond Useful Life
AHU-4	Sections 1C, 1D, 2C, and 2D	65.0 Tons	Beyond Useful Life
AHU-5	Sections 1C, 1D, 2C, and 2D	55.0 Tons	Beyond Useful Life
AHU-6	Sections 1C, 1D, 2C, and 2D	65.0 Tons	Beyond Useful Life
AHU-7	Section 1A	55.0 Tons	Beyond Useful Life
AHU-12	Mechanical Room	10.0 Tons	Beyond Useful Life

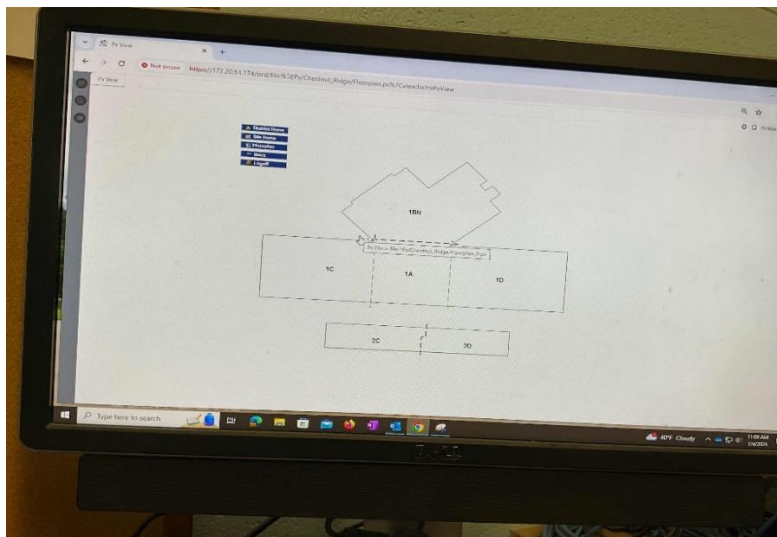

BAS Screenshot - Building Sections

The AHUs are in fair condition but are heavily weather-worn and their serial numbers are no longer legible. Based on documentation provided by facility maintenance staff, these units are operating beyond their useful life. All the AHUs are equipped with VFDs and are controlled by the facility's BAS.



Rooftop AHUs

Unit	Room Temp	RH Room Setpt	Duct Temp	Fan Command	Box Flow	RH Flow Setpt	Chiller Command	Return Valve Command	Damper Cfg Setpt	CO2 Htg Setpt	Last Dev Indict
Attendance_VAV_14	69.1 °F	65.0 °F	62.2 °F	Run	72 cfm	12 cfm	0.0 %	0.0 %	11.0 °F	68.0 °F	Run
Room_A103_VAV_1	71.4 °F	71.0 °F	65.0 °F	Run	200 cfm	12 cfm	0.0 %	0.0 %	11.0 °F	68.0 °F	Run
Room_A104_VAV_2	68.0 °F	65.0 °F	65.0 °F	Run	150 cfm	12 cfm	40.0 %	75.0 %	7.0 °F	71.0 °F	Run
Room_A105_VAV_3	65.0 °F	65.0 °F	62.2 °F	Run	140 cfm	12 cfm	30.0 %	80.0 %	10.0 °F	68.0 °F	Run
Room_A107_VAV_4	72.0 °F	65.0 °F	65.0 °F	Run	170 cfm	12 cfm	31.0 %	0.0 %	68.0 °F	68.0 °F	Run
Room_A107_VAV_5	69.0 °F	65.0 °F	62.2 °F	Run	140 cfm	12 cfm	0.0 %	0.0 %	68.0 °F	68.0 °F	Run
Room_A107_VAV_6A	70.0 °F	65.0 °F	64.4 °F	Run	210 cfm	200 cfm	41.0 %	0.0 %	68.0 °F	67.0 °F	Run
Room_A110_VAV_9B	68.0 °F	65.0 °F	62.2 °F	Run	80 cfm	100 cfm	0.0 %	0.0 %	68.0 °F	68.0 °F	Run
Room_A111_VAV_8	68.0 °F	65.0 °F	62.2 °F	Run	110 cfm	70 cfm	0.0 %	0.0 %	71.0 °F	68.0 °F	Run
Room_A113_VAV_9	68.0 °F	65.0 °F	62.2 °F	Run	100 cfm	100 cfm	0.0 %	0.0 %	71.0 °F	68.0 °F	Run
Room_A114_VAV_11	69.0 °F	65.0 °F	62.2 °F	Run	200 cfm	10 cfm	0.0 %	0.0 %	10.0 °F	62.0 °F	Run
Room_A116_VAV_10	68.0 °F	65.0 °F	62.2 °F	Run	110 cfm	100 cfm	44.0 %	20.0 %	21.0 °F	68.0 °F	Run
Room_A118_VAV_7	71.0 °F	65.0 °F	62.2 °F	Run	200 cfm	250 cfm	44.0 %	3.0 %	21.0 °F	68.0 °F	Run
Room_P001-VAV_15	69.0 °F	65.0 °F	64.0 °F	Run	15 cfm	1.0 cfm	0.0 %	0.0 %	21.0 °F	68.0 °F	Run
Room_P002-VAV_16	69.0 °F	65.0 °F	64.0 °F	Run	4 cfm	0.0 cfm	0.0 %	0.0 %	21.0 °F	68.0 °F	Run

Unit	Duct Temp	Return Air Setpt	Return Air CO2	Return Air CO2 Setpt	Return Air Temp	Outdoor Air Flow	Room Status	Supply Status	Filter Status
AHU1	60.4 °F	50.0 °F	2.4 ppm	40.0 ppm	40.7 °F	44.0 cfm	1.00 in.wc	1.00 in.wc	Filter OK
	62.0 °F	50.0 °F	50.0 ppm	1000 ppm		1.00 cfm	0.00 in.wc	0.00 in.wc	Filter OK
	50.0 °F						1.00 in.wc	1.00 in.wc	

Supply Fan Command	Return Fan Command	Chiller Command	Return Valve Command	CO2 Htg Command	Supply VFD Command	Return VFD Command
Run	Run	0.0 %	0.0 %	0.0 %	0.0 %	0.0 %

Parameter	Value
Outdoor Air Temperature	43.4 °F
Outdoor Air Humidity	2.8 %RH

Status Indication Legend

Alarm	Fail	Overheat	Overrun	Stuck	Stop
-------	------	----------	---------	-------	------

BAS Screenshot - Typical AHU to VAV Connection Configuration

2.6 Heating Hot Water Systems


Three non-condensing HB-Smith 2,636 MBh hot water boilers serve the building's heating load. The burners are non-modulating with a nominal efficiency of 78%. The boilers are configured in an automated control scheme. Multiple boilers are required under high load conditions. Installed in 2005, they are in good condition, but nearing the end of their useful life.

The hydronic distribution system is a two-pipe heating and cooling system.


Seasonal changeover begins in November for the heating season and in April for the cooling season.

The boilers are configured in a variable flow primary distribution with two, 40.0 hp VFD controlled hot water pumps operating with an automated control scheme. The boilers provide hot water to the various air handlers and RTUs throughout the building.


Hot water is supplied at 185°F when the outside air temperature is low, and the setpoint is adjusted linearly to 170°F when the outside air is above 40°F. The hot water return temperature is typically 165°F.

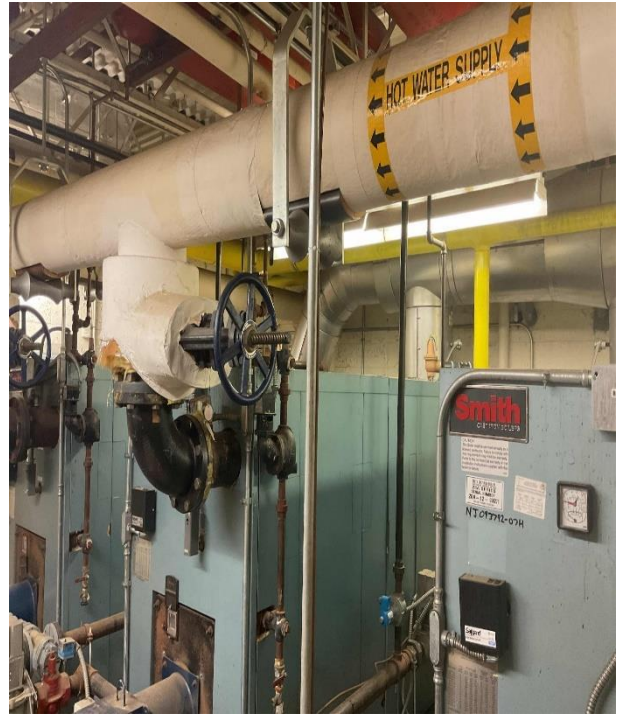

Heating Hot Water Boilers and Layout

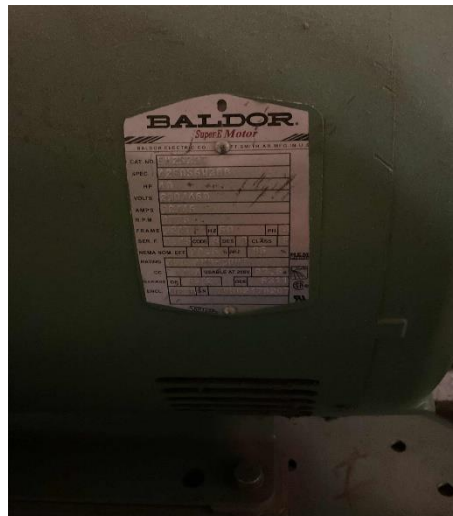

Heating Hot Water Pumps and VFD Controllers

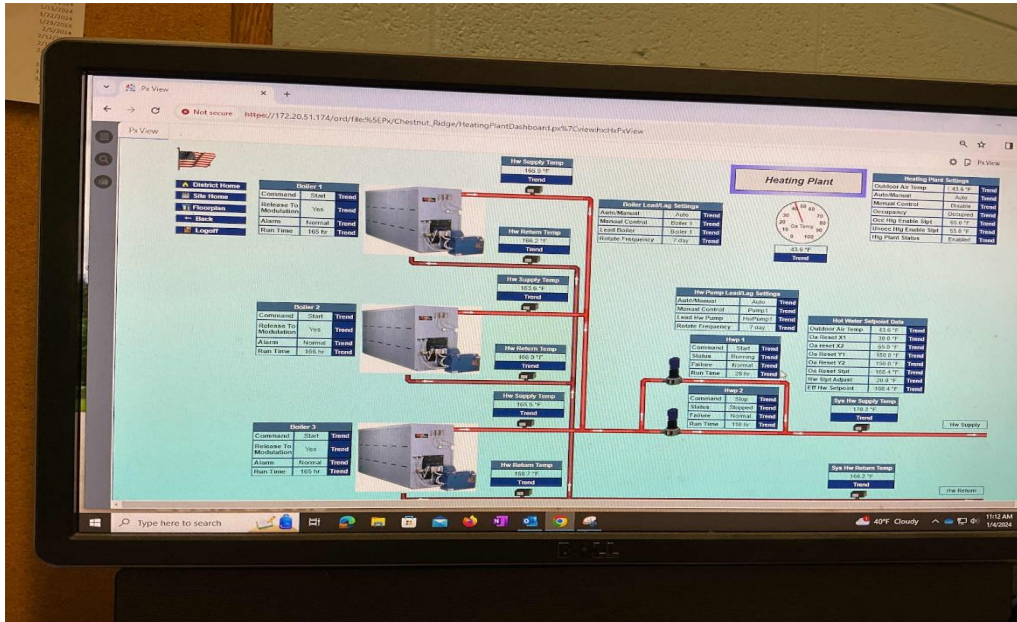

BAS Screenshot - Heating Plant Configuration

2.7 Chilled Water Systems

The chiller plant consists of a two, 225-ton, Carrier, R-22, air-cooled screw chillers. The chillers are supplied by two, 60.0 hp pumps, with both pumps being VFD-controlled. Both chillers were installed in 2023 and are well within their expected useful lifespan.


The chiller plant supplies chilled water to the facility's various air handlers. The chiller plant has a peak load of 450 tons. The facility's BAS controls the chillers to meet the load, operating the least number of chillers required.



Carrier Chillers



Chilled Water Pumps and VFD-Controllers

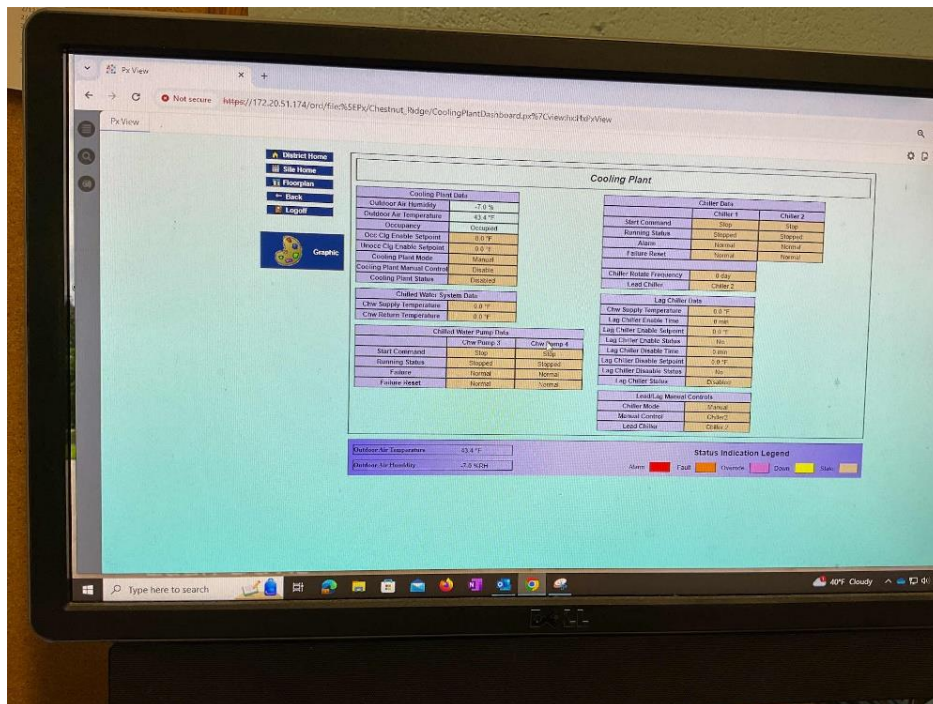

BAS Screenshot - Chilled Water Plant



Domestic Hot Water Storage Tank

2.10 Food Service Equipment

The kitchen has all electric equipment that is used to prepare meals for students. Most cooking is done using an electric oven. Bulk prepared foods are held in several electric holding cabinets. Equipment is not high efficiency and is in fair condition.

The dishwasher is a non-ENERGY STAR high temperature, door type unit. The unit is supplemented by a 30-kW booster water.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.



Typical Food Service Equipment



Non-ENERGY STAR Dishwasher



Booster Heater

2.11 Refrigeration

The kitchen has several stand-up refrigerators with solid doors. There are several freezer and refrigerator chests as well. All equipment is standard efficiency and in good condition.

The walk-in refrigerator has an estimated 0.91-ton compressor and two-fan evaporator. This unit has air defrost controls but lacks evaporator fan controls.

The walk-in medium temperature freezer has a 0.83-ton compressor and two-fan evaporator. This unit has electric defrost controls but lacks evaporator fan controls.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.



Walk-In Evaporators



Typical Refrigerator Chest

2.12 Plug Load and Vending Machines

The location is doing a great job managing the electrical plug loads. This report makes additional suggestions for ECMs in this area as well as energy efficient best practices.

There are 171 computer workstations throughout the facility. Plug loads include general cafe and office equipment. There are classroom typical loads such as televisions, projectors, and fans.

There are several residential-style refrigerators throughout the building that are used to store faculty meals and classroom supplies. These vary in condition and efficiency.

There is one refrigerated beverage vending machines and one non-refrigerated vending machines. Vending machines are not equipped with occupancy-based controls.



Typical Plug Load Fixtures

2.13 Water-Using Systems

Water is (mainly) provided by a municipal water supply company. Potable water is used for drinking, cleaning, cooking, sanitary fixtures, and building conditioning. Water leaks were not observed/reported.

EPA WaterSense® has set maximum flow rates for sanitary fixtures. They are: 1.28 gallons per flush (gpf) for toilets, 0.5 gpf for urinals, 1.5 gallons per minute (gpm) for lavatory faucets, and 2.0 gpm for showerheads. There are 25 restrooms with toilets, urinals, and sinks. Faucet flow rates are at 2.0 gpm or higher. Toilets are rated at 1.6 gpf and urinals are rated at 1.0 gpf. The site has a commercial kitchen with a non-ENERGY STAR dishwasher.




Typical Water-Using Fixtures

3 ENERGY AND WATER USE AND COSTS


Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	1,847,074 kWh	\$280,228
Natural Gas	61,747 Therms	\$100,148
Total		\$380,376

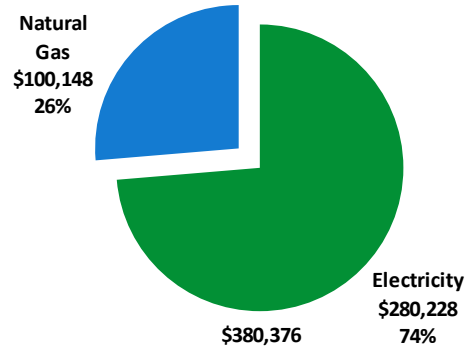

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.


The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.

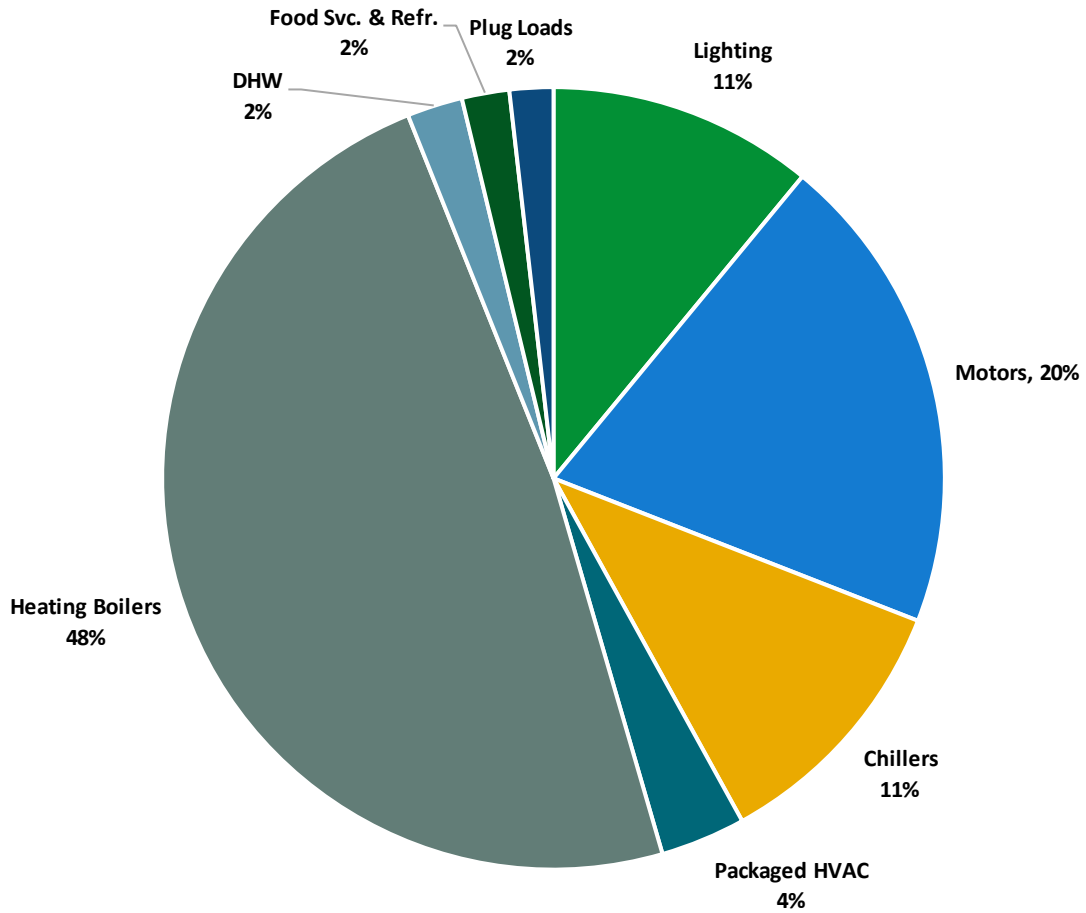

Energy Balance by System

3.1 Electricity

Atlantic City Electric delivers electricity under rate class Annual General Service Secondary.

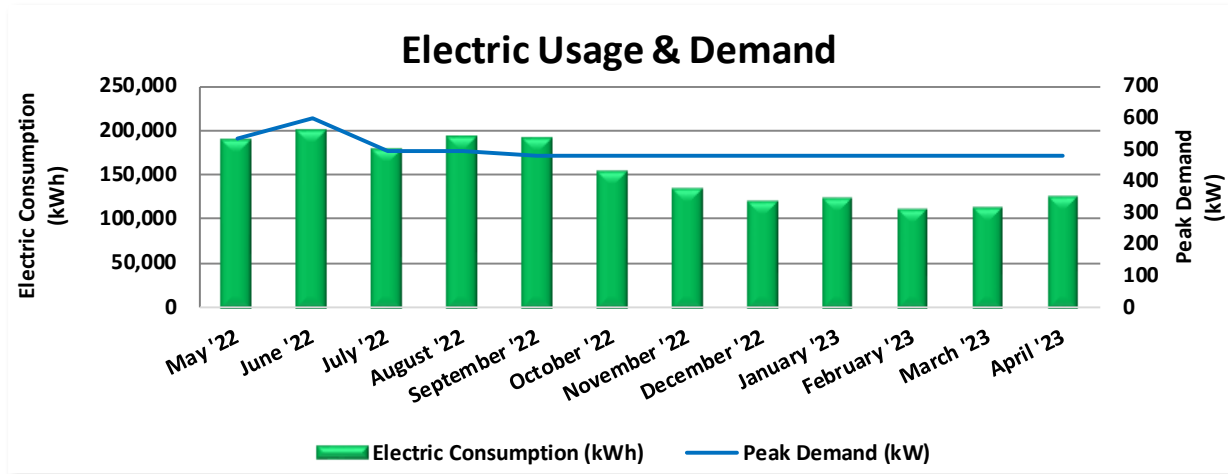


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
5/30/22	32	190,483	536	\$7,246	\$27,660
6/29/22	30	200,207	600	\$7,603	\$28,421
7/28/22	29	180,084	494	\$6,064	\$24,840
8/30/22	33	193,954	494	\$6,893	\$27,128
9/29/22	30	191,538	480	\$6,786	\$28,202
10/30/22	31	154,458	480	\$6,312	\$23,282
11/29/22	30	134,945	480	\$6,110	\$21,194
12/29/22	30	120,338	480	\$6,112	\$19,875
1/30/23	32	125,207	480	\$6,522	\$20,935
2/27/23	28	112,052	480	\$5,707	\$18,562
3/30/23	31	113,096	480	\$6,318	\$19,558
4/27/23	28	125,652	480	\$5,708	\$19,803
Totals	364	1,842,014	600	\$77,379	\$279,460
Annual	365	1,847,074	600	\$77,592	\$280,228

Notes:

- Peak demand of 600 kW occurred in June '22.
- Average demand over the past 12 months was 497 kW.
- The average electric cost over the past 12 months was \$0.152/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

3.2 Natural Gas

South Jersey Gas delivers natural gas under rate class General Service (GSGMOBGSS), with natural gas supply provided by UGI, a third-party supplier.

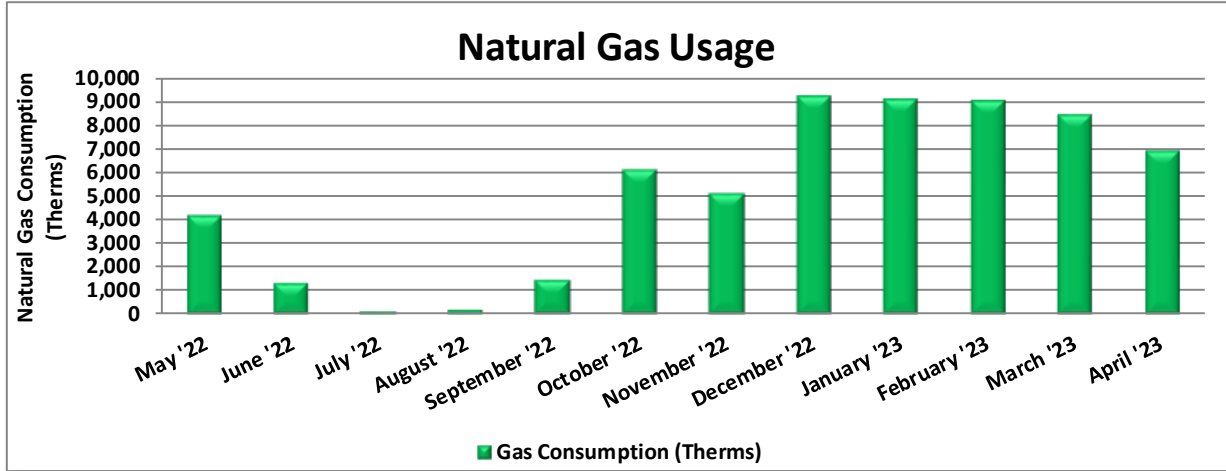


Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
5/27/22	29	4,155	\$7,331
6/29/22	33	1,298	\$2,471
7/28/22	29	134	\$249
8/30/22	33	196	\$347
9/29/22	30	1,474	\$2,844
10/28/22	29	6,129	\$10,868
11/23/22	26	5,114	\$8,310
12/29/22	36	9,247	\$15,053
1/30/23	32	9,098	\$15,098
2/27/23	28	9,039	\$14,290
3/27/23	28	8,471	\$12,881
4/25/23	29	6,886	\$9,584
Totals	362	61,239	\$99,325
Annual	365	61,747	\$100,148

Notes:

- The average gas cost for the past 12 months is \$1.622/therm, which is the blended rate used throughout the analysis.

3.3 Water


Washington Township MUA delivers water to the project site.

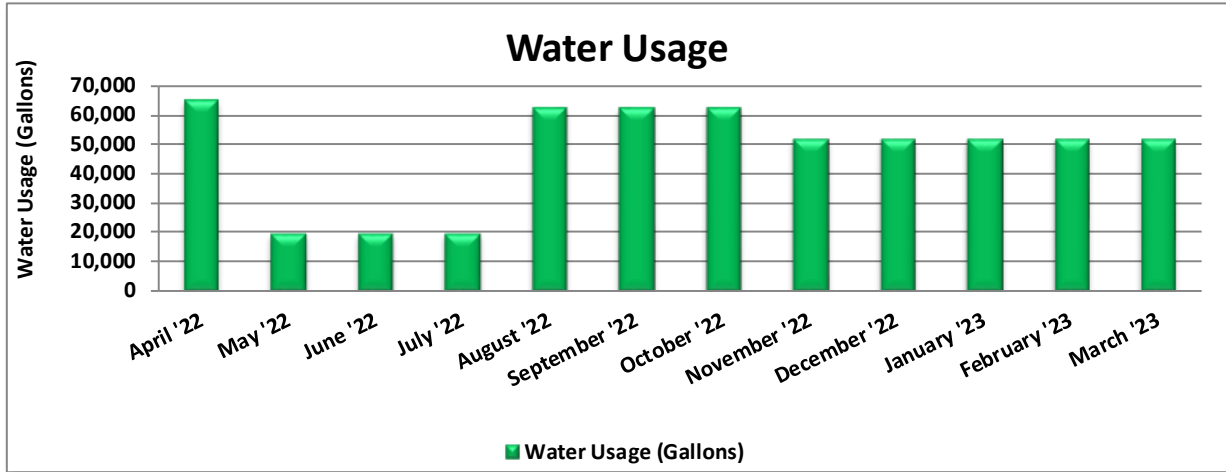

Water Billing Data			
Period Ending	Days in Period	Water Usage (gallons)	Water Cost
5/1/22	30	65,667	\$545
6/1/22	31	20,000	\$450
7/1/22	30	20,000	\$450
8/1/22	31	20,000	\$450
9/1/22	31	62,667	\$527
10/1/22	30	62,667	\$527
11/1/22	31	62,667	\$527
12/1/22	30	51,917	\$493
1/1/23	31	51,917	\$493
2/1/23	31	51,917	\$493
3/1/23	28	51,917	\$497
4/1/23	31	51,917	\$497
Totals	365	573,250	\$5,950
Annual	365	573,250	\$5,950

Notes:

- The average cost of water for the past 12 months is \$0.0104/gal.

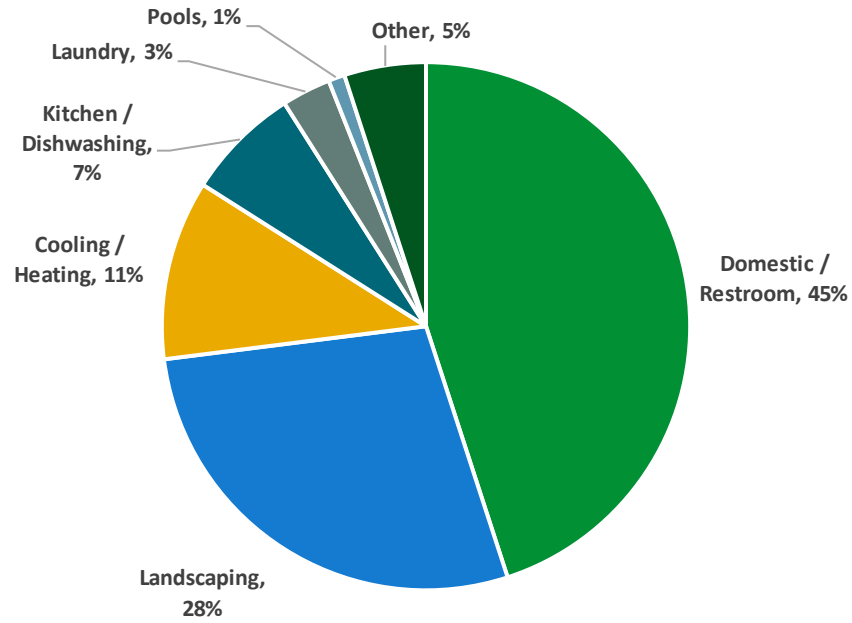

Typical Education Water End Use⁴


⁴ Chart is of typical water end use and not specific to the facility

3.4 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency’s (EPA) Portfolio Manager® software. Benchmarking compares your building’s energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building’s energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR benchmarking score provides a comprehensive snapshot of your building’s energy performance. It assesses the building’s physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

Benchmarking Score	2
---------------------------	----------

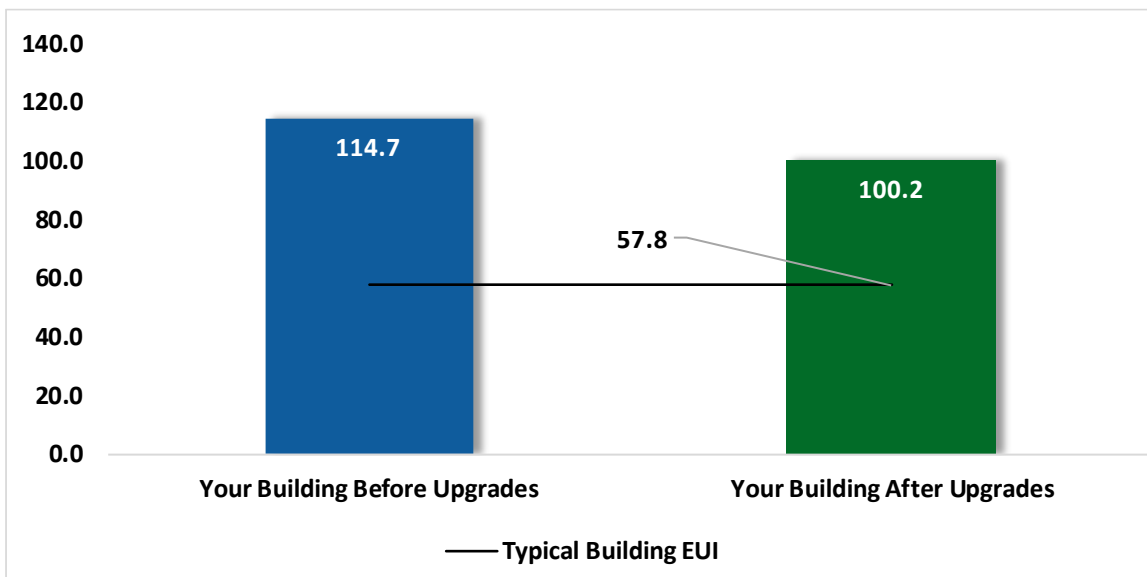


Energy Use Intensity Comparison⁵

This building performs at, or below the national average. This report contains suggestions about how to improve building performance and reduce energy costs.

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings’ energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building’s energy use and the benchmarking score.

⁵ Based on all evaluated ECMs

Water Benchmarking

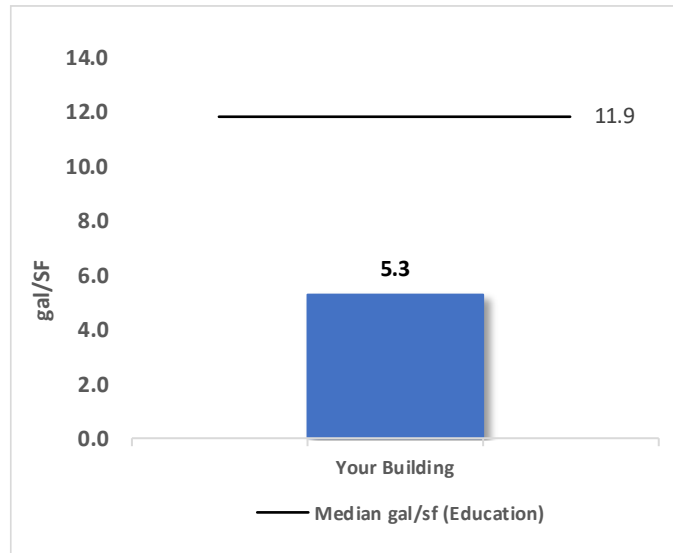

A benchmark is provided for your building’s water use based on the annual water use in gallons per square foot of building area (gal/sf-yr.). Your building is compared to other similar buildings based on average water usage as available from the 2012 Commercial Buildings Energy Consumption Survey (CBECS) and from the EPA ENERGY STAR DataTrends Water Use Tracking database.

Water use varies considerably depending mainly on the extent of outdoor water use and whether process water is used, such as for vehicle washing and for laboratory sterilizers. Cooling towers and steam boilers are also significant water users. Kitchens and sanitary fixtures may use varying amounts of water.

Tracking your Energy Performance

Keeping track of your energy and water use on a monthly basis is one of the best ways to keep utility costs in check and keep your facility operating efficiently. Update your utility information in Portfolio Manager regularly, so that you can keep track of your building’s performance.

We have created a Portfolio Manager account for your facility and have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR Portfolio Manager to track your building’s performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR and Portfolio Manager, visit their [website](#).

3.5 Understanding Your Utility Bills

The State of New Jersey Department of the Public Advocate provides detailed information on how to read natural gas and electric bills. Your bills contain important information including account numbers, meter numbers, rate schedules, meter readings, and the supply and delivery charges. Gas and electric bills both provide comparisons of current energy consumption with prior usage.

Sample bills, with annotation, may be viewed at:

https://www.nj.gov/rpa/docs/Understanding_Electric_Bill.pdf

https://www.nj.gov/rpa/docs/Understanding_Gas_Bill.pdf

Why Utility Bills Vary

Utility bills vary from one month to another for many reasons. For this reason, assessing the effects of your energy savings efforts can be difficult.

Billing periods vary, typically ranging between 28 and 33 days. Electric bills provide the kilowatt-hours (kWh) used per month while gas bills provide therms (or hundreds of cubic feet - CCF) per month consumption information. Monthly consumption information can be helpful as a tool to assess your efforts to reduce energy, particularly when compared to monthly usage from a similar calendar period in a prior year.

Bills typically vary seasonally, often with more gas consumed in the winter for heating, and more electricity used in the summer when air conditioning is used. Facilities with electric heating may experience higher electricity use in the winter. Seasonal variance will be impacted by the type of heating and cooling systems used. Normal seasonal fluctuations are further impacted by the weather. Extremely cold or hot weathers causes HVAC equipment to run longer, increasing usage. Other monthly fluctuations in usage can be caused by changes in building occupancy. Utility bills provide a comparison of usage between the current period and comparable billing month period of the prior year. Year-to-year monthly use comparisons can point to trends with energy savings for measures/projects that were implemented within the timeframe, but these comparisons do not account for changing weather or occupancy patterns.

The price of fuel and purchased power used to produce and delivery electricity and gas fluctuates. Any increase or decrease in these costs will be reflected in your monthly bill. Additionally, billing rates occasionally change after justification and approval of the NJBPU. For this reason, it is more useful to review energy use rather than cost when assessing energy use trends or the impact of energy conservation measures implemented.

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives in this report are based on the previously run state rebate program SmartStart, which has been retired. Now, all investor-owned gas and electric utility companies are offering complementary energy efficiency programs directly to their customers. Some measures and proposed upgrades may be eligible for higher incentives than those shown below. The incentives in the summary tables should be used for high-level planning purposes. To verify incentives, reach out to your utility provider or visit the [NJCEP website](#) for more information.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades			206,177	31.3	-43	\$30,581	\$65,680	\$13,310	\$52,370	1.7	202,571
ECM 1	Retrofit Fixtures with LED Lamps	Yes	206,177	31.3	-43	\$30,581	\$65,680	\$13,310	\$52,370	1.7	202,571
Lighting Control Measures			62,103	9.3	-13	\$9,211	\$46,730	\$10,200	\$36,530	4.0	61,017
ECM 2	Install Occupancy Sensor Lighting Controls	Yes	55,178	8.3	-12	\$8,184	\$38,290	\$4,510	\$33,780	4.1	54,213
ECM 3	Install High/Low Lighting Controls	Yes	6,925	1.0	-1	\$1,027	\$8,440	\$5,690	\$2,750	2.7	6,804
Variable Frequency Drive (VFD) Measures			16,997	5.3	0	\$2,579	\$32,800	\$1,200	\$31,600	12.3	17,116
ECM 4	Install VFDs on Constant Volume (CV) Fans	No	16,997	5.3	0	\$2,579	\$32,800	\$1,200	\$31,600	12.3	17,116
Unitary HVAC Measures			7,085	6.6	0	\$1,075	\$56,600	\$3,600	\$53,000	49.3	7,135
ECM 5	Install High Efficiency Air Conditioning Units	No	7,085	6.6	0	\$1,075	\$56,600	\$3,600	\$53,000	49.3	7,135
Gas Heating (HVAC/Process) Replacement			0	0.0	486	\$7,881	\$221,000	\$10,300	\$210,700	26.7	56,896
ECM 6	Install High Efficiency Hot Water Boilers	No	0	0.0	486	\$7,881	\$221,000	\$10,300	\$210,700	26.7	56,896
Domestic Water Heating Upgrade			0	0.0	20	\$326	\$400	\$190	\$210	0.6	2,353
ECM 7	Install Low-Flow DHW Devices	Yes	0	0.0	20	\$326	\$400	\$190	\$210	0.6	2,353
Food Service & Refrigeration Measures			23,372	2.6	52	\$4,382	\$34,660	\$1,260	\$33,400	7.6	29,569
ECM 8	Dishwasher Replacement	Yes	8,110	0.9	52	\$2,066	\$22,000	\$1,000	\$21,000	10.2	14,200
ECM 9	Refrigeration Controls	No	1,269	0.0	0	\$193	\$4,120	\$160	\$3,960	20.6	1,278
ECM 10	Replace Refrigeration Equipment	Yes	11,172	1.3	0	\$1,695	\$8,000	\$0	\$8,000	4.7	11,250
ECM 11	Vending Machine Control	Yes	2,821	0.3	0	\$428	\$540	\$100	\$440	1.0	2,840
TOTALS			315,734	55.0	501	\$56,035	\$457,870	\$40,060	\$417,810	7.5	376,657

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		206,177	31.3	-43	\$30,581	\$65,680	\$13,310	\$52,370	1.7	202,571
ECM 1	Retrofit Fixtures with LED Lamps	206,177	31.3	-43	\$30,581	\$65,680	\$13,310	\$52,370	1.7	202,571
Lighting Control Measures		62,103	9.3	-13	\$9,211	\$46,730	\$10,200	\$36,530	4.0	61,017
ECM 2	Install Occupancy Sensor Lighting Controls	55,178	8.3	-12	\$8,184	\$38,290	\$4,510	\$33,780	4.1	54,213
ECM 3	Install High/Low Lighting Controls	6,925	1.0	-1	\$1,027	\$8,440	\$5,690	\$2,750	2.7	6,804
Domestic Water Heating Upgrade		0	0.0	20	\$326	\$400	\$190	\$210	0.6	2,353
ECM 7	Install Low-Flow DHW Devices	0	0.0	20	\$326	\$400	\$190	\$210	0.6	2,353
Food Service & Refrigeration Measures		22,103	2.5	52	\$4,189	\$30,540	\$1,100	\$29,440	7.0	28,291
ECM 8	Dishwasher Replacement	8,110	0.9	52	\$2,066	\$22,000	\$1,000	\$21,000	10.2	14,200
ECM 10	Replace Refrigeration Equipment	11,172	1.3	0	\$1,695	\$8,000	\$0	\$8,000	4.7	11,250
ECM 11	Vending Machine Control	2,821	0.3	0	\$428	\$540	\$100	\$440	1.0	2,840
TOTALS		290,383	43.1	16	\$44,307	\$143,350	\$24,800	\$118,550	2.7	294,232

* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Cost Effective ECMs

4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Upgrades		206,177	31.3	-43	\$30,581	\$65,680	\$13,310	\$52,370	1.7	202,571
ECM 1	Retrofit Fixtures with LED Lamps	206,177	31.3	-43	\$30,581	\$65,680	\$13,310	\$52,370	1.7	202,571

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

ECM 1: Retrofit Fixtures with LED Lamps

Replace fluorescent, HID, or incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

Affected Building Areas: all areas with fluorescent fixtures with T8 tubes, kitchen, janitorial closets, and classrooms

4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		62,103	9.3	-13	\$9,211	\$46,730	\$10,200	\$36,530	4.0	61,017
ECM 2	Install Occupancy Sensor Lighting Controls	55,178	8.3	-12	\$8,184	\$38,290	\$4,510	\$33,780	4.1	54,213
ECM 3	Install High/Low Lighting Controls	6,925	1.0	-1	\$1,027	\$8,440	\$5,690	\$2,750	2.7	6,804

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 2: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected Building Areas: offices, conference rooms, classrooms, gymnasium, library, restrooms, mechanical/janitorial rooms, and storage rooms

ECM 3: Install High/Low Lighting Controls

Install occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be considered when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as occupants approach the area. This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

Affected Building Areas: corridors and stairwells

4.3 Variable Frequency Drives (VFD)

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Variable Frequency Drive (VFD) Measures		16,997	5.3	0	\$2,579	\$32,800	\$1,200	\$31,600	12.3	17,116
ECM 4	Install VFDs on Constant Volume (CV) Fans	16,997	5.3	0	\$2,579	\$32,800	\$1,200	\$31,600	12.3	17,116

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

ECM 4: Install VFDs on Constant Volume (CV) Fans

Install VFDs to control constant volume fan motor speeds. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature.

For RTUs with direct expansion (DX) cooling systems, the minimum air flow across the cooling coil required to prevent the coil from freezing must be determined during the final project design. The control system programming should maintain the minimum air flow whenever the compressor is operating. Prior to implementation, verify minimum fan speed in cooling mode with the manufacturer. Note that savings will vary depending on the operating characteristics of each AHU.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

Affected Air Handlers: RTU-8, RTU-13, RTU-17, and RTU-18

4.4 Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Unitary HVAC Measures		7,085	6.6	0	\$1,075	\$56,600	\$3,600	\$53,000	49.3	7,135
ECM 5	Install High Efficiency Air Conditioning Units	7,085	6.6	0	\$1,075	\$56,600	\$3,600	\$53,000	49.3	7,135

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the equipment is eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

ECM 5: Install High Efficiency Air Conditioning Units

Replace standard efficiency packaged air conditioning units with high efficiency packaged air conditioning units. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling and heating load, and the estimated annual operating hours.

Affected Units: RTU-8, RTU-13, RTU-14, RTU-17, and RTU-18

4.5 Gas-Fired Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Gas Heating (HVAC/Process) Replacement		0	0.0	486	\$7,881	\$221,000	\$10,300	\$210,700	26.7	56,896
ECM 6	Install High Efficiency Hot Water Boilers	0	0.0	486	\$7,881	\$221,000	\$10,300	\$210,700	26.7	56,896

ECM 6: Install High Efficiency Hot Water Boilers

Replace older inefficient hot water boilers with high efficiency hot water boilers. Energy savings results from improved combustion efficiency and reduced standby losses at low loads.

For the purposes of this analysis, we evaluated the replacement of boilers on a one-for-one basis with equipment of the same capacity. We recommend that you work with your mechanical design team to select boilers that are sized appropriately for the heating load. In many cases installing multiple modular boilers, rather than one or two large boilers, will result in higher overall plant efficiency while providing additional system redundancy.

Replacing the boilers has a long payback and may not be justifiable based simply on energy considerations. However, the boilers are nearing the end of their normal useful life. Typically, the marginal cost of purchasing high efficiency boilers can be justified by the marginal savings from the improved efficiency. When the boiler is eventually replaced, consider purchasing boilers that exceed the minimum efficiency required by building codes. We also recommend working with your mechanical design team to determine whether the heating system can operate with return water temperatures below 130°F, which would allow the use of condensing boilers.

4.6 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Domestic Water Heating Upgrade		0	0.0	20	\$326	\$400	\$190	\$210	0.6	2,353
ECM 7	Install Low-Flow DHW Devices***	0	0.0	20	\$326	\$400	\$190	\$210	0.6	2,353

ECM 7: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing.

4.7 Food Service and Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Food Service & Refrigeration Measures		23,372	2.6	52	\$4,382	\$34,660	\$1,260	\$33,400	7.6	29,569
ECM 8	Dishwasher Replacement	8,110	0.9	52	\$2,066	\$22,000	\$1,000	\$21,000	10.2	14,200
ECM 9	Refrigeration Controls	1,269	0.0	0	\$193	\$4,120	\$160	\$3,960	20.6	1,278
ECM 10	Replace Refrigeration Equipment	11,172	1.3	0	\$1,695	\$8,000	\$0	\$8,000	4.7	11,250
ECM 11	Vending Machine Control	2,821	0.3	0	\$428	\$540	\$100	\$440	1.0	2,840

ECM 8: Dishwasher Replacement

Replace existing dishwashers with new energy-efficient door-type dishwashers. New high efficiency models often use an average of 40% less energy and water, compared to current standard efficiency equipment.

ECM 9: Refrigeration Controls

Install additional controls to optimize the operation of walk-in coolers and freezers.

Many walk-in coolers and freezers have evaporator fans that run continuously. The measure adds a control system feature to automatically shut off evaporator fans when not needed.

Energy savings for each of the control measures account for reduction in compressor and fan operating hours as well as reduction in the refrigeration heat load as appropriate.

ECM 10: Replace Refrigeration Equipment

Replace existing refrigerator and freezer chests with new ENERGY STAR rated equipment. The energy savings associated with this measure come from reduced energy usage, due to more efficient technology, and reduced run times.

ECM 11: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

4.8 Measures for Future Consideration

There are additional opportunities for improvement that Washington Township BOE may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment, and/or include significant system reconfiguration. These measure(s) are therefore beyond the scope of this energy audit. These measure(s) are described here to support a whole building approach to energy efficiency and sustainability.

Washington Township BOE may wish to consider the Energy Savings Improvement Program (ESIP) or other whole building approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to:

- Evaluate these measures further.
- Develop firm costs.
- Determine measure savings.
- Prepare detailed implementation plans.

Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

Retro-Commissioning Study

Due to the complexity of today's HVAC systems and controls, a thorough analysis and rebalance of heating, ventilation, and cooling systems should periodically be conducted. There are indications at this site that systems may not be operating correctly or as efficiently as they could be. One important tool available to building operators to ensure proper system operation is retro-commissioning.

Retro-commissioning is a common practice recommended by the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE) to be implemented every few years. We recommend that you contact a reputable engineering firm that specializes in energy control systems and retro-commissioning. Ask them to propose a scope of work and an outline of the procedures and processes to be implemented, including a schedule and the roles of all responsible parties.

Once goals and responsibilities are established, the objective of the investigation process is to understand how the building is currently operating, identify the issues, and determine the most cost-effective way to improve performance. The retro-commissioning agent will review building documentation, interview building occupants, and inspect and test the equipment. Information is then compiled into a report and shared with facility staff, who will select which recommendations to implement after reviewing the findings.

The implementation phase puts the selected processes into place. Typical measures may include sensor calibration, equipment schedule changes, damper linkage repair and similar relatively low-cost adjustments—although more expensive sophisticated programming and building control system upgrades may be warranted. Approved measures may be implemented by the agent, the building staff, or by subcontractors. Typically, a combination of these individuals makes up the retro-commissioning team.

After the approved measures are implemented, the team will verify that the changes are working as expected. Baseline and post-case measurements will allow building staff to monitor equipment and ensure that the benefits are maintained.

VRF Systems

Consider variable refrigerant flow (VRF) systems as part of a comprehensive package unit upgrade project. (VRF systems use direct expansion (DX) heat pumps to transport heat between an outdoor condensing unit and a network of indoor evaporators, located near or within the conditioned space, through refrigerant piping installed in the building. Attributes that distinguish VRF from other DX system types are:

- Multiple indoor units connected to a common outdoor unit
- Scalability
- Variable capacity
- Distributed control
- Simultaneous heating and cooling capability

VRF provides flexibility by allowing for many different indoor units (with different capacities and configurations), individual zone control, the unique ability to offer simultaneous heating and cooling in separate zones on a common refrigerant circuit, and heat recovery from one zone to another. VRF systems are equipped with at least one variable-speed and/or variable-capacity compressor.

To match the building's load profiles, energy is transferred from one indoor space to another through the refrigerant line, and only one energy source is necessary to provide both heating and cooling. VRF systems also operate efficiently at part load because of the compressor's variable capacity control. VRF systems are ideal for applications with varying loads or where zoning is required. Some other advantages of VRF systems include consistent comfort, quiet operation, energy efficiency, installation flexibility, zoned heating and cooling, state-of-the-art controls, and reliability.

VRF systems are more expensive than conventional heat pump systems; however, the higher initial cost can be offset by improved cooling efficiency during part load operation—a SEER (cooling) rating of 18.0 is not uncommon for small packaged VRF-equipped heat pumps.

When you are replacing packaged HVAC equipment, we recommend a comprehensive approach. Work with your contractor or design engineer to make sure your systems are sized and zoned according to current space configurations and occupancy. Select high efficiency equipment and controls that match your heating and cooling needs. Commission the system and controls to ensure proper operation, comfort, ventilation, and energy use.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5%–20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR Portfolio Manager



You've heard it before—you cannot manage what you do not measure. ENERGY STAR Portfolio Manager is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions⁶. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Weatherization

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. Materials used may include caulk, polyurethane foam, and other weather-stripping materials. There is an energy savings opportunity by reducing the uncontrolled air exchange between the outside and inside of the building. Blower door assisted comprehensive building air sealing will reduce the amount of air exchange, which will in turn reduce the load on the buildings heating and cooling equipment, providing energy savings and increased occupant comfort.

Doors and Windows

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Lighting Maintenance



Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.

⁶ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>

In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

Lighting Controls

As part of a lighting maintenance schedule, test lighting controls to ensure proper functioning. For occupancy sensors, this requires triggering the sensor and verifying that the sensor's timer settings are correct. For daylight and photocell sensors, maintenance involves cleaning sensor lenses and confirming that setpoints and sensitivity are configured properly. Adjust exterior lighting time clock controls seasonally as needed to match your lighting requirements.

Motor Controls

Electric motors often run unnecessarily, and this is an overlooked opportunity to save energy. These motors should be identified and turned off when appropriate. For example, exhaust fans often run unnecessarily when ventilation requirements are already met. Whenever possible, use automatic devices such as twist timers or occupancy sensors to turn off motors when they are not needed.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Thermostat Schedules and Temperature Resets



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5°F-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

Economizer Maintenance

Economizers can significantly reduce cooling system load. A malfunctioning economizer can increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air. Common economizer malfunctions include broken outdoor thermostat or enthalpy control or dampers that are stuck or improperly adjusted.

Periodic inspection and maintenance will keep economizers working in sync with the heating and cooling system. This maintenance should be part of annual system maintenance, and it should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position.

Chiller Maintenance

Service chillers regularly to keep them operating properly. Chillers are responsible for a substantial portion of a commercial building's overall energy usage, and when they do not work well, there is usually a noticeable increase in energy bills and increased occupant complaints. Regular diagnostics and service can

save five to ten percent of the cost of operating your chiller. If you already have a maintenance contract in place, your existing service company should be able to provide these services.

AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less, and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Ductwork Maintenance

Duct maintenance has two primary goals: keep the ducts clean to avoid air quality problems and seal leaks to save energy. Check for cleanliness, obstructions that block airflow, water damage, and leaks. Ducts should be inspected at least every two years.

The biggest symptoms of clogged air ducts are differing temperatures throughout the building and areas with limited airflow from supply registers. If a particular air duct is clogged, then air flow will only be cut off to some rooms in the building—not all of them. The reduced airflow will make it more difficult for those areas to reach the temperature setpoint, which will cause the HVAC system to run longer to cool or heat that area properly. If you suspect clogged air ducts, ensure that all areas in front of supply registers are clear of items that may block or restrict air flow, and you should check for fire dampers or balancing dampers that have failed closed.

Duct leakage in commercial buildings can account for 5%–25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Check ductwork for leakage. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.

Distribution system losses are dependent on-air system temperature, the size of the distribution system, and the level of insulation of the ductwork. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is missing or worn, the system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

Boiler Maintenance

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely and efficiently. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the boiler tubes to improve heat transfer.

Optimize HVAC Equipment Schedules

Energy management systems (BAS) typically provide advanced controls for building HVAC systems, including chillers, boilers, air handling units, rooftop units and exhaust fans. The BAS monitors and reports operational status, schedules equipment start and stop times, locks out equipment operation based on outside air or space temperature, and often optimizes damper and valve operation based on complex

algorithms. These BAS features, when in proper adjustment, can improve comfort for building occupants and save substantial energy.

Know your BAS scheduling capabilities. Regularly monitor HVAC equipment operating schedules and match them to building operating hours to eliminate unnecessary equipment operation and save energy. Monitoring should be performed often at sites with frequently changing usage patterns – daily in some cases. We recommend using the optimal start feature of the BAS (if available) to optimize the building warmup sequence. Most BAS scheduling programs provide for holiday schedules, which can be used during reduced use or shutdown periods. Finally, many systems are equipped with a one-time override function, which can be used to provide additional space conditioning due to a one-time, special event. When available this override feature should be used rather than changing the base operating schedule.

Water Heater Maintenance

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues, and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR products where available.

6 WATER BEST PRACTICES

Getting Started



The commercial and institutional sector is the second largest consumer of publicly supplied water in the United States, accounting for 17% of the withdrawals from public water supplies⁷. In New Jersey, excluding water used for power generation, approximately 80% of total water use was attributed to potable supply during the period of 2009 to 2018. Water withdrawals for potable supply have not changed noticeably during the period from 1990 to 2018⁸.

Water management planning serves as the foundation for any successful water reduction effort. It is the first step a commercial or institutional facility owner or manager should take to achieve and sustain long-term water savings. Understanding how water is used within a facility is critical for the water management planning process. A water assessment provides a comprehensive account of all known water uses at the facility. It allows the water management team to establish a baseline from which progress and program success can be measured. It also enables the water management team to set achievable goals and identify and prioritize specific projects based on the relative savings opportunities and project cost-effectiveness.

Water conservation devices may significantly reduce your water and sewer usage costs. Any reduction in water use reduces grid-level electricity use since a significant amount of electricity is used to treat and deliver water from reservoirs to end users.

For more information regarding water conservation or additional details regarding the practices shown below go to the EPA's WaterSense website⁹ or download a copy of EPA's "WaterSense at Work: Best Management Practices for Commercial and Institutional Facilities"¹⁰ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water Metering and Submetering

Tracking a facility's total water use, as well as specific end uses, is a key component of a facility's water-efficiency efforts. Accurately measuring water use can help facility managers identify areas for targeted reductions and track progress from water-efficiency upgrades. If possible, install meters to measure all water conveyed to the facility, regardless of the source. Each source should be metered separately. Consider developing a metering plan and installing separate submeters to measure specific end uses. There are many types and sizes of meters intended for different uses. Installing the correct type and size of meter are critical to accurate water measurement. Sub-metering applications may include:

- Individual tenant spaces
- Cooling tower make-up and blowdown water supply
- Water lines serving other HVAC systems including water circulating loops
- Make up water supply for steam boiler plants with a capacity of 500,000 Btu/hr. or greater
- Systems or equipment that use single pass cooling water
- Irrigation systems

⁷ Estimated from analyzing data in: [Solley, Wayne B., et al, "Estimated Use of Water in the United States in 1995", U.S Geological Survey Circular 1200, \(1998\)](#)

⁸ <https://dep.nj.gov/wp-content/uploads/dsr/trends-water-supply.pdf>

⁹ <https://www.epa.gov/watersense>

¹⁰ <https://www.epa.gov/watersense/watersense-work-0>

- Roof spray systems (for irrigating vegetated roofs or thermal conditioning)
- Ornamental water features
- Indoor and outdoor pools and spas
- Industrial water using processes

Leak Detection and Repair

Identifying and repairing leaks and other water use anomalies within a facility's water distribution system or from processes or equipment can keep a facility from wasting significant quantities of water. Examples of common leaks include leaking toilets and faucets, drip irrigation malfunctions, stuck float valves, and broken distribution lines. Reading meters, installing failure abatement technologies, and conducting visual and auditory inspections are important best practices to detect leaks. Train building occupants, employees, and visitors to report any leaks that they detect. To reduce unnecessary water loss, detected leaks should be repaired quickly. Repairing leaks in water distribution that is pressurized by on-site pumps or in heated or chilled water piping will also reduce energy use.

Toilets and Urinals

Toilets and urinals are considered sanitary fixtures and are found in most facilities. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously flushing, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment and the frequency of use, it may be cost effective to replace older inefficient fixtures with current generation WaterSense labeled equipment.

Commercial facilities typically use tank toilets or wall-mount flushometers. Educate and inform users with restroom signage and other means to avoid flushing inappropriate objects. For tank toilets, periodically check to ensure fill valves are working properly and that water level is set correctly. Annually test toilets to ensure the flappers are not worn or allowing water to seep from the tank into the bowl and down the sewer. Control stops and piston valves on flushometer toilets should be checked at least annually.

Most urinals use water to flush liquid. These standard single-user fixtures are present in most facilities. Non-water urinals use a specially designed trap that allows liquid waste to drain out of the fixture through a trap seal, and into the drainage system. Flushing urinals should be inspected at least annually for proper valve and sensor operation. For non-water urinals, follow maintenance practices as directed by the manufacturer to ensure products perform as expected. Non-water urinals can be considered during urinal replacement, however, review the condition and design of the existing plumbing system and the expected usage patterns to ensure that these products will provide the anticipated performance.

Faucets and Showerheads

Faucets and showerheads are sanitary fixtures that generally dispense heated water. Reducing water use by these fixtures translates into a reduction of site fuel or electric use depending on how water is heated. High efficiency fixtures are at least 20% more efficient than available standard products. Leaking or damaged equipment is a substantial source of water waste. Train users to report continuously dripping, leaking, or otherwise improperly operating equipment to the appropriate personnel. Depending on the age of the equipment and the frequency of use, it may be cost effective to replace older fixtures with current generation WaterSense labeled equipment.

Faucets are used for a variety of purposes, and standard flow rates are dictated by the intended use. Public use lavatory faucets and kitchen faucets are subject to maximum flow rates while service sinks are not. Periodically inspect faucet aerators for scale buildup to ensure flow is not being restricted. Clean or replace the aerator or other spout end device as needed. Check and adjust automatic sensors (where

installed) to ensure they are operating properly to avoid faucets running longer than necessary. Post materials in restrooms and kitchens to ensure user awareness of the facility's water-efficiency goals. Remind users to turn off the tap when they are done and to consider turning the tap off during sanitation activities when it is not being used. Consider installing lavatory and kitchen faucet fixtures with reduced flow. Federal standards limit kitchen and restroom faucet flows to 2.2 gpm. To qualify for a WaterSense label a faucet cannot exceed 1.5 gpm.

Effective in 1992, the maximum allowable flow rate for all showerheads sold in the United States is 2.5 gpm. Since this standard was enacted, many showerheads have been designed to use even less water. WaterSense labeled equipment is designed to use 2.0 gpm, or less. For optimum showerhead efficiency, the system pressure should be tested to make sure that it is between 20 and 80 pounds per square inch (psi). Verify that plumbing lines are routed through a shower valve to prevent water pressure fluctuations. Periodically inspect showerheads for scale buildup to ensure flow is not being restricted. In general, replace showerheads with 2.5 gpm flow rates or higher with WaterSense labeled models. Note: Use of poor performing replacement reduced flow showerheads may result in increased use if the duration of use is increased to compensate for reduced performance. WaterSense labeled showerheads are independently certified to meet or exceed minimum performance requirements for spray coverage and force.

Commercial Kitchen Equipment

Commercial and institutional sectors, including hospitals, offices, and schools, have substantial kitchen water use. Water in food service is used for steam cooking, spray/flow cleaning, dish washing, and ice making. In most commercial kitchens, the commercial dishwasher and pre-rinse spray valve account for over two-thirds of the water use. Newer technologies and better practices are available that can significantly reduce commercial kitchen equipment water and energy use. For example, ENERGY STAR qualified dishwashers and steam cookers are at least 10% more water-efficient and 15% more energy-efficient than standard models. With some models saving significantly more.

Cooking equipment includes combination ovens, steam cookers, and steam kettles. For efficient steam cooking operation, fill vessels to capacity when possible, set temperatures optimally for the process, and keep doors and lids closed while cooking. Replace gaskets to ensure proper sealing and repair leaks. When replacing combination ovens, select connectionless equipment; replace steam cookers with ENERGY STAR rated steam cookers.

Spray/flow cleaning equipment includes dipper wells, pre-rinse spray valves, food disposals, and wash down sprayers. Turn off water when service periods are slow and keep flow rates to minimum level. Train users to scrape food rather than rely on water pressure. Inspect for leaks and scaling. Test system pressure to ensure it is between 20 and 80 pounds per square inch (psi) for optimum flow and performance of spray equipment. For dipper wells, consider installing in-line flow restrictors to reduce flow. Pre-rinse spray valves can be replaced with new assemblies which use 1.3 gpm or less. Washdown sprayers can be equipped with self-closing nozzles or consider mopping/sweeping as an alternative.

Dishwashers range in type and include undercounter, stationary/hood, conveyor, and flight-type models. Only run dishwashers when they are full and fill racks to maximum capacity. Be sure to replace damaged dishwasher racks. Educate staff to scrape dishes prior to loading. Ensure that final rinse pressure and water temperature are within the manufacturer's recommendations. Operate the dishwasher close to or at the minimum flow rate and set rinse cycle time to the manufacturer's minimum recommended settings. Make sure that manual fill valves close completely after the wash tank is filled. Find and repair any leaks. Inspect valves and rinse nozzles for proper operation and repair worn nozzles. Look for ENERGY STAR qualified models when purchasing or leasing a new commercial dishwasher or replacing an existing unit.

Consider your kitchen throughput to select an appropriately sized commercial dishwasher since an oversized dishwasher will waste water if the machine is not loaded to capacity.

Landscaping and Irrigation

Most facilities that own or maintain surrounding landscape will have outdoor water use. The amount of outdoor water use is dictated by the size and design of the landscape and the need for supplemental irrigation. Studies show that average landscape water use in the institutional sector can range from 7% of total water use for hospitals, 22% for office buildings, and up to 30% for schools.

Proper landscape design can help minimize outdoor water use. Regionally appropriate plant choices, healthy soils with appropriate grading, the use of mulches, and limiting the use of high water-using plants such as turfgrass can significantly reduce the need for supplemental irrigation. In addition, proper design, installation, and maintenance of irrigation equipment can have a dramatic impact on outdoor water use.

- Retain a landscape professional certified in water-efficient landscaping.
- Maintain soil quality by applying mulch, soil amendments, and good topsoil.
- Maintain existing plants by manually pulling weeds, raising the blade on mowers, and including shaded areas in the overall landscape design.
- Minimize water used for hardscape cleaning and use recycled or reclaimed water where applicable, especially in water features.

Irrigation system optimization combines efficient irrigation practices with efficient technologies and can be complex. Irrigation professionals who are properly educated on water-efficient practices can help ensure that existing irrigation systems are efficiently operated and properly maintained. In general, plan for or adjust irrigation systems to prevent over (or under) watering.

- Improve distribution uniformity so water is evenly applied over the landscape.
- Irrigation schedules should be updated based on changing weather conditions.
- In general, apply water in larger amounts, but less frequently, resulting in deep watering.
- If a dedicated landscape water meter is installed, incorporate an outdoor water budget.
- Routinely look for leaks, overwatering, or overspray.
- Require a full irrigation system audit every 3 years by a qualified irrigation auditor.
- Consider drip irrigation systems for plant beds as they can reduce irrigation water use by 20% to 50% as compared to traditional sprinklers.
- More efficient sprinkler heads can reduce irrigation water use by 30%.
- Smart irrigation controllers can schedule irrigation based on weather data or on-site conditions, reducing irrigation water use by 15% compared to manual or clock timer irrigation systems.

7 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


7.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has high potential for installing a PV array.

The amount of free area, ease of installation (location), and the lack of shading elements contribute to the high potential. A PV array located on the roof may be feasible. If you are interested in pursuing the installation of PV, we recommend conducting a full feasibility study.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

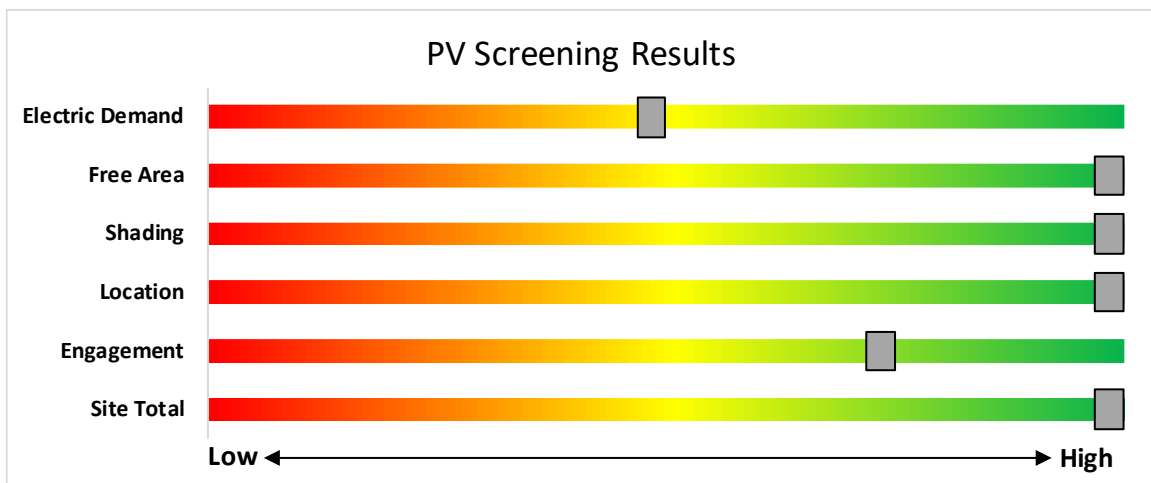

Potential	High	
System Potential	107	kW DC STC
Electric Generation	127,477	kWh/yr
Displaced Cost	\$19,340	/yr
Installed Cost	\$278,200	

Photovoltaic Screening

Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners must register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

- ◆ **Successor Solar Incentive Program (SuSI):** <https://www.njcleanenergy.com/renewable-energy/programs/susi-program>
- ◆ **Basic Info on Solar PV in NJ:** <http://www.njcleanenergy.com/whysolar>
- ◆ **NJ Solar Market FAQs:** www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs
- ◆ **Approved Solar Installers in the NJ Market:** http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1

7.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.


CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The low or infrequent thermal load and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

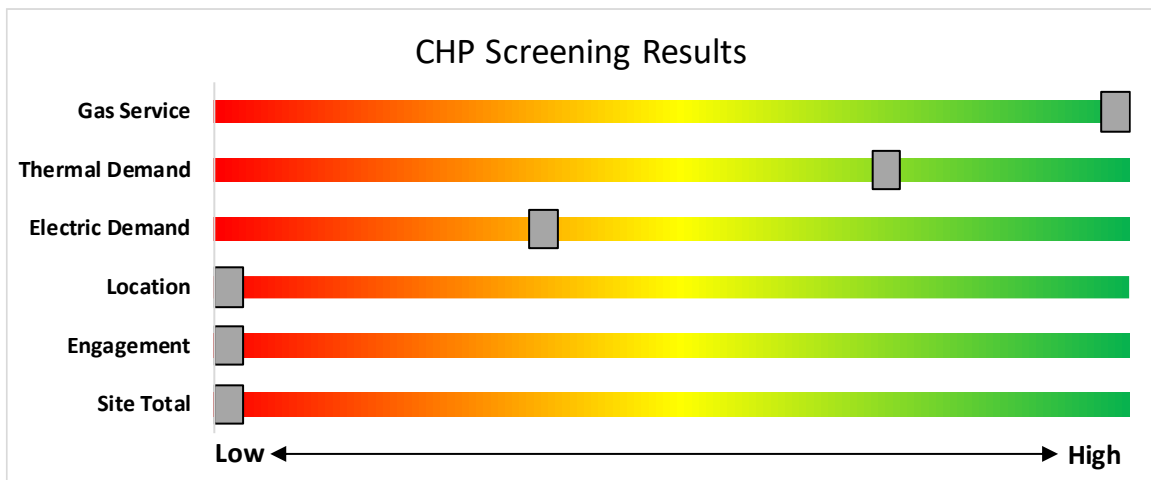

Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation: http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/

8 ELECTRIC VEHICLES

All electric vehicles (EVs) have an electric motor instead of an internal combustion engine. EVs function by plugging into a charge point, taking electricity from the grid, and then storing it in rechargeable batteries. Although electricity production may contribute to air pollution, the U.S. EPA categorizes all electric vehicles as zero-emission vehicles because they produce no direct exhaust or tailpipe emissions.

EVs are typically more expensive than similar conventional and hybrid vehicles, although some cost can be recovered through fuel savings, federal tax credit, or state incentives

8.1 EV Charging

EV charging stations provide a means for electric vehicle operators to recharge their batteries at a facility. While many EV drivers charge at home, others do not have access to regular home charging, and the ability to charge at work or in public locations is critical to making EVs practical for more drivers. Charging can also be used for electric fleet vehicles, which can reduce fuel and maintenance costs for fleets that replace gas or diesel vehicles with EVs.

EV charging comes in three main types. For this assessment, the screening considers addition of Level 2 charging, which is most common at workplaces and other public locations. Depending on the site type and usage, other levels of charging power may be more appropriate.


The preliminary assessment of EV charging at the facility shows that there is medium potential for adding EV chargers to the facility's parking, based on potential costs of installation and other site factors.

The primary costs associated with installing EV charging are the charger hardware and the cost to extend power from the facility to parking spaces. This may include upgrades to electric panels to serve increased loads.


The type and size of the parking area impact the costs and feasibility of adding EV charging. Parking structure installations can be less costly than surface lot installations as power may be readily available, and equipment and wiring can be surface mounted. Parking lot installations often require trenching through concrete or asphalt surface. Large parking areas provide greater flexibility in charger siting than smaller lots.

The location and capacity of facility electric panels also impact charger installation costs. A Level 2 charger generally requires a dedicated 208-240V, 40 Amp circuit. The electric panel nearest the planned installation may not have available capacity and may need to be upgraded to serve new EV charging loads. Alternatively, chargers could be powered from a more distant panel. The distance from the panel to the location of charging stations ties directly to costs, as conduits, cables, and potential trenching costs all increase on a per-foot basis. The more charging stations planned, the more likely it is that additional electrical capacity will be needed.

Other factors to consider when planning for EV charging at a facility include who the intended users are, how long they park vehicles at the site, and whether they will need to pay for the electricity they use.

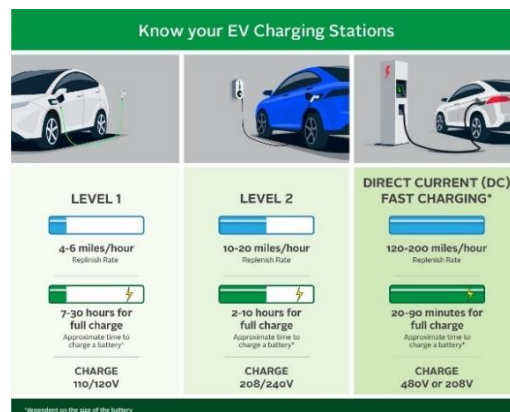

The graphic below displays the results of the EV charging assessment conducted as part of this audit. The position of each slider indicates the impact each factor has on the feasibility of installing EV charging at the site.

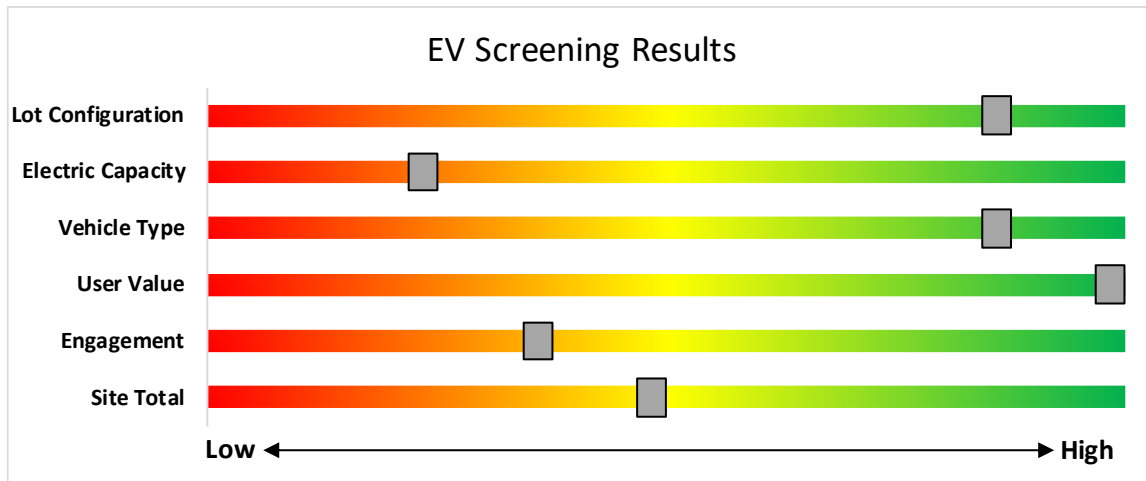

EV Charger Screening

Electric Vehicle Programs Available

New Jersey is leading the way on electric vehicle (EV) adoption on the East Coast. There are several programs designed to encourage EV adoption in New Jersey, which is crucial to reaching a 100% clean energy future.

NJCEP offers a variety of EV programs for vehicles, charging stations, and fleets. Certain EV charging stations that receive electric utility service from Atlantic City Electric Company (ACE), Public Service Electric and Gas Company (PSE&G) or Jersey Central Power and Light (JCP&L), may be eligible for additional electric vehicle charging incentives directly from the utility. Projects may be eligible for both the incentives offered by this BPU program and incentives offered by ACE, PSE&G or JCP&L, up to 90% of the combined charger purchase and installation costs. Please check ACE, PSE&G or JCP&L program eligibility requirements before purchasing EV charging equipment, as additional conditions on types of eligible chargers may apply for utility incentives.

EV Charging incentive information is available from Atlantic City Electric, PSE&G and JCP&L. For more information and to keep up to date on all EV programs please visit <https://www.njcleanenergy.com/commercial-industrial/programs/electric-vehicle-programs>

9 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs and Utility Energy Efficiency Programs can help. Pick the program that works best for you. This section provides an overview of currently available incentive programs in New Jersey.

NJBPU and NJCEP Administered Programs



- New Construction (residential, commercial, industrial, government)
 - Large Energy Users
 - Energy Savings Improvement Program (financing)
 - State Facilities Initiative*
 - Local Government Energy Audits
 - Combined Heat & Power & Fuel Cells
- *State facilities are also eligible for utility programs

Utility Administered Programs



- Existing buildings (residential, commercial, industrial, government)
- Efficient Products
 - Lighting & Marketplace
 - HVAC
 - Appliance Rebates
 - Appliance Recycling

9.1 New Jersey's Clean Energy Program

Save money while saving the planet! New Jersey's Clean Energy Program is a statewide program that offers incentives, programs, and services that benefit New Jersey residents, businesses, educational, non-profit, and government entities to help them save energy, money, and the environment.

Large Energy Users

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers. To qualify entities must have incurred at least \$5 million in total energy costs in the prior fiscal year.

Incentives

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually

How to Participate

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEED). Once the FEED is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at <http://www.njcleanenergy.com/LEUP>.

Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation. ≤

Incentives¹¹

Eligible Technology	Size (Installed Rated Capacity)	Incentive (\$/Watt) ⁵	% of Total Cost Cap per Project	\$ Cap per Project
CHPs powered by non-renewable or renewable fuel source, or a combination: ⁴ - Gas Internal Combustion Engine - Gas Combustion Turbine - Microturbine	≤500 kW ¹	\$2.00	30-40% ²	\$2 million
	>500 kW - 1 MW ¹	\$1.00		
	> 1 MW - 3 MW ¹	\$0.55	30%	\$3 million
	>3 MW ¹	\$0.35		
Fuel Cells ≥60%	Same as above ¹	Applicable amount above	30%	\$1 million
Waste Heat to Power (WHP) ³ Powered by non-renewable fuel source. Heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine)	≤1MW ¹	\$1.00	30%	\$2 million
	> 1MW ¹	\$.50	30%	\$3 million

¹¹

¹ Incentives are tiered, which means the incentive levels vary based upon the installed rated capacity, as listed in the chart above. For example, a 4 MW CHP system would receive \$2.00/watt for the first 500 kW, \$1.00/watt for the second 500 kW, \$0.55/watt for the next 2 MW and \$0.35/watt for the last 1 MW (up to the caps listed).

² The maximum incentive will be limited to 30% of total project. For CHP projects up to 1 MW, this cap will be increased to 40% where a cooling application is used or included with the CHP system (e.g. absorption chiller).

³ Projects will be eligible for incentives shown above, not to exceed the lesser of % of total project cost per project cap or maximum \$ per project cap. Projects installing CHP or FC with WHP will be eligible for incentive shown above, not to exceed the lesser caps of the CHP or FC incentive. Minimum efficiency will be calculated based on annual total electricity generated, utilized waste heat at the host site (i.e. not lost/rejected), and energy input.

⁴ Systems fueled by a Class 1 Renewable Fuel Source, as defined by N.J.A.C. 14:8-2.5, are eligible for a 30% incentive bonus. If the fuel is mixed, the bonus will be prorated accordingly. For example, if the mix is 60/40 (60% being a Class 1 renewable), the bonus will be 18%. This bonus will be included in the final performance incentive payment, based on system performance and fuel mix consumption data. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.

⁵ CHP-FC systems located at Critical Facility and incorporating blackstart and islanding technology are eligible for a 25% incentive bonus. This bonus incentive will be paid with the second/Installation incentive payment. Total incentive, inclusive of bonus, shall not exceed above stipulated caps.



How to Participate

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at <http://www.njcleanenergy.com/CHP>.

Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects must register their projects prior to the start of construction to establish the project’s eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two sub-programs. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

Administratively Determined Incentive (ADI) Program

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

Market Segments	Size MW dc	Incentive Value (\$/SREC II)	Public Entities Incentive Value - \$20 Adder (\$/SRECII)
Net Metered Residential	All types and sizes	\$90	N/A
Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects smaller than 1 MW	\$100	\$120
Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects 1 MW to 5 MW	\$90	\$110
Small Net Metered Non-Residential Ground Mount	Projects smaller than 1 MW	\$85	\$105
Large Net Metered Non-Residential Ground Mount	Projects 1 MW to 5 MW	\$80	\$100
LMI Community Solar	Up to 5 MW	\$90	N/A
Non-LMI Community Solar	Up to 5 MW	\$70	N/A
Interim Subsection (t)	All types and sizes	\$100	N/A

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations.

Competitive Solar Incentive (CSI) Program

The CSI Program opened on April 15, 2023, and will serve as the permanent program within the SuSI Program providing incentives to larger solar facilities. The CSI Program is open to qualifying grid supply solar facilities, non-residential net metered solar installations with a capacity greater than five (5) megawatts (“MW”), and to eligible grid supply solar facilities installed in combination with energy storage.



CSI eligible facilities will only be allowed to register in the CSI program upon award of a bid pursuant to N.J.A.C. 14:8-11.10.

The CSI program structure has separate categories, or tranches, to ensure that a range of solar project types, including those on preferred sites, are able to participate despite potentially different project cost profiles. The Board has approved four tranches for grid supply and large net metered solar and an additional fifth tranche for storage in combination with grid supply solar. The following table lists procurement targets for the first solicitation:

Tranche	Project Type	MW (dc) Targets
Tranche 1.	Basic Grid Supply	140
Tranche 2.	Grid Supply on the Built Environment	80
Tranche 3.	Grid Supply on Contaminated Sites and Landfills	40
Tranche 4.	Net Metered Non- Residential	40
Tranche 5.	*Storage Paired with Grid	160 MWh

*The storage tranche of 160 MWh corresponds to a 4-hour storage pairing of 40 MW of solar

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state’s Energy Master Plan.

If you are considering installing solar on your building, visit the following link for more information: <https://njcleanenergy.com/renewable-energy/programs/susi-program>

Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

Demand Response (DR) Energy Aggregator

Demand Response Energy Aggregator is a program designed to reduce the electric load when electric wholesale prices are high or when the reliability of the electric grid is threatened due to peak demand. Grid operators call upon curtailment service providers and commercial facilities to reduce electric usage during times of peak demand, making the grid more reliable and reducing transmission costs for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in DR programs. Program participation is voluntary, and participants receive payments whether or not their facility is called upon to curtail its electric usage.

Typically, an electric customer must be capable of reducing their electric demand, within minutes, by at least 100 kW or more in order to participate in a DR program. Customers with greater capability to quickly curtail their demand during peak hours receive higher payments. Customers with back-up generators on site may also receive additional DR payments for their generating capacity if they agree to run the generators for grid support when called upon. Eligible customers who have chosen to participate in DR programs often find it to be a valuable source of revenue for their facility, because the payments can significantly offset annual electric costs.

Participating customers can often quickly reduce their peak load through simple measures, such as temporarily raising temperature setpoints on thermostats (so that air conditioning units run less frequently) or agreeing to dim or shut off less critical lighting. This usually requires some level of building automation and controls capability to ensure rapid load reduction during a DR curtailment event. DR program participants may need to install smart meters or may need to also sub-meter larger energy-using equipment, such as chillers, to demonstrate compliance with DR program requirements.

DR does not include the reduction of electricity consumption based on normal operating practice or behavior. For example, if a company's normal schedule is to close for a holiday, the reduction of electricity due to this closure or scaled-back operation is not considered a DR activity in most situations.

The first step toward participation in a DR program is to contact a curtailment service provider. A list of these providers is available on the website of the independent system operator, PJM, and it includes contact information for each company, as well as the states where they have active business¹². PJM also posts training materials for program members interested in specific rules and requirements regarding DR activity along with a variety of other DR program information¹³.

Curtailment service providers typically offer free assessments to determine a facility's eligibility to participate in a DR program. They will provide details regarding program rules and requirements for metering and controls, assess a facility's ability to temporarily reduce electric load, and provide details on payments to be expected for participation in the program. Providers usually offer multiple options for DR to larger facilities, and they may also install controls or remote monitoring equipment of their own to help ensure compliance with all terms and conditions of a DR contract.

¹² <http://www.pjm.com/markets-and-operations/demand-response.aspx>.

¹³ <http://www.pjm.com/training/training-events.aspx>.

9.2 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey's investor-owned gas and electric utilities to reduce their customers' use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

Prescriptive and Custom

The Prescriptive and Custom rebate program through your utility provider offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

Equipment Examples

Lighting

Lighting Controls

HVAC Equipment

Refrigeration

Gas Heating

Gas Cooling

Commercial Kitchen Equipment

Food Service Equipment

Variable Frequency Drives

Electronically Commutate Motors

Variable Frequency Drives

Plug Loads Controls

Washers and Dryers

Agricultural

Water Heating

The Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type. The Custom program provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives.

Direct Install

Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW or less over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures.

How to Participate

To participate in Direct Install, you will work with a participating contractor. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the Direct Install program, subject to program rules and eligibility, while the remaining percent of the cost is paid to the contractor by the customer.




Engineered Solutions

The Engineered Solutions Program provides tailored energy-efficiency assistance and services to municipalities, universities, schools, hospitals, and healthcare facilities (MUSH), non-profit entities, and multifamily buildings. Customers receive expert guided services, including investment-grade energy auditing, engineering design, installation assistance, construction administration, commissioning, and measurement and verification (M&V) services to support the implementation of cost-effective and comprehensive efficiency projects. Engineered Solutions is generally a good option for medium to large sized facilities with a peak demand over 200 kW looking to implement as many measures as possible under a single project to achieve deep energy savings. Engineered Solutions has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program. Incentives for this program are based on project scope and energy savings achieved.

For more information on any of these programs, contact your local utility provider or visit <https://www.njcleanenergy.com/transition>.

10 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

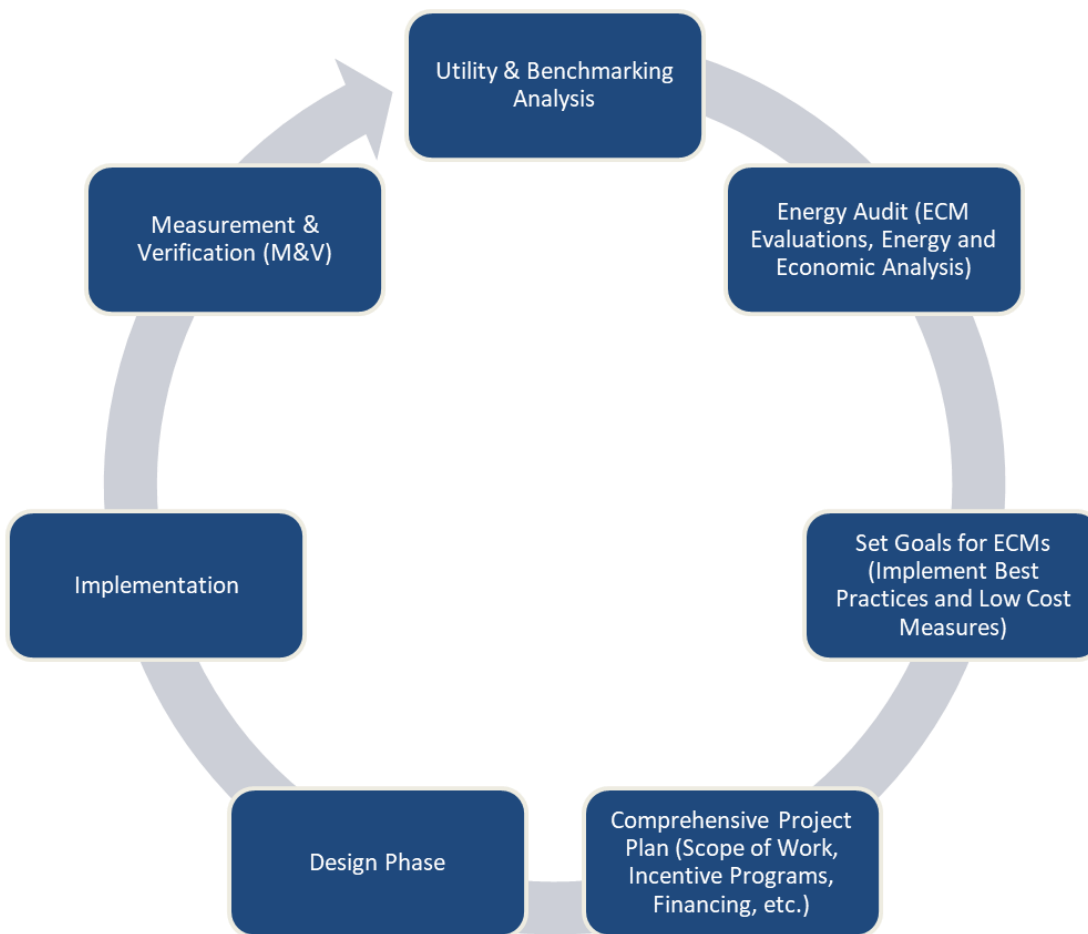

Project Development Cycle

11 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

11.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website¹⁴.

11.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website¹⁵.

¹⁴ www.state.nj.us/bpu/commercial/shopping.html

¹⁵ www.state.nj.us/bpu/commercial/shopping.html

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom - 101	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 102	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 103	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 104	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 105	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 106	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 107	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,817	-1	\$418	\$1,040	\$180	2.1
Classroom - 108	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 109	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 111	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 112	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 113	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 114	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 115	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.3	2,012	0	\$298	\$840	\$140	2.3
Classroom - 116	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 117	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 118	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 120	12	LED - Fixtures: Ambient 2x4 Fixture	Wall Switch	S	50	4,356	2	None	Yes	12	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	50	3,006	0.1	891	0	\$132	\$330	\$40	2.2
Classroom - 123	21	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	4,356	1, 2	Relamp	Yes	21	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,006	1.0	6,338	-1	\$940	\$1,990	\$390	1.7
Classroom - 123	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	3,006	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,006	0.1	327	0	\$49	\$130	\$30	2.1
Classroom - 124	14	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	4,356	1, 2	Relamp	Yes	14	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,006	0.6	4,225	-1	\$627	\$1,210	\$250	1.5
Classroom - 201	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 202	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 203	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 204	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2

Location	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom - 205	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 206	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 207	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 208	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 209	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 210	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.5	3,622	-1	\$537	\$1,570	\$250	2.5
Classroom - 211	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.5	3,622	-1	\$537	\$1,570	\$250	2.5
Classroom - 212	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 213	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 214	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.5	3,622	-1	\$537	\$1,570	\$250	2.5
Classroom - 215	13	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	13	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,616	-1	\$388	\$990	\$170	2.1
Classroom - 216	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Classroom - 217	15	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	15	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.5	3,018	-1	\$448	\$1,090	\$190	2.0
Classroom - 218	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.5	3,622	-1	\$537	\$1,570	\$250	2.5
Classroom - 219	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 220	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 221	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 222	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 223	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 224	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Classroom - 225	11	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	11	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.3	2,213	0	\$328	\$890	\$150	2.3
Classroom - 227	14	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	14	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,817	-1	\$418	\$1,040	\$180	2.1
Classroom 121	10	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	10	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.3	2,012	0	\$298	\$840	\$140	2.3
Computer Lab - 111	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2
Computer Lab - 119	8	LED - Fixtures: Ambient 2x4 Fixture	Wall Switch	S	50	4,356	2	None	Yes	8	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	50	3,006	0.1	594	0	\$88	\$330	\$40	3.3

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	15	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	4,356	1, 2	Relamp	Yes	15	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,006	0.8	5,317	-1	\$789	\$1,660	\$340	1.7
Library	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Library	104	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	104	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	3.1	20,925	-4	\$3,104	\$7,580	\$1,290	2.0
Locker Room - Boys	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Locker Room - Boys	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	3,006	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.0	218	0	\$32	\$100	\$20	2.5
Locker Room - Boys	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.6	4,225	-1	\$627	\$1,720	\$280	2.3
Locker Room - Girls	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Locker Room - Girls	20	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	20	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.6	4,024	-1	\$597	\$1,670	\$270	2.3
Mechanical - 2nd Floor	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	4,356	1, 2	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,006	0.1	709	0	\$105	\$330	\$60	2.6
Mechanical - Boiler Room	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Boiler Room	21	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	21	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.6	4,225	-1	\$627	\$1,720	\$280	2.3
Mechanical - Roof Annex	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	402	0	\$60	\$250	\$40	3.5
Multipurpose - Cafeteria	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Multipurpose - Cafeteria	30	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	4,356	1, 2	Relamp	Yes	30	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,006	1.4	9,054	-2	\$1,343	\$2,560	\$520	1.5
Office - Boys PE	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	402	0	\$60	\$250	\$40	3.5
Office - Counselors	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Office - Counselors	9	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	S	9	4,356	2	None	Yes	9	LED Lamps: (1) 9W A19 Screw-In Lamp	Occupancy Sensor	9	3,006	0.0	120	0	\$18	\$330	\$40	16.3
Office - Counselors	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	402	0	\$60	\$250	\$40	3.5
Office - Counselors	9	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	9	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.3	1,811	0	\$269	\$790	\$130	2.5
Office - Counselors	11	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	3,006	1	Relamp	No	11	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.3	1,200	0	\$178	\$560	\$110	2.5
Office - CST	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.2	1,207	0	\$179	\$630	\$100	3.0
Office - Girls PE	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	402	0	\$60	\$250	\$40	3.5
Office - Kitchen	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	4,356	0.0	158	0	\$23	\$50	\$10	1.7
Office - Main	26	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	4,356	1, 2	Relamp	Yes	26	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,006	1.2	7,847	-2	\$1,164	\$2,300	\$460	1.6
Office - Mechanical	12	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	12	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.4	2,414	-1	\$358	\$940	\$160	2.2

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - Next to SRO	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	805	0	\$119	\$530	\$80	3.8
Office - Nurse	18	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	18	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.5	3,622	-1	\$537	\$1,570	\$250	2.5
Office - Speech	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	4,356	1, 2	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	3,006	0.1	604	0	\$90	\$280	\$50	2.6
Office - Student Resource Officer	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Restroom - Boys PE Office	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	3,006	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.0	109	0	\$16	\$50	\$10	2.5
Restroom - Class 115	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Occupancy Sensor	S	9	3,006		None	No	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Occupancy Sensor	9	3,006	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Faculty Women's by Gym	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	S	50	3,006		None	No	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	50	3,006	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Female by 101	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Restroom - Female by 118	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Restroom - Female by 203	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Restroom - Female by 225	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Restroom - Female by Gym	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.2	1,006	0	\$149	\$580	\$90	3.3
Restroom - Female Faculty by 118	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	S	50	3,006		None	No	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	50	3,006	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Female Faculty by 203	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Occupancy Sensor	S	33	3,006	1	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,006	0.0	53	0	\$8	\$40	\$10	3.8
Restroom - Female Faculty by 225	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	S	50	3,006		None	No	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	50	3,006	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Girls PE Office	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	3,006	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.0	109	0	\$16	\$50	\$10	2.5
Restroom - Kitchen	1	Linear Fluorescent - T8: 2' T8 (17W) - 1L	Occupancy Sensor	S	22	3,006	1	Relamp	No	1	LED - Linear Tubes: (1) 2' Lamp	Occupancy Sensor	9	3,006	0.0	45	0	\$7	\$30	\$0	4.5
Restroom - Main Office	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Occupancy Sensor	S	9	3,006		None	No	1	LED Lamps: (1) 9W A19 Screw-In Lamp	Occupancy Sensor	9	3,006	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Male by 101	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Restroom - Male by 119	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Restroom - Male by 203	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Restroom - Male by 225	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	604	0	\$90	\$480	\$70	4.6
Restroom - Male by Gym	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.2	1,006	0	\$149	\$580	\$90	3.3
Restroom - Male Faculty by 101	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	S	50	3,006		None	No	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	50	3,006	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Male Faculty by 118	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	S	50	3,006		None	No	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	50	3,006	0.0	0	0	\$0	\$0	\$0	0.0

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Restroom - Male Faculty by 203	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Occupancy Sensor	S	33	3,006	1	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Occupancy Sensor	17	3,006	0.0	53	0	\$8	\$40	\$10	3.8
Restroom - Male Faculty by 225	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	S	50	3,006		None	No	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	50	3,006	0.0	0	0	\$0	\$0	\$0	0.0
Restroom - Nurse	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	3,006	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.0	109	0	\$16	\$50	\$10	2.5
Restroom - Unisex by Gym	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	S	50	3,006		None	No	1	LED - Fixtures: Ambient 2x4 Fixture	Occupancy Sensor	50	3,006	0.0	0	0	\$0	\$0	\$0	0.0
Shop - Class 125	2	Compact Fluorescent: (1) 13W A19 Screw-In Lamp	Wall Switch	S	13	4,356		None	No	2	Compact Fluorescent: (1) 13W A19 Screw-In Lamp	Wall Switch	13	4,356	0.0	0	0	\$0	\$0	\$0	0.0
Shop - Class 125	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Shop - Class 125	2	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	S	9	4,356		None	No	2	LED Lamps: (1) 9W A19 Screw-In Lamp	Wall Switch	9	4,356	0.0	0	0	\$0	\$0	\$0	0.0
Shop - Class 125	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	3,006	1	Relamp	No	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	655	0	\$97	\$300	\$60	2.5
Shop - Class 125	32	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	32	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	1.0	6,438	-1	\$955	\$2,610	\$430	2.3
Stairs - By 107	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs - By 107	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	4,356	1, 3	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,006	0.2	1,408	0	\$209	\$910	\$320	2.8
Stairs - By 214	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs - By 214	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	4,356	1, 3	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,006	0.2	1,408	0	\$209	\$910	\$320	2.8
Stairs - By 220	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Stairs - By 220	7	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch		62	4,356	1, 3	Relamp	Yes	7	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	3,006	0.2	1,408	0	\$209	\$910	\$320	2.8
Storage - By 104	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,006	0.2	1,063	0	\$158	\$600	\$100	3.2
Storage - By 107	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,006	0.2	1,063	0	\$158	\$600	\$100	3.2
Storage - By 112	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,006	0.2	1,063	0	\$158	\$600	\$100	3.2
Storage - By 115	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	4,356	1, 2	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,006	0.2	1,063	0	\$158	\$600	\$100	3.2
Storage - By 208	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	4,356	1, 2	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,006	0.1	709	0	\$105	\$330	\$60	2.6
Storage - By 215	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	4,356	1, 2	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,006	0.1	709	0	\$105	\$330	\$60	2.6
Storage - By 221	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Occupancy Sensor	S	114	3,006	1	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	3,006	0.0	185	0	\$27	\$90	\$20	2.5
Storage - By Counseling Conference	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.2	1,207	0	\$179	\$630	\$100	3.0
Storage - Cafeteria	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.1	402	0	\$60	\$250	\$40	3.5
Storage - Kitchen	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	4,356	0.0	158	0	\$23	\$50	\$10	1.7

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Theater - Multipurpose Stage	6	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	4,356	1, 2	Relamp	Yes	6	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	3,006	0.2	1,207	0	\$179	\$630	\$100	3.0

Motor Inventory & Recommendations

		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - Boiler Room	Chilled Water Pump	2	Chilled Water Pump	60.00	95.0%	Yes	Weg		W	2,507		No	95.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Boiler Room	Combustion Air Fan	3	Combustion Air Fan	1.50	84.0%	No	Marathon		W	1,746		No	84.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Boiler Room	Heating Hot Water Pump	2	Heating Hot Water Pump	40.00	94.1%	Yes			W	2,000		No	94.1%	No		0.0	0	0	\$0	\$0	\$0	0.0
Elevator	Elevator Motor	1	Other	15.00	93.0%	No			W	180		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	AHU Supply Motor	1	Supply Fan	10.00	91.7%	Yes	York AHU Supply Fan		W	2,900		No	91.7%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	AHU Supply Motor	5	Exhaust Fan	15.00	93.0%	Yes	York AHU Return Fan		W	2,900		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	AHU Supply Motor	4	Supply Fan	30.00	94.1%	Yes	York AHU Supply Fan		W	2,900		No	94.1%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	AHU Supply Motor	2	Exhaust Fan	3.00	85.5%	Yes	York AHU Return Fan		W	2,900		No	85.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	AHU Supply Motor	2	Supply Fan	7.50	91.0%	Yes	York AHU Supply Fan		W	2,900		No	91.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical - Boiler Room	AHU Supply Motor	1	Supply Fan	5.00	89.5%	Yes			W	2,900		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Exhaust Fan Motor	10	Exhaust Fan	0.33	66.6%	No			W	2,900		No	66.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Exhaust Fan Motor	2	Exhaust Fan	0.25	65.0%	No			W	2,900		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Exhaust Fan Motor	3	Exhaust Fan	0.75	70.0%	No			W	2,900		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Exhaust Fan Motor	1	Exhaust Fan	1.00	82.6%	No			W	2,900		No	82.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Exhaust Fan Motor	1	Exhaust Fan	0.33	66.6%	No			W	2,900		No	66.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	Exhaust Fan Motor	1	Exhaust Fan	0.25	65.0%	No			W	2,900		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	RTU 13, 17, & 18	3	Supply Fan	1.00	82.6%	No			W	2,900	4	No	85.5%	Yes	3	0.9	3,126	0	\$474	\$11,800	\$200	24.5
Exterior Roof	RTU 13, 17, & 18	3	Exhaust Fan	1.00	82.6%	No			W	2,900		No	82.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	RTU 8	1	Supply Fan	3.00	85.5%	No			W	2,900	4	No	89.5%	Yes	1	0.9	3,076	0	\$467	\$5,100	\$200	10.5
Exterior Roof	RTU 8	1	Exhaust Fan	1.00	82.6%	No			W	2,900		No	82.6%	No		0.0	0	0	\$0	\$0	\$0	0.0

		Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Exterior Roof	RTU 10A & 10B	2	Supply Fan	7.50	91.0%	Yes			W	3,600		No	91.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	RTU 10A & 10B	2	Exhaust Fan	1.00	82.6%	No			W	3,600		No	82.6%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	RTU 15 (Cafeteria)	1	Supply Fan	15.00	93.0%	Yes			W	2,900		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	RTU 15 (Cafeteria)	1	Exhaust Fan	2.00	84.5%	No			W	2,900		No	84.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	RTU 14	1	Supply Fan	3.00	85.5%	No			W	2,900	4	No	89.5%	Yes	1	0.9	3,076	0	\$467	\$5,100	\$200	10.5
Exterior Roof	RTU 11	1	Supply Fan	4.12	85.5%	No			W	2,900	4	No	89.5%	Yes	1	1.3	4,224	0	\$641	\$5,400	\$300	8.0
Exterior Roof	RTU 9	1	Supply Fan	4.12	85.5%	No			W	2,400	4	No	89.5%	Yes	1	1.3	3,496	0	\$530	\$5,400	\$300	9.6
Interior Spaces	VAV Boxes	76	Supply Fan	0.25	65.0%	No			W	3,200		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

Packaged HVAC Inventory & Recommendations

		Existing Conditions									Proposed Conditions							Energy Impact & Financial Analysis							
Location	Area(s)/System(s) Served	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Exterior Roof	RTU 13, 17, & 18	3	Package Unit	4.20		10.26		AAON	RM-004-3-0-BA01	B	5	Yes	3	Package Unit	4.20		16.00		2.6	2,839	0	\$431	\$24,700	\$1,300	54.3
Exterior Roof	RTU 8	1	Package Unit	8.40		10.00		AAON	RM-008-3-0-BA02	B	5	Yes	1	Package Unit	8.40		14.00		1.4	1,547	0	\$235	\$12,200	\$700	49.0
Exterior Roof	RTU 10A & 10B	2	Package Unit	35.00	420.00	10.53		AAON	RN-031-3-0-BA02	B		No							0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	RTU 15 (Cafeteria)	1	Package Unit	40.00	480.00	10.53		AAON	RN-031-3-0-BB02	B		No							0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	RTU 14	1	Package Unit	17.80		10.53		AAON	RM-018-3-0-BA02	B	5	Yes	1	Package Unit	17.80		14.00		2.5	2,700	0	\$410	\$19,700	\$1,600	44.2
Exterior Roof	RTU 11	1	Package Unit	15.00	180.00	13.00		TRANE	OAGD180B4	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	RTU 9	1	Package Unit	10.00	120.00	13.00		TRANE	OAGD120B4	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Exterior Roof	2nd Floor Storage Room	1	Split-System Air-Source HP	1.83	24.00	16.50	7 HSPF	FUJITSU	AOU24RLXF20	B		No							0.0	0	0	\$0	\$0	\$0	0.0
Mechanical Room	Mechanical Room	1	Unit Heater		4.39		1 COP			W		No							0.0	0	0	\$0	\$0	\$0	0.0

Electric Chiller Inventory & Recommendations

		Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
Location	Area(s)/System(s) Served	Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Exterior - Ground	All Chilled Water Systems	2	Air-Cooled Screw Chiller	225.00	Carrier	30XVB2256MC216 DDO	W		No							0.0	0	0	\$0	\$0	\$0	0.0

Space Heating Boiler Inventory & Recommendations

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis							
Location	Area(s)/System(s) Served	System Quantity	System Type	Output Capacity per Unit (MBh)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - Boiler Room	All Hot Water HVAC	3	Non-Condensing Hot Water Boiler	2,636	HB Smith	28A - S/W - 12	B	6	Yes	3	Non-Condensing Hot Water Boiler	2,636	85.00%	Ec	0.0	0	486	\$7,881	\$221,000	\$10,300	26.7

DHW Inventory & Recommendations

		Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis						
Location	Area(s)/System(s) Served	System Quantity	System Type	Manufacturer	Model	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical - Boiler Room	All DHW	2	Indirect System	Bradford White	NTV399N XN3	W		No						0.0	0	0	\$0	\$0	\$0	0.0

Low-Flow Device Recommendations

		Recommendation Inputs				Energy Impact & Financial Analysis						
Location	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Restrooms	7	48	Faucet Aerator (Lavatory)	2.00	0.50	0.0	0	20	\$326	\$400	\$190	0.6

Reach-In Cooler/Freezer Inventory & Recommendations

		Existing Conditions				Proposed Conditions					Energy Impact & Financial Analysis						
Location	Cooler/Freezer Quantity	Case Type/Temperature	Manufacturer	Model	ECM #	Install EC Evaporator Fan Motors?	Install Electric Defrost Control?	Install Energy Efficient Doors?	Install Door Heater Control?	Install Aluminum Night Covers?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - Mechanical Room	0	Cooler (35F to 55F)	QBD Cooling Systems	CD26HB		No	No	No	No	No	0.0	0	0	\$0	\$0	\$0	0.0

Walk-In Cooler/Freezer Inventory & Recommendations

		Existing Conditions				Proposed Conditions			Energy Impact & Financial Analysis						
Location	Cooler/Freezer Quantity	Case Type/Temperature	Manufacturer	Model	ECM #	Install EC Evaporator Fan Motors?	Install Electric Defrost Control?	Install Evaporator Fan Control?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Cooler (35F to 55F)	Russell	RL6A094ADA	9	No	No	Yes	0.0	644	0	\$98	\$2,060	\$80	20.3
Kitchen	1	Medium Temp Freezer (0F to 30F)	Heatcraft	BELO100BS6EMAB0400	9	No	No	Yes	0.0	625	0	\$95	\$2,060	\$80	20.9

Commercial Refrigerator/Freezer Inventory & Recommendations

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Refrigerator/ Freezer Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Stand-Up Refrigerator, Solid Door (31 - 50 cu. ft.)	Continental	2RN	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Stand-Up Refrigerator, Solid Door (>50 cu. ft.)	Traulsen	RRI-32LPUT	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Freezer Chest	Coldtech	43SCL-LH-DGM	No	10	Yes	0.6	5,216	0	\$791	\$3,100	\$0	3.9
Kitchen	1	Refrigerator Chest	Mimet	CV-200ICAN	No	10	Yes	0.1	1,021	0	\$155	\$1,900	\$0	12.3
Kitchen	1	Freezer Chest	GE	FCM 20SUB WW	No	10	Yes	0.6	4,936	0	\$749	\$3,000	\$0	4.0
Kitchen	1	Refrigerator Chest	Powers Equipment Co	#681	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Refrigerator Chest	Powers Equipment Co	#569	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	2	Stand-Up Refrigerator, Solid Door (16 - 30 cu. ft.)	Traulsen	RHT-1-32-WUT	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Office	1	Stand-Up Refrigerator, Solid Door (≤15 cu. ft.)	QBD Cooling Systems	CD-26-HB	No		No	0.0	0	0	\$0	\$0	\$0	0.0

Cooking Equipment Inventory & Recommendations

Existing Conditions						Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Equipment Type	Manufacturer	Model	High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen	1	Insulated Food Holding Cabinet (Full Size)	Continental	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	2	Electric Convection Oven (Full Size)	Blodgett	Unknown	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen	1	Electric Steamer	Blodgett	SB-10E	No		No	0.0	0	0	\$0	\$0	\$0	0.0

Dishwasher Inventory & Recommendations

Existing Conditions								Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Dishwasher Type	Manufacturer	Model	Water Heater Fuel Type	Booster Heater Fuel Type	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Payback w/ Incentives in Years
Kitchen	1	Single Tank Conveyor (High Temp)	Hobart	CRS66A	Natural Gas	Electric	No	8	Yes	0.9	8,110	52	\$2,066	\$22,000	\$1,000	10.2

Plug Load Inventory

Existing Conditions						
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?	Manufacturer	Model
Whitman Elementary	1	Clothes Dryer	1,200	No		
Whitman Elementary	1	Clothes Washer	700	No		
Whitman Elementary	8	Coffee Machine	900	No		
Whitman Elementary	30	Desktop	145	No		
Whitman Elementary	4	Fan (Ceiling)	200	No		
Whitman Elementary	2	Kiln	11,000	No		
Whitman Elementary	141	Laptop	45	No		
Whitman Elementary	10	Microwave	1,000	No		
Whitman Elementary	1	Pottery Wheel	400	No		
Whitman Elementary	2	Treadmills	500	No		
Whitman Elementary	1	3D Printer	70	No		
Whitman Elementary	11	Air Purifier	300	No		
Whitman Elementary	1	Belt Sander	1,200	No		
Whitman Elementary	3	Drill Press	1,000	No		
Whitman Elementary	3	Jig Saw	1,800	No		
Whitman Elementary	2	Portable Belt Sander	1,000	No		
Whitman Elementary	2	Portable Jig Saw	1,500	No		
Whitman Elementary	1	Portable Table Saw	1,800	No		
Whitman Elementary	1	Table Saw	2,200	No		
Whitman Elementary	1	Wheelchair Elevator	100	No		
Whitman Elementary	3	Paper Shredder	150	No		
Whitman Elementary	21	Printer (Medium/Small)	240	No		
Whitman Elementary	5	Printer/Copier (Large)	600	No		
Whitman Elementary	37	Projector	100	No		
Whitman Elementary	7	Refrigerator (Mini)	126	No		
Whitman Elementary	6	Refrigerator (Residential)	450	No		
Whitman Elementary	2	Serving Table (Chilled/Heated)	300	No		
Whitman Elementary	4	Speakers (Medium/Small)	75	No		
Whitman Elementary	26	Television	130	No		
Whitman Elementary	1	Toaster	1,000	No		
Whitman Elementary	4	Toaster Oven	700	No		
Whitman Elementary	30	Water Fountain	100	No		

Vending Machine Inventory & Recommendations

Location	Existing Conditions		Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Dining Area - Staff Dining Room	1	Glass Fronted Refrigerated	11	Yes	0.1	1,209	0	\$183	\$270	\$50	1.2
Dining Area - Staff Dining Room	1	Refrigerated	11	Yes	0.2	1,612	0	\$245	\$270	\$50	0.9

APPENDIX B: ENERGY STAR STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of site energy and source energy. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

ENERGY STAR[®] Statement of Energy Performance

LEARN MORE AT energystar.gov

2

Chestnut Ridge Middle School

Primary Property Type: K-12 School
Gross Floor Area (ft²): 108,813
Built: 1989

For Year Ending: March 31, 2023
Date Generated: May 07, 2024

ENERGY STAR[®]
Score¹

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information		
Property Address Chestnut Ridge Middle School 641 Hurffville-Cross Keys Road Sewell, New Jersey 08082	Property Owner Washington Township Board of Education 206 Holly Avenue Sewell, NJ 08080 (856) 589-6644	Primary Contact Janine Wechter 206 Holly Avenue Sewell, NJ 08080 (856) 589-6644 x 6502 jwechter@wtps.org
Property ID: 30742137		

Energy Consumption and Energy Use Intensity (EUI)			
Site EUI 114.4 kBtu/ft ²	Annual Energy by Fuel		National Median Comparison
	Natural Gas (kBtu)	6,175,825 (50%)	National Median Site EUI (kBtu/ft ²)
	Electric - Grid (kBtu)	6,274,340 (50%)	National Median Source EUI (kBtu/ft ²)
			% Diff from National Median Source EUI
Source EUI 221 kBtu/ft ²			Annual Emissions
			Total (Location-Based) GHG Emissions
			(Metric Tons CO ₂ e/year)
			1,043

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: _____ Date: _____

Licensed Professional

() _____



Professional Engineer or Registered Architect Stamp (if applicable)

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
Btu	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
CHP	<i>Combined heat and power</i> . Also referred to as cogeneration.
COP	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
DCV	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
US DOE	<i>United States Department of Energy</i>
EC Motor	<i>Electronically commutated motor</i>
ECM	<i>Energy conservation measure</i>
EER	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
EUI	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
ENERGY STAR	ENERGY STAR is the government-backed symbol for energy efficiency. The ENERGY STAR program is managed by the EPA.
EPA	<i>United States Environmental Protection Agency</i>
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
GHG	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
gpf	<i>Gallons per flush</i>

gpm	<i>Gallon per minute</i>
HID	<i>High intensity discharge</i> : high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
hp	<i>Horsepower</i>
HPS	<i>High-pressure sodium</i> : a type of HID lamp.
HSPF	<i>Heating seasonal performance factor</i> : a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
HVAC	<i>Heating, ventilating, and air conditioning</i>
IHP 2014	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
IPLV	<i>Integrated part load value</i> : a measure of the part load efficiency usually applied to chillers.
kBtu	One thousand British thermal units
kW	<i>Kilowatt</i> : equal to 1,000 Watts.
kWh	<i>Kilowatt-hour</i> : 1,000 Watts of power expended over one hour.
LED	<i>Light emitting diode</i> : a high-efficiency source of light with a long lamp life.
LGEA	<i>Local Government Energy Audit</i>
Load	The total power a building or system is using at any given time.
Measure	A single activity, or installation of a single type of equipment, which is implemented in a building system to reduce total energy consumption.
MH	<i>Metal halide</i> : a type of HID lamp.
MBh	<i>Thousand Btu per hour</i>
MBtu	<i>One thousand British thermal units</i>
MMBtu	<i>One million British thermal units</i>
MV	<i>Mercury Vapor</i> : a type of HID lamp.
NJBPU	<i>New Jersey Board of Public Utilities</i>
NJCEP	<i>New Jersey's Clean Energy Program</i> : NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment.
psig	Pounds per square inch gauge
Plug Load	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
PV	<i>Photovoltaic</i> : refers to an electronic device capable of converting incident light directly into electricity (direct current).

SEER	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
SEP	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR Portfolio Manager.
Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
SREC (II)	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
therm	100,000 Btu. Typically used as a measure of natural gas consumption.
tons	A unit of cooling capacity equal to 12,000 Btu/hr.
Turnkey	Provision of a complete product or service that is ready for immediate use.
VAV	<i>Variable air volume</i>
VFD	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
WaterSense®	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
Watt (W)	Unit of power commonly used to measure electricity use.