



Local Government Energy Audit Report

Clifton Fire Station No. 1

May 15, 2020

Prepared for:

City of Clifton
84 1st Street
Clifton, NJ 07011

Prepared by:

TRC
900 Route 9 North
Woodbridge, NJ 07095

Disclaimer

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from RS Means. Cost estimates include material and labor pricing associated with installation of primary recommended equipment only. Cost estimates do not include demolition or removal of hazardous waste. We encourage the owner of the facility to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2020 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

Table of Contents


1 Executive Summary.....	1
1.1 Planning Your Project	4
Pick Your Installation Approach	4
More Options from Around the State.....	6
2 Existing Conditions.....	7
2.1 Site Overview.....	7
2.2 Building Occupancy	7
2.3 Building Envelope	8
2.4 Lighting Systems.....	8
2.5 Air Handling Systems.....	9
Roof Top Unit	9
2.6 Heating Only Systems.....	10
Infrared Heating	10
Electric Baseboard.....	10
2.7 Domestic Hot Water.....	11
2.8 Food Service Equipment.....	11
2.9 Plug Load & Vending Machines.....	12
2.10 Water-Using Systems	12
3 Energy Use and Costs	13
3.1 Electricity	15
3.2 Natural Gas.....	16
3.3 Benchmarking.....	17
Tracking Your Energy Performance	18
4 Energy Conservation Measures	19
4.1 Lighting Controls.....	22
ECM 1: Install Occupancy Sensor Lighting Controls	22
4.2 Variable Frequency Drives (VFD).....	23
ECM 2: Install VFDs on Constant Volume (CV) Fans	23
4.3 Gas-Fired Heating	24
ECM 3: Install Infrared Heaters	24
4.4 HVAC Improvements	24
ECM 4: Install Pipe Insulation.....	24
4.5 Domestic Water Heating	25
ECM 5: Install Tankless Water Heater	25
ECM 6: Install Low-Flow DHW Devices.....	25
4.6 Food Service & Refrigeration Measures.....	26

ECM 7: Vending Machine Control	26
4.7 Measures for Future Consideration	27
High Speed Insulated Overhead Doors	27
5 Energy Efficient Best Practices	28
Energy Tracking with ENERGY STAR® Portfolio Manager®	28
Weatherization.....	28
Doors and Windows	28
Window Treatments/Coverings	28
Lighting Maintenance.....	29
Motor Maintenance	29
Fans to Reduce Cooling Load	29
Thermostat Schedules and Temperature Resets	29
AC System Evaporator/Condenser Coil Cleaning	29
HVAC Filter Cleaning and Replacement	29
Furnace Maintenance	30
Water Heater Maintenance	30
Plug Load Controls.....	30
Water Conservation	31
Procurement Strategies	31
6 On-site Generation	32
6.1 Solar Photovoltaic	33
6.2 Combined Heat and Power	34
7 Project Funding and Incentives.....	35
7.1 SmartStart	36
7.2 Direct Install	37
7.3 Pay for Performance - Existing Buildings.....	38
7.4 Combined Heat and Power	39
7.5 Energy Savings Improvement Program.....	40
7.6 SREC Registration Program.....	41
8 Energy Purchasing and Procurement Strategies	42
8.1 Retail Electric Supply Options.....	42
8.2 Retail Natural Gas Supply Options	42
Appendix A: Equipment Inventory & Recommendations	A-1
Appendix B: ENERGY STAR® Statement of Energy Performance.....	B-1
Appendix C: Glossary	C-1

1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) report for Clifton Fire Station No. 1. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

BUILDING PERFORMANCE REPORT

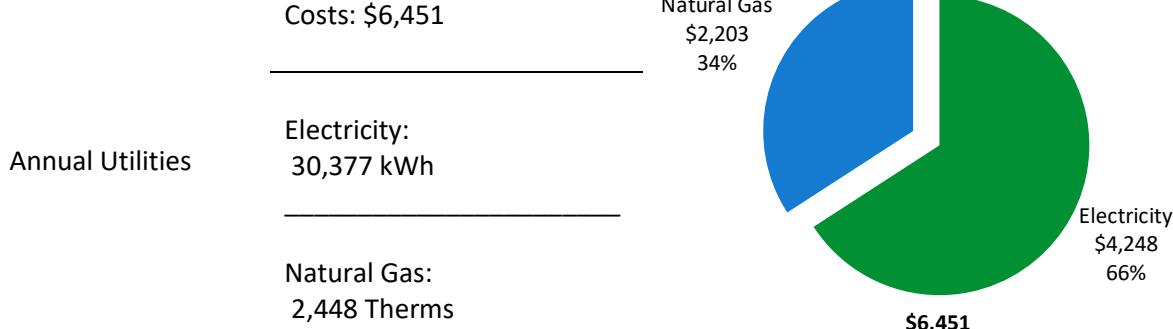

ENERGY STAR® Benchmarking Score	N/A <i>(1-100 scale)</i>	A standard energy use benchmark is not available for this facility type. This report contains suggestions about how to improve building performance and reduce energy costs.
---------------------------------	-----------------------------	--

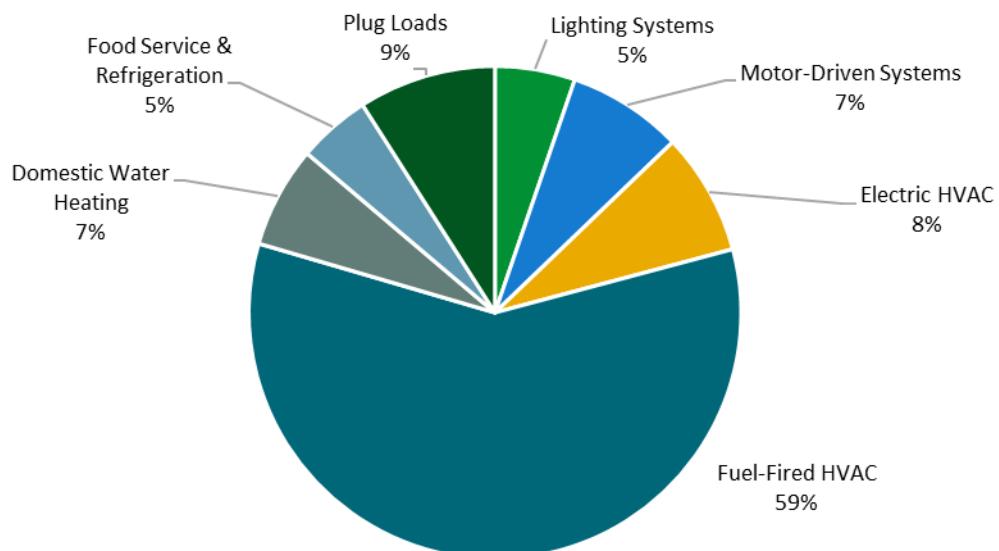


Figure 1 - Energy Use by System


POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$9,519
Potential Rebates & Incentives ¹	\$2,222
Annual Cost Savings	\$874
Annual Energy Savings	Electricity: 5,066 kWh Natural Gas: 184 Therms
Greenhouse Gas Emission Savings	4 Tons
Simple Payback	8.4 Years
Site Energy Savings (all utilities)	10%

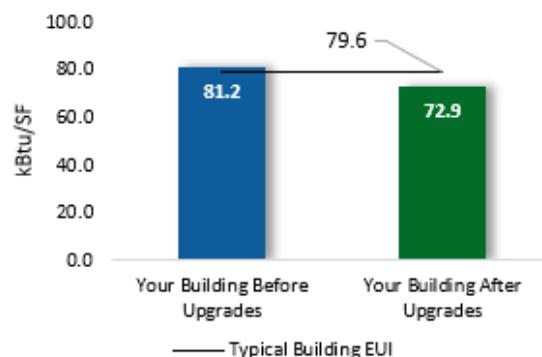

Scenario 2: Cost Effective Package²

Installation Cost	\$4,976
Potential Rebates & Incentives	\$622
Annual Cost Savings	\$733
Annual Energy Savings	Electricity: 5,066 kWh Natural Gas: 27 Therms
Greenhouse Gas Emission Savings	3 Tons
Simple Payback	5.9 Years
Site Energy Savings (all utilities)	6%

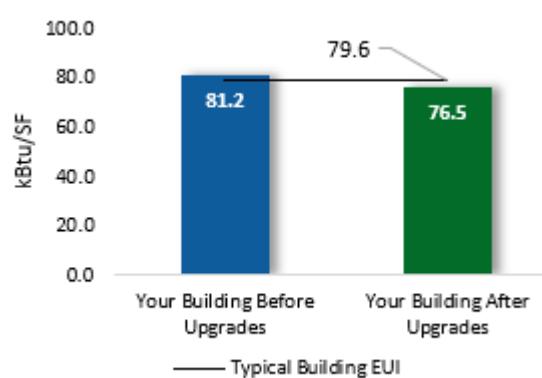

On-site Generation Potential

Photovoltaic	None
Combined Heat and Power	None

¹ Incentives are based on current SmartStart Prescriptive incentives. Other Program incentives may apply.

² A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)	
	Lighting Control Measures		1,421	0.1	0	\$196	\$1,698	\$350	\$1,348	6.9	1,396	
ECM 1	Install Occupancy Sensor Lighting Controls	Yes	1,421	0.1	0	\$196	\$1,698	\$350	\$1,348	6.9	1,396	
	Variable Frequency Drive (VFD) Measures		2,033	0.3	0	\$284	\$3,010	\$150	\$2,860	10.1	2,047	
ECM 2	Install VFDs on Constant Volume (CV) Fans	Yes	2,033	0.3	0	\$284	\$3,010	\$150	\$2,860	10.1	2,047	
	Gas Heating (HVAC/Process) Replacement		0	0.0	12	\$108	\$2,942	\$1,000	\$1,942	18.0	1,405	
ECM 3	Install Infrared Heaters	No	0	0.0	12	\$108	\$2,942	\$1,000	\$1,942	18.0	1,405	
	HVAC System Improvements		0	0.0	1	\$10	\$23	\$8	\$15	1.5	133	
ECM 4	Install Pipe Insulation	Yes	0	0.0	1	\$10	\$23	\$8	\$15	1.5	133	
	Domestic Water Heating Upgrade		0	0.0	6	\$50	\$1,616	\$614	\$1,002	20.1	647	
ECM 5	Install Tankless Water Heater	No	0	0.0	4	\$33	\$1,602	\$600	\$1,002	30.7	425	
ECM 6	Install Low-Flow DHW Devices	Yes	0	0.0	2	\$17	\$14	\$14	\$0	0.0	222	
	Food Service & Refrigeration Measures		1,612	0.2	0	\$225	\$230	\$100	\$130	0.6	1,623	
ECM 7	Vending Machine Control	Yes	1,612	0.2	0	\$225	\$230	\$100	\$130	0.6	1,623	
	TOTALS (COST EFFECTIVE MEASURES)			5,066	0.6	3	\$733	\$4,976	\$622	\$4,353	5.9	5,421
	TOTALS (ALL MEASURES)			5,066	0.6	18	\$874	\$9,519	\$2,222	\$7,297	8.4	7,251

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMS, groups of ECMS, or use a comprehensive approach where all ECMS are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

Pick Your Installation Approach

New Jersey's Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMS identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Install Occupancy Sensor Lighting Controls	X	X	
ECM 2	Install VFDs on Constant Volume (CV) Fans	X		
ECM 3	Install Infrared Heaters	X	X	
ECM 4	Install Pipe Insulation	X	X	
ECM 5	Install Tankless Water Heater	X	X	
ECM 6	Install Low-Flow DHW Devices	X	X	
ECM 7	Vending Machine Control	X	X	

Figure 3 – Funding Options



New Jersey's Clean Energy Programs At-A-Glance

	SmartStart Flexibility to install at your own pace	Direct Install Turnkey installation	Pay for Performance Whole building upgrades
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.

Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.



Individual Measures with SmartStart

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

Turnkey Installation with Direct Install

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

Whole Building Approach with Pay for Performance

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

More Options from Around the State

Financing and Planning Support with the Energy Savings Improvement Program (ESIP)

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

Resiliency with Return on Investment through Combined Heat & Power (CHP)

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

Ongoing Electric Savings with Demand Response

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPU) has sponsored this Local Government Energy Audit (LGEA) Report for Clifton Fire Station No. 1. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

2.1 Site Overview

On January 14, 2020, TRC performed an energy audit at Clifton Fire Station No. 1 located in Clifton, New Jersey. TRC met with Mike Pressler to review the facility operations and help focus our investigation on specific energy-using systems.

Clifton Fire Station No. 1 is a two-story, 4,294 square foot building built in 1948. Spaces include a basement, kitchen/lounge, main garage, officer's dorm, restrooms, laundry room, corridors, stairwells and mechanical space. The main building is 100% heated. The building is cooled, except for the garage.

General note: The City of Clifton may shut down this facility in the future in order to consolidate sites.

2.2 Building Occupancy

The facility is occupied year-round. Typical occupancy includes 3 people. There is a total of 4 shifts which are 24 hours each.

Building Name	Weekday/Weekend	Operating Schedule
Fire Station No. 1	Weekday	24/7
	Weekend	24/7

Figure 4 - Building Occupancy Schedule

2.3 Building Envelope

Building walls are concrete block with a façade constructed of concrete and brick. The roof is flat and covered with light colored membrane. The roof is in fair condition with areas in poor condition due to water pooling. The walls are made of concrete masonry units (CMUs). Some windows are cellular glass block and in fair condition. Some windows are operable, double pane with vinyl frames. The glass-to-frame seals are in poor condition. The operable window weather seals are in poor condition, showing evidence of excessive wear.

Exterior doors are metal with metal frames and are in fair condition with worn door seals. Overhead doors are minimally insulated sectional steel doors with worn sealing materials. They are operated by fractional horsepower motors. Degraded window and door seals increase drafts and outside air infiltration.




Building Façade



Roof



Building Façade



Roof

2.4 Lighting Systems

The primary interior lighting system uses 15-Watt linear LED lamps. Fixture types include 2-lamp, 4-foot long industrial, wrap or strip fixtures. Additionally, there are some LED general purpose lamps and LED strip and recessed can fixtures. These LED upgrades were completed 5 to 10 years ago under the Direct Install program. Interior light fixtures are manually controlled via wall switches. Most fixtures are in fair condition. Interior lighting levels were generally sufficient.


Exterior fixtures include LED wall pack fixtures and general-purpose screw in LED lamps that are in good condition. They are controlled by photocell controls.



LED Linear Fixture



LED Wall Pack Fixture



LED Screw in Lamp



LED Screw in Lamps

2.5 Air Handling Systems

Roof Top Unit

The facility is served by a packaged rooftop unit (RTU). It has a cooling capacity of 4 tons and a gas-fired heating capacity of 101 MBh. The RTU serves the whole building except for the garage. The RTU is relatively new, highly efficient, and in good condition. The supply fan motor is 1 hp and operates throughout the year subject to start/stop control. Refer to Appendix A for detailed information. The RTU is controlled by a local thermostat which was set to 70°F at the time of the audit. It should be noted that reducing this setpoint to 68°F during the heating season and increasing this setpoint to 72°F during the cooling season will provide energy savings at no cost.



Roof Top Unit



Thermostat

2.6 Heating Only Systems

Infrared Heating


The main garage is heated by a gas-fired infrared heater with a heating capacity of 83 MBh. This equipment is beyond its useful life and in poor condition. The unit is controlled by a manual dial thermostat in the space. There is also a through-the-wall exhaust fan with a fractional horsepower motor in the garage.



Infrared Heater

Electric Baseboard

The basement is heated by an electric baseboard heater with an assumed heating capacity of 5 kW. This equipment is nearing the end of its useful life and in poor condition. The unit is controlled by a manual dial located on the unit.



Baseboard Heater

2.7 Domestic Hot Water

Hot water is produced by a 40 gallon, 38 MBh gas-fired storage tank water heater with an efficiency rating of 80%. A fractional hp circulation pump distributes water to end uses, operating continuously. The domestic hot water pipes are not insulated.



Storage Tank Water Heater



High Flow Sink Aerator

2.8 Food Service Equipment

The kitchen has a residential gas stove that has low use and is standard efficiency.

Visit https://www.energystar.gov/products/commercial_food_service_equipment for the latest information on high efficiency food service equipment.



Gas Stove

2.9 Plug Load & Vending Machines

You may wish to consider paying particular attention to minimizing your plug load usage. This report makes suggestions for ECMs in this area as well as Energy Efficient Best Practices.

There is one computer workstation in the facility. Plug loads throughout the building include general café and office equipment. There is a clothes washer and dryer on site as well as an electric space heater. There is a refrigerated beverage vending machine which is not currently equipped with occupancy-based controls.



Washing Machines


2.10 Water-Using Systems

There are restrooms with showers and sinks. Faucet flow rates are at 2.2 gallons per minute (gpm) and considered high flow devices. Showerheads vary in flow rate.

3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	30,377 kWh	\$4,248
Natural Gas	2,448 Therms	\$2,203
Total		\$6,451

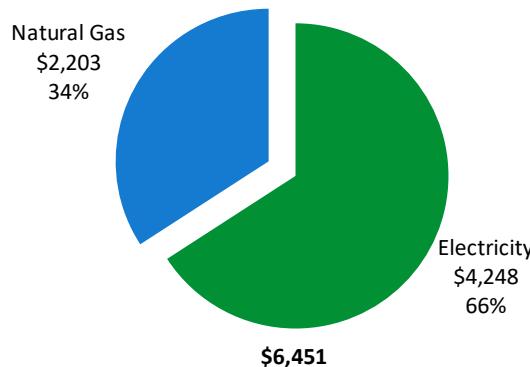

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


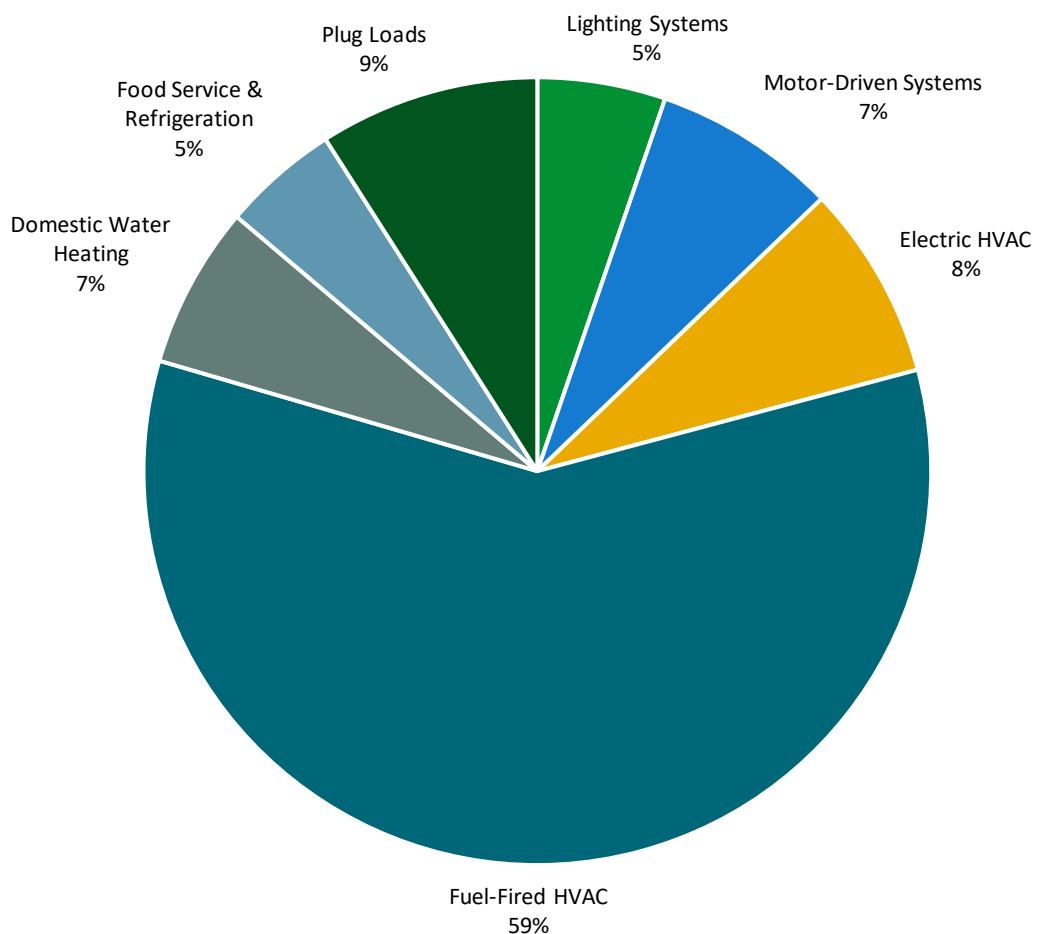


Figure 5 - Energy Balance

3.1 Electricity

PSE&G delivers electricity under rate class GLP, with electric production provided by Aggressive Energy, a third-party supplier.

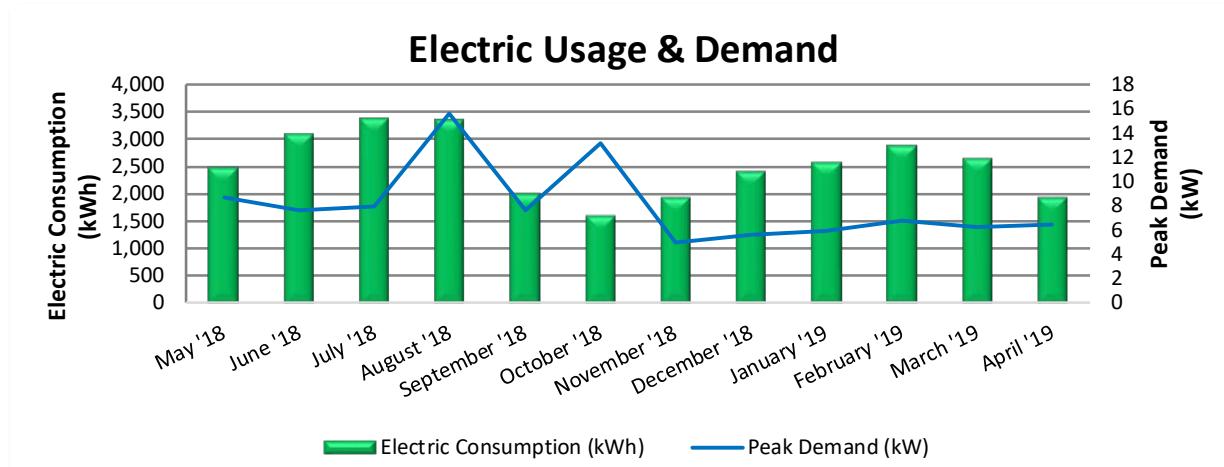


Electric Billing Data						
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost	TRC Estimated Usage?
6/7/18	31	2,490	9	\$38	\$412	Yes
7/5/18	29	3,094	8	\$33	\$471	Yes
8/3/18	30	3,390	8	\$34	\$511	Yes
9/4/18	30	3,374	16	\$34	\$507	Yes
10/3/18	31	2,019	8	\$33	\$267	Yes
11/1/18	30	1,604	13	\$28	\$216	Yes
12/3/18	30	1,934	5	\$20	\$250	Yes
1/4/19	31	2,411	6	\$22	\$309	Yes
2/4/19	31	2,579	6	\$23	\$331	Yes
3/6/19	31	2,890	7	\$27	\$371	Yes
4/7/19	31	2,657	6	\$24	\$341	Yes
5/8/19	30	1,935	7	\$26	\$263	Yes
Totals	365	30,377	16	\$341	\$4,248	
Annual	365	30,377	16	\$341	\$4,248	

Notes:

- Peak demand of 16 kW occurred in August 2018.
- Average demand over the past 12 months was 8 kW.
- The average electric cost over the past 12 months was \$0.140/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.

3.2 Natural Gas

PSE&G delivers natural gas under rate class GSG (HTG), with natural gas supply provided by East Coast Power and Gas, a third-party supplier.

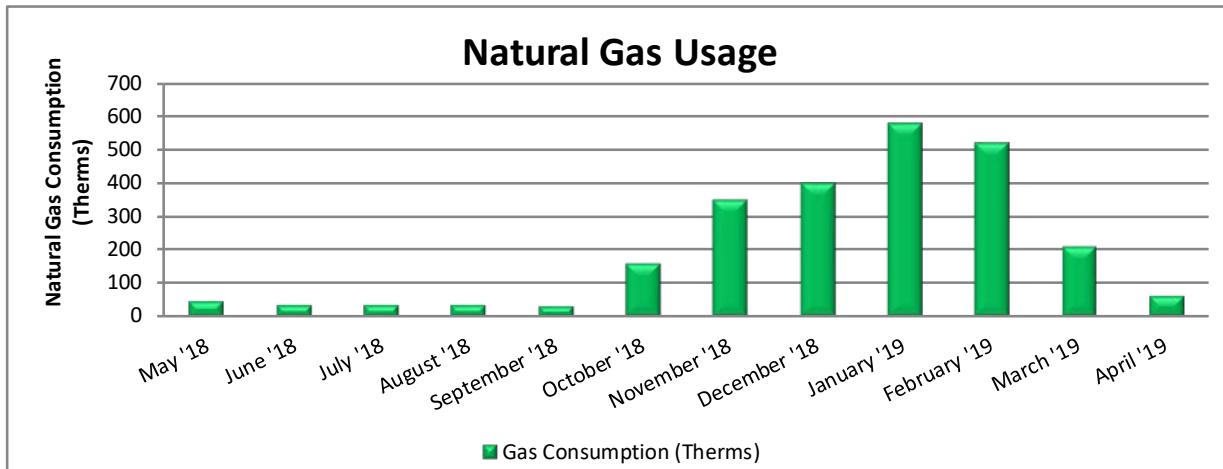

Gas Billing Data				
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost	TRC Estimated Usage?
6/7/18	31	46	\$48	Yes
7/5/18	29	36	\$40	Yes
8/3/18	30	32	\$37	Yes
9/4/18	30	33	\$38	Yes
10/3/18	31	30	\$36	Yes
11/1/18	30	160	\$149	Yes
12/3/18	30	349	\$303	Yes
1/4/19	31	397	\$346	Yes
2/4/19	31	576	\$511	Yes
3/6/19	31	520	\$463	Yes
4/7/19	31	207	\$172	Yes
5/8/19	30	60	\$61	Yes
Totals	365	2,448	\$2,203	
Annual	365	2,448	\$2,203	

Notes:

- The average gas cost for the past 12 months is \$0.900/therm, which is the blended rate used throughout the analysis.

3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager®* software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

Benchmarking Score

N/A

Due to its unique characteristics, this building type is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

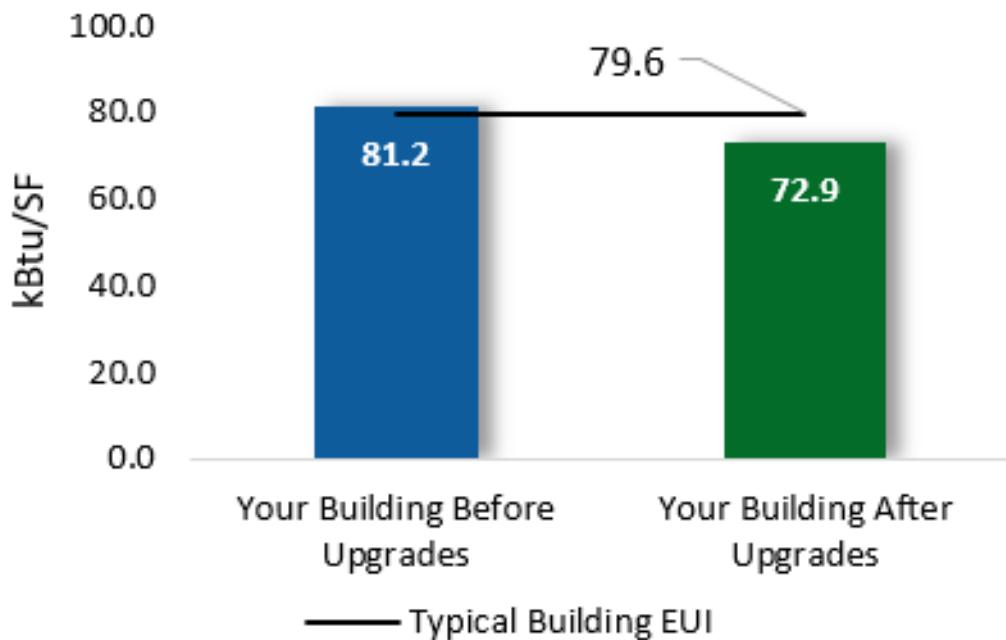


Figure 6 - Energy Use Intensity Comparison³

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

³ Based on all evaluated ECMs



Tracking Your Energy Performance

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website⁴.

⁴ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

4 ENERGY CONSERVATION MEASURES

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see **Appendix A: Equipment Inventory & Recommendations**.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
	Lighting Control Measures		1,421	0.1	0	\$196	\$1,698	\$350	\$1,348	6.9	1,396
ECM 1	Install Occupancy Sensor Lighting Controls	Yes	1,421	0.1	0	\$196	\$1,698	\$350	\$1,348	6.9	1,396
	Variable Frequency Drive (VFD) Measures		2,033	0.3	0	\$284	\$3,010	\$150	\$2,860	10.1	2,047
ECM 2	Install VFDs on Constant Volume (CV) Fans	Yes	2,033	0.3	0	\$284	\$3,010	\$150	\$2,860	10.1	2,047
	Gas Heating (HVAC/Process) Replacement		0	0.0	12	\$108	\$2,942	\$1,000	\$1,942	18.0	1,405
ECM 3	Install Infrared Heaters	No	0	0.0	12	\$108	\$2,942	\$1,000	\$1,942	18.0	1,405
	HVAC System Improvements		0	0.0	1	\$10	\$23	\$8	\$15	1.5	133
ECM 4	Install Pipe Insulation	Yes	0	0.0	1	\$10	\$23	\$8	\$15	1.5	133
	Domestic Water Heating Upgrade		0	0.0	6	\$50	\$1,616	\$614	\$1,002	20.1	647
ECM 5	Install Tankless Water Heater	No	0	0.0	4	\$33	\$1,602	\$600	\$1,002	30.7	425
ECM 6	Install Low-Flow DHW Devices	Yes	0	0.0	2	\$17	\$14	\$14	\$0	0.0	222
	Food Service & Refrigeration Measures		1,612	0.2	0	\$225	\$230	\$100	\$130	0.6	1,623
ECM 7	Vending Machine Control	Yes	1,612	0.2	0	\$225	\$230	\$100	\$130	0.6	1,623
	TOTALS		5,066	0.6	18	\$874	\$9,519	\$2,222	\$7,297	8.4	7,251

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
	Lighting Control Measures	1,421	0.1	0	\$196	\$1,698	\$350	\$1,348	6.9	1,396
ECM 1	Install Occupancy Sensor Lighting Controls	1,421	0.1	0	\$196	\$1,698	\$350	\$1,348	6.9	1,396
	Variable Frequency Drive (VFD) Measures	2,033	0.3	0	\$284	\$3,010	\$150	\$2,860	10.1	2,047
ECM 2	Install VFDs on Constant Volume (CV) Fans	2,033	0.3	0	\$284	\$3,010	\$150	\$2,860	10.1	2,047
	HVAC System Improvements	0	0.0	1	\$10	\$23	\$8	\$15	1.5	133
ECM 4	Install Pipe Insulation	0	0.0	1	\$10	\$23	\$8	\$15	1.5	133
	Domestic Water Heating Upgrade	0	0.0	2	\$17	\$14	\$14	\$0	0.0	222
ECM 6	Install Low-Flow DHW Devices	0	0.0	2	\$17	\$14	\$14	\$0	0.0	222
	Food Service & Refrigeration Measures	1,612	0.2	0	\$225	\$230	\$100	\$130	0.6	1,623
ECM 7	Vending Machine Control	1,612	0.2	0	\$225	\$230	\$100	\$130	0.6	1,623
	TOTALS	5,066	0.6	3	\$733	\$4,976	\$622	\$4,353	5.9	5,421

* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

** - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMS

4.1 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
Lighting Control Measures		1,421	0.1	0	\$196	\$1,698	\$350	\$1,348	6.9	1,396
ECM 1	Install Occupancy Sensor Lighting Controls	1,421	0.1	0	\$196	\$1,698	\$350	\$1,348	6.9	1,396

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

ECM 1: Install Occupancy Sensor Lighting Controls

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

Affected building areas: kitchen/lounge, basement, garage, restrooms, and the laundry room.

4.2 Variable Frequency Drives (VFD)

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
	Variable Frequency Drive (VFD) Measures	2,033	0.3	0	\$284	\$3,010	\$150	\$2,860	10.1	2,047
ECM 2	Install VFDs on Constant Volume (CV) Fans	2,033	0.3	0	\$284	\$3,010	\$150	\$2,860	10.1	2,047

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

ECM 2: Install VFDs on Constant Volume (CV) Fans

Install VFDs to control constant volume fan motor speeds. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor, if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature.

For air handlers with direct expansion (DX) cooling systems, the minimum air flow across the cooling coil required to prevent the coil from freezing must be determined during the final project design. The control system programming should maintain the minimum air flow whenever the compressor is operating. Prior to implementation, verify minimum fan speed in cooling mode with the manufacturer. Note that savings will vary depending on the operating characteristics of each AHU.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

Affected air handlers: rooftop unit.

4.3 Gas-Fired Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
	Gas Heating (HVAC/Process) Replacement	0	0.0	12	\$108	\$2,942	\$1,000	\$1,942	18.0	1,405
ECM 3	Install Infrared Heaters	0	0.0	12	\$108	\$2,942	\$1,000	\$1,942	18.0	1,405

ECM 3: Install Infrared Heaters

We evaluated existing, aging infrared heating equipment with new low-intensity infrared heating units with an enclosed flame.

For the purposes of this report, we evaluated the installation of units with an increased capacity (100 MBh) in comparison to the existing units. It is recommended, the unit capacity and location within the space be re-evaluated during the sizing and placement of the new heaters as part of the system redesign.

Infrared heaters heat objects and surfaces directly, including the occupants of the space, rather than heating large volumes of air. Infrared heaters also heat the floor which then re-radiates the heat. As a result, infrared heaters are more effective and efficient at maintaining occupant comfort at significantly lower cost for certain space types.

Affected building areas: main garage.

4.4 HVAC Improvements

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
	HVAC System Improvements	0	0.0	1	\$10	\$23	\$8	\$15	1.5	133
ECM 4	Install Pipe Insulation	0	0.0	1	\$10	\$23	\$8	\$15	1.5	133

ECM 4: Install Pipe Insulation

Install insulation on domestic hot water system piping. Distribution system losses are dependent on system fluid temperature, the size of the distribution system, and the level of insulation of the piping. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is exposed to water, when the insulation has been removed from some areas of the pipe, or when valves have not been properly insulated system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

4.5 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
	Domestic Water Heating Upgrade	0	0.0	6	\$50	\$1,616	\$614	\$1,002	20.1	647
ECM 5	Install Tankless Water Heater	0	0.0	4	\$33	\$1,602	\$600	\$1,002	30.7	425
ECM 6	Install Low-Flow DHW Devices	0	0.0	2	\$17	\$14	\$14	\$0	0.0	222

ECM 5: Install Tankless Water Heater

We evaluated the replacement of the existing tank water heater with a tankless water heating system. Tankless water heaters (a.k.a. “on-demand water heaters”) only heat water when hot water is needed. Water is heated as it flows through the pipe to the hot water tap. Energy savings from a tankless water heater are based on eliminating heat losses associated with maintaining unnecessary standby hot water capacity.

ECM 6: Install Low-Flow DHW Devices

Install low-flow devices to reduce overall hot water demand. The following low flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Additional cost savings may result from reduced water usage.

4.6 Food Service & Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO ₂ e Emissions Reduction (lbs)
	Food Service & Refrigeration Measures	1,612	0.2	0	\$225	\$230	\$100	\$130	0.6	1,623
ECM 7	Vending Machine Control	1,612	0.2	0	\$225	\$230	\$100	\$130	0.6	1,623

ECM 7: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and they power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

4.7 Measures for Future Consideration

There are additional opportunities for improvement that the City of Clifton may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment and/or include significant system reconfiguration. These measures are therefore beyond the scope of this energy audit. These measure(s) are described here to support a whole building approach to energy efficiency and sustainability.

The City of Clifton may wish to consider the Energy Savings Improvement Program (ESIP) and take a whole building/entity wide energy project approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to evaluate these measures further, develop firm costs, savings estimates and detailed implementation plans. Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

High Speed Insulated Overhead Doors

Energy efficient overhead doors are an important consideration when improving the building envelope of the main garage area. The heat transfer through the closed overhead doors through by conduction and space convection heat loss when overhead doors are opened are responsible for a significant portion of the facility's heating energy consumption. We recommend replacing overhead doors with high speed insulated overhead doors. This measure will permit overhead doors to open and close more than twice as quickly as the existing case, significantly reducing heat loss in the garage area. The insulation will further mitigate heat loss when the doors are closed. For this measure to be effective the overhead doors would need to remain closed whenever the garage is being conditioned except when vehicles need to leave or enter.

As part of the installation, the overhead door frames should be properly sealed with weather stripping and sealing materials to ensure the mitigation of air infiltration. Building envelopes that limit air infiltration play a key role in optimizing heating and cooling efficiency, controlling moisture, and providing occupant comfort. Overhead door replacement may be an expensive upgrade, especially as it may involve structural or architectural elements.

Overall savings will also vary depending on the type of heating system present. Since infrared heaters tend to radiate heat directly to occupants or objects, they contribute less to overall heat loss than forced air systems do. Areas with forced air heat are the better candidates for this measure.

We recommend this as a measure for further study.

5 ENERGY EFFICIENT BEST PRACTICES

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

Energy Tracking with ENERGY STAR® Portfolio Manager®



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions⁵. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

Weatherization

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. Materials used may include caulk, polyurethane foam, and other weather-stripping materials. There is an energy savings opportunity by reducing the uncontrolled air exchange between the outside and inside of the building. Blower door assisted comprehensive building air sealing will reduce the amount of air exchange which will in turn reduce the load on the buildings heating and cooling equipment and thus providing energy savings and increased occupant comfort.

Doors and Windows

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour (ACH) can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

Window Treatments/Coverings

Use high-reflectivity films or cover windows with shades or shutters to reduce solar heat gain and reduce the load on cooling and heating systems. Older, single pane windows and east or west-facing windows are especially prone to solar heat gain. In addition, use shades or shutters at night during cold weather to reduce heat loss.

⁵ <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.

Lighting Maintenance

-  Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.
- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture relamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

Motor Maintenance

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

Fans to Reduce Cooling Load

Install ceiling fans to supplement your cooling system. Thermostat settings can typically be increased by 4°F with no change in overall occupant comfort due to the wind chill effect of moving air.

Thermostat Schedules and Temperature Resets



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5°F-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

AC System Evaporator/Condenser Coil Cleaning

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

HVAC Filter Cleaning and Replacement

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

Furnace Maintenance

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should: check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.


Water Heater Maintenance

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

Plug Load Controls



Reducing plug loads is a common way to decrease your electrical use. Limiting the energy use of plug loads can include increasing occupant awareness, removing under-used equipment, installing hardware controls, and using software controls. Consider enabling the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips⁶. Your local utility may offer incentives or rebates for this equipment.

⁶ For additional information refer to "Assessing and Reducing Plug and Process Loads in Office Buildings" <http://www.nrel.gov/docs/fy13osti/54175.pdf>, or "Plug Load Best Practices Guide" <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

Water Conservation



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense® ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense® website⁷ or download a copy of EPA's "WaterSense® at Work: Best Management Practices for Commercial and Institutional Facilities"⁸ to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

Procurement Strategies

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense® products where available.

⁷ <https://www.epa.gov/watersense>.

⁸ <https://www.epa.gov/watersense/watersense-work-0>.

6 ON-SITE GENERATION

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has no potential for installing a PV array.

This facility does not appear to meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as sufficient and sustained electric demand and sufficient flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

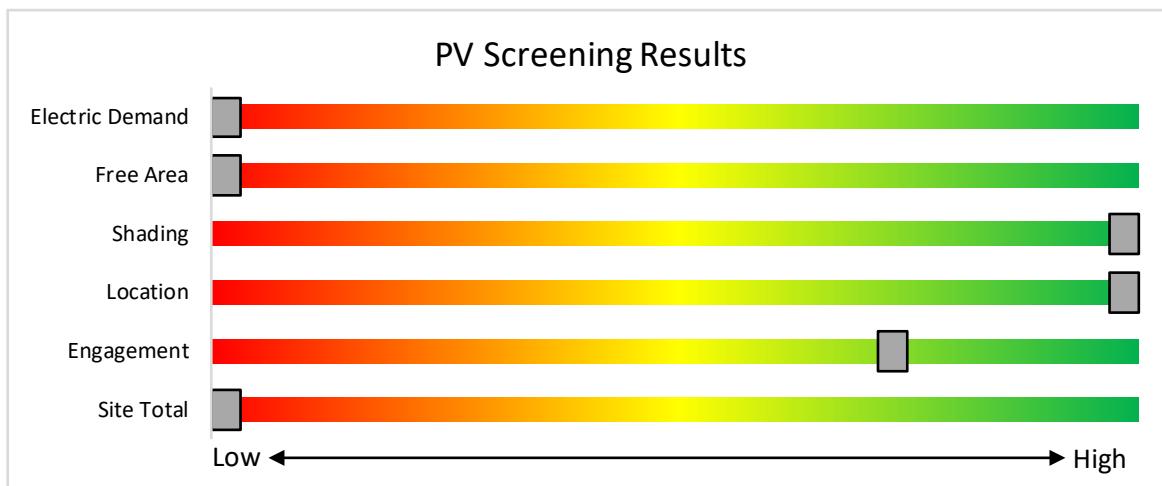


Figure 9 - Photovoltaic Screening

6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The low or infrequent thermal load is the most significant factor contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

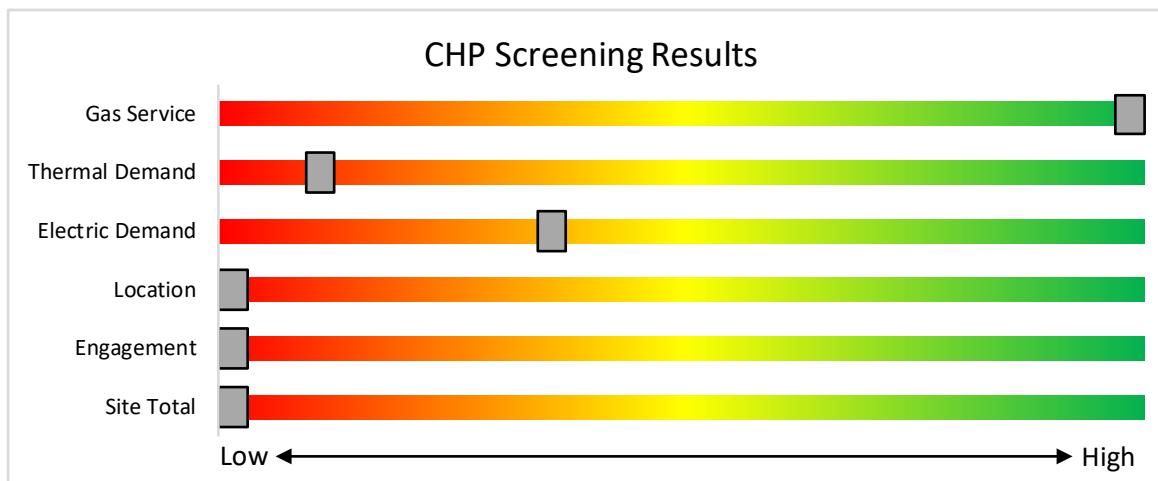


Figure 10 - Combined Heat and Power Screening

7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs can help. Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available New Jersey Clean Energy Programs.

	SmartStart <i>Flexibility to install at your own pace</i>	Direct Install <i>Turnkey installation</i>	Pay for Performance <i>Whole building upgrades</i>
Who should use it?	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together. Average peak demand should be below 200 kW. Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time. Peak demand should be over 200 kW.
How does it work?	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
What are the Incentives?	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project. You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
How do I participate?	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting www.njcleanenergy.com for program details, applications, and to contact a qualified contractor.			

7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy-efficient equipment based on market trends and new technologies.

Equipment with Prescriptive Incentives Currently Available:

Electric Chillers

Electric Unitary HVAC

Gas Cooling

Gas Heating

Gas Water Heating

Ground Source Heat Pumps

Lighting

Lighting Controls

Refrigeration Doors

Refrigeration Controls

Refrigerator/Freezer Motors

Food Service Equipment

Variable Frequency Drives

Incentives

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

How to Participate

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit www.njcleanenergy.com/SSB for a detailed program description, instructions for applying, and applications.

7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: www.njcleanenergy.com/DI.

7.3 Pay for Performance - Existing Buildings



Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures that results in at least 15% source energy savings, and lighting cannot make up the majority of the savings. P4P is a generally a good option for medium-to-large sized facilities looking to implement as many

measures as possible under a single project to achieve deep energy savings. This program has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program.

Based on the site building and utility data provided, the facility does not meet the requirements of the current P4P program.

Incentives

Incentives are based on estimated and achieved energy savings ranging from \$0.18-\$0.22/kWh and \$1.80-\$2.50/therm, capped at the lesser of 50% total project cost, or \$1 million per electric account and \$1 million per natural gas account, per fiscal year, not to exceed \$2 million per project. An incentive of \$0.15/square foot is also available to offset the cost of developing the Energy Reduction Plan (see below) contingent on the project moving forward with measure installation.

How to Participate

Contact one of the pre-approved consultants and contractors (“Partners”). Under direct contract to you, they will help further evaluate the measures identified in this report through development of the energy reduction plan), assist you in implementing selected measures, and verify actual savings one year after the installation. Your Partner will also help you apply for incentives.

Approval of the final scope of work is required by the program prior to installation. Installation can be done by the contractor of your choice (some P4P Partners are also contractors) or by internal staff, but the Partner remains involved throughout construction to ensure compliance with the program requirements.

Detailed program descriptions, instructions for applying, applications and list of Partners can be found at: www.njcleanenergy.com/P4P.

7.4 Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

Incentives

Eligible Technologies	Size (Installed Rated Capacity) ¹	Incentive (\$/kW)	% of Total Cost Cap per Project ³	\$ Cap per Project ³
Powered by non-renewable or renewable fuel source ⁴	≤500 kW	\$2,000	30-40% ²	\$2 million
	>500 kW - 1 MW	\$1,000		
Gas Internal Combustion Engine	> 1 MW - 3 MW	\$550	30%	\$3 million
	>3 MW	\$350		
Fuel Cells with Heat Recovery	<1 MW	\$1,000	30%	\$2 million
	> 1MW	\$500		
Waste Heat to Power*	<1 MW	\$1,000	30%	\$3 million
	> 1MW	\$500		

*Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

How to Participate

You work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at: www.njcleanenergy.com/CHP.

7.5 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter into contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program description and application can be found at: www.njcleanenergy.com/ESIP.

ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.

7.6 SREC Registration Program

The SREC (Solar Renewable Energy Certificate) Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number, which enables it to generate New Jersey SRECs. SRECs are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SRECs to be placed in the customer's electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project's life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar Renewable Portfolio Standard. Purchasing SRECs can help them meet those requirements. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period fluctuates depending on supply and demand.

Information about the SRP can be found at: www.njcleanenergy.com/srec.

8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website⁹.

8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website¹⁰.

⁹ www.state.nj.us/bpu/commercial/shopping.html.

¹⁰ www.state.nj.us/bpu/commercial/shopping.html.

APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

Lighting Inventory & Recommendations

Location	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis								
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Exterior	3	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell		23	4,380		None	No	3	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	23	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior	1	LED Lamps: 9W Screw in Lamp	Photocell		9	4,380		None	No	1	LED Lamps: 9W Screw in Lamp	Photocell	9	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior	1	LED Lamps: 14W PAR38 Lamp	Photocell		14	4,380		None	No	1	LED Lamps: 14W PAR38 Lamp	Photocell	14	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen/Lounge	4	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	8,736	1	None	Yes	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.0	339	0	\$47	\$540	\$140	8.5
Kitchen/Lounge	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	8,736	1	None	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.0	85	0	\$12	\$0	\$0	0.0
Stairs	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch		29	8,736		None	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	8,736	0.0	0	0	\$0	\$0	\$0	0.0
Basement	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	8,736	1	None	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.0	254	0	\$35	\$270	\$70	5.7
Garage	4	LED - Fixtures: Linear Strip	Wall Switch	S	30	8,736	1	None	Yes	4	LED - Fixtures: Linear Strip	Occupancy Sensor	30	6,028	0.0	351	0	\$48	\$540	\$140	8.3
Garage	2	LED Lamps: 9W Screw in Lamp	Wall Switch	S	9	8,736	1	None	Yes	2	LED Lamps: 9W Screw in Lamp	Occupancy Sensor	9	6,028	0.0	53	0	\$7	\$0	\$0	0.0
Garage	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	8,736	1	None	Yes	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	6,028	0.0	85	0	\$12	\$0	\$0	0.0
Officer's Dorm	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	2,912		None	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Restroom	1	LED Lamps: 9W Screw in Lamp	Wall Switch	S	9	8,736	1	None	Yes	1	LED Lamps: 9W Screw in Lamp	Occupancy Sensor	9	6,028	0.0	26	0	\$4	\$116	\$0	31.9
Dorm	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	S	29	2,912		None	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,912	0.0	0	0	\$0	\$0	\$0	0.0
Laundry Room	1	LED - Fixtures: Linear Strip	Wall Switch	S	30	8,736	1	None	Yes	1	LED - Fixtures: Linear Strip	Occupancy Sensor	30	6,028	0.0	88	0	\$12	\$116	\$0	9.6
Laundry Room	1	LED Lamps: 9W Screw in Lamp	Wall Switch	S	9	8,736	1	None	Yes	1	LED Lamps: 9W Screw in Lamp	Occupancy Sensor	9	6,028	0.0	26	0	\$4	\$0	\$0	0.0
Restroom	1	LED - Fixtures: Linear Strip	Wall Switch	S	30	8,736	1	None	Yes	1	LED - Fixtures: Linear Strip	Occupancy Sensor	30	6,028	0.0	88	0	\$12	\$116	\$0	9.6
Restroom	1	LED Lamps: 9W Screw in Lamp	Wall Switch	S	9	8,736	1	None	Yes	1	LED Lamps: 9W Screw in Lamp	Occupancy Sensor	9	6,028	0.0	26	0	\$4	\$0	\$0	0.0

Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions				Energy Impact & Financial Analysis								
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Roof	Main Building	1	Supply Fan	1.0	85.5%	No	W	8,760	2	No	85.5%	Yes	1	0.3	2,033	0	\$284	\$3,010	\$150	10.1
Garage	Building Exhaust	1	Exhaust Fan	0.3	65.0%	No	B	8,760		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Garage	Overhead Door	1	Other	0.2	70.0%	No	W	292		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions					Proposed Conditions						Energy Impact & Financial Analysis								
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Basement	Electric Baseboard	1	Electric Resistance Heat		17.07	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Roof	Main Building	1	Packaged AC	4.00		W		No							0.0	0	0	\$0	\$0	\$0	0.0

Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions					Proposed Conditions					Energy Impact & Financial Analysis							
		System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Garage	Garage	1	Infrared Unit Heater	83	B	3	Yes	1	Infrared Unit Heater	100	93.00%	Et	0.0	0	12	\$108	\$2,942	\$1,000	18.0
Roof	Main Building	1	Furnace	101	W		No						0.0	0	0	\$0	\$0	\$0	0.0

Pipe Insulation Recommendations

Location	Area(s)/System(s) Affected	Recommendation Inputs				Energy Impact & Financial Analysis								
		ECM #	Length of Uninsulated Pipe (ft)	Pipe Diameter (in)		Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years		
Basement	Domestic Hot Water	4	4	0.50		0.0	0	1	\$10	\$23	\$8	1.5		

DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions							Energy Impact & Financial Analysis							
		System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years	
Basement	Domestic Hot Water	1	Storage Tank Water Heater (\leq 50 Gal)	B	5	Yes	1	Tankless Water Heater	Natural Gas	95.00%	EF	0.0	0	4	\$33	\$1,602	\$600	30.7	

Low-Flow Device Recommendations

Recommendation Inputs						Energy Impact & Financial Analysis							
Location	ECM #	Device Quantity	Device Type		Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Restroom	6	2	Faucet Aerator (Lavatory)		2.20	0.50	0.0	0	2	\$17	\$14	\$14	0.0

Cooking Equipment Inventory & Recommendations

Location	Existing Conditions				Proposed Conditions			Energy Impact & Financial Analysis							
	Quantity	Equipment Type			High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years	
Kitchen	1	Gas Convection Oven (Half Size)			Yes		No	0.0	0	0	\$0	\$0	\$0	0.0	

Plug Load Inventory

Existing Conditions				
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Fire Station No.1	1	Computer	125	
Fire Station No.1	1	Medium Printer	100	
Fire Station No.1	1	Fan	100	
Fire Station No.1	4	TV	55	
Fire Station No.1	1	Radio	25	
Fire Station No.1	1	Coffee Machine	800	
Fire Station No.1	1	Microwave	700	
Fire Station No.1	1	Toaster	1,200	
Fire Station No.1	1	Large Refrigerator	1,100	
Fire Station No.1	1	Electric Space Heater	1,500	
Fire Station No.1	1	Clothes Washer/Dryer	3,000	
Fire Station No.1	1	Misc Server Load	4,500	

Vending Machine Inventory & Recommendations

Existing Conditions			Proposed Conditions		Energy Impact & Financial Analysis						
Location	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Garage	1	Refrigerated	7	Yes	0.2	1,612	0	\$225	\$230	\$100	0.6

APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

 LEARN MORE AT energystar.gov	<h3 style="color: white; background-color: #0070C0; padding: 5px;">ENERGY STAR® Statement of Energy Performance</h3> <p style="font-size: 2em; font-weight: bold; color: black; margin-top: 10px;">N/A</p> <p style="margin-top: 10px;"> Clifton Fire Station No. 1 Primary Property Type: Fire Station Gross Floor Area (ft²): 4,294 Built: 1948 </p> <p style="margin-top: 10px;"> ENERGY STAR® Score¹ For Year Ending: April 30, 2019 Date Generated: February 06, 2020 </p>						
<small>1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.</small>							
Property & Contact Information <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%; padding: 5px;">Property Address Clifton Fire Station No. 1 84 1st Street Clifton, New Jersey 07011</td> <td style="width: 33%; padding: 5px;">Property Owner City of Clifton 900 Clifton Avenue Clifton, NJ 07013 (973) 470-5854</td> <td style="width: 33%; padding: 5px;">Primary Contact Dominick Villano 900 Clifton Avenue Clifton, NJ 07013 (973) 470-5854 dvillano@cliftonnj.org</td> </tr> </table> <p style="margin-top: 5px;">Property ID: 9002084</p>		Property Address Clifton Fire Station No. 1 84 1st Street Clifton, New Jersey 07011	Property Owner City of Clifton 900 Clifton Avenue Clifton, NJ 07013 (973) 470-5854	Primary Contact Dominick Villano 900 Clifton Avenue Clifton, NJ 07013 (973) 470-5854 dvillano@cliftonnj.org			
Property Address Clifton Fire Station No. 1 84 1st Street Clifton, New Jersey 07011	Property Owner City of Clifton 900 Clifton Avenue Clifton, NJ 07013 (973) 470-5854	Primary Contact Dominick Villano 900 Clifton Avenue Clifton, NJ 07013 (973) 470-5854 dvillano@cliftonnj.org					
Energy Consumption and Energy Use Intensity (EUI) <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%; padding: 5px;"> Site EUI 81.5 kBtu/ft² </td> <td style="width: 33%; padding: 5px;"> Annual Energy by Fuel Natural Gas (kBtu) 248,239 (70%) Electric - Grid (kBtu) 103,604 (30%) </td> <td style="width: 33%; padding: 5px;"> National Median Comparison National Median Site EUI (kBtu/ft²) 79.6 National Median Source EUI (kBtu/ft²) 124.9 % Diff from National Median Source EUI 2% </td> </tr> <tr> <td colspan="2" style="padding: 5px;"> Source EUI 127.8 kBtu/ft² </td> <td style="padding: 5px;"> Annual Emissions Greenhouse Gas Emissions (Metric Tons CO₂e/year) 24 </td> </tr> </table>		Site EUI 81.5 kBtu/ft ²	Annual Energy by Fuel Natural Gas (kBtu) 248,239 (70%) Electric - Grid (kBtu) 103,604 (30%)	National Median Comparison National Median Site EUI (kBtu/ft ²) 79.6 National Median Source EUI (kBtu/ft ²) 124.9 % Diff from National Median Source EUI 2%	Source EUI 127.8 kBtu/ft ²		Annual Emissions Greenhouse Gas Emissions (Metric Tons CO ₂ e/year) 24
Site EUI 81.5 kBtu/ft ²	Annual Energy by Fuel Natural Gas (kBtu) 248,239 (70%) Electric - Grid (kBtu) 103,604 (30%)	National Median Comparison National Median Site EUI (kBtu/ft ²) 79.6 National Median Source EUI (kBtu/ft ²) 124.9 % Diff from National Median Source EUI 2%					
Source EUI 127.8 kBtu/ft ²		Annual Emissions Greenhouse Gas Emissions (Metric Tons CO ₂ e/year) 24					
Signature & Stamp of Verifying Professional							
<p>I _____ (Name) verify that the above information is true and correct to the best of my knowledge.</p> <p>LP Signature: _____ Date: _____</p> <p>Licensed Professional</p> <p>_____ _____ _____</p>							
<div style="border: 1px solid black; width: 150px; height: 150px; margin-left: auto; margin-right: 0;"></div> <p style="margin-top: 5px;">Professional Engineer or Registered Architect Stamp (if applicable)</p>							

APPENDIX C: GLOSSARY

TERM	DEFINITION
Blended Rate	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
Btu	<i>British thermal unit:</i> a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
CHP	<i>Combined heat and power.</i> Also referred to as cogeneration.
COP	<i>Coefficient of performance:</i> a measure of efficiency in terms of useful energy delivered divided by total energy input.
Demand Response	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
DCV	<i>Demand control ventilation:</i> a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
US DOE	<i>United States Department of Energy</i>
EC Motor	<i>Electronically commutated motor</i>
ECM	<i>Energy conservation measure</i>
EER	<i>Energy efficiency ratio:</i> a measure of efficiency in terms of cooling energy provided divided by electric input.
EUI	<i>Energy Use Intensity:</i> measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
Energy Efficiency	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
ENERGY STAR®	ENERGY STAR® is the government-backed symbol for energy efficiency. The ENERGY STAR® program is managed by the EPA.
EPA	<i>United States Environmental Protection Agency</i>
Generation	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
GHG	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
gpf	<i>Gallons per flush</i>

gpm	<i>Gallon per minute</i>
HID	<i>High intensity discharge:</i> high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
hp	<i>Horsepower</i>
HPS	<i>High-pressure sodium:</i> a type of HID lamp
HSPF	<i>Heating seasonal performance factor:</i> a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
HVAC	<i>Heating, ventilating, and air conditioning</i>
IHP 2014	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
IPLV	<i>Integrated part load value:</i> a measure of the part load efficiency usually applied to chillers.
kBtu	One thousand British thermal units
kW	<i>Kilowatt:</i> equal to 1,000 Watts.
kWh	<i>Kilowatt-hour:</i> 1,000 Watts of power expended over one hour.
LED	<i>Light emitting diode:</i> a high-efficiency source of light with a long lamp life.
LGEA	<i>Local Government Energy Audit</i>
Load	The total power a building or system is using at any given time.
Measure	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
MH	<i>Metal halide:</i> a type of HID lamp
MBh	<i>Thousand Btu per hour</i>
MBtu	<i>One thousand British thermal units</i>
MMBtu	<i>One million British thermal units</i>
MV	<i>Mercury Vapor:</i> a type of HID lamp
NJBPU	<i>New Jersey Board of Public Utilities</i>
NJCEP	<i>New Jersey's Clean Energy Program:</i> NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money and the environment.
psig	Pounds per square inch gauge
Plug Load	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.
PV	<i>Photovoltaic:</i> refers to an electronic device capable of converting incident light directly into electricity (direct current).

SEER	<i>Seasonal energy efficiency ratio:</i> a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
SEP	<i>Statement of energy performance:</i> a summary document from the ENERGY STAR® Portfolio Manager®.
Simple Payback	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
SREC	<i>Solar renewable energy credit:</i> a credit you can earn from the state for energy produced from a photovoltaic array.
T5, T8, T12	A reference to a linear lamp diameter. The number represents increments of 1/8 th of an inch.
Temperature Setpoint	The temperature at which a temperature regulating device (thermostat, for example) has been set.
therm	100,000 Btu. Typically used as a measure of natural gas consumption.
tons	A unit of cooling capacity equal to 12,000 Btu/hr.
Turnkey	Provision of a complete product or service that is ready for immediate use
VAV	<i>Variable air volume</i>
VFD	<i>Variable frequency drive:</i> a controller used to vary the speed of an electric motor.
WaterSense®	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
Watt (W)	Unit of power commonly used to measure electricity use.