



# Local Government Energy Audit Report

Clifton Community Recreation Center

May 15, 2020

*Prepared for:*

City of Clifton

1232 Main Avenue

Clifton, NJ 07011

*Prepared by:*

TRC

900 Route 9 North

Woodbridge, NJ 07095

## Disclaimer

---

The goal of this audit report is to identify potential energy efficiency opportunities, help prioritize specific measures for implementation, and provide information about financial incentives that may be available. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings were reviewed for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated installation costs on our experience at similar facilities, pricing from local contractors and vendors, and/or cost estimates from RS Means. Cost estimates include material and labor pricing associated with installation of primary recommended equipment only. Cost estimates do not include demolition or removal of hazardous waste. We encourage the owner of the facility to independently confirm these cost estimates and to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on individual measures and conditions. TRC and NJBPU do not guarantee installed cost estimates and shall in no event be held liable should actual installed costs vary from estimates.

New Jersey's Clean Energy Program (NJCEP) incentive values provided in this report are estimates based on program information available at the time of the report. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state and federal requirements.

Copyright ©2020 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

# Table of Contents

---


<b>1</b>	<b>Executive Summary.....</b>	<b>1</b>
<b>1.1</b>	<b>Planning Your Project .....</b>	<b>4</b>
	Pick Your Installation Approach .....	4
	More Options from Around the State .....	6
<b>2</b>	<b>Existing Conditions.....</b>	<b>7</b>
2.1	Site Overview.....	7
2.2	Building Occupancy .....	7
2.3	Building Envelope .....	8
2.4	Lighting Systems.....	9
2.5	Air Handling Systems .....	10
	Packaged Unit .....	10
	Air Conditioners .....	10
2.6	Heating Steam System.....	11
2.7	Domestic Hot Water .....	11
2.8	Plug Load & Vending Machines.....	12
2.9	Water-Using Systems .....	12
<b>3</b>	<b>Energy Use and Costs .....</b>	<b>13</b>
3.1	Electricity .....	15
3.2	Natural Gas.....	16
3.3	Benchmarking.....	17
	Tracking Your Energy Performance .....	18
<b>4</b>	<b>Energy Conservation Measures .....</b>	<b>19</b>
4.1	Lighting .....	22
	ECM 1: Install LED Fixtures .....	22
	ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers.....	22
	ECM 3: Retrofit Fixtures with LED Lamps.....	23
4.2	Lighting Controls.....	23
	ECM 4: Install Occupancy Sensor Lighting Controls .....	23
	ECM 5: Install Daylight Dimming/Photocell Controls.....	24
	ECM 6: Install High/Low Lighting Controls .....	24
4.3	Variable Frequency Drives (VFD).....	25
	ECM 7: Install VFDs on Constant Volume (CV) Fans.....	25
4.4	Electric Unitary HVAC .....	26
	ECM 8: Install High Efficiency Air Conditioning Units.....	26
4.5	HVAC Improvements .....	27
	ECM 9: Install Occupancy-Controlled Thermostats.....	27
	ECM 10: Install Pipe Insulation.....	27

4.6	Domestic Water Heating .....	28
	ECM 11: Install Low-Flow DHW Devices.....	28
<b>5</b>	<b>Energy Efficient Best Practices .....</b>	<b>29</b>
	Energy Tracking with ENERGY STAR® Portfolio Manager® .....	29
	Weatherization.....	29
	Doors and Windows .....	29
	Window Treatments/Coverings .....	29
	Lighting Maintenance.....	30
	Motor Maintenance .....	30
	Destratification Fans .....	30
	AC System Evaporator/Condenser Coil Cleaning .....	30
	HVAC Filter Cleaning and Replacement .....	30
	Steam Trap Repair and Replacement.....	31
	Thermostatic Radiator Valve Installations .....	31
	Boiler Maintenance.....	31
	Furnace Maintenance .....	31
	Water Heater Maintenance .....	32
	Water Conservation .....	33
	Procurement Strategies .....	33
<b>6</b>	<b>On-site Generation .....</b>	<b>34</b>
6.1	Solar Photovoltaic .....	35
6.2	Combined Heat and Power .....	36
<b>7</b>	<b>Project Funding and Incentives.....</b>	<b>37</b>
7.1	SmartStart .....	38
7.2	Direct Install .....	39
7.3	Pay for Performance - Existing Buildings.....	40
7.4	Combined Heat and Power .....	41
7.5	Energy Savings Improvement Program .....	42
7.6	SREC Registration Program.....	43
<b>8</b>	<b>Energy Purchasing and Procurement Strategies .....</b>	<b>44</b>
8.1	Retail Electric Supply Options.....	44
8.2	Retail Natural Gas Supply Options .....	44
	<b>Appendix A: Equipment Inventory &amp; Recommendations .....</b>	<b>A-1</b>
	<b>Appendix B: ENERGY STAR® Statement of Energy Performance.....</b>	<b>B-1</b>
	<b>Appendix C: Glossary .....</b>	<b>C-1</b>

# 1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBPB) has sponsored this Local Government Energy Audit (LGEA) report for Clifton Community Recreation Center. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

## BUILDING PERFORMANCE REPORT

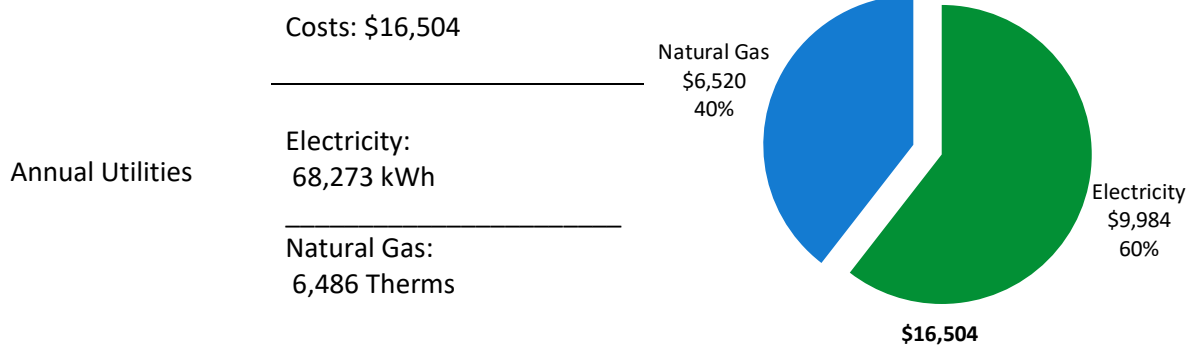

ENERGY STAR®  
Benchmarking Score

N/A  
(1-100 scale)

A standard energy use benchmark is not available for this facility type. This report contains suggestions about how to improve building performance and reduce energy costs.

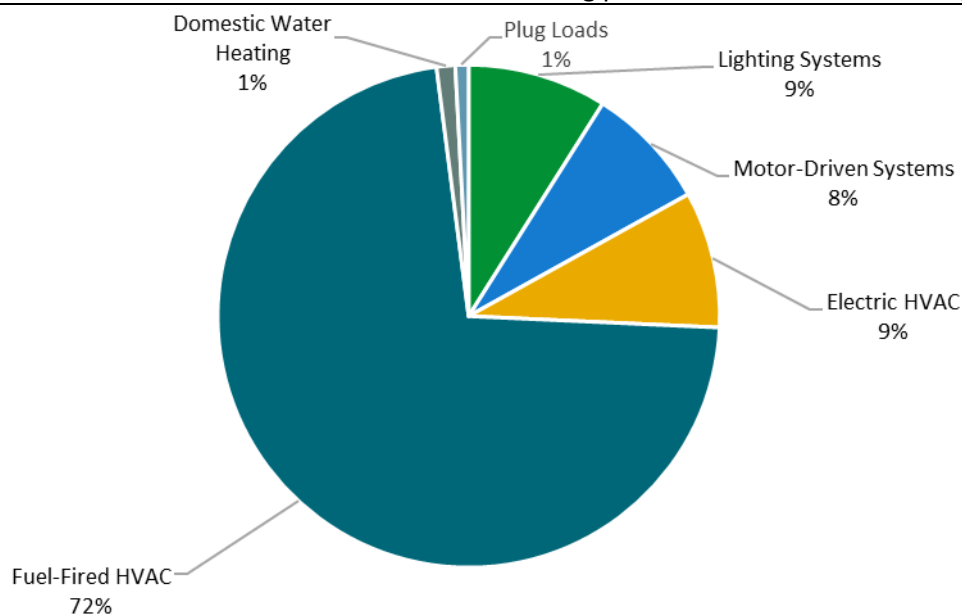


Figure 1 - Energy Use by System


## POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


### Scenario 1: Full Package (all evaluated measures)

Installation Cost	\$24,096
Potential Rebates & Incentives <sup>1</sup>	\$7,217
Annual Cost Savings	\$4,632
Annual Energy Savings	Electricity: 30,022 kWh Natural Gas: 240 Therms
Greenhouse Gas Emission Savings	17 Tons
Simple Payback	3.6 Years
Site Energy Savings (all utilities)	14%

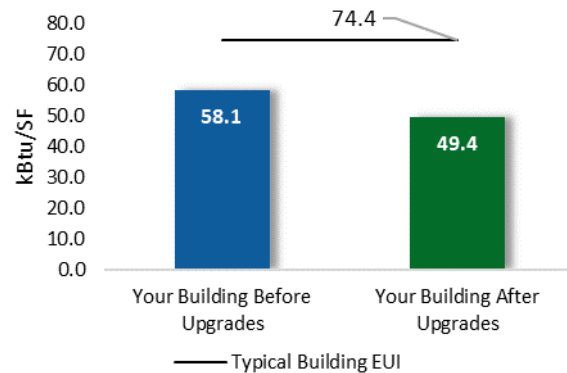

### Scenario 2: Cost Effective Package<sup>2</sup>

Installation Cost	\$16,711
Potential Rebates & Incentives	\$6,271
Annual Cost Savings	\$4,353
Annual Energy Savings	Electricity: 28,111 kWh Natural Gas: 241 Therms
Greenhouse Gas Emission Savings	16 Tons
Simple Payback	2.4 Years
Site Energy Savings (all utilities)	14%

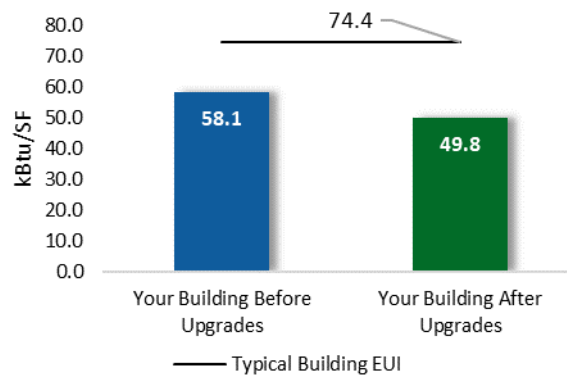

### On-site Generation Potential

Photovoltaic	None
Combined Heat and Power	None

<sup>1</sup> Incentives are based on current SmartStart Prescriptive incentives. Other Program incentives may apply.

<sup>2</sup> A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.



#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>12,750</b>	<b>4.4</b>	<b>-2</b>	<b>\$1,841</b>	<b>\$6,277</b>	<b>\$3,228</b>	<b>\$3,049</b>	<b>1.7</b>	<b>12,563</b>
ECM 1	Install LED Fixtures	Yes	155	0.0	0	\$23	\$465	\$200	\$265	11.7	157
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	274	0.1	0	\$39	\$170	\$40	\$130	3.3	269
ECM 3	Retrofit Fixtures with LED Lamps	Yes	12,321	4.3	-2	\$1,779	\$5,642	\$2,988	\$2,654	1.5	12,137
<b>Lighting Control Measures</b>			<b>3,150</b>	<b>1.2</b>	<b>-1</b>	<b>\$454</b>	<b>\$6,005</b>	<b>\$1,050</b>	<b>\$4,955</b>	<b>10.9</b>	<b>3,097</b>
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	2,873	1.1	-1	\$414	\$5,130	\$840	\$4,290	10.4	2,822
ECM 5	Install Daylight Dimming/Photocell Controls	Yes	124	0.0	0	\$18	\$200	\$0	\$200	11.0	125
ECM 6	Install High/Low Lighting Controls	No	153	0.1	0	\$22	\$675	\$210	\$465	21.1	150
<b>Variable Frequency Drive (VFD) Measures</b>			<b>8,293</b>	<b>2.2</b>	<b>0</b>	<b>\$1,213</b>	<b>\$4,761</b>	<b>\$2,000</b>	<b>\$2,761</b>	<b>2.3</b>	<b>8,351</b>
ECM 7	Install VFDs on Constant Volume (CV) Fans	Yes	8,293	2.2	0	\$1,213	\$4,761	\$2,000	\$2,761	2.3	8,351
<b>Electric Unitary HVAC Measures</b>			<b>1,758</b>	<b>1.4</b>	<b>0</b>	<b>\$257</b>	<b>\$6,711</b>	<b>\$736</b>	<b>\$5,975</b>	<b>23.2</b>	<b>1,770</b>
ECM 8	Install High Efficiency Air Conditioning Units	No	1,758	1.4	0	\$257	\$6,711	\$736	\$5,975	23.2	1,770
<b>HVAC System Improvements</b>			<b>4,070</b>	<b>0.0</b>	<b>25</b>	<b>\$848</b>	<b>\$314</b>	<b>\$174</b>	<b>\$140</b>	<b>0.2</b>	<b>7,044</b>
ECM 9	Install Occupancy-Controlled Thermostats	Yes	4,070	0.0	10	\$693	\$239	\$150	\$89	0.1	5,236
ECM 10	Install Pipe Insulation	Yes	0	0.0	15	\$155	\$75	\$24	\$51	0.3	1,807
<b>Domestic Water Heating Upgrade</b>			<b>0</b>	<b>0.0</b>	<b>2</b>	<b>\$19</b>	<b>\$29</b>	<b>\$29</b>	<b>\$0</b>	<b>0.0</b>	<b>222</b>
ECM 11	Install Low-Flow DHW Devices	Yes	0	0.0	2	\$19	\$29	\$29	\$0	0.0	222
<b>TOTALS (COST EFFECTIVE MEASURES)</b>			<b>28,111</b>	<b>7.8</b>	<b>24</b>	<b>\$4,353</b>	<b>\$16,711</b>	<b>\$6,271</b>	<b>\$10,440</b>	<b>2.4</b>	<b>31,126</b>
<b>TOTALS (ALL MEASURES)</b>			<b>30,022</b>	<b>9.3</b>	<b>24</b>	<b>\$4,632</b>	<b>\$24,096</b>	<b>\$7,217</b>	<b>\$16,880</b>	<b>3.6</b>	<b>33,047</b>

\* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.

## 1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

### Pick Your Installation Approach

New Jersey's Clean Energy Programs give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives before purchasing materials or starting installation.

The potential ECMs identified for this building likely qualify for multiple incentive and funding programs. Based on current program rules and requirements, your measures are likely to qualify for the following programs:

Energy Conservation Measure		SmartStart	Direct Install	Pay For Performance
ECM 1	Install LED Fixtures	x	x	
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	x	x	
ECM 3	Retrofit Fixtures with LED Lamps	x	x	
ECM 4	Install Occupancy Sensor Lighting Controls	x	x	
ECM 5	Install Daylight Dimming/Photocell Controls	x	x	
ECM 6	Install High/Low Lighting Controls	x	x	
ECM 7	Install VFDs on Constant Volume (CV) Fans	x	x	
ECM 8	Install High Efficiency Air Conditioning Units	x	x	
ECM 9	Install Occupancy-Controlled Thermostats	x	x	
ECM 10	Install Pipe Insulation	x	x	
ECM 11	Install Low-Flow DHW Devices	x	x	

*Figure 3 – Funding Options*





## New Jersey's Clean Energy Programs At-A-Glance

	<b>SmartStart</b> Flexibility to install at your own pace	<b>Direct Install</b> Turnkey installation	<b>Pay for Performance</b> Whole building upgrades
<b>Who should use it?</b>	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together.  Average peak demand should be below 200 kW.  Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time.  Peak demand should be over 200 kW.
<b>How does it work?</b>	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
<b>What are the Incentives?</b>	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project.  You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
<b>How do I participate?</b>	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.

Take the next step by visiting [www.njcleanenergy.com](http://www.njcleanenergy.com) for program details, applications, and to contact a qualified contractor.

### *Individual Measures with SmartStart*

For facilities wishing to pursue only selected individual measures (or planning to phase implementation of selected measures over multiple years), incentives are available through the SmartStart program. To participate, you can use internal resources or an outside firm or contractor to perform the final design of the ECM(s) and install the equipment. Program pre-approval is required for some SmartStart incentives, so only after receiving pre-approval should you proceed with ECM installation.

### *Turnkey Installation with Direct Install*

The Direct Install program provides turnkey installation of multiple measures through an authorized network of participating contractors. This program can provide substantially higher incentives than SmartStart, up to 70% of the cost of selected measures. Direct Install contractors will assess and verify individual measure eligibility and, in most cases, they perform the installation work. The Direct Install program is available to sites with an average peak demand of less than 200 kW.

### *Whole Building Approach with Pay for Performance*

Pay for Performance can be a good option for medium to large sized facilities to achieve deep energy savings. Pay for Performance allows you to install as many measures as possible under a single project as well as address measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program (ESIP) loan also use this program. Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures resulting in at least 15% energy savings, where lighting cannot make up the majority of the savings.

## **More Options from Around the State**

### *Financing and Planning Support with the Energy Savings Improvement Program (ESIP)*

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as, attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

### *Resiliency with Return on Investment through Combined Heat & Power (CHP)*

The CHP program provides incentives for combined heat and power (aka cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

### *Ongoing Electric Savings with Demand Response*

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

## 2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBPUB) has sponsored this Local Government Energy Audit (LGEA) Report for Clifton Community Recreation Center. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs. This report also contains valuable information on financial incentives from New Jersey's Clean Energy Program (NJCEP) for implementing ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

### 2.1 Site Overview

On January 10, 2020, TRC performed an energy audit at Clifton Community Recreation Center located in Clifton, New Jersey. TRC met with Bill Gumann to review the facility operations and help focus our investigation on specific energy-using systems.

Clifton Community Recreation Center is a two-story, 15,300 square foot building built in 1938. Spaces include classrooms, gymnasium, storage rooms, playroom, corridors, stairwells, and mechanical space. The facility is 100% heated and partially (approximately 50%) cooled. Recent improvements include: Within the last five years, the facility has installed a new steam boiler. There is an outside contractor who maintains it.

### 2.2 Building Occupancy

The facility is occupied year-round. Occupancy is typically low on the weekdays and higher on the weekends (25 people on average). The largest area is the gymnasium which is typically rented out for events on Saturdays; we estimate about six hours of use on the weekend days. During spring and summer months, the gym is used for 2 to 5 hours per day on weekdays. The gym is used less in the winter. Maintenance and recreation staff occupy the building for continued maintenance activities.

Building Name	Weekday/Weekend	Operating Schedule
Community Recreation Center	Monday	8:15AM - 7:00PM
	Tuesday-Friday	8:15AM - 4:15PM
	Saturday	Occasional Use
	Sunday	Closed

*Figure 4 - Building Occupancy Schedule*

## 2.3 Building Envelope

Building walls are concrete block with a brick facade. The roof is flat and covered with light membrane and is in fair condition. The walls are made of concrete masonry units (CMUs). The facility is presumed to contain the level of insulation which was required at the time of construction.

Most of the windows are operable, double-paned with vinyl frames. There are also some smaller fixed windows with wooden frames. The glass-to-frame seals are in fair to poor condition. Exterior doors have metal or wooden frames and are in poor condition with worn or missing door seals. Degraded window and door seals increase drafts and outside air infiltration. We recommend including the replacement of seals, caulk, and weather-stripping of doors as part of ongoing maintenance practices.




*Building Façade*



*Building Façade*



*Skylights and Roof*



*Wooden Double Door with Air Gap*

## 2.4 Lighting Systems

The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. There are also a few 40-Watt T12 fixtures. Additionally, there are some compact fluorescent lamps (CFL), halogen incandescent, and incandescent lamps as well as LED general purpose lamps. Typically, T8 fluorescent lamps use electronic ballasts and T12 fluorescent lamps use magnetic ballasts. Fixture types are recessed troffer and continuous row strip fixtures. Majority of fixtures are in good condition. All exit signs are LED. Interior lighting levels were generally sufficient for the space they serve. All interior light fixtures are manually controlled via wall switches.




*Linear T8 Fluorescent Fixtures*



*Linear T8 Fluorescent Fixtures*



*Recessed Troffer Fixtures with T8 Lamps*



*Recessed Troffer Fixtures with T8 Lamps*



*Manual Wall Switches*



*Timeclock*

Exterior fixtures include wall pack fixtures, flood lights, and general-purpose screw-based lamps. These fixtures contain high intensity discharge (HID), incandescent, and LED lamps. Exterior light fixtures are controlled by a time clock or photocell, depending on the fixture.



*LED Flood Lamps*



*Incandescent Screw in Lamp*

## 2.5 Air Handling Systems

### Packaged Unit

A packaged roof top unit serves the main gym area. The unit is located on the roof and is in good condition and within its useful life. This unit has a cooling capacity of 25 tons, a heating capacity of 292 MBh, and is of standard efficiency. This unit is used to provide back-up heating for the main gym area. The unit has a 7.5 hp supply fan motor that is of standard efficiency and operates as start/stop. It is controlled by a programmable thermostat located within the gym area, which is inoperable and in need of replacement. Refer to Appendix A for detailed information.



*Roof Top Unit*



*Thermostat with No Display Reading*

### Air Conditioners

The old post office area which is now utilized as classroom space is cooled by a split air conditioning (AC) system. The outdoor condensing unit is in poor condition and is beyond its useful life. This system has a capacity of approximately 4 tons and is presumed to be of low efficiency. A single window AC unit serves an arts and crafts room. The unit is in poor condition, inefficient, and operating beyond its useful life. These units are manually controlled.



*Outdoor Condensing Unit for Split AC System*



*Window AC Unit*



## 2.6 Heating Steam System

There is a Smith Cast Iron Steam Boiler with an output capacity of 762 MBh and an efficiency of about 81%. This boiler is less than five years old, in good condition, and there is a service contract in place. The steam boiler serves the building heating load through steam radiators throughout the building with manual dial valves. Facility staff reported these valves remain fully open throughout the winter heating season. At the time of the audit, there were windows open while the heat was on which indicates overheating of the facility. There is a steam pipe that runs through an unconditioned storage room with worn and missing insulation which should be repaired/replaced. The remainder of pipes appear to be adequately insulated.



*Steam Boiler*



*Steam Radiator with  
Manual Dial Valve*



*Uninsulated Pipe*



*Steam Radiators*

## 2.7 Domestic Hot Water

Hot water is produced with an 81-gallon, 399 MBh Rheem Rudd storage tank water heater with an efficiency rating of 80%. This equipment was installed in 2006 and is in good condition. There is a fractional horsepower motor that distributes water to end uses. The circulation pump operates continuously. The domestic hot water pipes are insulated, and the insulation is in fair condition.



*Storage Tank Water Heater*



*High- and Low-Flow Sink Aerators*

## 2.8 Plug Load & Vending Machines

The location is doing a great job managing their electrical plug loads. This report makes additional suggestions for ECMs in this area as well as Energy Efficient Best Practices.

Plug loads throughout the building include general entertainment equipment such as a TV, radio, and speakers. There is also a large residential refrigerator that should be replaced with an ENERGY STAR® unit at the end of its useful life.


## 2.9 Water-Using Systems

There are restrooms with hand washing sinks. Faucet flow rates are at 2.2 gallons per minute (gpm) or low flow, 0.5 gpm.

### 3 ENERGY USE AND COSTS


Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	68,273 kWh	\$9,984
Natural Gas	6,486 Therms	\$6,520
Total		\$16,504

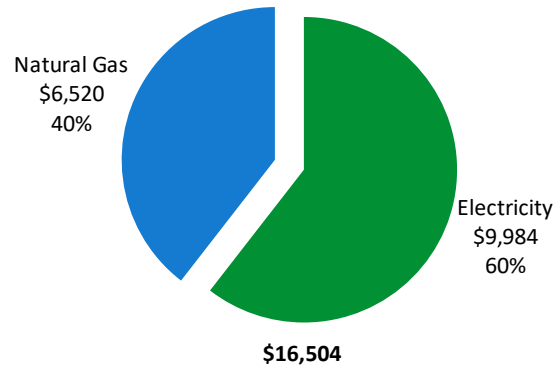

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.


The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.

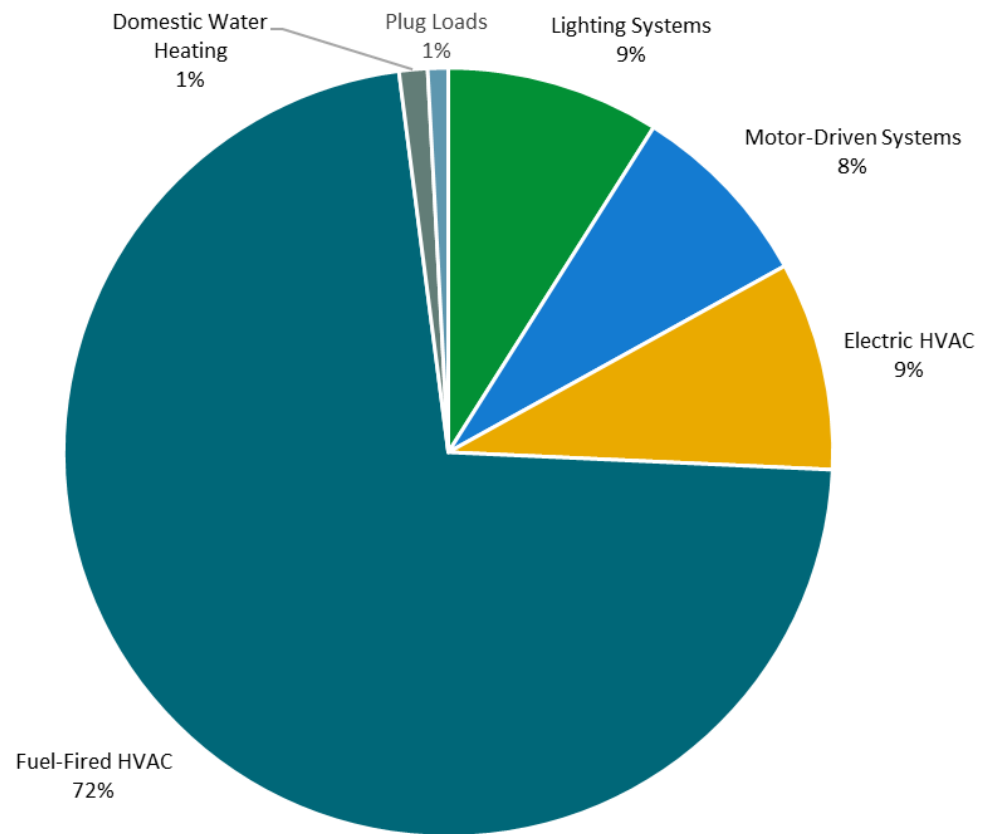

*Figure 5 - Energy Balance*

### 3.1 Electricity

PSE&G delivers electricity under rate class GLP, with electric production provided by Aggressive Energy, a third-party supplier.

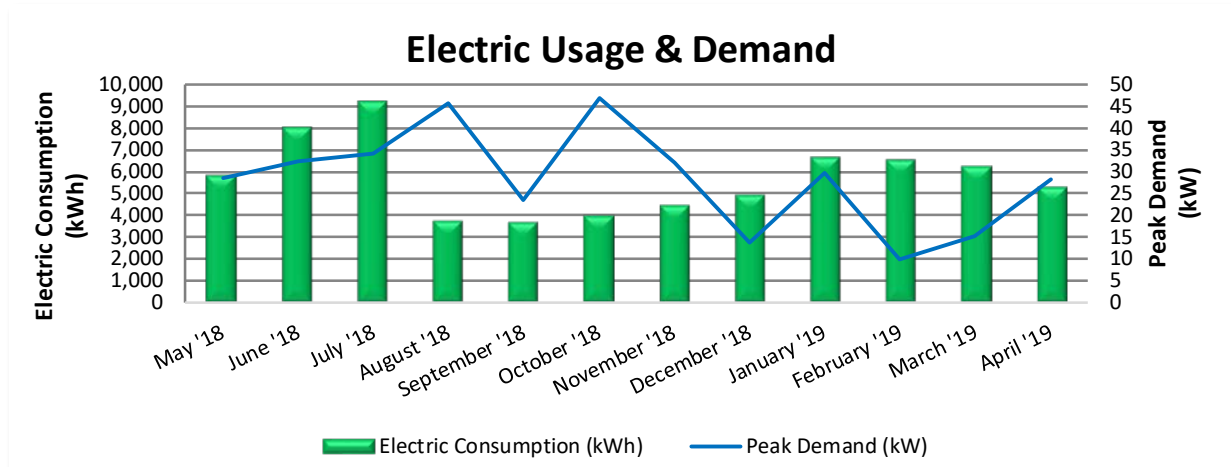


Electric Billing Data						
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost	TRC Estimated Usage?
6/7/18	31	5,768	29	\$124	\$914	Yes
7/9/18	29	7,980	32	\$260	\$1,367	Yes
8/7/18	30	9,165	34	\$274	\$1,531	Yes
9/6/18	30	3,750	46	\$183	\$738	Yes
10/5/18	31	3,645	23	\$101	\$521	Yes
11/5/18	30	3,990	47	\$100	\$560	Yes
12/6/18	30	4,440	32	\$126	\$469	Yes
1/7/19	31	4,905	14	\$54	\$632	Yes
2/6/19	31	6,645	30	\$117	\$902	Yes
3/8/19	31	6,480	10	\$39	\$805	Yes
4/8/19	31	6,225	15	\$60	\$795	Yes
5/8/19	30	5,280	28	\$110	\$751	Yes
<b>Totals</b>	<b>365</b>	<b>68,273</b>	<b>47</b>	<b>\$1,548</b>	<b>\$9,984</b>	
<b>Annual</b>	<b>365</b>	<b>68,273</b>	<b>47</b>	<b>\$1,548</b>	<b>\$9,984</b>	

Notes:

- Peak demand of 47 kW occurred in October 2018.
- Average demand over the past 12 months was 28 kW.
- The average electric cost over the past 12 months was \$0.146/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.
- The spikes in electrical demand in August and October are likely due to all air conditioning equipment being turned on at the same time and higher than normal occupancy of the building

## 3.2 Natural Gas

PSE&G supplies and delivers natural gas under rate class GSG (HTP).

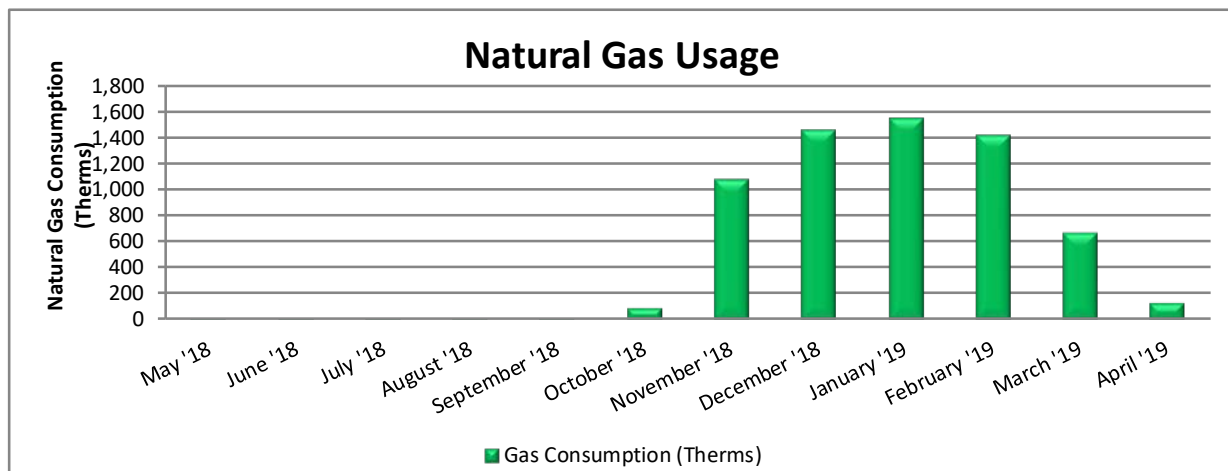

Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
6/7/18	31	12	\$22
7/9/18	29	13	\$23
8/7/18	30	11	\$22
9/6/18	30	9	\$20
10/5/18	31	10	\$21
11/5/18	30	94	\$101
12/6/18	30	1,080	\$1,058
1/7/19	31	1,464	\$1,602
2/6/19	31	1,555	\$1,593
3/8/19	31	1,426	\$1,364
4/8/19	31	678	\$572
5/8/19	30	135	\$124
<b>Totals</b>	<b>365</b>	<b>6,486</b>	<b>\$6,520</b>
<b>Annual</b>	<b>365</b>	<b>6,486</b>	<b>\$6,520</b>

Notes:

- The average gas cost for the past 12 months is \$1.005/therm, which is the blended rate used throughout the analysis.



### 3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency's (EPA) *Portfolio Manager*® software. Benchmarking compares your building's energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy and operating hours. Some building types can be scored with a 1-100 ranking of a building's energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building's energy performance. It assesses the building's physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

#### Benchmarking Score

N/A

Due to its unique characteristics, this building type is not able to receive a benchmarking score. This report contains suggestions about how to improve building performance and reduce energy costs.

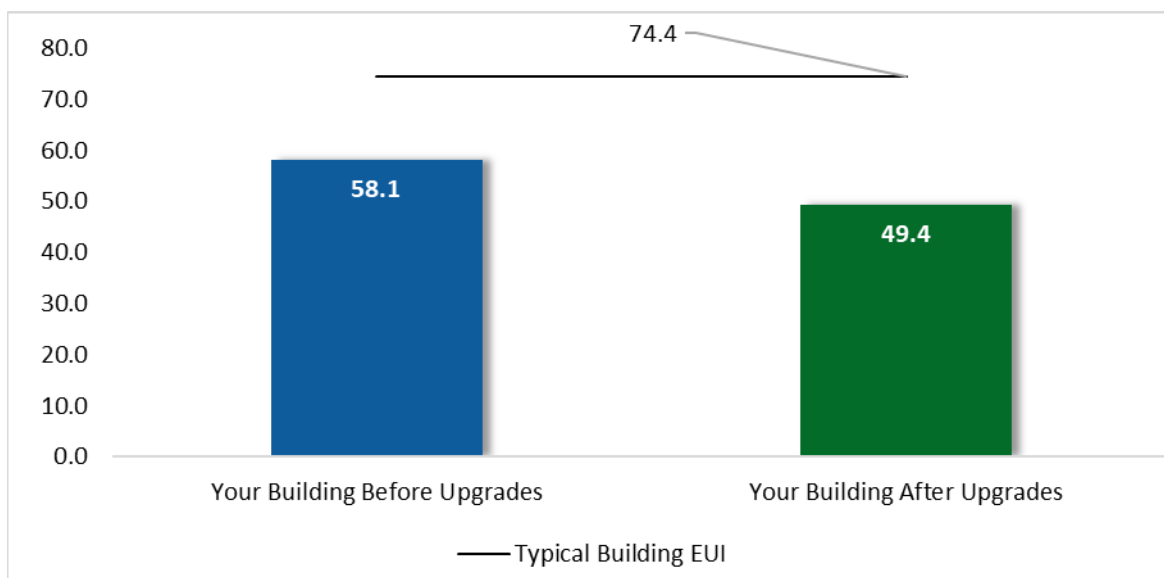


Figure 6 - Energy Use Intensity Comparison<sup>3</sup>

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings' energy performance. A lower EUI means better performance and less energy consumed. A number of factors can cause a building to vary from the "typical" energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building's energy use and the benchmarking score.

<sup>3</sup> Based on all evaluated ECMs

### **Tracking Your Energy Performance**

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

**We have created a Portfolio Manager® account for your facility and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.**

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their website<sup>4</sup>.

---

<sup>4</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/earn-recognition/energy-star-certification/how-app-1>.

## 4 ENERGY CONSERVATION MEASURES

---

The goal of this audit report is to identify and evaluate potential energy efficiency improvements, provide information about the cost effectiveness of those improvements, and recognize potential financial incentives from NJBPU. Most energy conservation measures have received preliminary analysis of feasibility which identifies expected ranges of savings and costs. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on the current NJCEP prescriptive SmartStart program. A higher level of investigation may be necessary to support any SmartStart Custom, Pay for Performance, or Direct Install incentive applications. Some measures and proposed upgrades may be eligible for higher incentives than those shown below through other NJCEP programs described in a following section of this report.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see **Appendix A: Equipment Inventory & Recommendations**.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>12,750</b>	<b>4.4</b>	<b>-2</b>	<b>\$1,841</b>	<b>\$6,277</b>	<b>\$3,228</b>	<b>\$3,049</b>	<b>1.7</b>	<b>12,563</b>
ECM 1	Install LED Fixtures	Yes	155	0.0	0	\$23	\$465	\$200	\$265	11.7	157
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	Yes	274	0.1	0	\$39	\$170	\$40	\$130	3.3	269
ECM 3	Retrofit Fixtures with LED Lamps	Yes	12,321	4.3	-2	\$1,779	\$5,642	\$2,988	\$2,654	1.5	12,137
<b>Lighting Control Measures</b>			<b>3,150</b>	<b>1.2</b>	<b>-1</b>	<b>\$454</b>	<b>\$6,005</b>	<b>\$1,050</b>	<b>\$4,955</b>	<b>10.9</b>	<b>3,097</b>
ECM 4	Install Occupancy Sensor Lighting Controls	Yes	2,873	1.1	-1	\$414	\$5,130	\$840	\$4,290	10.4	2,822
ECM 5	Install Daylight Dimming/Photocell Controls	Yes	124	0.0	0	\$18	\$200	\$0	\$200	11.0	125
ECM 6	Install High/Low Lighting Controls	No	153	0.1	0	\$22	\$675	\$210	\$465	21.1	150
<b>Variable Frequency Drive (VFD) Measures</b>			<b>8,293</b>	<b>2.2</b>	<b>0</b>	<b>\$1,213</b>	<b>\$4,761</b>	<b>\$2,000</b>	<b>\$2,761</b>	<b>2.3</b>	<b>8,351</b>
ECM 7	Install VFDs on Constant Volume (CV) Fans	Yes	8,293	2.2	0	\$1,213	\$4,761	\$2,000	\$2,761	2.3	8,351
<b>Electric Unitary HVAC Measures</b>			<b>1,758</b>	<b>1.4</b>	<b>0</b>	<b>\$257</b>	<b>\$6,711</b>	<b>\$736</b>	<b>\$5,975</b>	<b>23.2</b>	<b>1,770</b>
ECM 8	Install High Efficiency Air Conditioning Units	No	1,758	1.4	0	\$257	\$6,711	\$736	\$5,975	23.2	1,770
<b>HVAC System Improvements</b>			<b>4,070</b>	<b>0.0</b>	<b>25</b>	<b>\$848</b>	<b>\$314</b>	<b>\$174</b>	<b>\$140</b>	<b>0.2</b>	<b>7,044</b>
ECM 9	Install Occupancy-Controlled Thermostats	Yes	4,070	0.0	10	\$693	\$239	\$150	\$89	0.1	5,236
ECM 10	Install Pipe Insulation	Yes	0	0.0	15	\$155	\$75	\$24	\$51	0.3	1,807
<b>Domestic Water Heating Upgrade</b>			<b>0</b>	<b>0.0</b>	<b>2</b>	<b>\$19</b>	<b>\$29</b>	<b>\$29</b>	<b>\$0</b>	<b>0.0</b>	<b>222</b>
ECM 11	Install Low-Flow DHW Devices	Yes	0	0.0	2	\$19	\$29	\$29	\$0	0.0	222
<b>TOTALS</b>			<b>30,022</b>	<b>9.3</b>	<b>24</b>	<b>\$4,632</b>	<b>\$24,096</b>	<b>\$7,217</b>	<b>\$16,880</b>	<b>3.6</b>	<b>33,047</b>

\* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>12,750</b>	<b>4.4</b>	<b>-2</b>	<b>\$1,841</b>	<b>\$6,277</b>	<b>\$3,228</b>	<b>\$3,049</b>	<b>1.7</b>	<b>12,563</b>
ECM 1	Install LED Fixtures	155	0.0	0	\$23	\$465	\$200	\$265	11.7	157
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	274	0.1	0	\$39	\$170	\$40	\$130	3.3	269
ECM 3	Retrofit Fixtures with LED Lamps	12,321	4.3	-2	\$1,779	\$5,642	\$2,988	\$2,654	1.5	12,137
<b>Lighting Control Measures</b>		<b>2,997</b>	<b>1.1</b>	<b>-1</b>	<b>\$432</b>	<b>\$5,330</b>	<b>\$840</b>	<b>\$4,490</b>	<b>10.4</b>	<b>2,947</b>
ECM 4	Install Occupancy Sensor Lighting Controls	2,873	1.1	-1	\$414	\$5,130	\$840	\$4,290	10.4	2,822
ECM 5	Install Daylight Dimming/Photocell Controls	124	0.0	0	\$18	\$200	\$0	\$200	11.0	125
<b>Variable Frequency Drive (VFD) Measures</b>		<b>8,293</b>	<b>2.2</b>	<b>0</b>	<b>\$1,213</b>	<b>\$4,761</b>	<b>\$2,000</b>	<b>\$2,761</b>	<b>2.3</b>	<b>8,351</b>
ECM 7	Install VFDs on Constant Volume (CV) Fans	8,293	2.2	0	\$1,213	\$4,761	\$2,000	\$2,761	2.3	8,351
<b>HVAC System Improvements</b>		<b>4,070</b>	<b>0.0</b>	<b>25</b>	<b>\$848</b>	<b>\$314</b>	<b>\$174</b>	<b>\$140</b>	<b>0.2</b>	<b>7,044</b>
ECM 9	Install Occupancy-Controlled Thermostats	4,070	0.0	10	\$693	\$239	\$150	\$89	0.1	5,236
ECM 10	Install Pipe Insulation	0	0.0	15	\$155	\$75	\$24	\$51	0.3	1,807
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>2</b>	<b>\$19</b>	<b>\$29</b>	<b>\$29</b>	<b>\$0</b>	<b>0.0</b>	<b>222</b>
ECM 11	Install Low-Flow DHW Devices	0	0.0	2	\$19	\$29	\$29	\$0	0.0	222
<b>TOTALS</b>		<b>28,111</b>	<b>7.8</b>	<b>24</b>	<b>\$4,353</b>	<b>\$16,711</b>	<b>\$6,271</b>	<b>\$10,440</b>	<b>2.4</b>	<b>31,126</b>

\* - All incentives presented in this table are based on NJ SmartStart equipment incentives and assume proposed equipment meets minimum performance criteria for that program.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 8 – Cost Effective ECMs

## 4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>12,750</b>	<b>4.4</b>	<b>-2</b>	<b>\$1,841</b>	<b>\$6,277</b>	<b>\$3,228</b>	<b>\$3,049</b>	<b>1.7</b>	<b>12,563</b>
ECM 1	Install LED Fixtures	155	0.0	0	\$23	\$465	\$200	\$265	11.7	157
ECM 2	Retrofit Fluorescent Fixtures with LED Lamps and Drivers	274	0.1	0	\$39	\$170	\$40	\$130	3.3	269
ECM 3	Retrofit Fixtures with LED Lamps	12,321	4.3	-2	\$1,779	\$5,642	\$2,988	\$2,654	1.5	12,137

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources are proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

### **ECM 1: Install LED Fixtures**

Replace the existing fixture containing a HID lamp with new LED light fixture. This measure saves energy by installing LEDs which use less power than other technologies with a comparable light output.

In some cases, HID fixtures can be retrofit with screw-based LED lamps. Replacing an existing HID fixture with a new LED fixture will generally provide better overall lighting optics; however, replacing the HID lamp with a LED screw-in lamp is typically a less expensive retrofit. We recommend you work with your lighting contractor to determine which retrofit solution is best suited to your needs and will be compatible with the existing fixture(s).

Maintenance savings may also be achieved since LED lamps last longer than other light sources and therefore do not need to be replaced as often.

**Affected building areas:** exterior fixture.

### **ECM 2: Retrofit Fluorescent Fixtures with LED Lamps and Drivers**

Retrofit fluorescent fixtures by removing the fluorescent tubes and ballasts and replacing them with LED tubes and LED drivers (if necessary), which are designed to be used in retrofitted fluorescent fixtures.

The measure uses the existing fixture housing but replaces the electric components with more efficient lighting technology which use less power than other lighting technologies but provides equivalent lighting output. Maintenance savings may also be achieved since LED tubes last longer than fluorescent tubes and therefore do not need to be replaced as often.

**Affected building areas:** the stairwell and classroom with fluorescent fixtures with T12 tubes.



### **ECM 3: Retrofit Fixtures with LED Lamps**

Replace fluorescent T8, compact fluorescent, halogen incandescent or incandescent lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies.

This measure saves energy by installing LEDs which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

**Affected building areas:** all areas with fluorescent fixtures with T8 tubes, general purpose fixtures throughout the interior and exterior of the building with compact fluorescent, halogen incandescent or incandescent lamps.

## **4.2 Lighting Controls**

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Control Measures</b>		<b>3,150</b>	<b>1.2</b>	<b>-1</b>	<b>\$454</b>	<b>\$6,005</b>	<b>\$1,050</b>	<b>\$4,955</b>	<b>10.9</b>	<b>3,097</b>
ECM 4	Install Occupancy Sensor Lighting Controls	2,873	1.1	-1	\$414	\$5,130	\$840	\$4,290	10.4	2,822
ECM 5	Install Daylight Dimming/Photocell Controls	124	0.0	0	\$18	\$200	\$0	\$200	11.0	125
ECM 6	Install High/Low Lighting Controls	153	0.1	0	\$22	\$675	\$210	\$465	21.1	150

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

### **ECM 4: Install Occupancy Sensor Lighting Controls**

Install occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours.

**Affected building areas:** main gym, storage rooms, classrooms, restrooms and the playground

### **ECM 5: Install Daylight Dimming/Photocell Controls**

Install photocells to eliminate exterior lighting use during daytime periods.

Photocells or photocell sensors are lighting controls used for dusk to dawn applications to automatically turn the fixtures on or off. Photo controls detect the amount of light outside and once the light level reaches a low point, the fixture will switch on. During the day the photocell will detect higher amounts of light and will turn the fixture off.

Photocells may be fixture mounted or wired externally and connected by line voltage to a single light fixture or to a series of fixtures.

This measure reduces energy use in exterior areas to restrict operation to non-daylight periods.

**Affected building areas:** exterior fixtures.

### **ECM 6: Install High/Low Lighting Controls**

We evaluated installing occupancy sensors to provide dual level lighting control for lighting fixtures in spaces that are infrequently occupied but may require some level of continuous lighting for safety or security reasons.

Lighting fixtures with these controls operate at default low levels when the area is unoccupied to provide minimal lighting to meet security or safety code requirements for egress. Sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Fixtures automatically switch back to low level after a predefined period of vacancy. In parking lots and parking garages with significant ambient lighting, this control can sometimes be combined with photocell controls to turn the lights off when there is sufficient daylight.

The controller lowers the light level by dimming the fixture output. Therefore, the controlled fixtures need to have a dimmable ballast or driver. This will need to be taken into account when selecting retrofit lamps and bulbs for the areas proposed for high/low control.

This measure provides energy savings by reducing the light fixture power draw when reduced light output is appropriate.

**Affected building areas:** hallways and entrance lobby.

For this type of measure the occupancy sensors will generally be ceiling or fixture mounted. Sufficient sensor coverage must be provided to ensure that lights turn on in each area as an occupant approaches.

### 4.3 Variable Frequency Drives (VFD)

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Variable Frequency Drive (VFD) Measures</b>		<b>8,293</b>	<b>2.2</b>	<b>0</b>	<b>\$1,213</b>	<b>\$4,761</b>	<b>\$2,000</b>	<b>\$2,761</b>	<b>2.3</b>	<b>8,351</b>
ECM 7	Install VFDs on Constant Volume (CV) Fans	8,293	2.2	0	\$1,213	\$4,761	\$2,000	\$2,761	2.3	8,351

Variable frequency drives control motors for fans, pumps, and process equipment based on the actual output required of the driven equipment. Energy savings result from more efficient control of motor energy usage when equipment operates at partial load. The magnitude of energy savings depends on the estimated amount of time that the motor would operate at partial load. For equipment with proposed VFDs, we have included replacing the controlled motor with a new inverter duty rated motor to conservatively account for the cost of an inverter duty rated motor.

#### **ECM 7: Install VFDs on Constant Volume (CV) Fans**

Install VFDs to control the roof top unit supply fan constant volume fan motor speed. This converts a constant-volume, single-zone air handling system into a variable-air-volume (VAV) system. A separate VFD is usually required to control the return fan motor or dedicated exhaust fan motor, if the air handler has one.

Zone thermostats signal the VFD to adjust fan speed to maintain the appropriate temperature in the zone, while maintaining a constant supply air temperature.

For air handlers with direct expansion (DX) cooling systems, the minimum air flow across the cooling coil required to prevent the coil from freezing must be determined during the final project design. The control system programming should maintain the minimum air flow whenever the compressor is operating. Prior to implementation, verify minimum fan speed in cooling mode with the manufacturer. Note that savings will vary depending on the operating characteristics of each AHU.

Energy savings result from reducing the fan speed (and power) when conditions allow for reduced air flow.

**Affected air handlers:** rooftop unit.

## 4.4 Electric Unitary HVAC

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Electric Unitary HVAC Measures</b>		<b>1,758</b>	<b>1.4</b>	<b>0</b>	<b>\$257</b>	<b>\$6,711</b>	<b>\$736</b>	<b>\$5,975</b>	<b>23.2</b>	<b>1,770</b>
ECM 8	Install High Efficiency Air Conditioning Units	1,758	1.4	0	\$257	\$6,711	\$736	\$5,975	23.2	1,770

Replacing the unitary HVAC units has a long payback period and may not be justifiable based simply on energy considerations. However, most of the units at this facility are nearing or have reached the end of their normal useful life. Typically, the marginal cost of purchasing a high efficiency unit can be justified by the marginal savings from the improved efficiency. When the window AC unit and split AC system is eventually replaced, consider purchasing equipment that exceeds the minimum efficiency required by building codes.

### **ECM 8: Install High Efficiency Air Conditioning Units**

We evaluated the replacement of standard efficiency air conditioning unit and split AC system with high efficiency equipment. The magnitude of energy savings for this measure depends on the relative efficiency of the older unit versus the new high efficiency unit, the average cooling load, and the estimated annual operating hours.

**Affected units:** window AC unit and split AC system.

## 4.5 HVAC Improvements

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>HVAC System Improvements</b>		<b>4,070</b>	<b>0.0</b>	<b>25</b>	<b>\$848</b>	<b>\$314</b>	<b>\$174</b>	<b>\$140</b>	<b>0.2</b>	<b>7,044</b>
ECM 9	Install Occupancy-Controlled Thermostats	4,070	0.0	10	\$693	\$239	\$150	\$89	0.1	5,236
ECM 10	Install Pipe Insulation	0	0.0	15	\$155	\$75	\$24	\$51	0.3	1,807

### **ECM 9: Install Occupancy-Controlled Thermostats**

Replace the inoperable thermostat controlling the roof top unit with an occupancy-controlled thermostat. An occupancy-controlled thermostat is paired with a door detector and/or sensor to identify movement and determine if a room is occupied or unoccupied. When occupancy is detected, the thermostat enables the programmed temperature setpoint. If no occupancy is sensed, the thermostat switches to unoccupied mode after a set period of time and reduces the temperature setpoint.

By reducing heating temperature setpoints and increasing cooling temperature setpoints when the space is unoccupied, the operation of the HVAC equipment is reduced while still maintaining reasonable space temperatures for building usage. Occupancy controlled thermostats provide energy savings by reducing heating and cooling energy usage when rooms are unoccupied.

### **ECM 10: Install Pipe Insulation**

Install insulation on steam system piping. Distribution system losses are dependent on system fluid temperature, the size of the distribution system, and the level of insulation of the piping. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is exposed to water, when the insulation has been removed from some areas of the pipe, or when valves have not been properly insulated system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

## 4.6 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated Install Cost (\$)	Estimated Incentive (\$)*	Estimated Net Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>2</b>	<b>\$19</b>	<b>\$29</b>	<b>\$29</b>	<b>\$0</b>	<b>0.0</b>	<b>222</b>
ECM 11	Install Low-Flow DHW Devices	0	0.0	2	\$19	\$29	\$29	\$0	0.0	222

### **ECM 11: Install Low-Flow DHW Devices**

Install low-flow devices to reduce overall hot water demand. The following low flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Additional cost savings may result from reduced water usage.

## 5 ENERGY EFFICIENT BEST PRACTICES

---

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs. You may already be doing some of these things— see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Energy Tracking with ENERGY STAR® Portfolio Manager®**



You've heard it before - you can't manage what you don't measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions<sup>5</sup>. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

### **Weatherization**

Caulk or weather strip leaky doors and windows to reduce drafts and loss of heated or cooled air. Sealing cracks and openings can reduce heating and cooling costs, improve building durability, and create a healthier indoor environment. Materials used may include caulk, polyurethane foam, and other weather-stripping materials. There is an energy savings opportunity by reducing the uncontrolled air exchange between the outside and inside of the building. Blower door assisted comprehensive building air sealing will reduce the amount of air exchange which will in turn reduce the load on the buildings heating and cooling equipment and thus providing energy savings and increased occupant comfort.

### **Doors and Windows**

Close exterior doors and windows in heated and cooled areas. Leaving doors and windows open leads to a loss of heat during the winter and chilled air during the summer. Reducing air changes per hour (ACH) can lead to increased occupant comfort as well as heating and cooling savings, especially when combined with proper HVAC controls and adequate ventilation.

### **Window Treatments/Coverings**

Use high-reflectivity films or cover windows with shades or shutters to reduce solar heat gain and reduce the load on cooling and heating systems. Older, single pane windows and east or west-facing windows are especially prone to solar heat gain. In addition, use shades or shutters at night during cold weather to reduce heat loss.

---

<sup>5</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.



### **Lighting Maintenance**



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.
- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

### **Motor Maintenance**

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

### **Destratification Fans**

For areas with high ceilings, destratification fans help balance the air temperature from floor to ceiling. They help reduce the recovery time needed to warm the space after nightly temperature setbacks and will increase occupants' comfort level.

Areas with high ceilings require the heating system to heat a larger volume of space than that which is occupied. As the warm air rises, the warmest space is at the ceiling level, rather than floor level. Higher temperatures at the ceiling accelerate heat loss through the roof, which requires additional energy consumption by the heating equipment to compensate for this accelerated heat transfer.

### **AC System Evaporator/Condenser Coil Cleaning**

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

### **HVAC Filter Cleaning and Replacement**

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

### **Steam Trap Repair and Replacement**

Steam traps are a crucial part of delivering heat from the boiler to the space heating units. Steam traps are automatic valves that remove condensate from the system. If the traps fail closed, condensate can build up in the steam supply side of the trap which reduces the flow in the steam lines and thermal capacity of the radiators. Or they may fail open, allowing steam into the condensate return lines resulting in wasted energy, water and hammering. Losses can be significantly reduced by testing and replacing equipment as they start to fail. Repair or replace traps that are blocked or allowing steam to pass. Inspect steam traps as part of a regular steam system maintenance plan.

### **Thermostatic Radiator Valve Installations**

We recommend investigating the installation of thermostatic control valves for existing steam radiators. Traditionally steam radiators have manual valves that are used to control the flow through the radiator. Replacing these manual valves with thermostatic control valves allows for automatic modulation of the steam flow to maintain the temperature setting. The valve will incrementally close as space temperature increases. This will allow a maximum temperature to be set per area/room. Using thermostatic control valves will result in energy savings by reducing the overheating of spaces throughout the facility.

### **Boiler Maintenance**

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely and efficiently. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the boiler tubes to improve heat transfer.

### **Furnace Maintenance**

Preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. Following the manufacturer's instructions, a yearly tune-up should: check for gas / carbon monoxide leaks; change the air and fuel filters; check components for cracks, corrosion, dirt, or debris build-up; ensure the ignition system is working properly; test and adjust operation and safety controls; inspect electrical connections; and lubricate motors and bearings.

## **Water Heater Maintenance**

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

## **Water Conservation**



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense® ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense® website<sup>6</sup> or download a copy of EPA's "WaterSense® at Work: Best Management Practices for Commercial and Institutional Facilities"<sup>7</sup> to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

## **Procurement Strategies**

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense® products where available.

---

<sup>6</sup> <https://www.epa.gov/watersense>.

<sup>7</sup> <https://www.epa.gov/watersense/watersense-work-0>.

## 6 ON-SITE GENERATION

---

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.


## 6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has no potential for installing a PV array.

This facility does not appear to meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as sufficient and sustained electric demand and sufficient flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

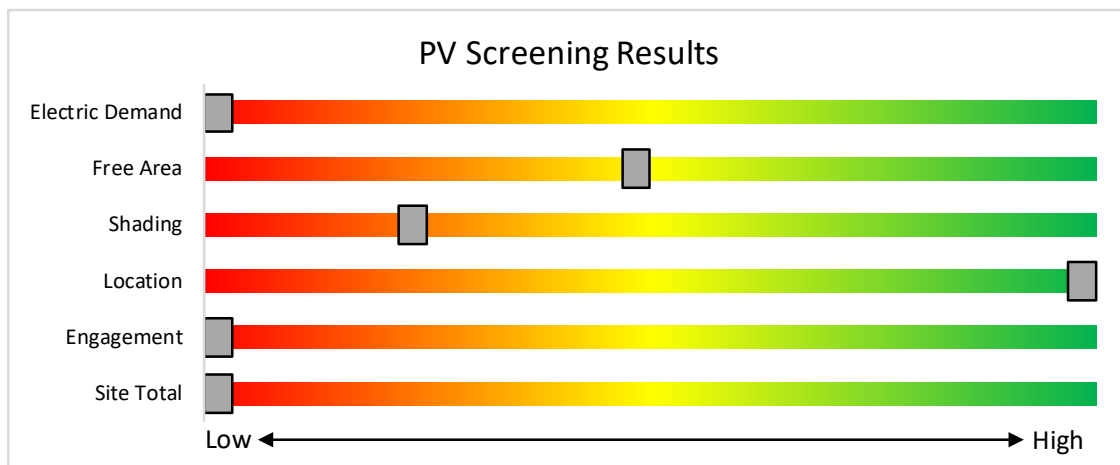

*Figure 9 - Photovoltaic Screening*

## 6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.


CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The low or infrequent thermal load is the most significant factor contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

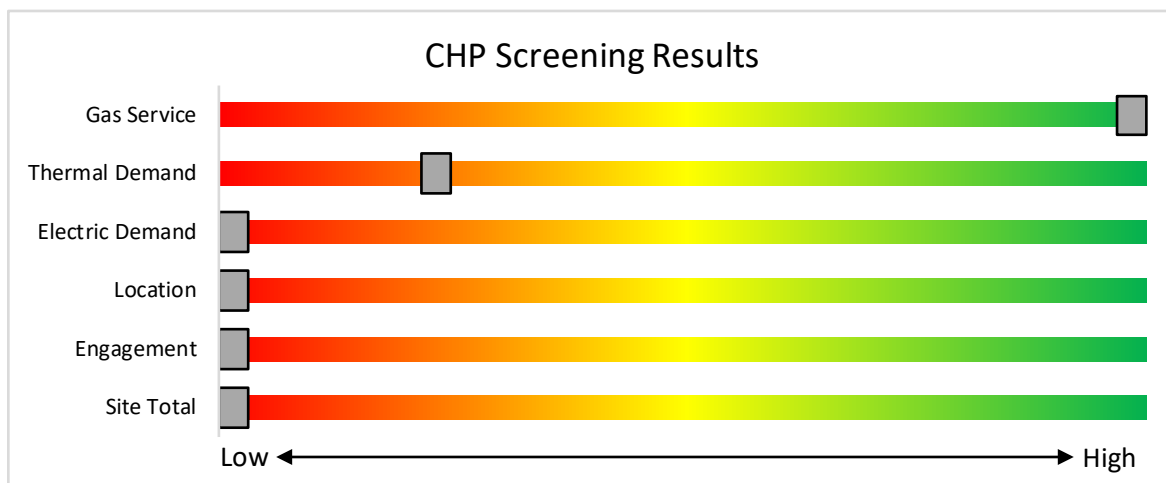

*Figure 10 - Combined Heat and Power Screening*



## 7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building's performance? New Jersey's Clean Energy Programs can help. Pick the program that works best for you. Incentive programs that may apply to this facility are identified in the Executive Summary. This section provides an overview of currently available New Jersey Clean Energy Programs.

	<b>SmartStart</b> <i>Flexibility to install at your own pace</i>	<b>Direct Install</b> <i>Turnkey installation</i>	<b>Pay for Performance</b> <i>Whole building upgrades</i>
<b>Who should use it?</b>	Buildings installing individual measures or small group of measures.	Small to mid-size facilities that can bundle multiple measures together.  Average peak demand should be below 200 kW.  Not suitable for significant building shell issues.	Mid to large size facilities looking to implement as many measures as possible at one time.  Peak demand should be over 200 kW.
<b>How does it work?</b>	Use in-house staff or your preferred contractor.	Pre-approved contractors pass savings along to you via reduced material and labor costs.	Whole-building approach to energy upgrades designed to reduce energy use by at least 15%. The more you save, the higher the incentives.
<b>What are the Incentives?</b>	Fixed incentives for specific energy efficiency measures.	Incentives pay up to 70% of eligible costs, up to \$125,000 per project.  You pay the remaining 30% directly to the contractor.	Up to 25% of installation cost, calculated based on level of energy savings per square foot.
<b>How do I participate?</b>	Submit an application for the specific equipment to be installed.	Contact a participating contractor in your region.	Contact a pre-qualified Partner to develop your Energy Reduction Plan and set your energy savings targets.
Take the next step by visiting <a href="http://www.njcleanenergy.com">www.njcleanenergy.com</a> for program details, applications, and to contact a qualified contractor.			

## 7.1 SmartStart



SmartStart offers incentives for installing prescriptive and custom energy efficiency measures at your facility. This program provides an effective mechanism for securing incentives for energy efficiency measures installed individually or as part of a package of energy upgrades. This program serves most common equipment types and sizes.

SmartStart routinely adds, removes, or modifies incentives from year-to-year for various energy-efficient equipment based on market trends and new technologies.

### **Equipment with Prescriptive Incentives Currently Available:**

*Electric Chillers*  
*Electric Unitary HVAC*  
*Gas Cooling*  
*Gas Heating*  
*Gas Water Heating*  
*Ground Source Heat Pumps*  
*Lighting*

*Lighting Controls*  
*Refrigeration Doors*  
*Refrigeration Controls*  
*Refrigerator/Freezer Motors*  
*Food Service Equipment*  
*Variable Frequency Drives*

### **Incentives**

The SmartStart Prescriptive program provides fixed incentives for specific energy efficiency measures. Prescriptive incentives vary by equipment type.

SmartStart Custom provides incentives for more unique or specialized technologies or systems that are not addressed through prescriptive incentives. Custom incentives are calculated at \$0.16/kWh and \$1.60/therm based on estimated annual savings. Incentives are capped at 50% of the total installed incremental project cost, or a project cost buy down to a one-year payback (whichever is less). Program incentives are capped at \$500,000 per electric account and \$500,000 per natural gas account, per fiscal year.

### **How to Participate**

Submit an application for the specific equipment to be installed. Many applications are designed as rebates, although others require application approval prior to installation. You can work with your preferred contractor or use internal staff to install measures.

Visit [www.njcleanenergy.com/SSB](http://www.njcleanenergy.com/SSB) for a detailed program description, instructions for applying, and applications.

## 7.2 Direct Install



Direct Install is a turnkey program available to existing small to medium-sized facilities with an average peak electric demand that does not exceed 200 kW over the recent 12-month period. You work directly with a pre-approved contractor who will perform a free energy assessment at your facility, identify specific eligible measures, and provide a clear scope of work for

installation of selected measures. Energy efficiency measures may include lighting and lighting controls, refrigeration, HVAC, motors, variable speed drives, and controls.

### Incentives

The program pays up to 70% of the total installed cost of eligible measures, up to \$125,000 per project. Each entity is limited to incentives up to \$250,000 per fiscal year.

### How to Participate

To participate in Direct Install, you will need to contact the participating contractor assigned to the region of the state where your facility is located. A complete list of Direct Install program partners is provided on the Direct Install website linked below. The contractor will be paid the measure incentives directly by the program, which will pass on to you in the form of reduced material and implementation costs. This means up to 70% of eligible costs are covered by the program, subject to program caps and eligibility, while the remaining 30% of the cost is paid to the contractor by the customer.

Detailed program descriptions and applications can be found at: [www.njcleanenergy.com/DI](http://www.njcleanenergy.com/DI).

## 7.3 Pay for Performance - Existing Buildings



Pay for Performance works for larger customers with a peak demand over 200 kW. The minimum installed scope of work must include at least two unique measures that results in at least 15% source energy savings, and lighting cannot make up the majority of the savings. P4P is a generally a good option for medium-to-large sized facilities looking to implement as many

measures as possible under a single project to achieve deep energy savings. This program has an added benefit of addressing measures that may not qualify for other programs. Many facilities pursuing an Energy Savings Improvement Program loan also use this program.

Based on the site building and utility data provided, the facility does not meet the requirements of the current P4P program.

### Incentives

Incentives are based on estimated and achieved energy savings ranging from \$0.18-\$0.22/kWh and \$1.80-\$2.50/therm, capped at the lesser of 50% total project cost, or \$1 million per electric account and \$1 million per natural gas account, per fiscal year, not to exceed \$2 million per project. An incentive of \$0.15/square foot is also available to offset the cost of developing the Energy Reduction Plan (see below) contingent on the project moving forward with measure installation.

### How to Participate

Contact one of the pre-approved consultants and contractors ("Partners"). Under direct contract to you, they will help further evaluate the measures identified in this report through development of the energy reduction plan), assist you in implementing selected measures, and verify actual savings one year after the installation. Your Partner will also help you apply for incentives.

Approval of the final scope of work is required by the program prior to installation. Installation can be done by the contractor of your choice (some P4P Partners are also contractors) or by internal staff, but the Partner remains involved throughout construction to ensure compliance with the program requirements.

Detailed program descriptions, instructions for applying, applications and list of Partners can be found at: [www.njcleanenergy.com/P4P](http://www.njcleanenergy.com/P4P).

## 7.4 Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

### Incentives

Eligible Technologies	Size (Installed Rated Capacity) <sup>1</sup>	Incentive (\$/kW)	% of Total Cost Cap per Project <sup>3</sup>	\$ Cap per Project <sup>3</sup>		
Powered by non-renewable or renewable fuel source <sup>4</sup>	≤500 kW	\$2,000	30-40% <sup>2</sup>	\$2 million		
Gas Internal Combustion Engine	>500 kW - 1 MW	\$1,000				
Gas Combustion Turbine	> 1 MW - 3 MW	\$550	30%	\$3 million		
Microturbine	>3 MW	\$350				
Fuel Cells with Heat Recovery						
Waste Heat to Power*	<1 MW	\$1,000	30%	\$2 million		
	> 1MW	\$500		\$3 million		

\*Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

### How to Participate

You work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at: [www.njcleanenergy.com/CHP](http://www.njcleanenergy.com/CHP).

## 7.5 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities and other public and state entities enter in to contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the ECMs, ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

### How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan (ESP) can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program description and application can be found at: [www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

*ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.*

## 7.6 SREC Registration Program

The SREC (Solar Renewable Energy Certificate) Registration Program (SRP) is used to register the intent to install solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project's eligibility to earn SRECs. Registration of the intent to participate in New Jersey's solar marketplace provides market participants with information about the pipeline of anticipated new solar capacity and insight into future SREC pricing.

After the registration is accepted, construction is complete, and final paperwork has been submitted and is deemed complete, the project is issued a New Jersey certification number, which enables it to generate New Jersey SRECs. SRECs are generated once the solar project has been authorized to be energized by the Electric Distribution Company (EDC).

Each time a solar installation generates 1,000 kilowatt-hours (kWh) of electricity, an SREC is earned. Solar project owners report the energy production to the SREC Tracking System. This reporting allows SRECs to be placed in the customer's electronic account. SRECs can then be sold on the SREC Tracking System, providing revenue for the first 15 years of the project's life.

Electricity suppliers, the primary purchasers of SRECs, are required to pay a Solar Alternative Compliance Payment (SACP) if they do not meet the requirements of New Jersey's Solar Renewable Portfolio Standard. Purchasing SRECs can help them meet those requirements. As SRECs are traded in a competitive market, the price may vary significantly. The actual price of an SREC during a trading period fluctuates depending on supply and demand.

Information about the SRP can be found at: [www.njcleanenergy.com/srec](http://www.njcleanenergy.com/srec).



## 8 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 8.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. So, though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website<sup>8</sup>.

### 8.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market-based and that fluctuate monthly. The utility provides basic gas supply service (BGSS) to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website<sup>9</sup>.

---

<sup>8</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

<sup>9</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

## APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

### Lighting Inventory & Recommendations

	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Stairs	1	LED Lamps: 4W Screw in Lamp	Wall Switch		4	2,080		None	No	1	LED Lamps: 4W Screw in Lamp	Wall Switch	4	2,080	0.0	0	0	\$0	\$0	\$0	0.0
Basement Hallway	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	3, 6	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	High/Low Control	29	1,435	0.1	283	0	\$41	\$335	\$270	1.6
Transition Spaces	13	Exit Signs: LED - 2 W Lamp	Wall Switch		6	8,760		None	No	13	Exit Signs: LED - 2 W Lamp	Wall Switch	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Room 7	8	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	3, 4	Relamp	Yes	8	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.5	1,330	0	\$192	\$854	\$390	2.4
Mechanical Room	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,460	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,460	0.0	52	0	\$7	\$37	\$20	2.2
Mechanical Room	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,460	3	Relamp	No	3	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	1,460	0.1	265	0	\$38	\$219	\$120	2.6
Storage	3	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,460	3, 4	Relamp	Yes	3	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,007	0.2	350	0	\$50	\$489	\$120	7.3
Storage	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,007	0.1	233	0	\$34	\$416	\$80	10.0
Storage	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,460	3, 4	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,007	0.3	467	0	\$67	\$562	\$160	6.0
Room 4 Storage	4	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,460	3, 4	Relamp	Yes	4	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,007	0.3	467	0	\$67	\$562	\$160	6.0
Room 3 Classroom	13	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	3, 4	Relamp	Yes	13	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,435	0.5	1,226	0	\$177	\$745	\$330	2.3
Hallway	2	LED Lamps: 9W Screw in Lamp	Wall Switch	S	9	2,080	6	None	Yes	2	LED Lamps: 9W Screw in Lamp	High/Low Control	9	1,435	0.0	13	0	\$2	\$0	\$0	0.0
Hallway	3	LED Lamps: 9W Screw in Lamp	Wall Switch	S	9	2,080	6	None	Yes	3	LED Lamps: 9W Screw in Lamp	High/Low Control	9	1,435	0.0	19	0	\$3	\$0	\$0	0.0
Hallway	1	Linear Fluorescent - T8: 2' T8 (17W) - 2L	Wall Switch	S	33	2,080	3	Relamp	No	1	LED - Linear Tubes: (2) 2' Lamps	Wall Switch	17	2,080	0.0	36	0	\$5	\$33	\$12	4.0
Restroom	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.1	332	0	\$48	\$416	\$150	5.6
Hallway	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	74	0	\$11	\$37	\$20	1.5
Room 1 Arts & Crafts	10	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	3, 4	Relamp	Yes	10	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,435	0.7	1,662	0	\$239	\$1,000	\$470	2.2
Restroom	1	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	2,080	3	Relamp	No	1	LED - Linear Tubes: (4) 4' Lamps	Wall Switch	58	2,080	0.0	126	0	\$18	\$73	\$40	1.8
Room 2 Storage	2	Linear Fluorescent - T8: 4' T8 (32W) - 4L	Wall Switch	S	114	1,460	3, 4	Relamp	Yes	2	LED - Linear Tubes: (4) 4' Lamps	Occupancy Sensor	58	1,007	0.1	233	0	\$34	\$416	\$80	10.0
Stairs	1	Linear Fluorescent - T12: 4' T12 (40W) - 2L	Wall Switch		88	2,080	2	Relamp & Reballast	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.1	133	0	\$19	\$69	\$20	2.6
Front Entrance	3	LED Lamps: 14W PAR38 Lamps	Wall Switch		14	2,080	6	None	Yes	3	LED Lamps: 14W PAR38 Lamps	High/Low Control	14	1,435	0.0	29	0	\$4	\$225	\$0	53.4
Front Entrance	1	LED - Fixtures: Decorative Pendant	Wall Switch		28	2,080	6	None	Yes	1	LED - Fixtures: Decorative Pendant	High/Low Control	28	1,435	0.0	19	0	\$3	\$0	\$0	0.0
Vestibule	2	Incandescent: 60W Screw in Lamp	Wall Switch	S	60	2,080	3, 6	Relamp	Yes	2	LED Lamps: (1) 9W Screw-In Lamp	High/Low Control	9	1,435	0.1	242	0	\$35	\$259	\$4	7.3
Main Gym	2	LED Lamps: (6) LED PAR38 Track Lighting	Wall Switch	S	84	2,600	4	None	Yes	2	LED Lamps: (6) LED PAR38 Track Lighting	Occupancy Sensor	84	1,794	0.0	146	0	\$21	\$0	\$0	0.0
Main Gym	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,600	3, 4	Relamp	Yes	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,794	0.3	884	0	\$127	\$274	\$150	1.0

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Main Gym	18	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,600	3, 4	Relamp	Yes	18	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,794	1.0	3,184	-1	\$459	\$2,336	\$890	3.2
Storage	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,460	3, 4	Relamp	Yes	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,007	0.1	199	0	\$29	\$380	\$60	11.2
Vestibule	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	74	0	\$11	\$37	\$20	1.5
Vestibule	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,080	3	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	2,080	0.0	74	0	\$11	\$37	\$20	1.5
Slop Sink	1	Compact Fluorescent: 13W Screw in Lamp	Wall Switch	S	13	2,080	3	Relamp	No	1	LED Lamps: (1) 9W Screw-In Lamp	Wall Switch	9	2,080	0.0	9	0	\$1	\$17	\$2	11.8
Restroom	1	LED - Fixtures: Ceiling Mount	Wall Switch	S	14	2,080	4	None	Yes	1	LED - Fixtures: Ceiling Mount	Occupancy Sensor	14	1,435	0.0	10	0	\$1	\$0	\$0	0.0
Restroom	2	LED - Fixtures: Downlight Recessed	Wall Switch	S	9	2,080	4	None	Yes	2	LED - Fixtures: Downlight Recessed	Occupancy Sensor	9	1,435	0.0	13	0	\$2	\$270	\$0	149.5
Classroom	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	3, 4	Relamp	Yes	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.3	849	0	\$122	\$599	\$250	2.8
Play Room	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,080	3, 4	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,435	0.1	283	0	\$41	\$380	\$130	6.1
Classroom	2	Linear Fluorescent - T12: 4' T12 (40W) - 1L	Wall Switch	S	46	2,080	2, 4	Relamp & Reballast	Yes	2	LED - Linear Tubes: (1) 4' Lamp	Occupancy Sensor	15	1,435	0.1	162	0	\$23	\$101	\$20	3.5
Classroom	1	Halogen Incandescent: 65W Screw in Lamp Track Lighting	Wall Switch	S	325	2,080	3, 4	Relamp	Yes	1	LED Lamps: (1) 9.5W Screw-In Lamp Track Lighting	Occupancy Sensor	48	1,435	0.3	656	0	\$95	\$356	\$80	2.9
Exterior	1	High-Pressure Sodium: (1) 35W Lamp	Photocell		46	4,380	1	Fixture Replacement	No	1	LED - Fixtures: Outdoor Pole/Arm-Mounted Area/Roadway Fixture	Photocell	11	4,380	0.0	155	0	\$23	\$465	\$200	11.7
Exterior	2	Incandescent: 60W Screw in Lamp	Timeclock		60	5,840	3, 5	Relamp	Yes	2	LED Lamps: (1) 9W Screw-In Lamp	Photocell	9	4,380	0.0	622	0	\$91	\$34	\$4	0.3
Flag Pole	3	Incandescent: 60W Screw in Lamp	Timeclock		60	5,840	3, 5	Relamp	Yes	3	LED Lamps: (1) 9W Screw-In Lamp	Photocell	9	4,380	0.0	933	0	\$136	\$252	\$6	1.8
Exterior	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Timeclock		20	5,840	5	None	Yes	2	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	20	4,380	0.0	58	0	\$9	\$0	\$0	0.0
Exterior	3	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell		30	4,380		None	No	3	LED - Fixtures: Outdoor Wall-Mounted Area Fixture	Photocell	30	4,380	0.0	0	0	\$0	\$0	\$0	0.0

### Motor Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions					Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
RTU	Main Gym	1	Supply Fan	7.5	89.5%	No	B	3,391	7	No	91.7%	Yes	1	2.2	8,293	0	\$1,213	\$4,761	\$2,000	2.3
Mechanical Room	Boiler Burner	1	Other	0.3	65.0%	No	W	2,745		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical Room	DHW Circulator	1	Water Supply Pump	0.3	65.0%	No	W	8,760		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Elevator Machine Room	Elevator	1	Other	30.0	65.0%	No	W	73		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

### Electric HVAC Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/EER)	Heating Mode Efficiency (COP)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Recreation Center	Recreation Center	1	Window AC	0.67		B	8	Yes	1	Window AC	0.67		12.00		0.1	170	0	\$25	\$726	\$0	29.3
Roof	Main Gym	1	Packaged AC	25.00		W		No							0.0	0	0	\$0	\$0	\$0	0.0
Outside	Old Post Office Area/Classroom	1	Split-System AC	4.00		B	8	Yes	1	Split-System AC	4.00		14.00		1.3	1,588	0	\$232	\$5,985	\$736	22.6

### Fuel Heating Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions					Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Output Capacity per Unit (MBh)	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units		Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Space Heating	1	Forced Draft Steam Boiler	762	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Roof	Space Heating	1	Furnace	292	W		No							0.0	0	0	\$0	\$0	\$0	0.0

### Occupancy Controlled Thermostat Recommendations

Location	Area(s)/System(s) Affected	Recommendation Inputs							Energy Impact & Financial Analysis						
		ECM #	Thermostat Quantity	Cooling Capacity of Controlled System (Tons)	Electric Heating Capacity of Controlled System (MBh)	Output Heating Capacity of Controlled System (MBh)	Cooling Setpoint Temp (deg F)	Heating Setpoint Temp (deg F)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Main Gym	RTU	9	1.00	25.00	0.00	292.00	70	70	0.0	4,070	10	\$693	\$239	\$150	0.1

### Pipe Insulation Recommendations

Location	Area(s)/System(s) Affected	Recommendation Inputs			Energy Impact & Financial Analysis						
		ECM #	Length of Uninsulated Pipe (ft)	Pipe Diameter (in)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Unconditioned Space	Space Heating	10	6	6.00	0.0	0	15	\$155	\$75	\$24	0.3

### DHW Inventory & Recommendations

Location	Area(s)/System(s) Served	Existing Conditions			Proposed Conditions							Energy Impact & Financial Analysis						
		System Quantity	System Type	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical Room	Domestic Hot Water	1	Storage Tank Water Heater (> 50 Gal)	W		No						0.0	0	0	\$0	\$0	\$0	0.0

### Low-Flow Device Recommendations


Location	Recommendation Inputs					Energy Impact & Financial Analysis						
	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Total Installation Cost	Total Incentives	Simple Payback w/ Incentives in Years
Recreation Center	11	4	Faucet Aerator (Lavatory)	2.20	0.50	0.0	0	2	\$19	\$29	\$29	0.0

### Plug Load Inventory


Location	Existing Conditions			
	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified?
Recreation Center	1	TV	150	
Recreation Center	1	Radio	25	
Recreation Center	1	Large Refrigerator	1,100	
Recreation Center	4	Speakers	400	

## APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

EUI is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.



### ENERGY STAR® Statement of Energy Performance



**ENERGY STAR®  
Score<sup>1</sup>**

### Clifton Community Recreation Center

**Primary Property Type:** Fitness Center/Health Club/Gym  
**Gross Floor Area (ft²):** 15,300  
**Built:** 1938

**For Year Ending:** April 30, 2019  
**Date Generated:** February 06, 2020

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information			
<b>Property Address</b> Clifton Community Recreation Center 1232 Main Avenue Clifton, New Jersey 07011	<b>Property Owner</b> City of Clifton 900 Clifton Avenue Clifton, NJ 07013 (973) 470-5854	<b>Primary Contact</b> Dominick Villano 900 Clifton Avenue Clifton, NJ 07013 (973) 470-5854 dvillano@cliftonnj.org	
Property ID: 9002082			

Energy Consumption and Energy Use Intensity (EUI)			
<b>Site EUI</b>	<b>Annual Energy by Fuel</b>	<b>National Median Comparison</b>	
58.1 kBtu/ft²	Electric - Grid (kBtu) 231,488 (26%)	National Median Site EUI (kBtu/ft²)	74.4
	Natural Gas (kBtu) 658,040 (74%)	National Median Source EUI (kBtu/ft²)	112
		% Diff from National Median Source EUI	-22%
<b>Source EUI</b>		<b>Annual Emissions</b>	
87.5 kBtu/ft²		Greenhouse Gas Emissions (Metric Tons CO2e/year)	58

**Signature & Stamp of Verifying Professional**

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**Licensed Professional**

\_\_\_\_\_  
 ( ) - \_\_\_\_\_  
 \_\_\_\_\_

Professional Engineer or Registered Architect Stamp (if applicable)

## APPENDIX C: GLOSSARY

TERM	DEFINITION
<b>Blended Rate</b>	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
<b>Btu</b>	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
<b>CHP</b>	<i>Combined heat and power</i> . Also referred to as cogeneration.
<b>COP</b>	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
<b>Demand Response</b>	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
<b>DCV</b>	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
<b>US DOE</b>	<i>United States Department of Energy</i>
<b>EC Motor</b>	<i>Electronically commutated motor</i>
<b>ECM</b>	<i>Energy conservation measure</i>
<b>EER</b>	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
<b>EUI</b>	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
<b>Energy Efficiency</b>	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
<b>ENERGY STAR®</b>	ENERGY STAR® is the government-backed symbol for energy efficiency. The ENERGY STAR® program is managed by the EPA.
<b>EPA</b>	<i>United States Environmental Protection Agency</i>
<b>Generation</b>	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
<b>GHG</b>	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.

<b>gpf</b>	<i>Gallons per flush</i>
<b>gpm</b>	<i>Gallon per minute</i>
<b>HID</b>	<i>High intensity discharge:</i> high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.
<b>hp</b>	<i>Horsepower</i>
<b>HPS</b>	<i>High-pressure sodium:</i> a type of HID lamp
<b>HSPF</b>	<i>Heating seasonal performance factor:</i> a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.
<b>HVAC</b>	<i>Heating, ventilating, and air conditioning</i>
<b>IHP 2014</b>	US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.
<b>IPLV</b>	<i>Integrated part load value:</i> a measure of the part load efficiency usually applied to chillers.
<b>kBtu</b>	One thousand British thermal units
<b>kW</b>	<i>Kilowatt:</i> equal to 1,000 Watts.
<b>kWh</b>	<i>Kilowatt-hour:</i> 1,000 Watts of power expended over one hour.
<b>LED</b>	<i>Light emitting diode:</i> a high-efficiency source of light with a long lamp life.
<b>LGEA</b>	<i>Local Government Energy Audit</i>
<b>Load</b>	The total power a building or system is using at any given time.
<b>Measure</b>	A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.
<b>MH</b>	<i>Metal halide:</i> a type of HID lamp
<b>MBh</b>	<i>Thousand Btu per hour</i>
<b>MBtu</b>	<i>One thousand British thermal units</i>
<b>MMBtu</b>	<i>One million British thermal units</i>
<b>MV</b>	<i>Mercury Vapor:</i> a type of HID lamp
<b>NJBPU</b>	<i>New Jersey Board of Public Utilities</i>
<b>NJCEP</b>	<i>New Jersey's Clean Energy Program:</i> NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money and the environment.
<b>psig</b>	<i>Pounds per square inch gauge</i>
<b>Plug Load</b>	Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.



<b>PV</b>	<i>Photovoltaic</i> : refers to an electronic device capable of converting incident light directly into electricity (direct current).
<b>SEER</b>	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
<b>SEP</b>	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR® Portfolio Manager®.
<b>Simple Payback</b>	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
<b>SREC</b>	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
<b>T5, T8, T12</b>	A reference to a linear lamp diameter. The number represents increments of 1/8 <sup>th</sup> of an inch.
<b>Temperature Setpoint</b>	The temperature at which a temperature regulating device (thermostat, for example) has been set.
<b>therm</b>	100,000 Btu. Typically used as a measure of natural gas consumption.
<b>tons</b>	A unit of cooling capacity equal to 12,000 Btu/hr.
<b>Turnkey</b>	Provision of a complete product or service that is ready for immediate use
<b>VAV</b>	<i>Variable air volume</i>
<b>VFD</b>	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
<b>WaterSense®</b>	The symbol for water efficiency. The WaterSense® program is managed by the EPA.
<b>Watt (W)</b>	Unit of power commonly used to measure electricity use.