



# Local Government Energy Audit Report

Plainfield Academy for the Arts and Advanced Studies

January 13, 2023

*Prepared for:*

Plainfield Board of Education  
1700 West Front Street  
Plainfield, New Jersey 07063

*Prepared by:*

TRC  
317 George Street  
New Brunswick, New Jersey 08901

## Disclaimer

---

The goal of this audit report is to identify potential energy efficiency opportunities and help prioritize specific measures for implementation. Most energy conservation measures have received preliminary analysis of feasibility that identifies expected ranges of savings and costs. This level of analysis is usually considered sufficient to establish a basis for further discussion and to help prioritize energy measures.

TRC reviewed the energy conservation measures and estimates of energy savings for technical accuracy. Actual, achieved energy savings depend on behavioral factors and other uncontrollable variables and, therefore, estimates of final energy savings are not guaranteed. TRC and the New Jersey Board of Public Utilities (NJBPU) shall in no event be liable should the actual energy savings vary.

TRC bases estimated material and labor costs primarily on RS Means cost manuals as well as on our experience at similar facilities. This approach is based on standard cost estimating manuals and is vendor neutral. Cost estimates include material and labor pricing associated with one for one equipment replacements. Cost estimates do not include demolition or removal of hazardous waste. The actual implementation costs for energy savings projects are anticipated to be significantly higher based on the specific conditions at your site(s). We strongly recommend that you work with your design engineer or contractor to develop actual project costs for your specific scope of work for the installation of high efficiency equipment. We encourage you to obtain multiple estimates when considering measure installations. Actual installation costs can vary widely based on selected products and installers. TRC and NJBPU do not guarantee cost estimates and shall in no event be held liable should actual installed costs vary from these material and labor estimates.

Incentive values provided in this report are estimated based of previously run state efficiency programs. Incentive levels are not guaranteed. The NJBPU reserves the right to extend, modify, or terminate programs without prior notice. Please review all available utility program incentives and eligibility requirements prior to selecting and installing any energy conservation measures.

The customer and their respective contractor(s) are responsible to implement energy conservation measures in complete conformance with all applicable local, state, and federal requirements.

Copyright ©2023 TRC. All rights reserved.

Reproduction or distribution of the whole, or any part of the contents of this document without written permission of TRC is prohibited. Neither TRC nor any of its employees makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any data, information, method, product or process disclosed in this document, or represents that its use will not infringe upon any privately-owned rights, including but not limited to, patents, trademarks or copyrights.

# Table of Contents

---

<b>1</b>	<b>Executive Summary</b> .....	<b>1</b>
1.1	<b>Planning Your Project</b> .....	4
	Pick Your Installation Approach .....	4
	Options from Around the State.....	5
<b>2</b>	<b>Existing Conditions</b> .....	<b>6</b>
2.1	Site Overview.....	6
2.2	Building Occupancy .....	6
2.3	Building Envelope .....	6
2.4	Lighting Systems.....	7
2.5	Air Handling Systems.....	8
	Unitary Electric HVAC Equipment .....	8
	Air Handling Units (AHUs) .....	8
2.6	Heating Hot Water Systems .....	8
2.7	Chilled Water Systems.....	9
2.8	Building Energy Management Systems (EMS) .....	9
2.9	Domestic Hot Water .....	10
2.10	Food Service Equipment.....	10
2.11	Refrigeration.....	11
2.12	Plug Load and Vending Machines .....	11
2.13	Water-Using Systems .....	12
2.14	On-Site Generation.....	12
<b>3</b>	<b>Energy Use and Costs</b> .....	<b>13</b>
3.1	Electricity .....	15
3.2	Natural Gas.....	16
3.3	Benchmarking.....	17
	Tracking Your Energy Performance .....	18
<b>4</b>	<b>Energy Conservation Measures</b> .....	<b>19</b>
4.1	Lighting .....	22
	ECM 1: Retrofit Fixtures with LED Lamps.....	22
4.2	Lighting Controls.....	22
	ECM 2: Install Occupancy Sensor Lighting Controls .....	23
4.3	Domestic Water Heating .....	23
	ECM 3: Install Low-Flow DHW Devices.....	23
4.4	Food Service & Refrigeration Measures.....	24
	ECM 4: Vending Machine Control .....	24
4.5	Custom Measures.....	24

ECM 5: Optimize HVAC Schedule .....	24
<b>4.6 Measures for Future Consideration .....</b>	<b>25</b>
Upgrade/Replace Energy Management System .....	25
Install High Efficiency Energy Recovery Units (ERUs).....	26
<b>5 Energy Efficient Best Practices .....</b>	<b>27</b>
Energy Tracking with ENERGY STAR® Portfolio Manager® .....	27
Lighting Maintenance.....	27
Motor Short Cycling Reduction .....	27
Motor Maintenance .....	28
Thermostat Schedules and Temperature Resets .....	28
Economizer Maintenance .....	28
Chiller Maintenance .....	28
AC System Evaporator/Condenser Coil Cleaning .....	28
HVAC Filter Cleaning and Replacement .....	28
Ductwork Maintenance.....	29
Boiler Maintenance.....	29
Label HVAC Equipment .....	29
Optimize HVAC Equipment Schedules .....	29
Water Heater Maintenance .....	30
Plug Load Controls.....	30
Water Conservation .....	31
Procurement Strategies .....	31
<b>6 On-site Generation .....</b>	<b>32</b>
6.1 Solar Photovoltaic .....	33
6.2 Combined Heat and Power .....	35
<b>7 Project Funding and Incentives.....</b>	<b>36</b>
7.1 Utility Energy Efficiency Programs .....	36
<b>8 New Jersey's Clean Energy Programs .....</b>	<b>37</b>
8.1 Large Energy Users .....	37
8.2 Combined Heat and Power .....	38
8.3 Successor Solar Incentive Program (SuSI) .....	39
8.4 Energy Savings Improvement Program .....	40
<b>9 Project Development .....</b>	<b>41</b>
<b>10 Energy Purchasing and Procurement Strategies .....</b>	<b>42</b>
10.1 Retail Electric Supply Options.....	42
10.2 Retail Natural Gas Supply Options .....	42
<b>Appendix A: Equipment Inventory &amp; Recommendations .....</b>	<b>A-1</b>
<b>Appendix B: ENERGY STAR® Statement of Energy Performance.....</b>	<b>B-1</b>
<b>Appendix C: Glossary .....</b>	<b>C-1</b>



## ENERGY EFFICIENCY INCENTIVE & REBATE TRANSITION

---

For the purposes of your LGEA, estimated incentives and rebates are included as placeholders for planning purposes. New Jersey utilities are rolling out their own energy efficiency programs, which your project may be eligible for depending on individual measures, quantities, and size of the building.

In 2018, Governor Murphy signed into law the landmark legislation known as the [Clean Energy Act](#). The law called for a significant overhaul of New Jersey's clean energy systems by building sustainable infrastructure in order to fight climate change and reduce carbon emissions, which will in turn create well-paying local jobs, grow the state's economy, and improve public health while ensuring a cleaner environment for current and future residents.


These next generation energy efficiency programs feature new ways of managing and delivering programs historically administered by New Jersey's Clean Energy Program™ (NJCEP). All of the investor-owned gas and electric utility companies will now also offer complementary energy efficiency programs and incentives directly to customers like you. NJCEP will still offer programs for new construction, renewable energy, the Energy Savings Improvement Program (ESIP), and large energy users.

New utility programs are under development. Keep up to date with developments by visiting the [NJCEP website](#).

# 1 EXECUTIVE SUMMARY

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) report for Plainfield Academy for the Arts and Advanced Studies. This report provides you with information about your facility's energy use, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help make changes in your facility. TRC conducted this study as part of a comprehensive effort to assist New Jersey school districts and local governments in controlling their energy costs and to help protect our environment by reducing statewide energy consumption.

## BUILDING PERFORMANCE REPORT

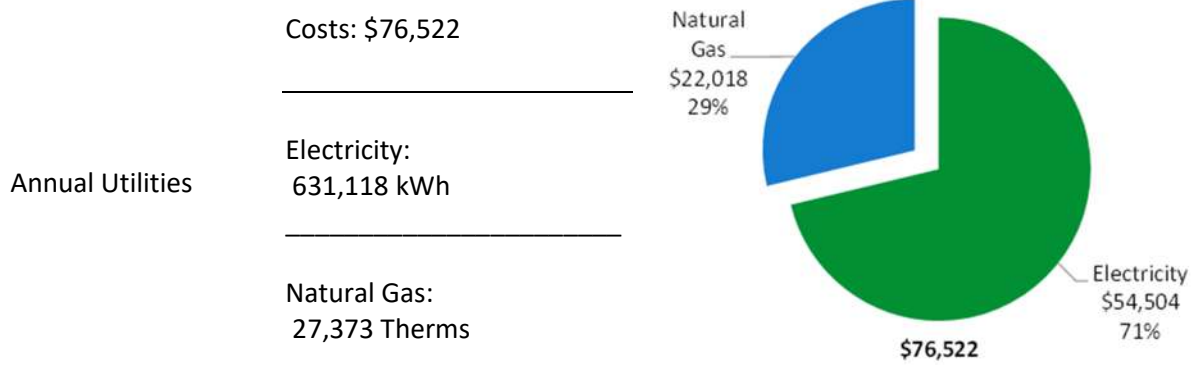

<p>ENERGY STAR® Benchmarking Score</p>	<p>64 <i>(1-100 scale)</i></p>	<p>Congratulations, your building performs better than the national average. This report has suggestions about how to keep your building running efficiently, further improve performance, and lower your energy bills even more.</p>
--	------------------------------------	---

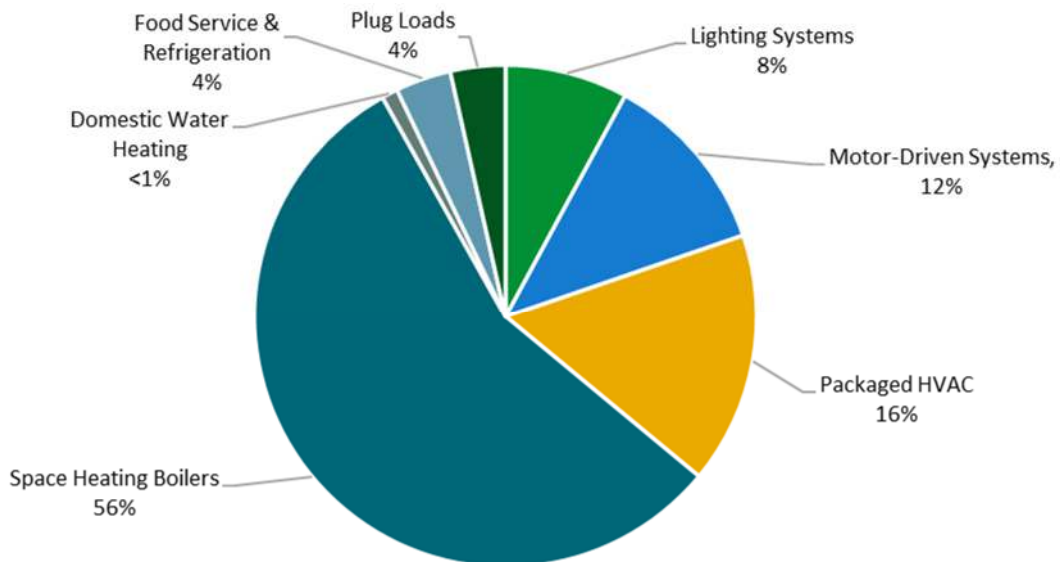


Figure 1 - Energy Use by System


## POTENTIAL IMPROVEMENTS



This energy audit considered a range of potential energy improvements in your building. Costs and savings will vary between improvements. Presented below are two potential scopes of work for your consideration.


### Scenario 1: Full Package (All Evaluated Measures)

Installation Cost	\$36,349
Potential Rebates & Incentives <sup>1</sup>	\$8,326
Annual Cost Savings	\$6,073
Annual Energy Savings	Electricity: 68,856 kWh Natural Gas: 157 Therms
Greenhouse Gas Emission Savings	36 Tons
Simple Payback	4.6 Years
Site Energy Savings (All Utilities)	5%

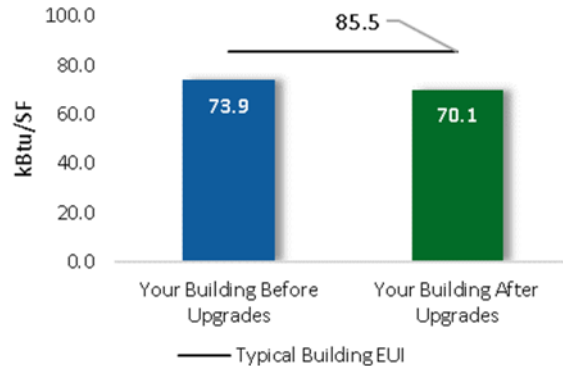

### Scenario 2: Cost Effective Package<sup>2</sup>

Installation Cost	\$35,423
Potential Rebates & Incentives	\$8,201
Annual Cost Savings	\$6,032
Annual Energy Savings	Electricity: 68,381 kWh Natural Gas: 158 Therms
Greenhouse Gas Emission Savings	35 Tons
Simple Payback	4.5 Years
Site Energy Savings (all utilities)	5%

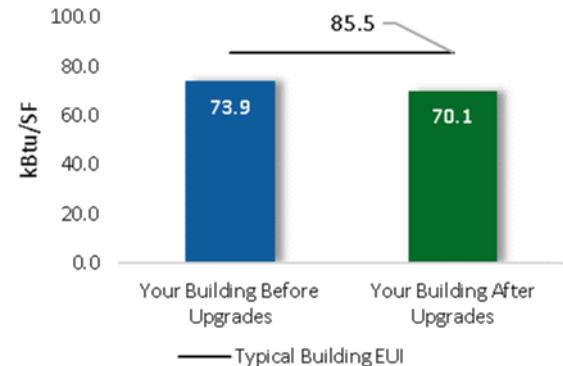

### On-site Generation Potential

Photovoltaic	Low
Combined Heat and Power	None

<sup>1</sup> Incentives are based on previously run state rebate programs. Contact your utility provider for current program incentives that may apply.

<sup>2</sup> A cost-effective measure is defined as one where the simple payback does not exceed two-thirds of the expected proposed equipment useful life. Simple payback is based on the net measure cost after potential incentives.

#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>61,325</b>	<b>18.9</b>	<b>-13</b>	<b>\$5,193</b>	<b>\$33,490</b>	<b>\$8,084</b>	<b>\$25,406</b>	<b>4.9</b>	<b>60,253</b>
ECM 1	Retrofit Fixtures with LED Lamps	Yes	61,325	18.9	-13	\$5,193	\$33,490	\$8,084	\$25,406	4.9	60,253
<b>Lighting Control Measures</b>			<b>475</b>	<b>0.2</b>	<b>0</b>	<b>\$40</b>	<b>\$926</b>	<b>\$125</b>	<b>\$801</b>	<b>19.9</b>	<b>466</b>
ECM 2	Install Occupancy Sensor Lighting Controls	No	475	0.2	0	\$40	\$926	\$125	\$801	19.9	466
<b>Domestic Water Heating Upgrade</b>			<b>0</b>	<b>0.0</b>	<b>2</b>	<b>\$18</b>	<b>\$43</b>	<b>\$17</b>	<b>\$26</b>	<b>1.4</b>	<b>265</b>
ECM 3	Install Low-Flow DHW Devices	Yes	0	0.0	2	\$18	\$43	\$17	\$26	1.4	265
<b>Food Service &amp; Refrigeration Measures</b>			<b>3,163</b>	<b>0.4</b>	<b>0</b>	<b>\$273</b>	<b>\$690</b>	<b>\$100</b>	<b>\$590</b>	<b>2.2</b>	<b>3,185</b>
ECM 4	Vending Machine Control	Yes	3,163	0.4	0	\$273	\$690	\$100	\$590	2.2	3,185
<b>Custom Measures</b>			<b>3,892</b>	<b>0.0</b>	<b>26</b>	<b>\$548</b>	<b>\$1,200</b>	<b>\$0</b>	<b>\$1,200</b>	<b>2.2</b>	<b>7,011</b>
ECM 5	Optimize HVAC Schedule	Yes	3,892	0.0	26	\$548	\$1,200	\$0	\$1,200	2.2	7,011
<b>TOTALS (COST EFFECTIVE MEASURES)</b>			<b>68,381</b>	<b>19.2</b>	<b>16</b>	<b>\$6,032</b>	<b>\$35,423</b>	<b>\$8,201</b>	<b>\$27,222</b>	<b>4.5</b>	<b>70,713</b>
<b>TOTALS (ALL MEASURES)</b>			<b>68,856</b>	<b>19.4</b>	<b>16</b>	<b>\$6,073</b>	<b>\$36,349</b>	<b>\$8,326</b>	<b>\$28,023</b>	<b>4.6</b>	<b>71,180</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 2 – Evaluated Energy Improvements

For more detail on each evaluated energy improvement and a break out of cost-effective improvements, see **Section 4: Energy Conservation Measures**.



## 1.1 Planning Your Project

Careful planning makes for a successful energy project. When considering this scope of work, you will have some decisions to make, such as:

- ◆ How will the project be funded and/or financed?
- ◆ Is it best to pursue individual ECMs, groups of ECMs, or use a comprehensive approach where all ECMs are installed together?
- ◆ Are there other facility improvements that should happen at the same time?

### Pick Your Installation Approach

Utility-run energy efficiency programs, such as New Jersey's Clean Energy Programs, give you the flexibility to do a little or a lot. Rebates, incentives, and financing are available to help reduce both your installation costs and your energy bills. If you are planning to take advantage of these programs, make sure to review incentive program guidelines before proceeding. This is important because in most cases you will need to submit applications for the incentives *before* purchasing materials or starting installation.

For details on these programs please visit [New Jersey's Clean Energy Program website](#) or contact your utility provider.



## **Options from Around the State**

### *Financing and Planning Support with the Energy Savings Improvement Program (ESIP)*

For larger facilities with limited capital availability to implement ECMs, project financing may be available through the ESIP. Supported directly by the NJBPU, ESIP provides government agencies with project development, design, and implementation support services, as well as attractive financing for implementing ECMs. You have already taken the first step as an LGEA customer, because this report is required to participate in ESIP.

### *Resiliency with Return on Investment through Combined Heat and Power (CHP)*

The CHP program provides incentives for combined heat and power (i.e., cogeneration) and waste heat to power projects. Combined heat and power systems generate power on-site and recover heat from the generation system to meet on-site thermal loads. Waste heat to power systems use waste heat to generate power. You will work with a qualified developer who will design a system that meets your building's heating and cooling needs.

### *Successor Solar Incentive Program (SuSI)*

New Jersey is committed to supporting solar energy. Solar projects help the state reach the renewable goals outlined in the state's Energy Master Plan. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available, but certified solar projects are able to earn one SREC II (Solar Renewable Energy Certificates II) for each megawatt-hour of solar electricity produced from a qualifying solar facility.

### *Ongoing Electric Savings with Demand Response*

The Demand Response Energy Aggregator program reduces electric loads at commercial facilities when wholesale electricity prices are high or when the reliability of the electric grid is threatened due to peak power demand. By enabling commercial facilities to reduce electric demand during times of peak demand, the grid is made more reliable, and overall transmission costs are reduced for all ratepayers. Curtailment service providers provide regular payments to medium and large consumers of electric power for their participation in demand response (DR) programs. Program participation is voluntary, and facilities receive payments regardless of whether they are called upon to curtail their load during times of peak demand.

### *Large Energy User Program (LEUP)*

LEUP designed to promote self-investment in energy efficiency and combined heat and power or fuel cell projects. It incentivizes owners/users of buildings to upgrade or install energy conserving measures in existing buildings to help offset the capital costs associated with the project. The efficiency upgrades are customized to meet the requirements of the customers' existing facilities, while advancing the State's energy efficiency, conservation, and greenhouse gas reduction goals.

## 2 EXISTING CONDITIONS

The New Jersey Board of Public Utilities (NJBP) has sponsored this Local Government Energy Audit (LGEA) Report for Plainfield Academy for the Arts and Advanced Studies. This report provides information on how your facility uses energy, identifies energy conservation measures (ECMs) that can reduce your energy use, and provides information and assistance to help you implement the ECMs.

TRC conducted this study as part of a comprehensive effort to assist New Jersey educational and local government facilities in controlling energy costs and protecting our environment by offering a wide range of energy management options and advice.

### 2.1 Site Overview

On September 6, 2022, TRC performed an energy audit at Plainfield Academy for the Arts and Advanced Studies located in Plainfield, New Jersey. TRC met with facility staff to review the facility operations and help focus our investigation on specific energy-using systems.

Plainfield Academy for the Arts and Advanced Studies is a one-story, 66,205 square foot building built in 2005. Spaces include classrooms, gymnasium, offices, cafeteria, corridors, kitchen, and mechanical space.

### 2.2 Building Occupancy

The facility is occupied from September through June. Typical weekday occupancy is 65 staff and 385 students. Summer occupancy includes a summer day camp and continuing maintenance activities.

Building Name	Weekday/Weekend	Operating Schedule
Plainfield Academy for the Arts & Advanced Studies	Weekday	6:30 AM - 10:00 PM
	Weekend	Closed

Figure 3 - Building Occupancy Schedule

### 2.3 Building Envelope

Building walls are concrete block over structural steel with a brick facade. The roof is flat and covered with black membrane, and it is in good condition.



Building Exterior Façade



Flat Roof



Interior Structure

Most of the windows are double glazed and have aluminum frames with a thermal break. The glass-to-frame seals are in fair condition. The operable window weather seals are in fair condition, showing little evidence of excessive wear. Exterior doors have aluminum frames and are in fair condition with undamaged door seals. Degraded window and door seals increase drafts and outside air infiltration.



*Window*



*Window Closeup*



*Exterior Door*

## 2.4 Lighting Systems


The primary interior lighting system uses 32-Watt linear fluorescent T8 lamps. Additionally, there are a few compact fluorescent lamps (CFL) and LED lamps. Typically, T8 fluorescent lamps use electronic ballasts. Fixture types include 2-lamp or 3-lamp, 4-foot-long recessed troffer, and surface mounted fixtures and 2-foot fixtures with U-bend tube lamps. Most fixtures are in fair condition. Gymnasium fixtures have manually controlled recessed troffers with linear fluorescent lamps. All exit signs are LED. Interior lighting levels were generally sufficient.



*Recessed Troffers*



*Recessed Troffers*

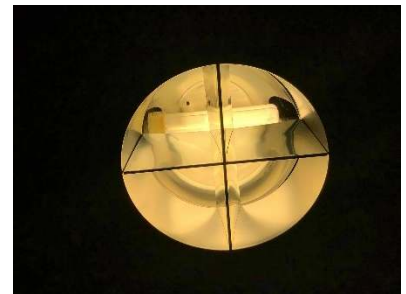

*Recessed Can Fixtures*

Most lighting fixtures are controlled by occupancy sensors and the remainder by wall switches. Exterior fixtures include LED wall packs and pole mounted fixtures have with LED lamps. Exterior light fixtures are generally controlled by photocell.



*LED Wall Pack*



*Pole Top Fixture with LED Lamps*



*Pole Top Fixture with LED Lamps*

## 2.5 Air Handling Systems

### Unitary Electric HVAC Equipment

A few offices and the server room are conditioned by ductless mini split systems. These have a capacity of 1.5 tons for cooling and two of the units are heat pumps with a capacity of 22,000 MBh. The units are in fair condition. They range in efficiency between 10.0 EER and 13.3 EER. They are not ENERGY STAR® labeled.



*Outdoor Condensing Unit*



*Indoor Evaporator*



*Outdoor Condensing Unit*

### Air Handling Units (AHUs)

The building is mainly conditioned by rooftop air handling units for the large common areas and indoor air handling units for classrooms. The units are connected to the chiller and boilers, both described in following sections. Each unit is equipped with a supply fan motor, hot water heating coil, and refrigerant coil for cooling. The HVAC systems are controlled by the facility EMS.



*Rooftop Air Handling Unit*



*Classroom Air Handling Unit*



*EMS AHU Diagram*

## 2.6 Heating Hot Water Systems

Three Aerco 2,000 MBh hot water boilers serve the building's heating load at a nominal efficiency of 80%. The boilers are configured in an automated control scheme. Multiple boilers are required under high load conditions. Installed in 2004, they are in fair condition.

The boilers are configured in a constant flow primary distribution with two, 10 hp constant speed hot water pumps operating in an automated control scheme. The boilers provide hot water to fan coil units and AHUs throughout the building.



Boilers



Heating Hot Water Pumps



EMS Diagram

## 2.7 Chilled Water Systems

The chiller plant consists of a 200-ton, Trane, R-134A, air cooled screw chiller. The chiller is configured in a primary-secondary distribution loop with two, 7.5 hp constant flow primary pumps (P3 and P4) and two, 15 hp variable flow secondary pumps (P5 and P6).


The chilled water supply temperature is reset based on outside air temperature. The chiller plant is locked out when the outside air temperature is below 65°F, and it is turned off from mid-December through February.



Chiller



Chilled Water Pumps

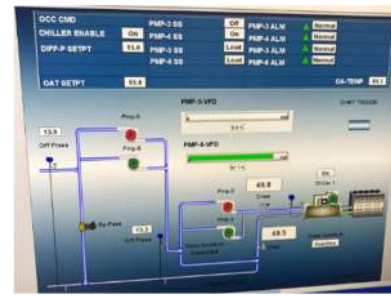

EMS Diagram


## 2.8 Building Energy Management Systems (EMS)

A Johnson Controls EMS controls the HVAC equipment, boilers, chiller, and air handlers. The EMS provides equipment scheduling control and monitors space temperatures, supply air temperatures, humidity, heating water loop temperatures, and chilled water loop temperatures.


The site staff expressed an interest in expanding the level of control provided by the EMS, replacing the EMS, and receiving additional training on operating the EMS.



EMS Version 7

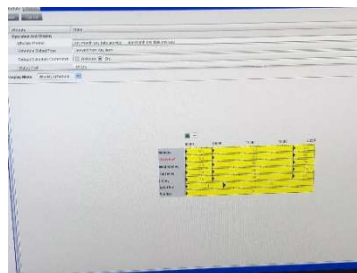

Schedule

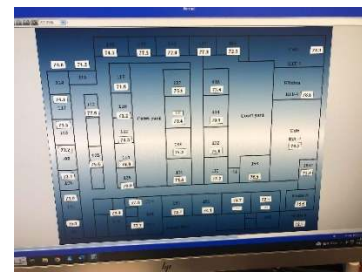

Building Diagram

## 2.9 Domestic Hot Water

Hot water is produced by a 100-gallon, 250 MBh gas-fired storage water heater with an efficiency rating of 80%. Two fractional hp circulation pumps distribute water to end uses. The circulation pumps operate continuously. The domestic hot water pipes are insulated, and the insulation is in fair condition.



*Hot Water Storage Heater*



*Hot Water Storage Heater*



*DHW Circulation Pumps*

## 2.10 Food Service Equipment

The kitchen has a mix of gas and electric equipment that is used to prepare meals for students and staff at this school and the adjoining Jefferson Elementary School. Most cooking is done using a gas-fired oven. Equipment is not high efficiency and is in good condition.

Visit [https://www.energystar.gov/products/commercial\\_food\\_service\\_equipment](https://www.energystar.gov/products/commercial_food_service_equipment) for the latest information on high efficiency food service equipment.



*Gas-fired Oven*



*Serving Equipment*

## 2.11 Refrigeration

The kitchen has several stand-up refrigerators with solid doors. There is also an energy efficient stand-up solid door freezer. There are freezer chests as well as several refrigerator chests. Equipment is generally standard efficiency and in good condition.

Visit [https://www.energystar.gov/products/commercial\\_food\\_service\\_equipment](https://www.energystar.gov/products/commercial_food_service_equipment) for the latest information on high efficiency food service equipment.



*Refrigerators*



*Freezer Chest*



*Refrigerator and Freezer Chest*

## 2.12 Plug Load and Vending Machines

The location is doing a great job managing their electrical plug loads. This report makes additional suggestions for ECMs in this area as well as energy efficient best practices.

There are 65 computer workstations throughout the facility. Plug loads throughout the building include general cafe and office equipment. There are classroom typical loads such as smartboards, projectors, and fans.

There are several residential-style refrigerators throughout the building. These vary in condition and efficiency.

There are two refrigerated beverage vending machines and one non-refrigerated vending machines. Vending machines are not equipped with occupancy-based controls.



*Smartboard*



*Copier*



*Vending Machine*



### 2.13 Water-Using Systems

There are 13 restrooms with toilets and sinks. Faucet flow rates are at 1.5 gallons per minute (gpm) or higher.



*Kitchen Sink*



*Lavatory sinks*



*Kitchen Sink*

### 2.14 On-Site Generation

Plainfield Academy for the Arts and Advanced Studies has a 347kW photovoltaic (PV) array with approximately 1,500 panels. This system provides approximately 41% of the electricity used.



*Solar Array*



*Inverters*




*Solar Array*

### 3 ENERGY USE AND COSTS

Twelve months of utility billing data are used to develop annual energy consumption and cost data. This information creates a profile of the annual energy consumption and energy costs.

Utility Summary		
Fuel	Usage	Cost
Electricity	631,118 kWh	\$54,504
Natural Gas	27,373 Therms	\$22,018
<b>Total</b>		<b>\$76,522</b>

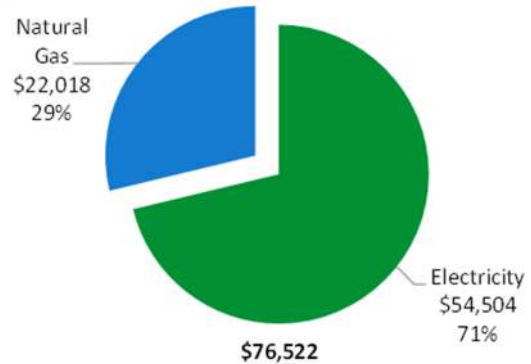

An energy balance identifies and quantifies energy use in your various building systems. This can highlight areas with the most potential for improvement. This energy balance was developed using calculated energy use for each of the end uses noted in the figure.

The energy auditor collects information regarding equipment operating hours, capacity, efficiency, and other operational parameters from facility staff, drawings, and on-site observations. This information is used as the inputs to calculate the existing conditions energy use for the site. The calculated energy use is then compared to the historical energy use and the initial inputs are revised, as necessary, to balance the calculated energy use to the historical energy use.


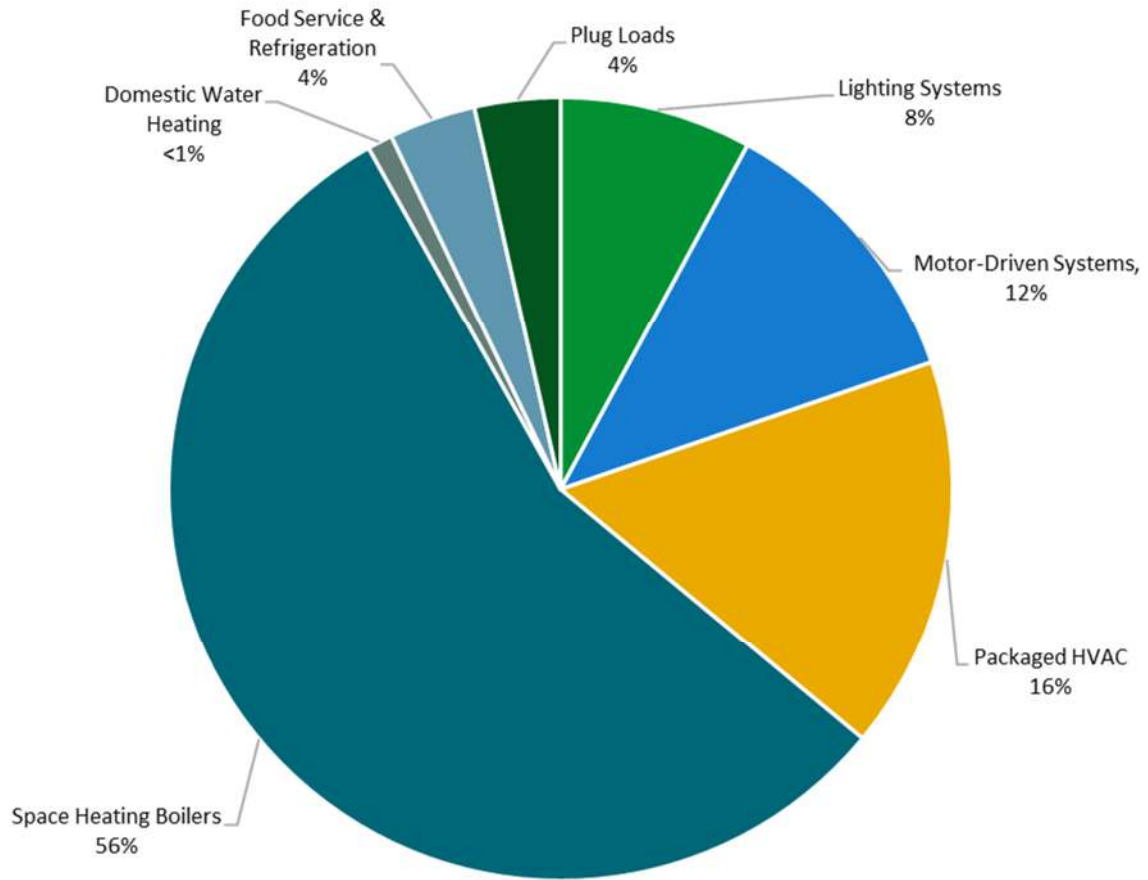


Figure 4 - Energy Balance

### 3.1 Electricity

PSE&G delivers electricity under rate class Large Power & Lighting Secondary.

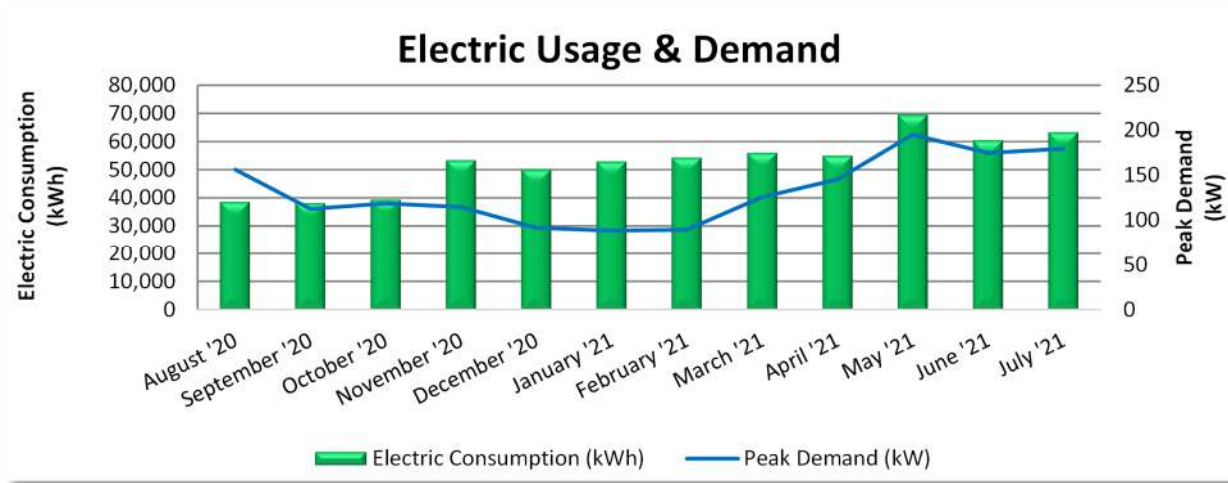


Electric Billing Data					
Period Ending	Days in Period	Electric Usage (kWh)	Demand (kW)	Demand Cost	Total Electric Cost
9/14/20	32	38,613	157	1,989	4,271
10/13/20	29	38,230	113	424	2,820
11/11/20	29	39,388	119	446	2,512
12/14/20	33	53,372	115	432	3,194
1/14/21	31	50,122	92	346	4,250
2/12/21	29	52,915	89	334	4,712
3/16/21	32	54,308	90	337	4,475
4/15/21	30	55,960	126	473	4,399
5/14/21	29	55,000	145	548	4,474
6/15/21	32	69,526	195	2,502	7,051
7/15/21	30	60,398	175	2,178	6,328
8/13/21	29	63,286	180	1,756	6,019
<b>Totals</b>	<b>365</b>	<b>631,118</b>	<b>195</b>	<b>\$11,764</b>	<b>\$54,504</b>
<b>Annual</b>	<b>365</b>	<b>631,118</b>	<b>195</b>	<b>\$11,764</b>	<b>\$54,504</b>

Notes:

- Peak demand of 195 kW occurred in May 2021.
- Average demand over the past 12 months was 133 kW.
- The average electric cost over the past 12 months was \$0.086/kWh, which is the blended rate that includes energy supply, distribution, demand, and other charges. This report uses this blended rate to estimate energy cost savings.
- On-site generation is through a PPA, and the site purchases the generated electricity from Advanced Solar. Solar is operated under a net metering agreement. The net consumption is the difference between the amount of electricity drawn from PSE&G when the generating system is not meeting the facilities' energy needs and the amount delivered when the system is producing more electricity than the site requires.

### 3.2 Natural Gas

PSE&G delivers natural gas under rate class Large Volume Gas, General Service Gas, with natural gas supply provided by UGI Energy, a third-party supplier.

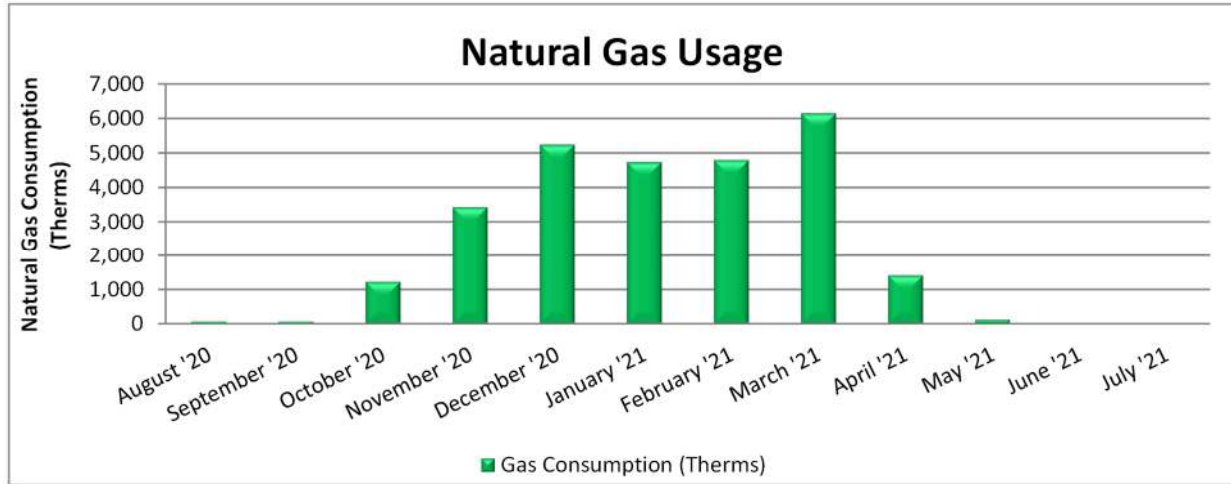

Gas Billing Data			
Period Ending	Days in Period	Natural Gas Usage (Therms)	Natural Gas Cost
9/15/20	33	79	221
10/12/20	27	78	223
11/10/20	29	1,229	1,398
12/14/20	34	3,434	2,683
1/14/21	31	5,246	3,726
2/11/21	28	4,735	3,643
3/16/21	33	4,794	3,694
4/14/21	29	6,144	4,757
5/13/21	29	1,418	1,009
6/15/21	33	135	253
7/14/21	29	39	204
8/13/21	30	42	206
<b>Totals</b>	<b>365</b>	<b>27,373</b>	<b>\$22,018</b>
<b>Annual</b>	<b>365</b>	<b>27,373</b>	<b>\$22,018</b>

Notes:

- The average gas cost for the past 12 months is \$0.804/therm, which is the blended rate used throughout the analysis.

### 3.3 Benchmarking

Your building was benchmarked using the United States Environmental Protection Agency’s (EPA) *Portfolio Manager*® software. Benchmarking compares your building’s energy use to that of similar buildings across the country, while neutralizing variations due to location, occupancy, and operating hours. Some building types can be scored with a 1-100 ranking of a building’s energy performance relative to the national building market. A score of 50 represents the national average and a score of 100 is best.

This ENERGY STAR® benchmarking score provides a comprehensive snapshot of your building’s energy performance. It assesses the building’s physical assets, operations, and occupant behavior, which is compiled into a quick and easy-to-understand score.

<b>Benchmarking Score</b>	<b>64</b>
---------------------------	-----------

Congratulations, your building performs better than the national average. This report has suggestions about how to keep your building running efficiently, further improve performance, and lower your energy bills even more.

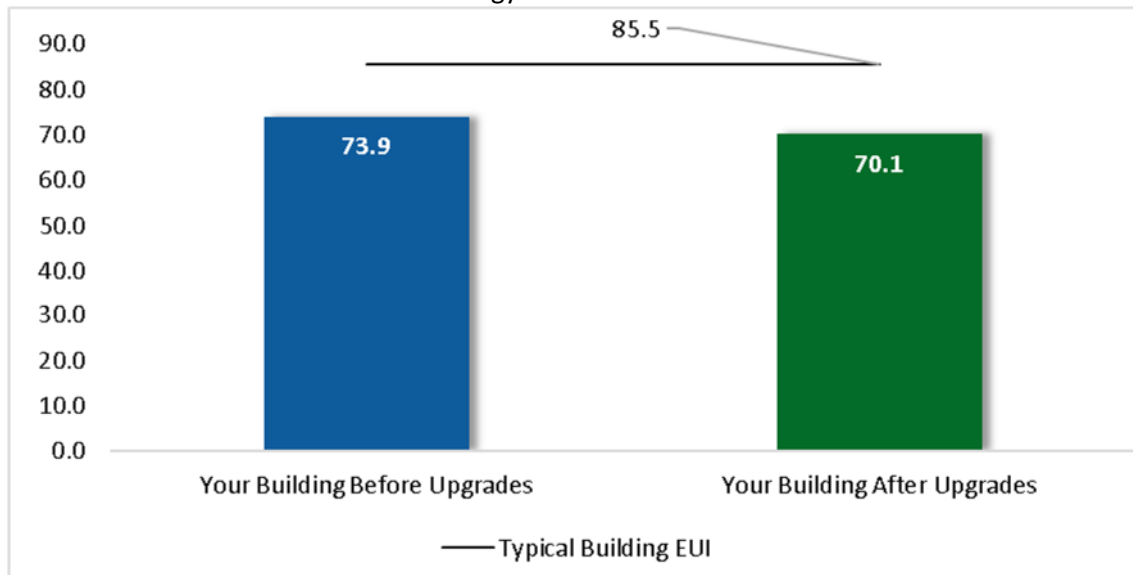


Figure 5 - Energy Use Intensity Comparison<sup>3</sup>

Energy use intensity (EUI) measures energy consumption per square foot and is the standard metric for comparing buildings’ energy performance. A lower EUI means better performance and less energy consumed. Several factors can cause a building to vary from typical energy usage. Local weather conditions, building age and insulation levels, equipment efficiency, daily occupancy hours, changes in occupancy throughout the year, equipment operating hours, and occupant behavior all contribute to a building’s energy use and the benchmarking score.

<sup>3</sup> Based on all evaluated ECMs

### **Tracking Your Energy Performance**

Keeping track of your energy use on a monthly basis is one of the best ways to keep energy costs in check. Update your utility information in Portfolio Manager® regularly, so that you can keep track of your building's performance.

**We have created a Portfolio Manager® account for your facility, and we have already entered the monthly utility data shown above for you. Account login information for your account will be sent via email.**

Free online training is available to help you use ENERGY STAR® Portfolio Manager® to track your building's performance at: <https://www.energystar.gov/buildings/training>.

For more information on ENERGY STAR® and Portfolio Manager®, visit their [website](#).

## 4 ENERGY CONSERVATION MEASURES

---

The goal of this audit report is to identify and evaluate potential energy efficiency improvements and provide information about the cost effectiveness of those improvements. Most energy conservation measures have received preliminary analysis of feasibility, which identifies expected ranges of savings. This level of analysis is typically sufficient to demonstrate project cost-effectiveness and help prioritize energy measures.

Calculations of energy use and savings are based on the current version of the *New Jersey's Clean Energy Program Protocols to Measure Resource Savings*, which is approved by the NJBPU. Further analysis or investigation may be required to calculate more precise savings based on specific circumstances.

Operation and maintenance costs for the proposed new equipment will generally be lower than the current costs for the existing equipment—especially if the existing equipment is at or past its normal useful life. We have conservatively assumed there to be no impact on overall maintenance costs over the life of the equipment.

Financial incentives are based on previously run state rebate programs. New utility programs are expected to start rolling out in the spring and summer of 2021. Keep up to date with developments by visiting the [NJCEP website](#). Some measures and proposed upgrades may be eligible for higher incentives than those shown below.

For a detailed list of the locations and recommended energy conservation measures for all inventoried equipment, see Appendix A: Equipment Inventory & Recommendations.



#	Energy Conservation Measure	Cost Effective?	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>			<b>61,325</b>	<b>18.9</b>	<b>-13</b>	<b>\$5,193</b>	<b>\$33,490</b>	<b>\$8,084</b>	<b>\$25,406</b>	<b>4.9</b>	<b>60,253</b>
ECM 1	Retrofit Fixtures with LED Lamps	Yes	61,325	18.9	-13	\$5,193	\$33,490	\$8,084	\$25,406	4.9	60,253
<b>Lighting Control Measures</b>			<b>475</b>	<b>0.2</b>	<b>0</b>	<b>\$40</b>	<b>\$926</b>	<b>\$125</b>	<b>\$801</b>	<b>19.9</b>	<b>466</b>
ECM 2	Install Occupancy Sensor Lighting Controls	No	475	0.2	0	\$40	\$926	\$125	\$801	19.9	466
<b>Domestic Water Heating Upgrade</b>			<b>0</b>	<b>0.0</b>	<b>2</b>	<b>\$18</b>	<b>\$43</b>	<b>\$17</b>	<b>\$26</b>	<b>1.4</b>	<b>265</b>
ECM 3	Install Low-Flow DHW Devices	Yes	0	0.0	2	\$18	\$43	\$17	\$26	1.4	265
<b>Food Service &amp; Refrigeration Measures</b>			<b>3,163</b>	<b>0.4</b>	<b>0</b>	<b>\$273</b>	<b>\$690</b>	<b>\$100</b>	<b>\$590</b>	<b>2.2</b>	<b>3,185</b>
ECM 4	Vending Machine Control	Yes	3,163	0.4	0	\$273	\$690	\$100	\$590	2.2	3,185
<b>Custom Measures</b>			<b>3,892</b>	<b>0.0</b>	<b>26</b>	<b>\$548</b>	<b>\$1,200</b>	<b>\$0</b>	<b>\$1,200</b>	<b>2.2</b>	<b>7,011</b>
ECM 5	Optimize HVAC Schedule	Yes	3,892	0.0	26	\$548	\$1,200	\$0	\$1,200	2.2	7,011
<b>TOTALS</b>			<b>68,856</b>	<b>19.4</b>	<b>16</b>	<b>\$6,073</b>	<b>\$36,349</b>	<b>\$8,326</b>	<b>\$28,023</b>	<b>4.6</b>	<b>71,180</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 6 – All Evaluated ECMs

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>61,325</b>	<b>18.9</b>	<b>-13</b>	<b>\$5,193</b>	<b>\$33,490</b>	<b>\$8,084</b>	<b>\$25,406</b>	<b>4.9</b>	<b>60,253</b>
ECM 1	Retrofit Fixtures with LED Lamps	61,325	18.9	-13	\$5,193	\$33,490	\$8,084	\$25,406	4.9	60,253
<b>Domestic Water Heating Upgrade</b>		<b>0</b>	<b>0.0</b>	<b>2</b>	<b>\$18</b>	<b>\$43</b>	<b>\$17</b>	<b>\$26</b>	<b>1.4</b>	<b>265</b>
ECM 3	Install Low-Flow DHW Devices	0	0.0	2	\$18	\$43	\$17	\$26	1.4	265
<b>Food Service &amp; Refrigeration Measures</b>		<b>3,163</b>	<b>0.4</b>	<b>0</b>	<b>\$273</b>	<b>\$690</b>	<b>\$100</b>	<b>\$590</b>	<b>2.2</b>	<b>3,185</b>
ECM 4	Vending Machine Control	3,163	0.4	0	\$273	\$690	\$100	\$590	2.2	3,185
<b>Custom Measures</b>		<b>3,892</b>	<b>0.0</b>	<b>26</b>	<b>\$548</b>	<b>\$1,200</b>	<b>\$0</b>	<b>\$1,200</b>	<b>2.2</b>	<b>7,011</b>
ECM 5	Optimize HVAC Schedule	3,892	0.0	26	\$548	\$1,200	\$0	\$1,200	2.2	7,011
<b>TOTALS</b>		<b>68,381</b>	<b>19.2</b>	<b>16</b>	<b>\$6,032</b>	<b>\$35,423</b>	<b>\$8,201</b>	<b>\$27,222</b>	<b>4.5</b>	<b>70,713</b>

\* - All incentives presented in this table are included as placeholders for planning purposes and are based on previously run state rebate programs. Contact your utility provider for details on current programs.

\*\* - Simple Payback Period is based on net measure costs (i.e. after incentives).

Figure 7 – Cost Effective ECMs

## 4.1 Lighting

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Upgrades</b>		<b>61,325</b>	<b>18.9</b>	<b>-13</b>	<b>\$5,193</b>	<b>\$33,490</b>	<b>\$8,084</b>	<b>\$25,406</b>	<b>4.9</b>	<b>60,253</b>
ECM 1	Retrofit Fixtures with LED Lamps	61,325	18.9	-13	\$5,193	\$33,490	\$8,084	\$25,406	4.9	60,253

When considering lighting upgrades, we suggest using a comprehensive design approach that simultaneously upgrades lighting fixtures and controls to maximize energy savings and improve occupant lighting. Comprehensive design will also consider appropriate lighting levels for different space types to make sure that the right amount of light is delivered where needed. If conversion to LED light sources is proposed, we suggest converting all of a specific lighting type (e.g., linear fluorescent) to LED lamps to minimize the number of lamp types in use at the facility, which should help reduce future maintenance costs.

### **ECM 1: Retrofit Fixtures with LED Lamps**

Replace fluorescent or CFL lamps with LED lamps. Many LED tubes are direct replacements for existing fluorescent tubes and can be installed while leaving the fluorescent fixture ballast in place. LED lamps can be used in existing fixtures as a direct replacement for most other lighting technologies. Be sure to specify replacement lamps that are compatible with existing dimming controls, where applicable. In some circumstances, you may need to upgrade your dimming system for optimum performance.

This measure saves energy by installing LEDs, which use less power than other lighting technologies yet provide equivalent lighting output for the space. Maintenance savings may also be available, as longer-lasting LEDs lamps will not need to be replaced as often as the existing lamps.

**Affected Building Areas:** all areas with fluorescent fixtures with T8 tubes and CFL lamps.

## 4.2 Lighting Controls

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Lighting Control Measures</b>		<b>475</b>	<b>0.2</b>	<b>0</b>	<b>\$40</b>	<b>\$926</b>	<b>\$125</b>	<b>\$801</b>	<b>19.9</b>	<b>466</b>
ECM 2	Install Occupancy Sensor Lighting Controls	475	0.2	0	\$40	\$926	\$125	\$801	19.9	466

Lighting controls reduce energy use by turning off or lowering lighting fixture power levels when not in use. A comprehensive approach to lighting design should upgrade the lighting fixtures and the controls together for maximum energy savings and improved lighting for occupants.

## **ECM 2: Install Occupancy Sensor Lighting Controls**

We evaluated installing occupancy sensors to control lighting fixtures in areas that are frequently unoccupied, even for short periods. For most spaces, we recommend that lighting controls use dual technology sensors, which reduce the possibility of lights turning off unexpectedly.

Occupancy sensors detect occupancy using ultrasonic and/or infrared sensors. When an occupant enters the space, the lighting fixtures switch to full lighting levels. Most occupancy sensor lighting controls allow users to manually turn fixtures on/off, as needed. Some controls can also provide dimming options.

Occupancy sensors can be mounted on the wall at existing switch locations, mounted on the ceiling, or in remote locations. In general, wall switch replacement sensors are best suited to single occupant offices and other small rooms. Ceiling-mounted or remote mounted sensors are used in large spaces, locations without local switching, and where wall switches are not in the line-of-sight of the main work area.

This measure provides energy savings by reducing the lighting operating hours. Most candidate areas are already subject to automatic controls.

**Affected Building Areas:** Kitchen, Classroom 168, and Office 160.

## 4.3 Domestic Water Heating

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
	<b>Domestic Water Heating Upgrade</b>	<b>0</b>	<b>0.0</b>	<b>2</b>	<b>\$18</b>	<b>\$43</b>	<b>\$17</b>	<b>\$26</b>	<b>1.4</b>	<b>265</b>
ECM 3	Install Low-Flow DHW Devices	0	0.0	2	\$18	\$43	\$17	\$26	1.4	265

## **ECM 3: Install Low-Flow DHW Devices**

Install low-flow devices to reduce overall hot water demand. The following low-flow devices are recommended to reduce hot water usage:

Device	Flow Rate
Faucet aerators (lavatory)	0.5 gpm
Faucet aerator (kitchen)	1.5 gpm
Showerhead	2.0 gpm
Pre-rinse spray valve (kitchen)	1.28 gpm

Low-flow devices reduce the overall water flow from the fixture, while still providing adequate pressure for washing. Additional cost savings may result from reduced water usage.

## 4.4 Food Service & Refrigeration Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Food Service &amp; Refrigeration Measures</b>		<b>3,163</b>	<b>0.4</b>	<b>0</b>	<b>\$273</b>	<b>\$690</b>	<b>\$100</b>	<b>\$590</b>	<b>2.2</b>	<b>3,185</b>
ECM 4	Vending Machine Control	3,163	0.4	0	\$273	\$690	\$100	\$590	2.2	3,185

### ECM 4: Vending Machine Control

Vending machines operate continuously, even during unoccupied hours. Install occupancy sensor controls to reduce energy use. These controls power down vending machines when the vending machine area has been vacant for some time, and they power up the machines at necessary regular intervals or when the surrounding area is occupied. Energy savings are dependent on the vending machine and activity level in the area surrounding the machines.

## 4.5 Custom Measures

#	Energy Conservation Measure	Annual Electric Savings (kWh)	Peak Demand Savings (kW)	Annual Fuel Savings (MMBtu)	Annual Energy Cost Savings (\$)	Estimated M&L Cost (\$)	Estimated Incentive (\$)*	Estimated Net M&L Cost (\$)	Simple Payback Period (yrs)**	CO <sub>2</sub> e Emissions Reduction (lbs)
<b>Custom Measures</b>		<b>3,892</b>	<b>0.0</b>	<b>26</b>	<b>\$548</b>	<b>\$1,200</b>	<b>\$0</b>	<b>\$1,200</b>	<b>2.2</b>	<b>7,011</b>
ECM 5	Optimize HVAC Schedule	3,892	0.0	26	\$548	\$1,200	\$0	\$1,200	2.2	7,011

### ECM 5: Optimize HVAC Schedule

Reduce long runtime hours. The measure will minimize excess wear on boilers, the chiller, and air handling units. Savings can be achieved by selective tuning of building equipment schedules through the EMS. The measure is conservatively estimated to save 1% of the energy associated with HVAC operation, which is achievable with limited reductions in scheduled operations. Costs are based on simple programming adjustments.

## 4.6 Measures for Future Consideration

There are additional opportunities for improvement that Plainfield Board of Education may wish to consider. These potential upgrades typically require further analysis, involve substantial capital investment, and/or include significant system reconfiguration. These measure(s) are therefore beyond the scope of this energy audit. These measure(s) are described here to support a whole building approach to energy efficiency and sustainability.

Plainfield Board of Education may wish to consider the Energy Savings Improvement Program (ESIP) or other whole building approach. With interest in implementing comprehensive, largescale and/or complex system wide projects, these measures may be pursued during development of a future energy savings plan. We recommend that you work with your energy service company (ESCO) and/or design team to:

- Evaluate these measures further.
- Develop firm costs.
- Determine measure savings.
- Prepare detailed implementation plans.

Other modernization or capital improvement funds may be leveraged for these types of refurbishments. As you plan for capital upgrades, be sure to consider the energy impact of the building systems and controls being specified.

### **Upgrade/Replace Energy Management System**

Based on our site survey and on conversations with facility staff, it appears that the existing energy management system (EMS) is substantially limited in its capabilities, means of control, monitoring/reporting function, or condition relative to new systems available in the marketplace. A substantial upgrade to your site's EMS could increase the efficiency of your building HVAC system operation.

The current generation EMS typically provides building systems with a network of temperature and pressure sensors that obtain feedback about field conditions and provide signals to control systems to adjust system operation for optimal functioning. Thirty years ago, most control systems were pneumatic systems driven by compressed air, with pneumatic thermostats and air driven actuators for valves and dampers. Pneumatics controls have largely been replaced by direct digital control (DDC) systems, but many pneumatic systems remain. Contemporary DDC systems afford tighter controls and enhanced monitoring and trending capabilities as compared to the older systems.

A controls upgrade would enable automated equipment start and stop times, temperature setpoints, and lockouts and deadbands to be programmed remotely using a graphic interface. Controls can be configured to optimize ventilation and outside air intake by adjusting economizer position, damper function, and fan speed. Existing chilled and hot water distribution system controls are typically tied in, including associated pumps and valves. Coordinated control of HVAC systems is dependent on a network of sensors and status points. A comprehensive building control system provides monitoring and control for all HVAC systems, so operators can adjust system programming for optimal comfort and energy savings.

It is recommended that an HVAC engineer or contractor who specializes in EMS be contacted for a detailed evaluation and implementation costs. A controls expert will be able to tell you to what extent an existing system can be refurbished or expanded, what sensors should be replaced, what additional HVAC systems could be controlled, and what monitoring and graphic capabilities can be added. For the purposes of this report, the potential energy savings and measure costs were estimated based on industry standards and previous project experience. Further analysis should be conducted for the feasibility of this measure. This is not an investment grade analysis, nor should be used as a basis for design and construction.

## **Install High Efficiency Energy Recovery Units (ERUs)**

HVAC energy consumption in typical commercial buildings may account for 40% – 60% of the facility's energy use. Areas with high outdoor air requirements are even more energy intensive. Some of the facility types that require a higher amount of outdoor air for ventilation, which then needs to be conditioned, include swimming pools, laboratories, commercial kitchens, hospitals, and wood/metal shops. These facilities have the potential for significant energy savings by installing energy recovery units (ERU). Other applications that may have significant potential include theaters, fitness centers, and gymnasiums.

An ERU is a type of air-to-air heat exchanger that recovers energy from the exhaust air. An ERU heat exchanger transfers both sensible and latent heat<sup>4</sup>. One common type is a rotary enthalpy wheel. An enthalpy wheel improves the heating and cooling efficiency of an air handler or package unit by transferring energy from the exhaust air to the incoming outside air to precondition the outdoor air before it reaches the heating/cooling coil. Additional benefits for installing ERUs include reduced summer peak electrical demand, enhanced humidity control, continued operating savings, and the potential to downsize the heating and cooling capacity in comparison to traditional HVAC units. ERUs are the most cost effective on systems that use 100% outside air.

---

<sup>4</sup> Sensible heat refers to the amount of energy needed to increase or decrease the temperature of a substance. Like air, independent of phase changes, Latent heat is the heat that results from an increase or decrease in the amount of moisture held by the air. Specifically, it's the amount of energy needed to cause a phase change.

## 5 ENERGY EFFICIENT BEST PRACTICES

---

A whole building maintenance plan will extend equipment life; improve occupant comfort, health, and safety; and reduce energy and maintenance costs.

Operation and maintenance (O&M) plans enhance the operational efficiency of HVAC and other energy intensive systems and could save 5%–20% of the energy usage in your building without substantial capital investment. A successful plan includes your records of energy usage trends and costs, building equipment lists, current maintenance practices, and planned capital upgrades, and it incorporates your ideas for improved building operation. Your plan will address goals for energy-efficient operation, provide detail on how to reach the goals, and outline procedures for measuring and reporting whether goals have been achieved.

You may already be doing some of these things—see our list below for potential additions to your maintenance plan. Be sure to consult with qualified equipment specialists for details on proper maintenance and system operation.

### **Energy Tracking with ENERGY STAR® Portfolio Manager®**



You've heard it before—you cannot manage what you do not measure. ENERGY STAR® Portfolio Manager® is an online tool that you can use to measure and track energy and water consumption, as well as greenhouse gas emissions<sup>5</sup>. Your account has already been established. Now you can continue to keep tabs on your energy performance every month.

### **Lighting Maintenance**



- Clean lamps, reflectors and lenses of dirt, dust, oil, and smoke buildup every six to twelve months. Light levels decrease over time due to lamp aging, lamp and ballast failure, and buildup of dirt and dust. Together, this can reduce total light output by up to 60% while still drawing full power.
- In addition to routine cleaning, developing a maintenance schedule can ensure that maintenance is performed regularly, and it can reduce the overall cost of fixture re-lamping and re-ballasting. Group re-lamping and re-ballasting maintains lighting levels and minimizes the number of site visits by a lighting technician or contractor, decreasing the overall cost of maintenance.

### **Motor Short Cycling Reduction**

Frequent stopping and starting of motors places substantial stress on rotors and other parts. This leads to wear and tear, lower efficiency, and higher maintenance costs. Adjust the load on the motor to limit the amount of unnecessary stopping and starting to improve motor performance.

---


<sup>5</sup> <https://www.energystar.gov/buildings/facility-owners-and-managers/existing-buildings/use-portfolio-manager>.



## **Motor Maintenance**

Motors have many moving parts. As these parts degrade over time, the efficiency of the motor is reduced. Routine maintenance prevents damage to motor components. Routine maintenance should include cleaning surfaces and ventilation openings on motors to prevent overheating, lubricating moving parts to reduce friction, inspecting belts and pulleys for wear and to ensure they are at proper alignment and tension, and cleaning and lubricating bearings. Consult a licensed technician to assess these and other motor maintenance strategies.

## **Thermostat Schedules and Temperature Resets**



Use thermostat setback temperatures and schedules to reduce heating and cooling energy use during periods of low or no occupancy. Thermostats should be programmed for a setback of 5°F-10°F during low occupancy hours (reduce heating setpoints and increase cooling setpoints). Cooling load can be reduced by increasing the facility's occupied setpoint temperature. In general, during the cooling season, thermostats should be set as high as possible without sacrificing occupant comfort.

## **Economizer Maintenance**

Economizers can significantly reduce cooling system load. A malfunctioning economizer can increase the amount of heating and mechanical cooling required by introducing excess amounts of cold or hot outside air. Common economizer malfunctions include broken outdoor thermostat or enthalpy control or dampers that are stuck or improperly adjusted.

Periodic inspection and maintenance will keep economizers working in sync with the heating and cooling system. This maintenance should be part of annual system maintenance, and it should include proper setting of the outdoor thermostat/enthalpy control, inspection of control and damper operation, lubrication of damper connections, and adjustment of minimum damper position.

## **Chiller Maintenance**

Service chillers regularly to keep them operating properly. Chillers are responsible for a substantial portion of a commercial building's overall energy usage, and when they do not work well, there is usually a noticeable increase in energy bills and increased occupant complaints. Regular diagnostics and service can save 5% to 10% of the cost of operating your chiller. If you already have a maintenance contract in place, your existing service company should be able to provide these services.

## **AC System Evaporator/Condenser Coil Cleaning**

Dirty evaporator and condenser coils restrict air flow and restrict heat transfer. This increases the loads on the evaporator and condenser fan and decreases overall cooling system performance. Keeping the coils clean allows the fans and cooling system to operate more efficiently.

## **HVAC Filter Cleaning and Replacement**

Air filters should be checked regularly (often monthly) and cleaned or replaced when appropriate. Air filters reduce indoor air pollution, increase occupant comfort, and help keep equipment operating efficiently. If the building has a building management system, consider installing a differential pressure switch across filters to send an alarm about premature fouling or overdue filter replacement. Over time, filters become less and less effective as particulate buildup increases. Dirty filters also restrict air flow through the air conditioning or heat pump system, which increases the load on the distribution fans.

## **Ductwork Maintenance**

Duct maintenance has two primary goals: keep the ducts clean to avoid air quality problems and seal leaks to save energy. Check for cleanliness, obstructions that block airflow, water damage, and leaks. Ducts should be inspected at least every two years.

The biggest symptoms of clogged air ducts are differing temperatures throughout the building and areas with limited airflow from supply registers. If a particular air duct is clogged, then air flow will only be cut off to some rooms in the building—not all of them. The reduced airflow will make it more difficult for those areas to reach the temperature setpoint, which will cause the HVAC system to run longer to cool or heat that area properly. If you suspect clogged air ducts, ensure that all areas in front of supply registers are clear of items that may block or restrict air flow, and you should check for fire dampers or balancing dampers that have failed closed.

Duct leakage in commercial buildings can account for 5%–25% of the supply airflow. In the case of rooftop air handlers, duct leakage can occur to the outside of the building wasting conditioned air. Check ductwork for leakage. Eliminating duct leaks can improve ventilation system performance and reduce heating and cooling system operation.

Distribution system losses are dependent on-air system temperature, the size of the distribution system, and the level of insulation of the ductwork. Significant energy savings can be achieved when insulation has not been well maintained. When the insulation is missing or worn, the system efficiency can be significantly reduced. This measure saves energy by reducing heat transfer in the distribution system.

## **Boiler Maintenance**

Many boiler problems develop slowly over time, so regular inspection and maintenance is essential to keeping the heating system running efficiently and preventing expensive repairs. Annual tune-ups should include a combustion analysis to analyze the exhaust from the boilers and to ensure the boiler is operating safely and efficiently. Boilers should be cleaned according to the manufacturer's instructions to remove soot and scale from the boiler tubes to improve heat transfer.

## **Label HVAC Equipment**

For improved coordination in maintenance practices, we recommend labeling or re-labeling the site HVAC equipment. Maintain continuity in labeling by following labeling conventions as indicated in the facility drawings or EMS building equipment list. Use weatherproof or heatproof labeling or stickers for permanence, but do not cover over original equipment nameplates, which should be kept clean and readable whenever possible. Besides equipment, label piping for service and direction of flow when possible. Ideally, maintain a log of HVAC equipment, including nameplate information, asset tag designation, areas served, installation year, service dates, and other pertinent information.

This investment in your equipment will enhance collaboration and communication between your staff and your contracted service providers and may help you with regulatory compliance.

## **Optimize HVAC Equipment Schedules**

Energy management systems (EMS) typically provide advanced controls for building HVAC systems, including chillers, boilers, air handling units, rooftop units and exhaust fans. The EMS monitors and reports operational status, schedules equipment start and stop times, locks out equipment operation based on outside air or space temperature, and often optimizes damper and valve operation based on complex algorithms. These EMS features, when in proper adjustment, can improve comfort for building occupants and save substantial energy.

Know your EMS scheduling capabilities. Regularly monitor HVAC equipment operating schedules and match them to building operating hours in order to eliminate unnecessary equipment operation and save energy. Monitoring should be performed often at sites with frequently changing usage patterns – daily in some cases. We recommend using the *optimal start* feature of the EMS (if available) to optimize the building warmup sequence. Most EMS scheduling programs provide for holiday schedules, which can be used during reduced use or shutdown periods. Finally, many systems are equipped with a one-time override function, which can be used to provide additional space conditioning due to a one-time, special event. When available this override feature should be used rather than changing the base operating schedule.


### **Water Heater Maintenance**

The lower the supply water temperature that is used for hand washing sinks, the less energy is needed to heat the water. Reducing the temperature results in energy savings and the change is often unnoticeable to users. Be sure to review the domestic water temperature requirements for sterilizers and dishwashers as you investigate reducing the supply water temperature.

Also, preventative maintenance can extend the life of the system, maintain energy efficiency, and ensure safe operation. At least once a year, follow manufacturer instructions to drain a few gallons out of the water heater using the drain valve. If there is a lot of sediment or debris, then a full flush is recommended. Turn the temperature down and then completely drain the tank. Annual checks should include checks for:

- Leaks or heavy corrosion on the pipes and valves.
- Corrosion or wear on the gas line and on the piping. If you noticed any black residue, soot, or charred metal, this is a sign you may be having combustion issues and you should have the unit serviced by a professional.
- For electric water heaters, look for signs of leaking such as rust streaks or residue around the upper and lower panels covering the electrical components on the tank.
- For water heaters more than three years old, have a technician inspect the sacrificial anode annually.

### **Plug Load Controls**



Reducing plug loads is a common way to decrease your electrical use. Limiting the energy use of plug loads can include increasing occupant awareness, removing under-used equipment, installing hardware controls, and using software controls. Consider enabling the most aggressive power settings on existing devices or install load sensing or occupancy sensing (advanced) power strips<sup>6</sup>. Your local utility may offer incentives or rebates for this equipment.

---

<sup>6</sup> For additional information refer to “Assessing and Reducing Plug and Process Loads in Office Buildings” <http://www.nrel.gov/docs/fy13osti/54175.pdf>, or “Plug Load Best Practices Guide” <http://www.advancedbuildings.net/plug-load-best-practices-guide-offices>.

## **Water Conservation**



Installing dual flush or low-flow toilets and low-flow/waterless urinals are ways to reduce water use. The EPA WaterSense™ ratings for urinals is 0.5 gallons per flush (gpf) and for flush valve toilets is 1.28 gpf (this is lower than the current 1.6 gpf federal standard).

For more information regarding water conservation go to the EPA's WaterSense™ website<sup>7</sup> or download a copy of EPA's "WaterSense™ at Work: Best Management Practices for Commercial and Institutional Facilities"<sup>8</sup> to get ideas for creating a water management plan and best practices for a wide range of water using systems.

Water conservation devices that do not reduce hot water consumption will not provide energy savings at the site level, but they may significantly affect your water and sewer usage costs. Any reduction in water use does however ultimately reduce grid-level electricity use since a significant amount of electricity is used to deliver water from reservoirs to end users.

If the facility has detached buildings with a master water meter for the entire campus, check for unnatural wet areas in the lawn or water seeping in the foundation at water pipe penetrations through the foundation. Periodically check overnight meter readings when the facility is unoccupied, and there is no other scheduled water usage.

Manage irrigation systems to use water more effectively outside the building. Adjust spray patterns so that water lands on intended lawns and plantings and not on pavement and walls. Consider installing an evapotranspiration irrigation controller that will prevent over-watering.

## **Procurement Strategies**

Purchasing efficient products reduces energy costs without compromising quality. Consider modifying your procurement policies and language to require ENERGY STAR® or WaterSense™ products where available.

---

<sup>7</sup> <https://www.epa.gov/watersense>.

<sup>8</sup> <https://www.epa.gov/watersense/watersense-work-0>.

## 6 ON-SITE GENERATION

---

You don't have to look far in New Jersey to see one of the thousands of solar electric systems providing clean power to homes, businesses, schools, and government buildings. On-site generation includes both renewable (e.g., solar, wind) and non-renewable (e.g., fuel cells) technologies that generate power to meet all or a portion of the facility's electric energy needs. Also referred to as distributed generation, these systems contribute to greenhouse gas (GHG) emission reductions, demand reductions, and reduced customer electricity purchases, which results in improved electric grid reliability through better use of transmission and distribution systems.

Preliminary screenings were performed to determine if an on-site generation measure could be a cost-effective solution for your facility. Before deciding to install an on-site generation system, we recommend conducting a feasibility study to analyze existing energy profiles, siting, interconnection, and the costs associated with the generation project including interconnection costs, departing load charges, and any additional special facilities charges.

## 6.1 Solar Photovoltaic

Photovoltaic (PV) panels convert sunlight into electricity. Individual panels are combined into an array that produces direct current (DC) electricity. The DC current is converted to alternating current (AC) through an inverter. The inverter is then connected to the building's electrical distribution system.

A preliminary screening based on the facility's electric demand, size and location of free area, and shading elements shows that the facility has low potential for installing additional PV arrays.

This facility does not appear to meet the minimum criteria for a cost-effective solar PV installation. To be cost-effective, a solar PV array needs certain minimum criteria, such as sufficient and sustained electric demand and sufficient flat or south-facing rooftop or other unshaded space on which to place the PV panels.

The graphic below displays the results of the PV potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

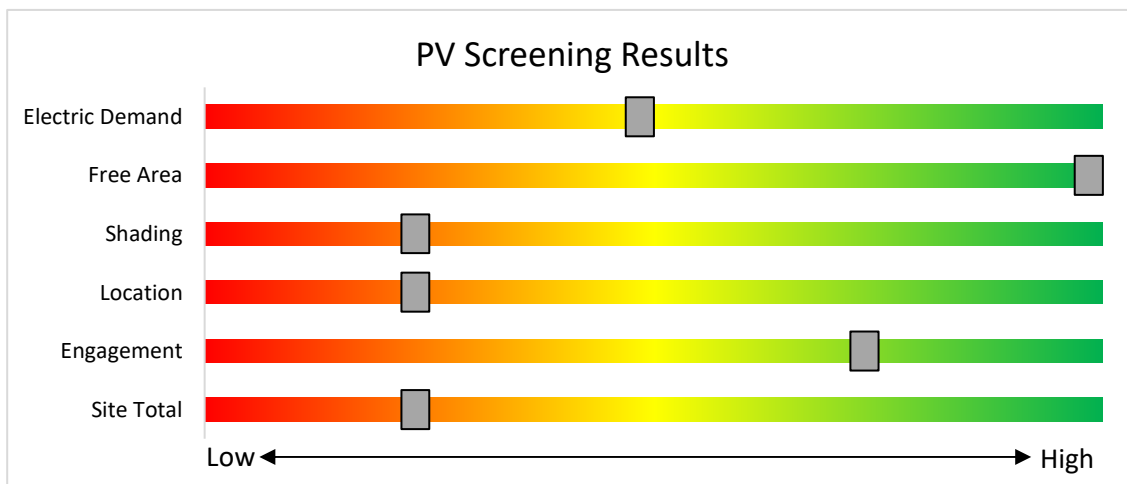


Figure 8 - Photovoltaic Screening

### **Successor Solar Incentive Program (SuSI)**

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The SuSI program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects. Solar projects may qualify to earn SREC- IIs (Solar Renewable Energy Certificates-II), however, the project owners *must* register their solar projects prior to the start of construction to establish the project's eligibility.

Get more information about solar power in New Jersey or find a qualified solar installer who can help you decide if solar is right for your building:

**Successor Solar Incentive Program (SuSI):** <https://www.njcleanenergy.com/renewable-energy/programs/susi-program>

- **Basic Info on Solar PV in NJ:** [www.njcleanenergy.com/whysolar](http://www.njcleanenergy.com/whysolar)
- **NJ Solar Market FAQs:** [www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs](http://www.njcleanenergy.com/renewable-energy/program-updates-and-background-information/solar-transition/solar-market-faqs).
- **Approved Solar Installers in the NJ Market:** [www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/?id=60&start=1](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/?id=60&start=1)

## 6.2 Combined Heat and Power

Combined heat and power (CHP) generates electricity at the facility and puts waste heat energy to good use. Common types of CHP systems are reciprocating engines, microturbines, fuel cells, backpressure steam turbines, and (at large facilities) gas turbines.

CHP systems typically produce a portion of the electric power used on-site, with the balance of electric power needs supplied by the local utility company. The heat is used to supplement (or replace) existing boilers and provide space heating and/or domestic hot water heating. Waste heat can also be routed through absorption chillers for space cooling.

The key criteria used for screening is the amount of time that the CHP system would operate at full load and the facility's ability to use the recovered heat. Facilities with a continuous need for large quantities of waste heat are the best candidates for CHP.

A preliminary screening based on heating and electrical demand, siting, and interconnection shows that the facility has no potential for installing a cost-effective CHP system.

Based on a preliminary analysis, the facility does not appear to meet the minimum requirements for a cost-effective CHP installation. The lack of gas service, low or infrequent thermal load, and lack of space for siting the equipment are the most significant factors contributing to the lack of CHP potential.

The graphic below displays the results of the CHP potential screening conducted as a part of this audit. The position of each slider indicates the potential (potential increases to the right) that each factor contributes to the overall site potential.

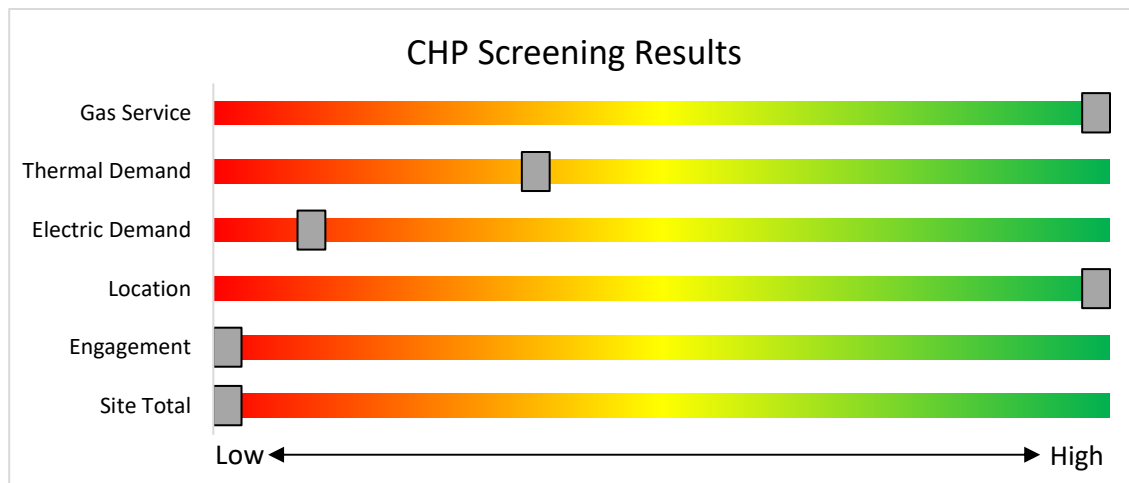


Figure 9 - Combined Heat and Power Screening

Find a qualified firm that specializes in commercial CHP cost assessment and installation: [http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved\\_vendorsearch/](http://www.njcleanenergy.com/commercial-industrial/programs/nj-smartstart-buildings/tools-and-resources/tradeally/approved_vendorsearch/).



## 7 PROJECT FUNDING AND INCENTIVES

Ready to improve your building’s performance? Your utility provider may be able to help.

### 7.1 Utility Energy Efficiency Programs

The Clean Energy Act, signed into law by Governor Murphy in 2018, requires New Jersey’s investor-owned gas and electric utilities to reduce their customers’ use by set percentages over time. To help reach these targets the New Jersey Board of Public Utilities approved a comprehensive suite of energy efficiency programs to be run by the utility companies.

The infographic features logos for Atlantic City Electric, Jersey Central Power & Light, PSEG, Rockland Electric Company, Elizabethtown Gas, South Jersey Gas, and New Jersey Natural Gas. Below the logos, the text reads: "Program areas to be served by the Utilities:" followed by a list of existing buildings and efficient products. A separate box lists proposed new programs and features.

**Program areas to be served by the Utilities:**

- Existing Buildings (residential, commercial, industrial, government)
- Efficient Products
  - HVAC
  - Appliance Rebates
  - Appliance Recycling

**Proposed New Programs & Features:**

- Dedicated multi-family program
- More financing options
- Quick home energy check-ups

These new utility programs are rolling out in the spring and summer of 2021. Keep up to date with developments by visiting:

<https://www.njcleanenergy.com/transition>

## 8 NEW JERSEY'S CLEAN ENERGY PROGRAMS

New Jersey's Clean Energy Program will continue to offer some energy efficiency programs.



### 8.1 Large Energy Users

The Large Energy Users Program (LEUP) is designed to foster self-directed investment in energy projects. This program is offered to New Jersey's largest energy customers that annually contribute at least \$200,000 to the NJCEP aggregate of all buildings/sites. This equates to roughly \$5 million in energy costs in the prior fiscal year.

#### Incentives

Incentives are based on the specifications below. The maximum incentive per entity is the lesser of:

- \$4 million
- 75% of the total project(s) cost
- 90% of total NJCEP fund contribution in previous year
- \$0.33 per projected kWh saved; \$3.75 per projected Therm saved annually

#### How to Participate

To participate in LEUP, you will first need submit an enrollment application. This program requires all qualified and approved applicants to submit an energy plan that outlines the proposed energy efficiency work for review and approval. Applicants may submit a Draft Energy Efficiency Plan (DEEP), or a Final Energy Efficiency Plan (FEEP). Once the FEEP is approved, the proposed work can begin.

Detailed program descriptions, instructions for applying, and applications can be found at [www.njcleanenergy.com/LEUP](http://www.njcleanenergy.com/LEUP).

## 8.2 Combined Heat and Power

The Combined Heat & Power (CHP) program provides incentives for eligible CHP or waste heat to power (WHP) projects. Eligible CHP or WHP projects must achieve an annual system efficiency of at least 65% (lower heating value, or LHV), based on total energy input and total utilized energy output. Mechanical energy may be included in the efficiency evaluation.

### Incentives

Eligible Technologies	Size (Installed Rated Capacity) <sup>1</sup>	Incentive (\$/kW)	% of Total Cost Cap per Project <sup>3</sup>	\$ Cap per Project <sup>3</sup>	
Powered by non-renewable or renewable fuel source <sup>4</sup>	≤500 kW	\$2,000	30-40% <sup>2</sup>	\$2 million	
	Gas Internal Combustion Engine	>500 kW - 1 MW			\$1,000
	Gas Combustion Turbine	> 1 MW - 3 MW	\$550	30%	\$3 million
	Microturbine Fuel Cells with Heat Recovery	>3 MW	\$350		
Waste Heat to Power*	<1 MW	\$1,000	30%	\$2 million	
	> 1MW	\$500		\$3 million	

\*Waste Heat to Power: Powered by non-renewable fuel source, heat recovery or other mechanical recovery from existing equipment utilizing new electric generation equipment (e.g. steam turbine).

Check the NJCEP website for details on program availability, current incentive levels, and requirements.

### How to Participate

You will work with a qualified developer or consulting firm to complete the CHP application. Once the application is approved the project can be installed. Information about the CHP program can be found at [www.njcleanenergy.com/CHP](http://www.njcleanenergy.com/CHP).

### 8.3 Successor Solar Incentive Program (SuSI)

The SuSI program replaces the SREC Registration Program (SRP) and the Transition Incentive (TI) program. The program is used to register and certify solar projects in New Jersey. Rebates are not available for solar projects, but owners of solar projects *must* register their projects prior to the start of construction to establish the project’s eligibility to earn SREC-IIs (Solar Renewable Energy Certificates-II). SuSI consists of two sub-programs. The Administratively Determined Incentive (ADI) Program and the Competitive Solar Incentive (CSI) Program.

#### Administratively Determined Incentive (ADI) Program

The ADI Program provides administratively set incentives for net metered residential projects, net metered non-residential projects 5 MW or less, and all community solar projects.

After the registration is accepted, construction is complete, and a complete final as-built packet has been submitted, the project is issued a New Jersey certification number, which enables it to generate New Jersey SREC- IIs.

Market Segments	Size MW dc	Incentive Value (\$/SREC II)	Public Entities Incentive Value - \$20 Adder (\$/SRECII)
Net Metered Residential	All types and sizes	\$90	N/A
Small Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects smaller than 1 MW	\$100	\$120
Large Net Metered Non-Residential located on Rooftop, Carport, Canopy and Floating Solar	Projects 1 MW to 5 MW	\$90	\$110
Small Net Metered Non-Residential Ground Mount	Projects smaller than 1 MW	\$85	\$105
Large Net Metered Non-Residential Ground Mount	Projects 1 MW to 5 MW	\$80	\$100
LMI Community Solar	Up to 5 MW	\$90	N/A
Non-LMI Community Solar	Up to 5 MW	\$70	N/A
Interim Subsection (t)	All types and sizes	\$100	N/A

Eligible projects may generate SREC-IIs for 15 years following the commencement of commercial operations which is defined as permission to operate (PTO) from the Electric Distribution Company. After 15 years, projects may be eligible for a NJ Class I REC.

SREC-IIs will be purchased monthly by the SREC-II Program Administrator who will allocate the SREC-IIs to the Load Serving Entities (BGS Providers and Third-Party Suppliers) annually based on their market share of retail electricity sold during the relevant Energy Year.

The ADI Program online portal is now open to new registrations effective August 28, 2021.

#### Competitive Solar Incentive Program

The Competitive Solar Incentive (CSI) Program will provide competitively set incentives for grid supply projects and net metered non-residential projects greater than 5MW. The program is currently under development with the goal of holding the first solicitation by early-to-mid 2022. For updates, please continue to check the [Solar Proceedings](#) page on the New Jersey’s Clean Energy Program website.

Solar projects help the State of New Jersey reach renewable energy goals outlined in the state’s Energy Master Plan.

If you are considering installing solar photovoltaics on your building, visit the following link for more information: <https://nccleanenergy.com/renewable-energy/programs/susi-program>.

## 8.4 Energy Savings Improvement Program

The Energy Savings Improvement Program (ESIP) serves New Jersey's government agencies by financing energy projects. An ESIP is a type of performance contract, whereby school districts, counties, municipalities, housing authorities, and other public and state entities enter into contracts to help finance building energy upgrades. Annual payments are lower than the savings projected from the energy conservation measures (ECMs), ensuring that ESIP projects are cash flow positive for the life of the contract.

ESIP provides government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources. NJCEP incentive programs described above can also be used to help further reduce the total project cost of eligible measures.

### How to Participate

This LGEA report is the first step to participating in ESIP. Next, you will need to select an approach for implementing the desired ECMs:

- (1) Use an energy services company or "ESCO."
- (2) Use independent engineers and other specialists, or your own qualified staff, to provide and manage the requirements of the program through bonds or lease obligations.
- (3) Use a hybrid approach of the two options described above where the ESCO is used for some services and independent engineers, or other specialists or qualified staff, are used to deliver other requirements of the program.

After adopting a resolution with a chosen implementation approach, the development of the energy savings plan can begin. The ESP demonstrates that the total project costs of the ECMs are offset by the energy savings over the financing term, not to exceed 15 years. The verified savings will then be used to pay for the financing.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Carefully consider all alternatives to develop an approach that best meets your needs. A detailed program descriptions and application can be found at [www.njcleanenergy.com/ESIP](http://www.njcleanenergy.com/ESIP).

*ESIP is a program delivered directly by the NJBPU and is not an NJCEP incentive program. As mentioned above, you can use NJCEP incentive programs to help further reduce costs when developing the energy savings plan. Refer to the ESIP guidelines at the link above for further information and guidance on next steps.*

## 9 PROJECT DEVELOPMENT

Energy conservation measures (ECMs) have been identified for your site, and their energy and economic analyses are provided within this LGEA report. Note that some of the identified projects may be mutually exclusive, such as replacing equipment versus upgrading motors or controls. The next steps with project development are to set goals and create a comprehensive project plan. The graphic below provides an overview of the process flow for a typical energy efficiency or renewable energy project. We recommend implementing as many ECMs as possible prior to undertaking a feasibility study for a renewable project. The cyclical nature of this process flow demonstrates the ongoing work required to continually improve building energy efficiency over time. If your building(s) scope of work is relatively simple to implement or small in scope, the measurement and verification (M&V) step may not be required. It should be noted through a typical project cycle, there will be changes in costs based on specific scopes of work, contractor selections, design considerations, construction, etc. The estimated costs provided throughout this LGEA report demonstrate the unburdened turn-key material and labor cost only. There will be contingencies and additional costs at the time of implementation. We recommend comprehensive project planning that includes the review of multiple bids for project work, incorporates potential operations and maintenance (O&M) cost savings, and maximizes your incentive potential.

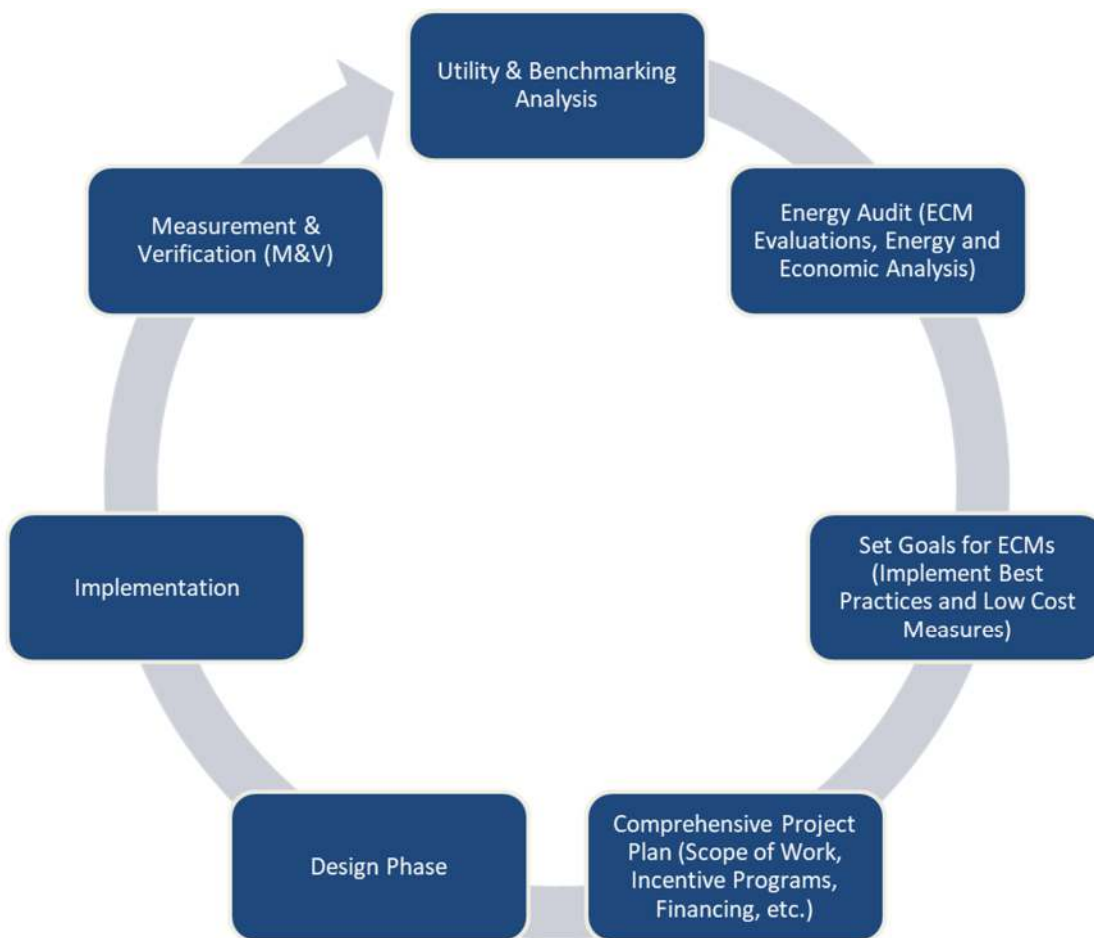


Figure 10 – Project Development Cycle

## 10 ENERGY PURCHASING AND PROCUREMENT STRATEGIES

---

### 10.1 Retail Electric Supply Options

Energy deregulation in New Jersey has increased energy buyers' options by separating the function of electricity distribution from that of electricity supply. Though you may choose a different company from which to buy your electric power, responsibility for your facility's interconnection to the grid and repair to local power distribution will still reside with the traditional utility company serving your region.

If your facility is not purchasing electricity from a third-party supplier, consider shopping for a reduced rate from third-party electric suppliers. If your facility already buys electricity from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party electric suppliers is available at the NJBPU website<sup>9</sup>.

### 10.2 Retail Natural Gas Supply Options

The natural gas market in New Jersey is also deregulated. Most customers that remain with the utility for natural gas service pay rates that are market based and fluctuate monthly. The utility provides basic gas supply service to customers who choose not to buy from a third-party supplier for natural gas commodity.

A customer's decision about whether to buy natural gas from a retail supplier typically depends on whether a customer prefers budget certainty and/or longer-term rate stability. Customers can secure longer-term fixed prices by signing up for service through a third-party retail natural gas supplier. Many larger natural gas customers may seek the assistance of a professional consultant to assist in their procurement process.

If your facility does not already purchase natural gas from a third-party supplier, consider shopping for a reduced rate from third-party natural gas suppliers. If your facility already purchases natural gas from a third-party supplier, review and compare prices at the end of each contract year.

A list of licensed third-party natural gas suppliers is available at the NJBPU website<sup>10</sup>.

---

<sup>9</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

<sup>10</sup> [www.state.nj.us/bpu/commercial/shopping.html](http://www.state.nj.us/bpu/commercial/shopping.html).

# APPENDIX A: EQUIPMENT INVENTORY & RECOMMENDATIONS

## Lighting Inventory & Recommendations

Location	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis							
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 102	18	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	18	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.6	2,303	0	\$195	\$986	\$270	3.7
Classroom 104	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 104	4	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	4	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	439	0	\$37	\$435	\$60	10.1
Classroom 106	15	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	15	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.5	1,919	0	\$163	\$822	\$225	3.7
Classroom 106	4	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	4	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	439	0	\$37	\$435	\$60	10.1
Classroom 108	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 108	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 110	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,535	0	\$130	\$657	\$180	3.7
Classroom 110	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 111	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.1	256	0	\$22	\$110	\$30	3.7
Classroom 112	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,535	0	\$130	\$657	\$180	3.7
Classroom 112	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 113	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.2	768	0	\$65	\$329	\$90	3.7
Classroom 114	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,535	0	\$130	\$657	\$180	3.7
Classroom 114	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 116	9	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	9	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.3	1,152	0	\$98	\$493	\$135	3.7
Classroom 116	2	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	2	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	220	0	\$19	\$217	\$30	10.1
Classroom 118	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 118	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 120	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 120	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 122	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,535	0	\$130	\$657	\$180	3.7
Classroom 122	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 124	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,535	0	\$130	\$657	\$180	3.7
Classroom 124	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1



Location	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 125 Teachers Lounge	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.2	768	0	\$65	\$329	\$90	3.7
Classroom 126	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,535	0	\$130	\$657	\$180	3.7
Classroom 126	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 130	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 130	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 131	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 131	2	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	2	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	220	0	\$19	\$217	\$30	10.1
Classroom 132	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 132	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 132	1	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.0	110	0	\$9	\$109	\$15	10.1
Classroom 133	14	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	14	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.5	1,791	0	\$152	\$767	\$210	3.7
Classroom 134	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 134	15	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	15	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.5	1,919	0	\$163	\$822	\$225	3.7
Classroom 135	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 135	1	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.0	110	0	\$9	\$109	\$15	10.1
Classroom 136	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.2	768	0	\$65	\$329	\$90	3.7
Classroom 137	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 143	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 143	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 144	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,535	0	\$130	\$657	\$180	3.7
Classroom 144	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 145	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,535	0	\$130	\$657	\$180	3.7
Classroom 145	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1
Classroom 146	12	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	12	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,535	0	\$130	\$657	\$180	3.7
Classroom 146	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.1	330	0	\$28	\$326	\$45	10.1

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Classroom 150	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 150	7	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	7	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.2	769	0	\$65	\$761	\$105	10.1
Classroom 152	10	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	10	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,280	0	\$108	\$548	\$150	3.7
Classroom 152	6	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,350	1	Relamp	No	6	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,350	0.2	659	0	\$56	\$652	\$90	10.1
Classroom 153	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.1	256	0	\$22	\$110	\$30	3.7
Classroom 156	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.2	640	0	\$54	\$274	\$75	3.7
Classroom 158	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 158	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 164	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.0	128	0	\$11	\$55	\$15	3.7
Classroom 166	11	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	11	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,408	0	\$119	\$602	\$165	3.7
Classroom 167	11	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	11	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.4	1,408	0	\$119	\$602	\$165	3.7
Classroom 168	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 168	16	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	16	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.6	2,047	0	\$173	\$876	\$240	3.7
Classroom 168	2	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	2	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Classroom 168	16	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,000	1, 2	Relamp	Yes	16	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,380	0.5	1,478	0	\$125	\$1,124	\$230	7.1
Conference 128E	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,350	1	Relamp	No	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,350	0.1	384	0	\$33	\$164	\$45	3.7
Corridor 1	2	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,588	1	Relamp	No	2	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,588	0.0	40	0	\$3	\$25	\$2	6.8
Corridor 1	6	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	6	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 1	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,588	1	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,588	0.1	282	0	\$24	\$110	\$30	3.3
Corridor 1	1	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,588	1	Relamp	No	1	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,588	0.0	121	0	\$10	\$109	\$15	9.1
Corridor 2	2	Compact Fluorescent: (1) 26W Biaxial Plug-In Lamp	Occupancy Sensor	S	26	2,588	1	Relamp	No	2	LED Lamps: GX23 (Plug-In) Lamps	Occupancy Sensor	19	2,588	0.0	40	0	\$3	\$25	\$2	6.8
Corridor 2	5	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	5	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Corridor 2	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,588	1	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,588	0.1	376	0	\$32	\$146	\$40	3.3
Corridor 2	8	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,588	1	Relamp	No	8	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,588	0.3	1,127	0	\$95	\$438	\$120	3.3
Dining Area 165	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0

Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis							
Location	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Dining Area 165	4	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	2,353	1	Relamp	No	4	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	2,353	0.1	440	0	\$37	\$435	\$60	10.1
Dining Area 2	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Dining Area 2	39	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,353	1	Relamp	No	39	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,353	1.4	4,997	-1	\$423	\$2,136	\$585	3.7
Electrical Room 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	350	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	350	0.0	25	0	\$2	\$73	\$20	24.6
Exterior 1	1	LED Lamps: (1) 75W Corn Bulb Screw-In Lamp	Photocell		75	4,380		None	No	1	LED Lamps: (1) 75W Corn Bulb Screw-In Lamp	Photocell	75	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Exterior 1	3	LED - Fixtures: Wall Pack	Photocell		40	4,380		None	No	3	LED - Fixtures: Wall Pack	Photocell	40	4,380	0.0	0	0	\$0	\$0	\$0	0.0
Gymnasium 148	3	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	3	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Gymnasium 148	30	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,353	1	Relamp	No	30	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,353	1.1	3,843	-1	\$325	\$1,643	\$450	3.7
Gymnasium Gym	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	2,353	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	2,353	0.1	256	0	\$22	\$110	\$30	3.7
Janitorial 1	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	350	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	350	0.0	13	0	\$1	\$37	\$10	24.6
Janitorial 142	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	18	0	\$2	\$37	\$10	17.3
Janitorial 151	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	350	1	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	350	0.1	51	0	\$4	\$146	\$40	24.6
Janitorial 163	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	500	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	500	0.0	18	0	\$2	\$37	\$10	17.3
Kitchen 1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	4	LED Lamps: (1) 10W A19 Screw-In Lamp	Wall Switch	S	10	1,000		None	No	4	LED Lamps: (1) 10W A19 Screw-In Lamp	Wall Switch	10	1,000	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,000	1, 2	Relamp	Yes	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,380	0.1	277	0	\$23	\$226	\$50	7.5
Lobby 1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Lobby 1	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	2,353	1	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	2,353	0.1	342	0	\$29	\$146	\$40	3.7
Mechanical 1	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	350	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	350	0.0	25	0	\$2	\$73	\$20	24.6
Office - Enclosed 103	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Office - Enclosed 103	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.2	381	0	\$32	\$274	\$75	6.2
Office - Enclosed 103	3	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	1,400	1	Relamp	No	3	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	1,400	0.1	196	0	\$17	\$326	\$45	16.9
Office - Enclosed 103A	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.1	152	0	\$13	\$110	\$30	6.2
Office - Enclosed 103B	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.1	152	0	\$13	\$110	\$30	6.2

Location	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Office - Enclosed 109	4	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	4	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.1	305	0	\$26	\$219	\$60	6.2
Office - Enclosed 127	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.1	152	0	\$13	\$110	\$30	6.2
Office - Enclosed 128A	6	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	6	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.2	457	0	\$39	\$329	\$90	6.2
Office - Enclosed 128A	5	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	5	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.2	381	0	\$32	\$274	\$75	6.2
Office - Enclosed 138	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.1	152	0	\$13	\$110	\$30	6.2
Office - Enclosed 139	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.1	152	0	\$13	\$110	\$30	6.2
Office - Enclosed 140	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.1	152	0	\$13	\$110	\$30	6.2
Office - Enclosed 141	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.1	152	0	\$13	\$110	\$30	6.2
Office - Enclosed 160	5	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	2,000	1, 2	Relamp	Yes	5	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,380	0.2	462	0	\$39	\$453	\$85	9.4
Office - Enclosed 166D	1	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	2,000	1	Relamp	No	1	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	2,000	0.0	109	0	\$9	\$55	\$15	4.3
Office - Open Plan 128	1	Exit Signs: LED - 2 W Lamp	None		6	8,760		None	No	1	Exit Signs: LED - 2 W Lamp	None	6	8,760	0.0	0	0	\$0	\$0	\$0	0.0
Office - Open Plan 128	1	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	S	30	1,400		None	No	1	LED - Fixtures: Ambient 2x2 Fixture	Occupancy Sensor	30	1,400	0.0	0	0	\$0	\$0	\$0	0.0
Office - Open Plan 128	14	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,400	1	Relamp	No	14	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,400	0.5	1,067	0	\$90	\$767	\$210	6.2
Restroom - Female 1	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,050	1	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,050	0.1	114	0	\$10	\$110	\$30	8.2
Restroom - Female 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,050	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,050	0.0	38	0	\$3	\$37	\$10	8.2
Restroom - Female 3	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,050	1	Relamp	No	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,050	0.1	172	0	\$15	\$164	\$45	8.2
Restroom - Female 3	1	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	1,050	1	Relamp	No	1	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	1,050	0.0	49	0	\$4	\$109	\$15	22.5
Restroom - Female 4	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,050	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,050	0.0	38	0	\$3	\$37	\$10	8.2
Restroom - Male 1	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,050	1	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,050	0.1	114	0	\$10	\$110	\$30	8.2
Restroom - Male 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,050	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,050	0.0	38	0	\$3	\$37	\$10	8.2
Restroom - Male 3	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Occupancy Sensor	S	93	1,050	1	Relamp	No	3	LED - Linear Tubes: (3) 4' Lamps	Occupancy Sensor	44	1,050	0.1	172	0	\$15	\$164	\$45	8.2
Restroom - Male 3	1	U-Bend Fluorescent - T8: U T8 (32W) - 3L	Occupancy Sensor	S	92	1,050	1	Relamp	No	1	LED - Linear Tubes: (3) U-Lamp	Occupancy Sensor	50	1,050	0.0	49	0	\$4	\$109	\$15	22.5
Restroom - Male 4	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,050	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,050	0.0	38	0	\$3	\$37	\$10	8.2
Restroom - Unisex 2	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,050	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,050	0.0	38	0	\$3	\$37	\$10	8.2
Restroom - Unisex 3	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,050	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,050	0.0	38	0	\$3	\$37	\$10	8.2

Location	Existing Conditions						Proposed Conditions								Energy Impact & Financial Analysis						
	Fixture Quantity	Fixture Description	Control System	Light Level	Watts per Fixture	Annual Operating Hours	ECM #	Fixture Recommendation	Add Controls?	Fixture Quantity	Fixture Description	Control System	Watts per Fixture	Annual Operating Hours	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Restroom - Unisex 4 Main Office	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,500	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,500	0.0	54	0	\$5	\$37	\$10	5.8
Restroom - Unisex 5 kitchen	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,500	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,500	0.0	54	0	\$5	\$37	\$10	5.8
Restroom - Unisex Nurse	1	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	1,050	1	Relamp	No	1	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	1,050	0.0	38	0	\$3	\$37	\$10	8.2
Server Room 105	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	750	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	750	0.0	54	0	\$5	\$73	\$20	11.5
Server Room 155	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,000	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,000	0.0	73	0	\$6	\$73	\$20	8.6
Storage 153A	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,000	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,000	0.0	73	0	\$6	\$73	\$20	8.6
Storage 153B	2	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,000	1	Relamp	No	2	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,000	0.0	73	0	\$6	\$73	\$20	8.6
Storage 158	4	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Occupancy Sensor	S	62	750	1	Relamp	No	4	LED - Linear Tubes: (2) 4' Lamps	Occupancy Sensor	29	750	0.1	109	0	\$9	\$146	\$40	11.5
Storage 164F	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	1,000	1	Relamp	No	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,000	0.1	163	0	\$14	\$164	\$45	8.6
Storage 164G	2	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	1,000	1	Relamp	No	2	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,000	0.1	109	0	\$9	\$110	\$30	8.6
Storage 166D	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	1,000	1	Relamp	No	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,000	0.1	163	0	\$14	\$164	\$45	8.6
Storage 8	3	Linear Fluorescent - T8: 4' T8 (32W) - 3L	Wall Switch	S	93	1,000	1	Relamp	No	3	LED - Linear Tubes: (3) 4' Lamps	Wall Switch	44	1,000	0.1	163	0	\$14	\$164	\$45	8.6
Storage Gym	3	Linear Fluorescent - T8: 4' T8 (32W) - 2L	Wall Switch	S	62	1,000	1	Relamp	No	3	LED - Linear Tubes: (2) 4' Lamps	Wall Switch	29	1,000	0.1	109	0	\$9	\$110	\$30	8.6

**Motor Inventory & Recommendations**

Location	Area(s)/System(s) Served	Existing Conditions									Proposed Conditions					Energy Impact & Financial Analysis						
		Motor Quantity	Motor Application	HP Per Motor	Full Load Efficiency	VFD Control?	Manufacturer	Model	Remaining Useful Life	Annual Operating Hours	ECM #	Install High Efficiency Motors?	Full Load Efficiency	Install VFDs?	Number of VFDs	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Mechanical 1	PAAAS High School	2	Chilled Water Pump	7.5	88.5%	No	US Motors	AD79	W	810		No	88.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	PAAAS High School	1	Chilled Water Pump	15.0	93.0%	Yes	Dayton	4GZC4A	W	810		No	93.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	PAAAS High School	1	Chilled Water Pump	15.0	91.0%	Yes	Westinghouse	ASGANE015-4-2/4	W	810		No	91.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior 2	PAAAS High School	1	Exhaust Fan	0.3	65.0%	No	Unknown	Unknown	W	2,500		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior 2	PAAAS High School	1	Exhaust Fan	0.3	65.0%	No	Unknown	Unknown	W	2,500		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior 2	PAAAS High School	1	Exhaust Fan	1.5	86.5%	No	Unknown	Unknown	W	2,500		No	86.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	PAAAS High School	2	Heating Hot Water Pump	10.0	89.5%	No	Armstrong	HB0104FKA	W	2,920		No	89.5%	No		0.0	0	0	\$0	\$0	\$0	0.0
Mechanical 1	PAAAS High School	2	DHW Circulation Pump	0.1	65.0%	No	Bell & Gossett	NBF-33	W	8,760		No	65.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
PAAAS High School	PAAAS High School	33	Supply Fan	0.5	70.0%	No	US Motors	K55HXENV-0115	W	3,200		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
Exterior 2	PAAAS High School	4	Supply Fan	7.5	91.0%	No	Unknown	Unknown	B	3,200		No	91.0%	No		0.0	0	0	\$0	\$0	\$0	0.0
PAAAS High School	PAAAS High School	2	Fan Coil Unit	0.5	70.0%	No	Unknown	Unknown	B	2,500		No	70.0%	No		0.0	0	0	\$0	\$0	\$0	0.0

**Packaged HVAC Inventory & Recommendations**

Location	Area(s)/System(s) Served	Existing Conditions									Proposed Conditions								Energy Impact & Financial Analysis						
		System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Cooling Capacity per Unit (Tons)	Heating Capacity per Unit (MBh)	Cooling Mode Efficiency (SEER/IEER/EER)	Heating Mode Efficiency	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Exterior 2	PAAAS High School	2	Ductless Mini-Split HP	1.50	22.00	13.30	3.5 COP	Fujitsu	AOU18RLXFZ	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Exterior 2	PAAAS High School	1	Ductless Mini-Split AC	1.50		11.70		Sanyo	CL1872	W		No							0.0	0	0	\$0	\$0	\$0	0.0
Exterior 2	PAAAS High School	1	Ductless Mini-Split AC	1.50		10.00		Mitsubishi	PUY-A18NHA3	W		No							0.0	0	0	\$0	\$0	\$0	0.0

**Electric Chiller Inventory & Recommendations**

Location	Area(s)/System(s) Served	Existing Conditions							Proposed Conditions							Energy Impact & Financial Analysis					
		Chiller Quantity	System Type	Cooling Capacity per Unit (Tons)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency Chillers?	Chiller Quantity	System Type	Constant/Variable Speed	Cooling Capacity (Tons)	Full Load Efficiency (kW/Ton)	IPLV Efficiency (kW/Ton)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives
Exterior 1	PAAAS High School	1	Air-Cooled Screw Chiller	200.00	Trane	RTAC 200A UJON UAFN N1WY 1DDL NNOE A11N NOEX N	W		No						0.0	0	0	\$0	\$0	\$0	0.0

**Space Heating Boiler Inventory & Recommendations**

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions							Energy Impact & Financial Analysis					
		System Quantity	System Type	Output Capacity per Unit (MBh)	Manufacturer	Model	Remaining Useful Life	ECM #	Install High Efficiency System?	System Quantity	System Type	Output Capacity per Unit (MBh)	Heating Efficiency	Heating Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives
Mechanical 1	PAAAS High School	3	Non-Condensing Hot Water Boiler	1,720	Aerco	201177	W		No					0.0	0	0	\$0	\$0	\$0	0.0

**DHW Inventory & Recommendations**

Location	Area(s)/System(s) Served	Existing Conditions						Proposed Conditions						Energy Impact & Financial Analysis					
		System Quantity	System Type	Manufacturer	Model	Remaining Useful Life	ECM #	Replace?	System Quantity	System Type	Fuel Type	System Efficiency	Efficiency Units	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives
Mechanical 1	PAAAS High School	1	Storage Tank Water Heater (> 50 Gal)	Bradford White	EF100T250E3N2	W		No					0.0	0	0	\$0	\$0	\$0	0.0

**Low-Flow Device Recommendations**

Location	Recommendation Inputs					Energy Impact & Financial Analysis						
	ECM #	Device Quantity	Device Type	Existing Flow Rate (gpm)	Proposed Flow Rate (gpm)	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
PAAAS High School	3	3	Faucet Aerator (Kitchen)	2.20	1.50	0.0	0	1	\$5	\$22	\$6	3.3
PAAAS High School	3	3	Faucet Aerator (Lavatory)	2.50	0.50	0.0	0	2	\$13	\$22	\$11	0.8

**Commercial Refrigerator/Freezer Inventory & Recommendations**

Location	Existing Conditions					Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Refrigerator/ Freezer Type	Manufacturer	Model	ENERGY STAR Qualified?	ECM #	Install ENERGY STAR Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Dining Area 2	1	Freezer Chest	Magic Chef	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Dining Area 2	1	Refrigerator Chest	Unknown	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	2	Freezer Chest	Unknown	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	3	Refrigerator Chest	Unknown	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	1	Stand-Up Freezer, Solid Door (16 - 30 cu. ft.)	Victory	Unknown	Yes		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	1	Stand-Up Refrigerator, Solid Door (≤15 cu. ft.)	Traulsen	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	1	Stand-Up Refrigerator, Solid Door (16 - 30 cu. ft.)	Adcraft	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	2	Stand-Up Refrigerator, Solid Door (16 - 30 cu. ft.)	Victory	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0

**Cooking Equipment Inventory & Recommendations**

Location	Existing Conditions					Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Equipment Type	Manufacturer	Model	High Efficiency Equipment?	ECM #	Install High Efficiency Equipment?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Kitchen 1	2	Gas Rack Oven (Double)	Garland	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0
Kitchen 1	1	Electric Steamer	Unknown	Unknown	No		No	0.0	0	0	\$0	\$0	\$0	0.0



**Plug Load Inventory**

Existing Conditions						
Location	Quantity	Equipment Description	Energy Rate (W)	ENERGY STAR Qualified ?	Manufacturer	Model
PAAAS High School	2	Coffee Machine	900	No	Unknown	Unknown
PAAAS High School	65	Desktop	270	No	Varied	Varied
Office - 109	1	Electric Space Heater	1,200	No	Vornado	Unknown
PAAAS High School	8	Fan	100	No	Varied	Varied
PAAAS High School	413	Laptop	75	No	Varied	Varied
PAAAS High School	6	Microwave	800	No	Varied	Varied
PAAAS High School	32	Apple TV	100	Yes	Apple	Unknown
PAAAS High School	9	Hand Dryer	1,000	No	Unknown	Unknown
PAAAS High School	2	Paper Shredder	100	No	Unknown	Unknown
PAAAS High School	57	Printer	100	No	Varied	Varied
PAAAS High School	3	Copier	1,500	No	Varied	Varied
PAAAS High School	3	Mini Refrigerator	126	No	Varied	Varied
PAAAS High School	2	Refrigerator	383	No	Unknown	Unknown
Classroom 102	1	Scanner	75	No	Unknown	Unknown
PAAAS High School	35	Smart Board	100	No	Varied	Varied
Corridor	1	Television	10	No	Unknown	Unknown
Teachers Lounge	1	Toaster	100	No	Unknown	Unknown
Conference 128E	1	Toaster Oven	1,500	No	Unknown	Unknown
Conference 128E	1	Water Cooler	600	No	Unknown	Unknown
PAAAS High School	10	Water Fountain	200	No	Elkay	Unknown

**Vending Machine Inventory & Recommendations**

Location	Existing Conditions		Proposed Conditions		Energy Impact & Financial Analysis						
	Quantity	Vending Machine Type	ECM #	Install Controls?	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Total Incentives	Simple Payback w/ Incentives in Years
Dining Area	1	Glass Fronted Refrigerated	4	Yes	0.1	1,209	0	\$104	\$230	\$50	1.7
Dining Area	1	Non-Refrigerated	4	Yes	0.0	343	0	\$30	\$230	\$0	7.8
Teachers Lounge	1	Refrigerated	4	Yes	0.2	1,612	0	\$139	\$230	\$50	1.3

**Custom (High Level) Measure Analysis**

Optimize HVAC Schedule

Building Square Footage: 59,585  
 Percent of Conditioned Area Impacted: 100%  
 Fuel Utility Rate: \$8.044 MMBtu  
 Blended Electric Utility Rate: \$0.086 kWh

Existing Conditions						Proposed Conditions					Energy Impact & Financial Analysis										
Description	Area(s)/System(s) Served	Remaining Useful Life	Total HVAC Motor Usage kWh	Total HVAC Electric Usage kWh	Total HVAC Fuel Usage MMBtu	Description	% Savings HVAC Motor Usage kWh	% Savings HVAC Electric Usage kWh	% Savings HVAC Fuel Usage MMBtu	Estimated Cost per Sqft	Total Peak kW Savings	Total Annual kWh Savings	Total Annual MMBtu Savings	Total Annual Energy Cost Savings	Estimated M&L Cost (\$)	Base Incentives	Enhanced Incentives	Total Incentives	Total Net Cost	Payback w/o Incentives in Years	Simple Payback w/ Incentives in Years
HVAC Schedule Longer than Occupancy	HVAC Equipment & Systems	2	163,917	225,302	2,640	Optimize HVAC Schedule	1%	1%	1%	\$0.02	0.00	3,892	26	\$548	\$1,200	\$0	\$0	\$0	\$1,200	2.19	2.19

# APPENDIX B: ENERGY STAR® STATEMENT OF ENERGY PERFORMANCE

Energy use intensity (EUI) is presented in terms of *site energy* and *source energy*. Site energy is the amount of fuel and electricity consumed by a building as reflected in utility bills. Source energy includes fuel consumed to generate electricity consumed at the site, factoring in electric production and distribution losses for the region.

## ENERGY STAR® Statement of Energy Performance

LEARN MORE AT [energystar.gov](http://energystar.gov)

# 64

**ENERGY STAR®  
Score<sup>1</sup>**

### Plainfield Academy For The Arts & Advanced Studies

**Primary Property Type:** K-12 School  
**Gross Floor Area (ft<sup>2</sup>):** 66,205  
**Built:** 2005

**For Year Ending:** June 30, 2021  
**Date Generated:** October 11, 2022

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

**Property & Contact Information**

<p><b>Property Address</b> Plainfield Academy For The Arts &amp; Advanced Studies 1700 W. Front Street Plainfield, New Jersey 07063</p>	<p><b>Property Owner</b> PlainfieldBOE 920 Park Avenue Plainfield, NJ 07060 (908) 731-4356</p>	<p><b>Primary Contact</b> Sean Sutton 920 Park Avenue Plainfield, NJ 07060 (908) 731-4356 <a href="mailto:ssutton@plainfield.k12.nj.us">ssutton@plainfield.k12.nj.us</a></p>
---	--	--

**Property ID:** 21326515

**Energy Consumption and Energy Use Intensity (EUI)**

<b>Site EUI</b>	<b>Annual Energy by Fuel</b>	<b>National Median Comparison</b>
73.5 kBtu/ft <sup>2</sup>	Natural Gas (kBtu) 2,740,840 (56%)	National Median Site EUI (kBtu/ft <sup>2</sup> ) 85.5
	Electric - Grid (kBtu) 1,225,138 (25%)	National Median Source EUI (kBtu/ft <sup>2</sup> ) 126.7
	Electric - Solar (kBtu) 897,624 (18%)	% Diff from National Median Source EUI -14%
<b>Source EUI</b>		<b>Annual Emissions</b>
108.8 kBtu/ft <sup>2</sup>		Greenhouse Gas Emissions (Metric Tons CO <sub>2</sub> e/year) 330

### Signature & Stamp of Verifying Professional

I \_\_\_\_\_ (Name) verify that the above information is true and correct to the best of my knowledge.

LP Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**Licensed Professional**

\_\_\_\_\_  
( ) \_\_\_\_\_  
\_\_\_\_\_



**Professional Engineer or Registered Architect Stamp (if applicable)**

## APPENDIX C: GLOSSARY

TERM	DEFINITION
<b>Blended Rate</b>	Used to calculate fiscal savings associated with measures. The blended rate is calculated by dividing the amount of your bill by the total energy use. For example, if your bill is \$22,217.22, and you used 266,400 kilowatt-hours, your blended rate is 8.3 cents per kilowatt-hour.
<b>Btu</b>	<i>British thermal unit</i> : a unit of energy equal to the amount of heat required to increase the temperature of one pound of water by one-degree Fahrenheit.
<b>CHP</b>	<i>Combined heat and power</i> . Also referred to as cogeneration.
<b>COP</b>	<i>Coefficient of performance</i> : a measure of efficiency in terms of useful energy delivered divided by total energy input.
<b>Demand Response</b>	Demand response reduces or shifts electricity usage at or among participating buildings/sites during peak energy use periods in response to time-based rates or other forms of financial incentives.
<b>DCV</b>	<i>Demand control ventilation</i> : a control strategy to limit the amount of outside air introduced to the conditioned space based on actual occupancy need.
<b>US DOE</b>	<i>United States Department of Energy</i>
<b>EC Motor</b>	<i>Electronically commutated motor</i>
<b>ECM</b>	<i>Energy conservation measure</i>
<b>EER</b>	<i>Energy efficiency ratio</i> : a measure of efficiency in terms of cooling energy provided divided by electric input.
<b>EUI</b>	<i>Energy Use Intensity</i> : measures energy consumption per square foot and is a standard metric for comparing buildings' energy performance.
<b>Energy Efficiency</b>	Reducing the amount of energy necessary to provide comfort and service to a building/area. Achieved through the installation of new equipment and/or optimizing the operation of energy use systems. Unlike conservation, which involves some reduction of service, energy efficiency provides energy reductions without sacrifice of service.
<b>ENERGY STAR®</b>	ENERGY STAR® is the government-backed symbol for energy efficiency. The ENERGY STAR® program is managed by the EPA.
<b>EPA</b>	<i>United States Environmental Protection Agency</i>
<b>Generation</b>	The process of generating electric power from sources of primary energy (e.g., natural gas, the sun, oil).
<b>GHG</b>	<i>Greenhouse gas</i> gases that are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus preventing long-wave radiant energy from leaving Earth's atmosphere. The net effect is a trapping of absorbed radiation and a tendency to warm the planet's surface.
<b>gpf</b>	<i>Gallons per flush</i>

<b>gpm</b>	<i>Gallon per minute</i>
<b>HID</b>	<i>High intensity discharge: high-output lighting lamps such as high-pressure sodium, metal halide, and mercury vapor.</i>
<b>hp</b>	<i>Horsepower</i>
<b>HPS</b>	<i>High-pressure sodium: a type of HID lamp.</i>
<b>HSPF</b>	<i>Heating seasonal performance factor: a measure of efficiency typically applied to heat pumps. Heating energy provided divided by seasonal energy input.</i>
<b>HVAC</b>	<i>Heating, ventilating, and air conditioning</i>
<b>IHP 2014</b>	<i>US DOE Integral Horsepower rule. The current ruling regarding required electric motor efficiency.</i>
<b>IPLV</b>	<i>Integrated part load value: a measure of the part load efficiency usually applied to chillers.</i>
<b>kBtu</b>	<i>One thousand British thermal units</i>
<b>kW</b>	<i>Kilowatt: equal to 1,000 Watts.</i>
<b>kWh</b>	<i>Kilowatt-hour: 1,000 Watts of power expended over one hour.</i>
<b>LED</b>	<i>Light emitting diode: a high-efficiency source of light with a long lamp life.</i>
<b>LGEA</b>	<i>Local Government Energy Audit</i>
<b>Load</b>	<i>The total power a building or system is using at any given time.</i>
<b>Measure</b>	<i>A single activity, or installation of a single type of equipment, that is implemented in a building system to reduce total energy consumption.</i>
<b>MH</b>	<i>Metal halide: a type of HID lamp.</i>
<b>MBh</b>	<i>Thousand Btu per hour</i>
<b>MBtu</b>	<i>One thousand British thermal units</i>
<b>MMBtu</b>	<i>One million British thermal units</i>
<b>MV</b>	<i>Mercury Vapor: a type of HID lamp.</i>
<b>NJBPU</b>	<i>New Jersey Board of Public Utilities</i>
<b>NJCEP</b>	<i>New Jersey's Clean Energy Program: NJCEP is a statewide program that offers financial incentives, programs and services for New Jersey residents, business owners and local governments to help them save energy, money, and the environment.</i>
<b>psig</b>	<i>Pounds per square inch gauge</i>
<b>Plug Load</b>	<i>Refers to the amount of power used in a space by products that are powered by means of an ordinary AC plug.</i>
<b>PV</b>	<i>Photovoltaic: refers to an electronic device capable of converting incident light directly into electricity (direct current).</i>

---

<b>SEER</b>	<i>Seasonal energy efficiency ratio</i> : a measure of efficiency in terms of annual cooling energy provided divided by total electric input.
-------------	---

---

<b>SEP</b>	<i>Statement of energy performance</i> : a summary document from the ENERGY STAR® Portfolio Manager®.
------------	---

---

<b>Simple Payback</b>	The amount of time needed to recoup the funds expended in an investment or to reach the break-even point between investment and savings.
-----------------------	--

---

<b>SREC</b>	<i>Solar renewable energy credit</i> : a credit you can earn from the state for energy produced from a photovoltaic array.
-------------	--

---

<b>TREC</b>	<i>Transition Incentive Renewable Energy Certificate</i> : a factorized renewable energy certificate you can earn from the state for energy produced from a photovoltaic array.
-------------	---

---

<b>T5, T8, T12</b>	A reference to a linear lamp diameter. The number represents increments of 1/8 <sup>th</sup> of an inch.
--------------------	--

---

<b>Temperature Setpoint</b>	The temperature at which a temperature regulating device (thermostat, for example) has been set.
-----------------------------	--

---

<b>therm</b>	100,000 Btu. Typically used as a measure of natural gas consumption.
--------------	--

---

<b>tons</b>	A unit of cooling capacity equal to 12,000 Btu/hr.
-------------	--

---

<b>Turnkey</b>	Provision of a complete product or service that is ready for immediate use.
----------------	---

---

<b>VAV</b>	<i>Variable air volume</i>
------------	----------------------------

---

<b>VFD</b>	<i>Variable frequency drive</i> : a controller used to vary the speed of an electric motor.
------------	---

---

<b>WaterSense™</b>	The symbol for water efficiency. The WaterSense™ program is managed by the EPA.
--------------------	---

---

<b>Watt (W)</b>	Unit of power commonly used to measure electricity use.
-----------------	---

---